


MODIFICATION TO SPECIAL USE PERMIT & SITE PLAN APPROVAL BAY POINTE CLUB MIXED USE DEVELOPMENT PHASE IV

n

WAREHAM, MASSACHUSETTS

OWNER / APPLICANT:

BAY POINTE CLUB, LLC
C/O STONESTREET, CORP.
501 WAMPANOAG TRAIL, SUITE 400
EAST PROVIDENCE, RHODE ISLAND 02915
401.433.6900

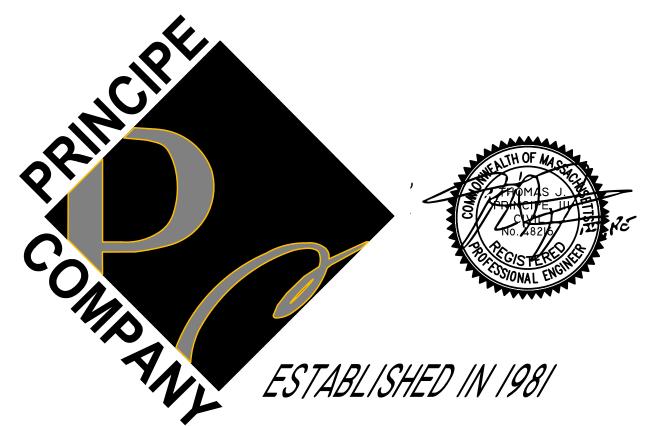

PREPARED BY:

PRINCIPE COMPANY, INC.

ENGINEERING DIVISION

PO BOX 298
TIVERTON, RHODE ISLAND 02878
401.816.5385
PRINCIPEENGINEERING@GMAIL.COM

DATE: NOVEMBER 4, 2021

REVISED: DECEMBER 8, 2021

REVISED: DECEMBER 29, 2021 REVISED: JANUARY 11, 2022

REVISED: JANUARY 11, 2022 REVISED: FEBRUARY 9, 2022

REVISED: MARCH 7, 2022

Vaterman ENGINEERING COMPANY Engineers & Surveyors - Est. 1894

FAX: 401.438.5773


46 Sutton Avenue East Providence, RI Phone: (401) - 438 - 5775 Fax: (401) - 438 - 5773 www.watermanengineering.net

EXISTING CONDITIONS AND PROPERTY LINE SURVEY BY:
RICHARD LIPSITZ, PLS
WATERMAN ENGINEERING COMPANY
46 SUTTON AVENUE
EAST PROVIDENCE, RHODE ISLAND 02914
PHONE: 401.438.5775

LIST OF DRAWINGS

- 1) TITLE SHEET
- 2) EXISTING CONDITIONS PLAN
- 3) SITE LAYOUT PLAN
- 4) GRADING & DRAINAGE PLAN
- 5) UTILITY PLAN
- 6-10) LANDSCAPE PLANS

11-18) CONSTRUCTION DETAIL SHEETS

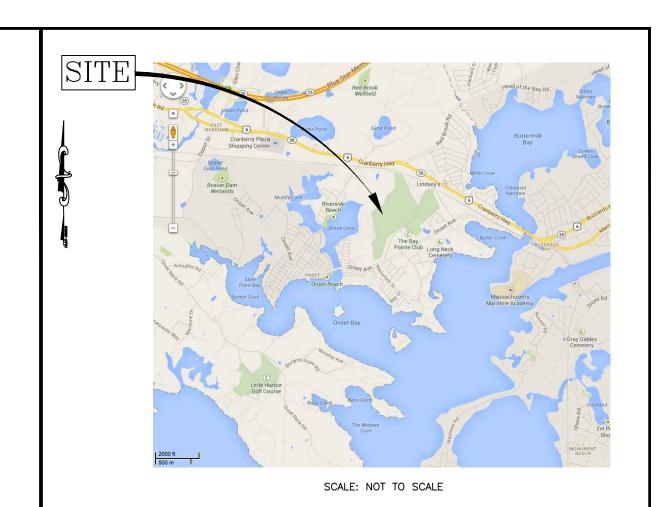

PROJECT DATA:

PLAT: 9	LOT: 1004.B
NUMBER OF CONDO BUILDINGS: BUILDING A: BUILDING B: BUILDING C: BUILDING D: BUILDING E BUILDING F: BUILDING G:	7 8 UNITS 6 UNITS 9 UNITS 7 UNITS 8 UNITS 8 UNITS 6 UNITS
NUMBER OF TOTAL DWELLING UN	NITS: 52

ZONING CLASSIFICATION:


"CR" CONFERENCE RECREATIONAL DISTRICT


REHAM PLANNING E PPROVED:	


I HEREBY CERTIFY THAT THERE HAS BEEN NO APPEAL TAKEN TO THIS PLANNING BOARD ACTION DURING THE 20-DAY STATUTORY APPEAL PERIOD


TOWN CLERK - WAREHAM MASSACHUSETTS




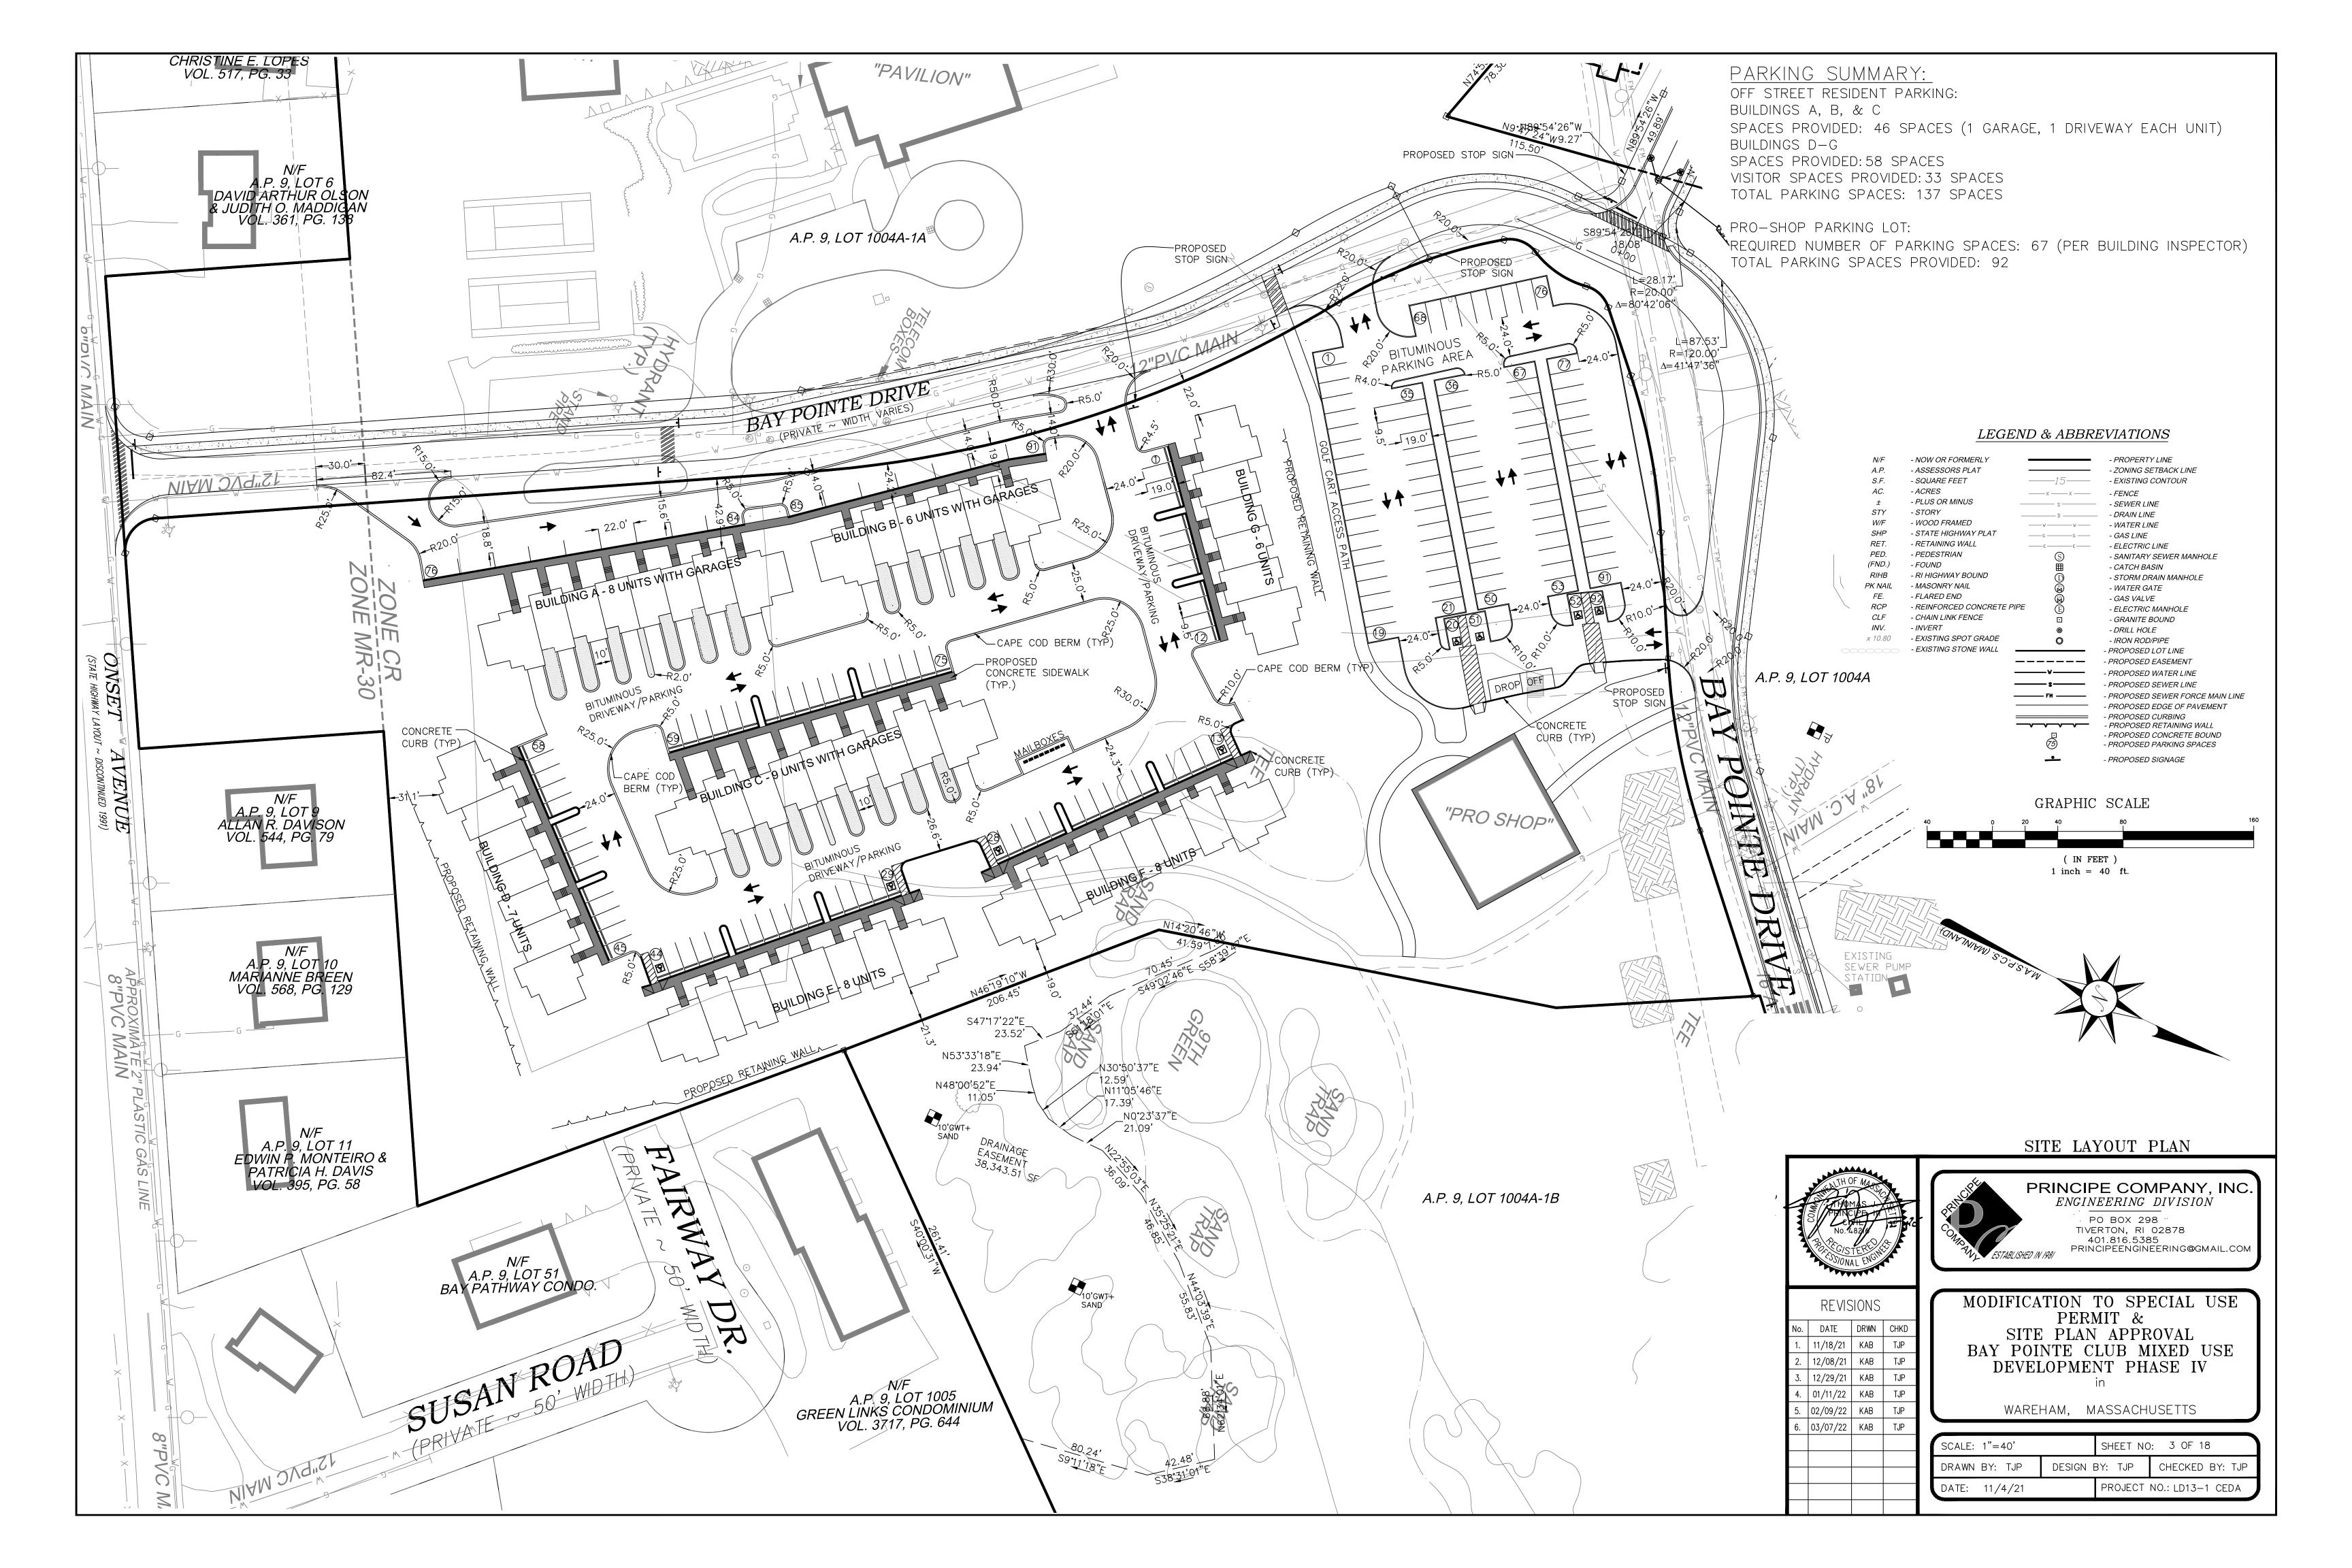


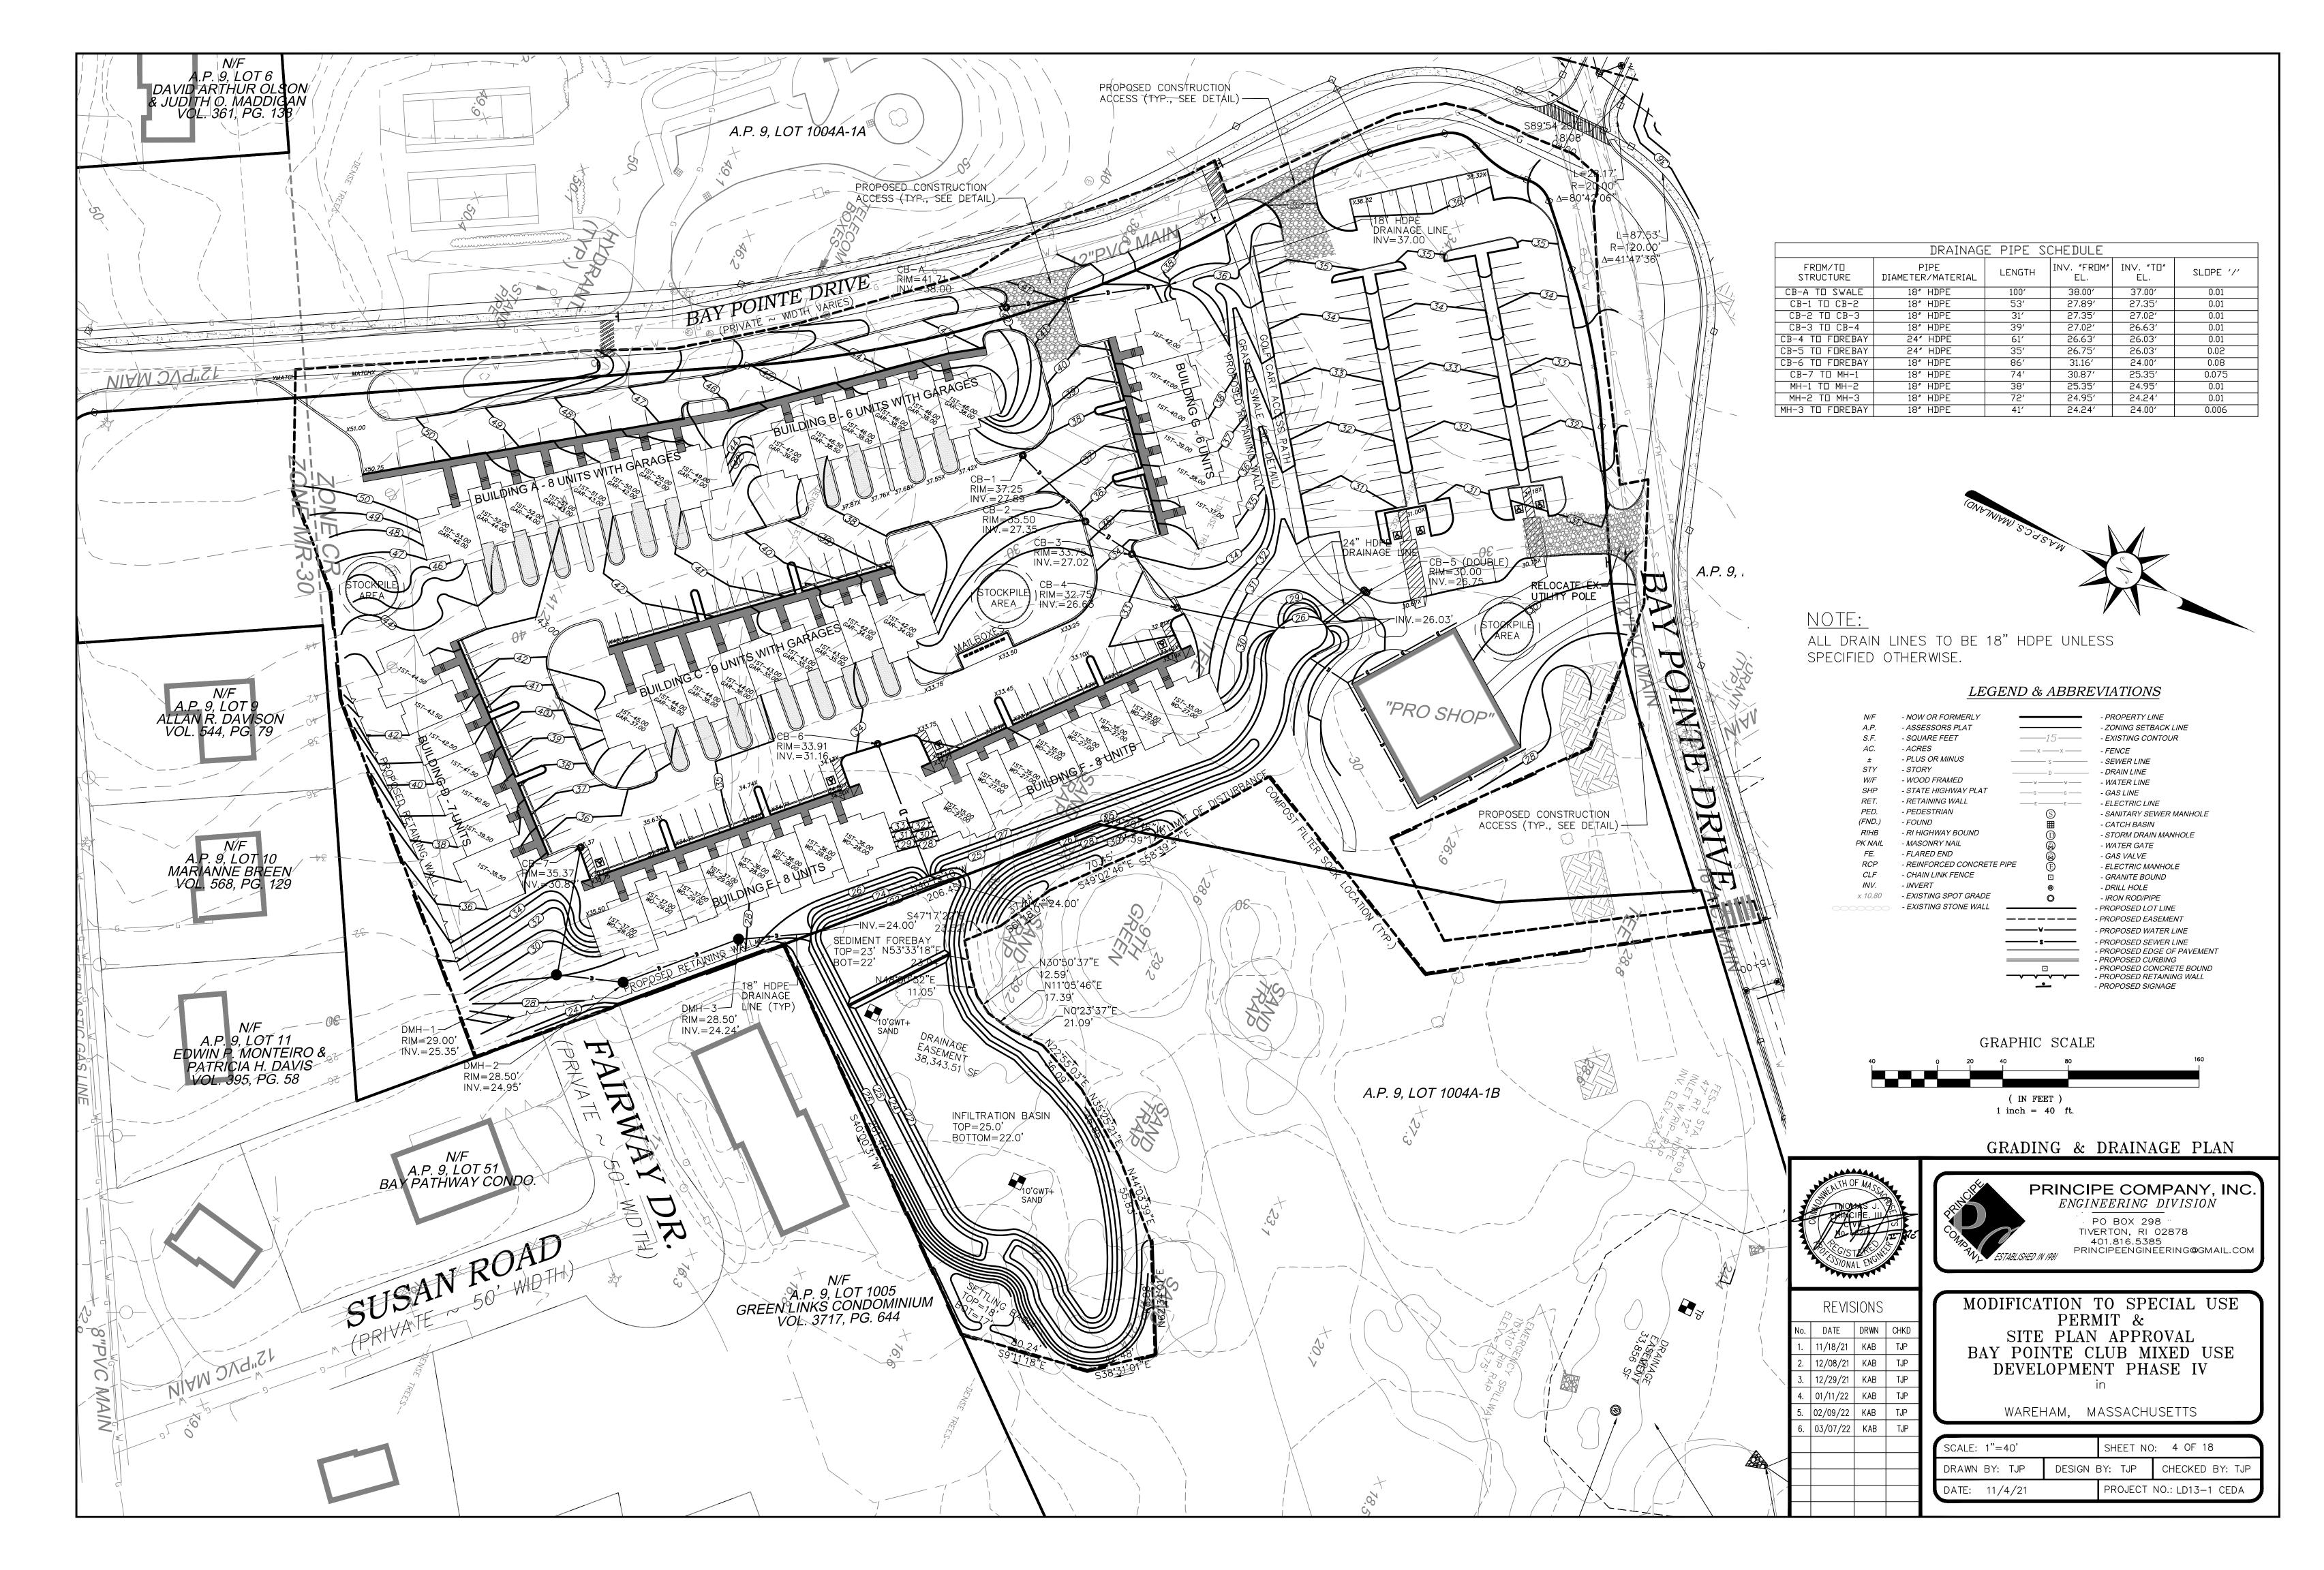


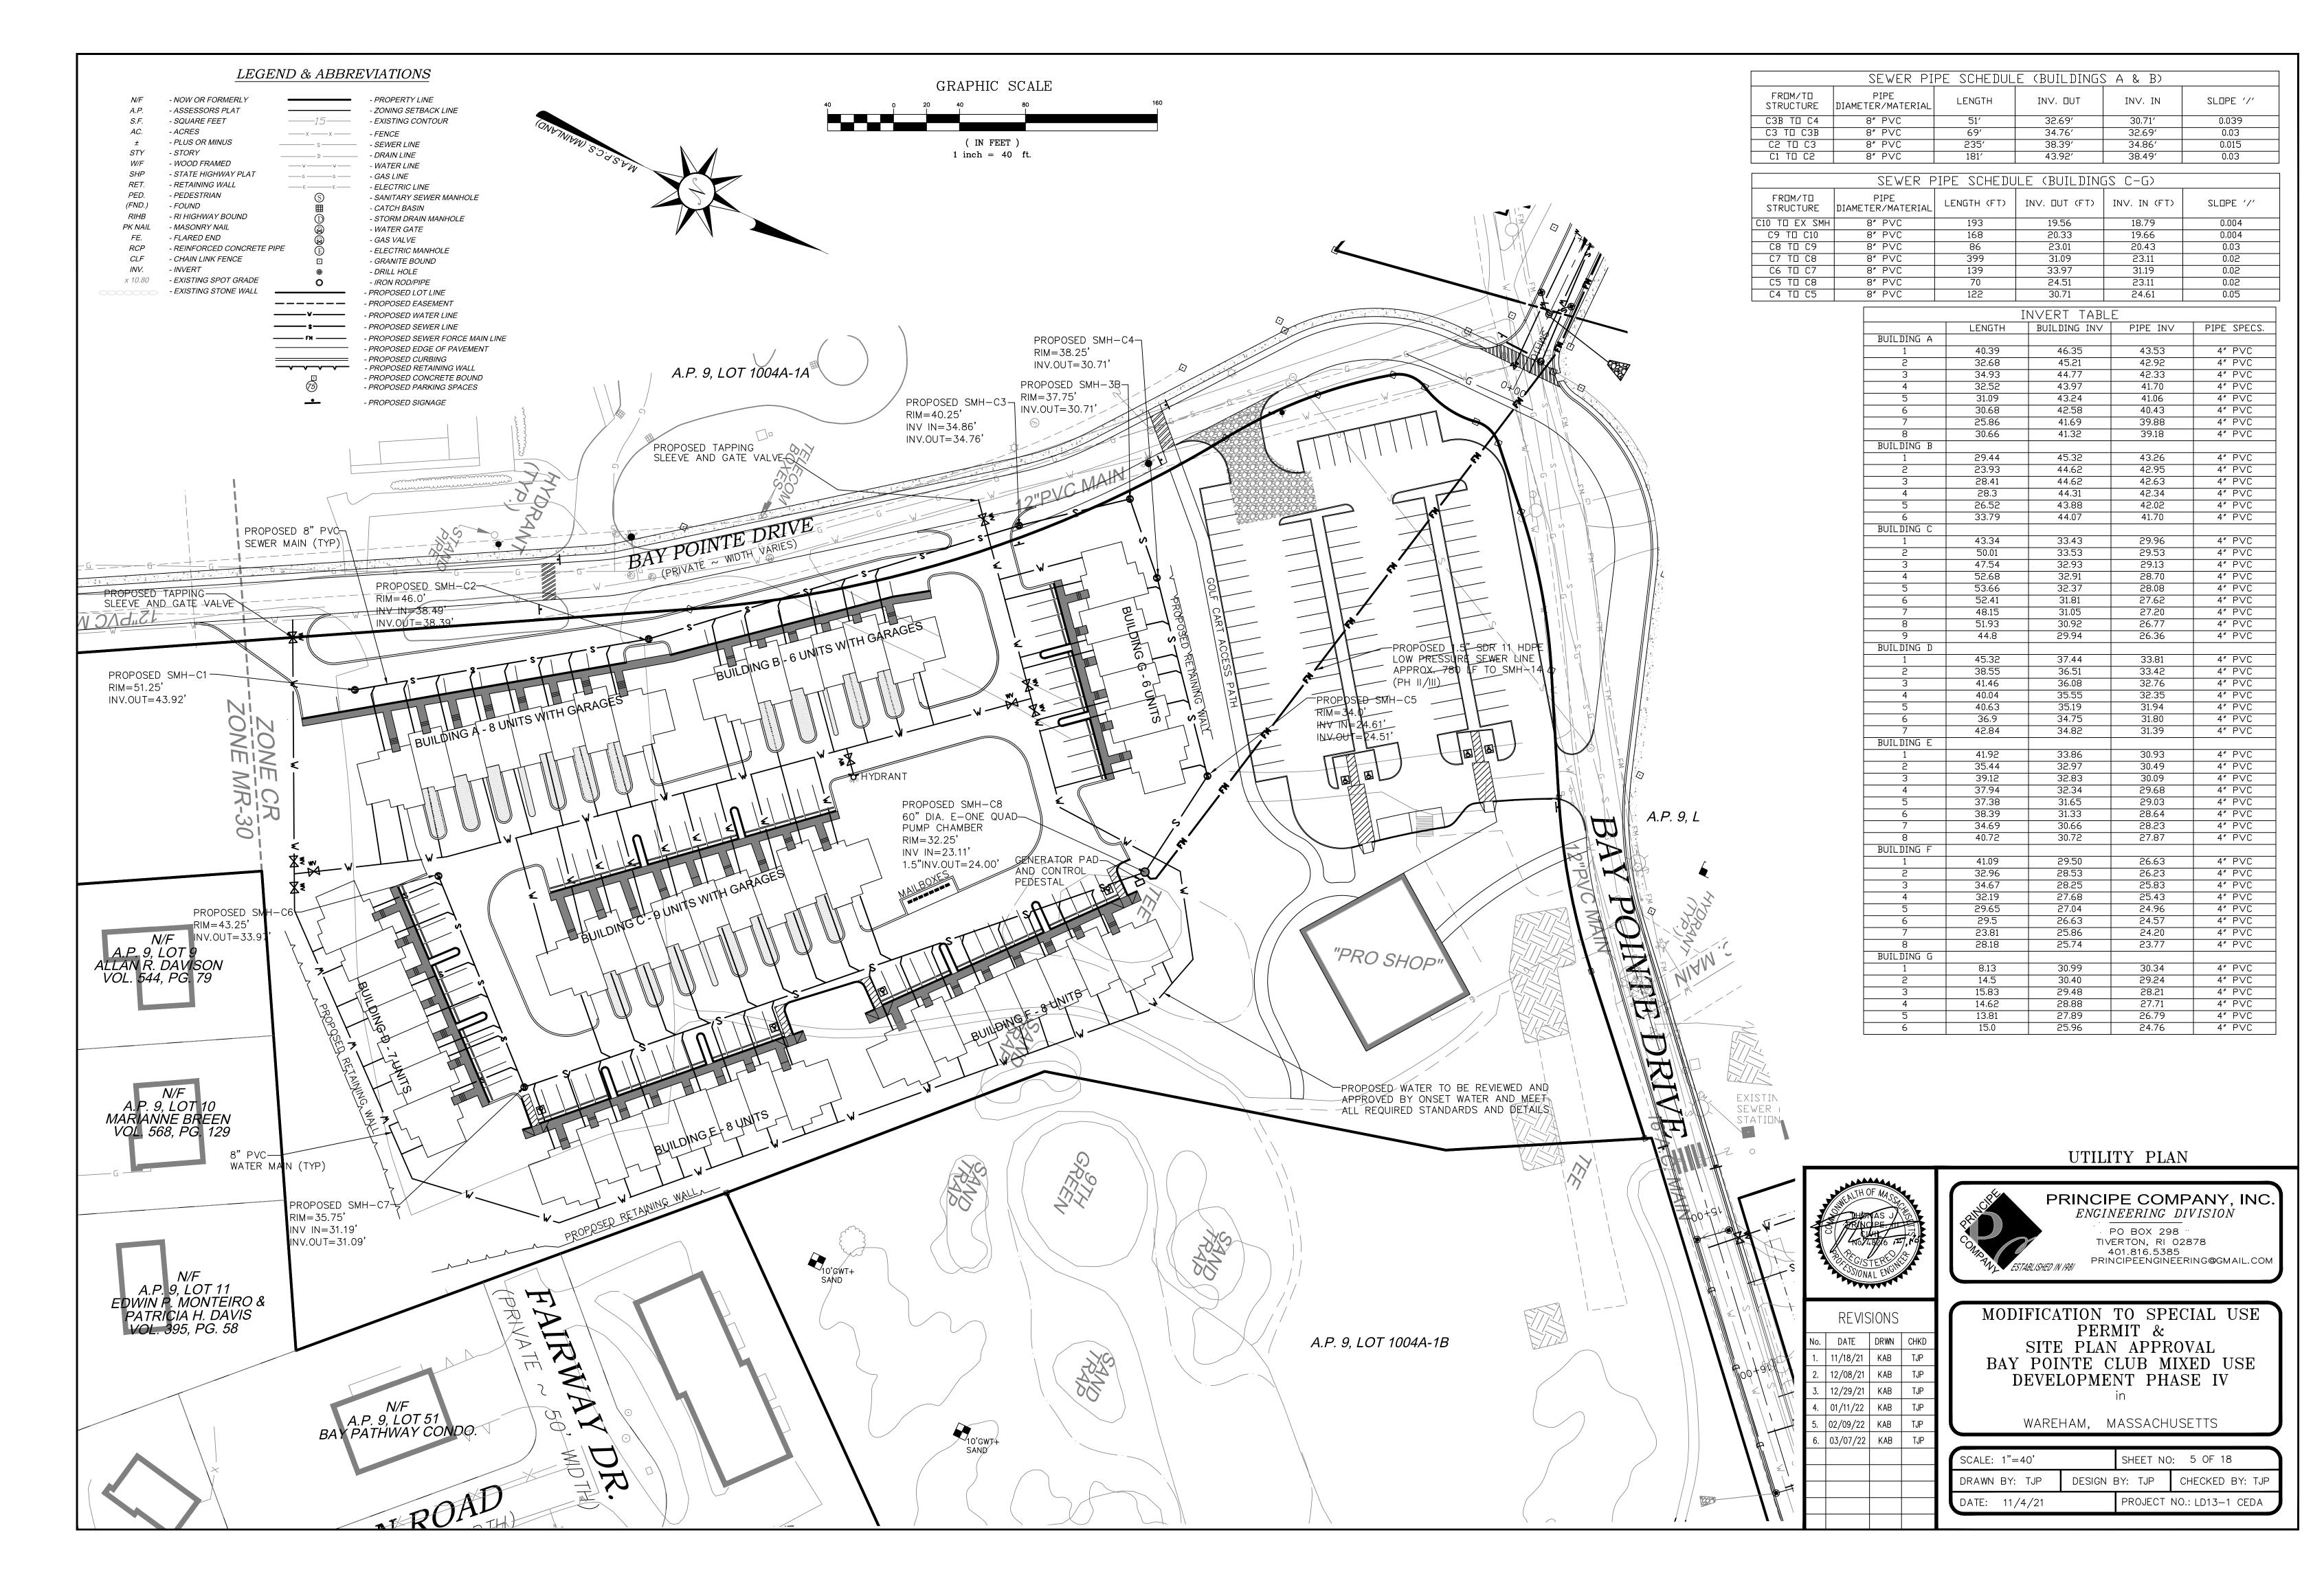


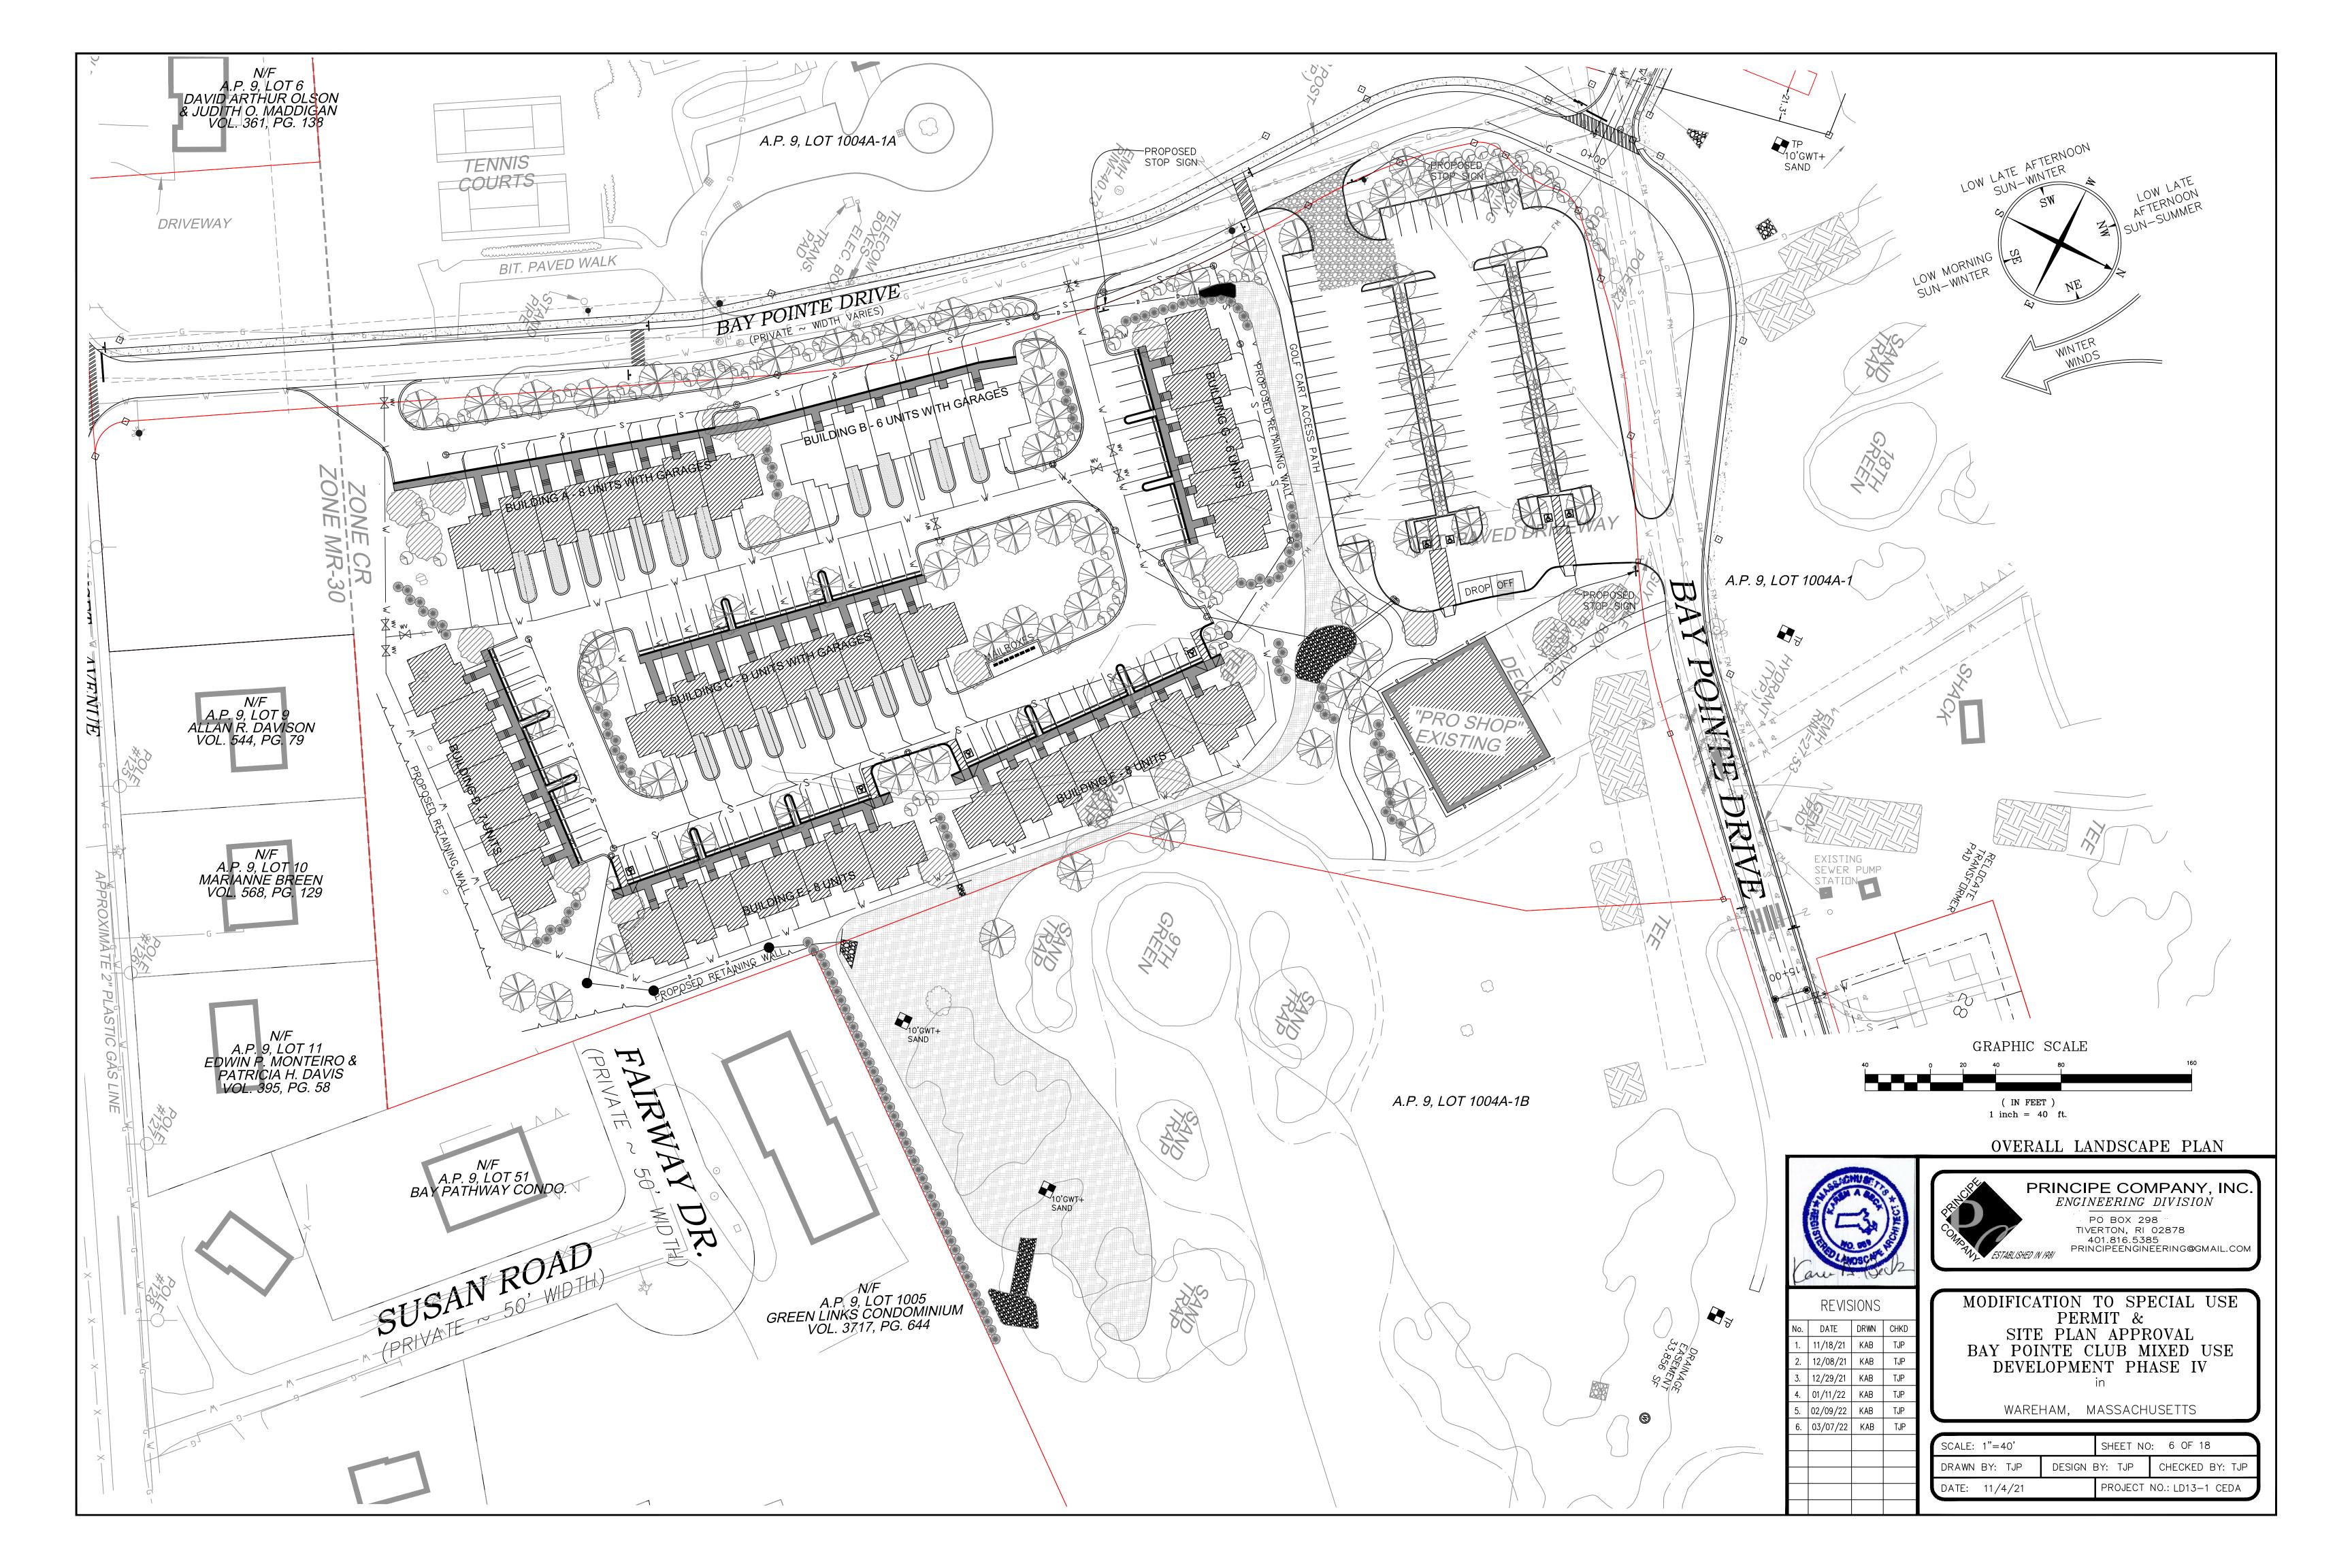


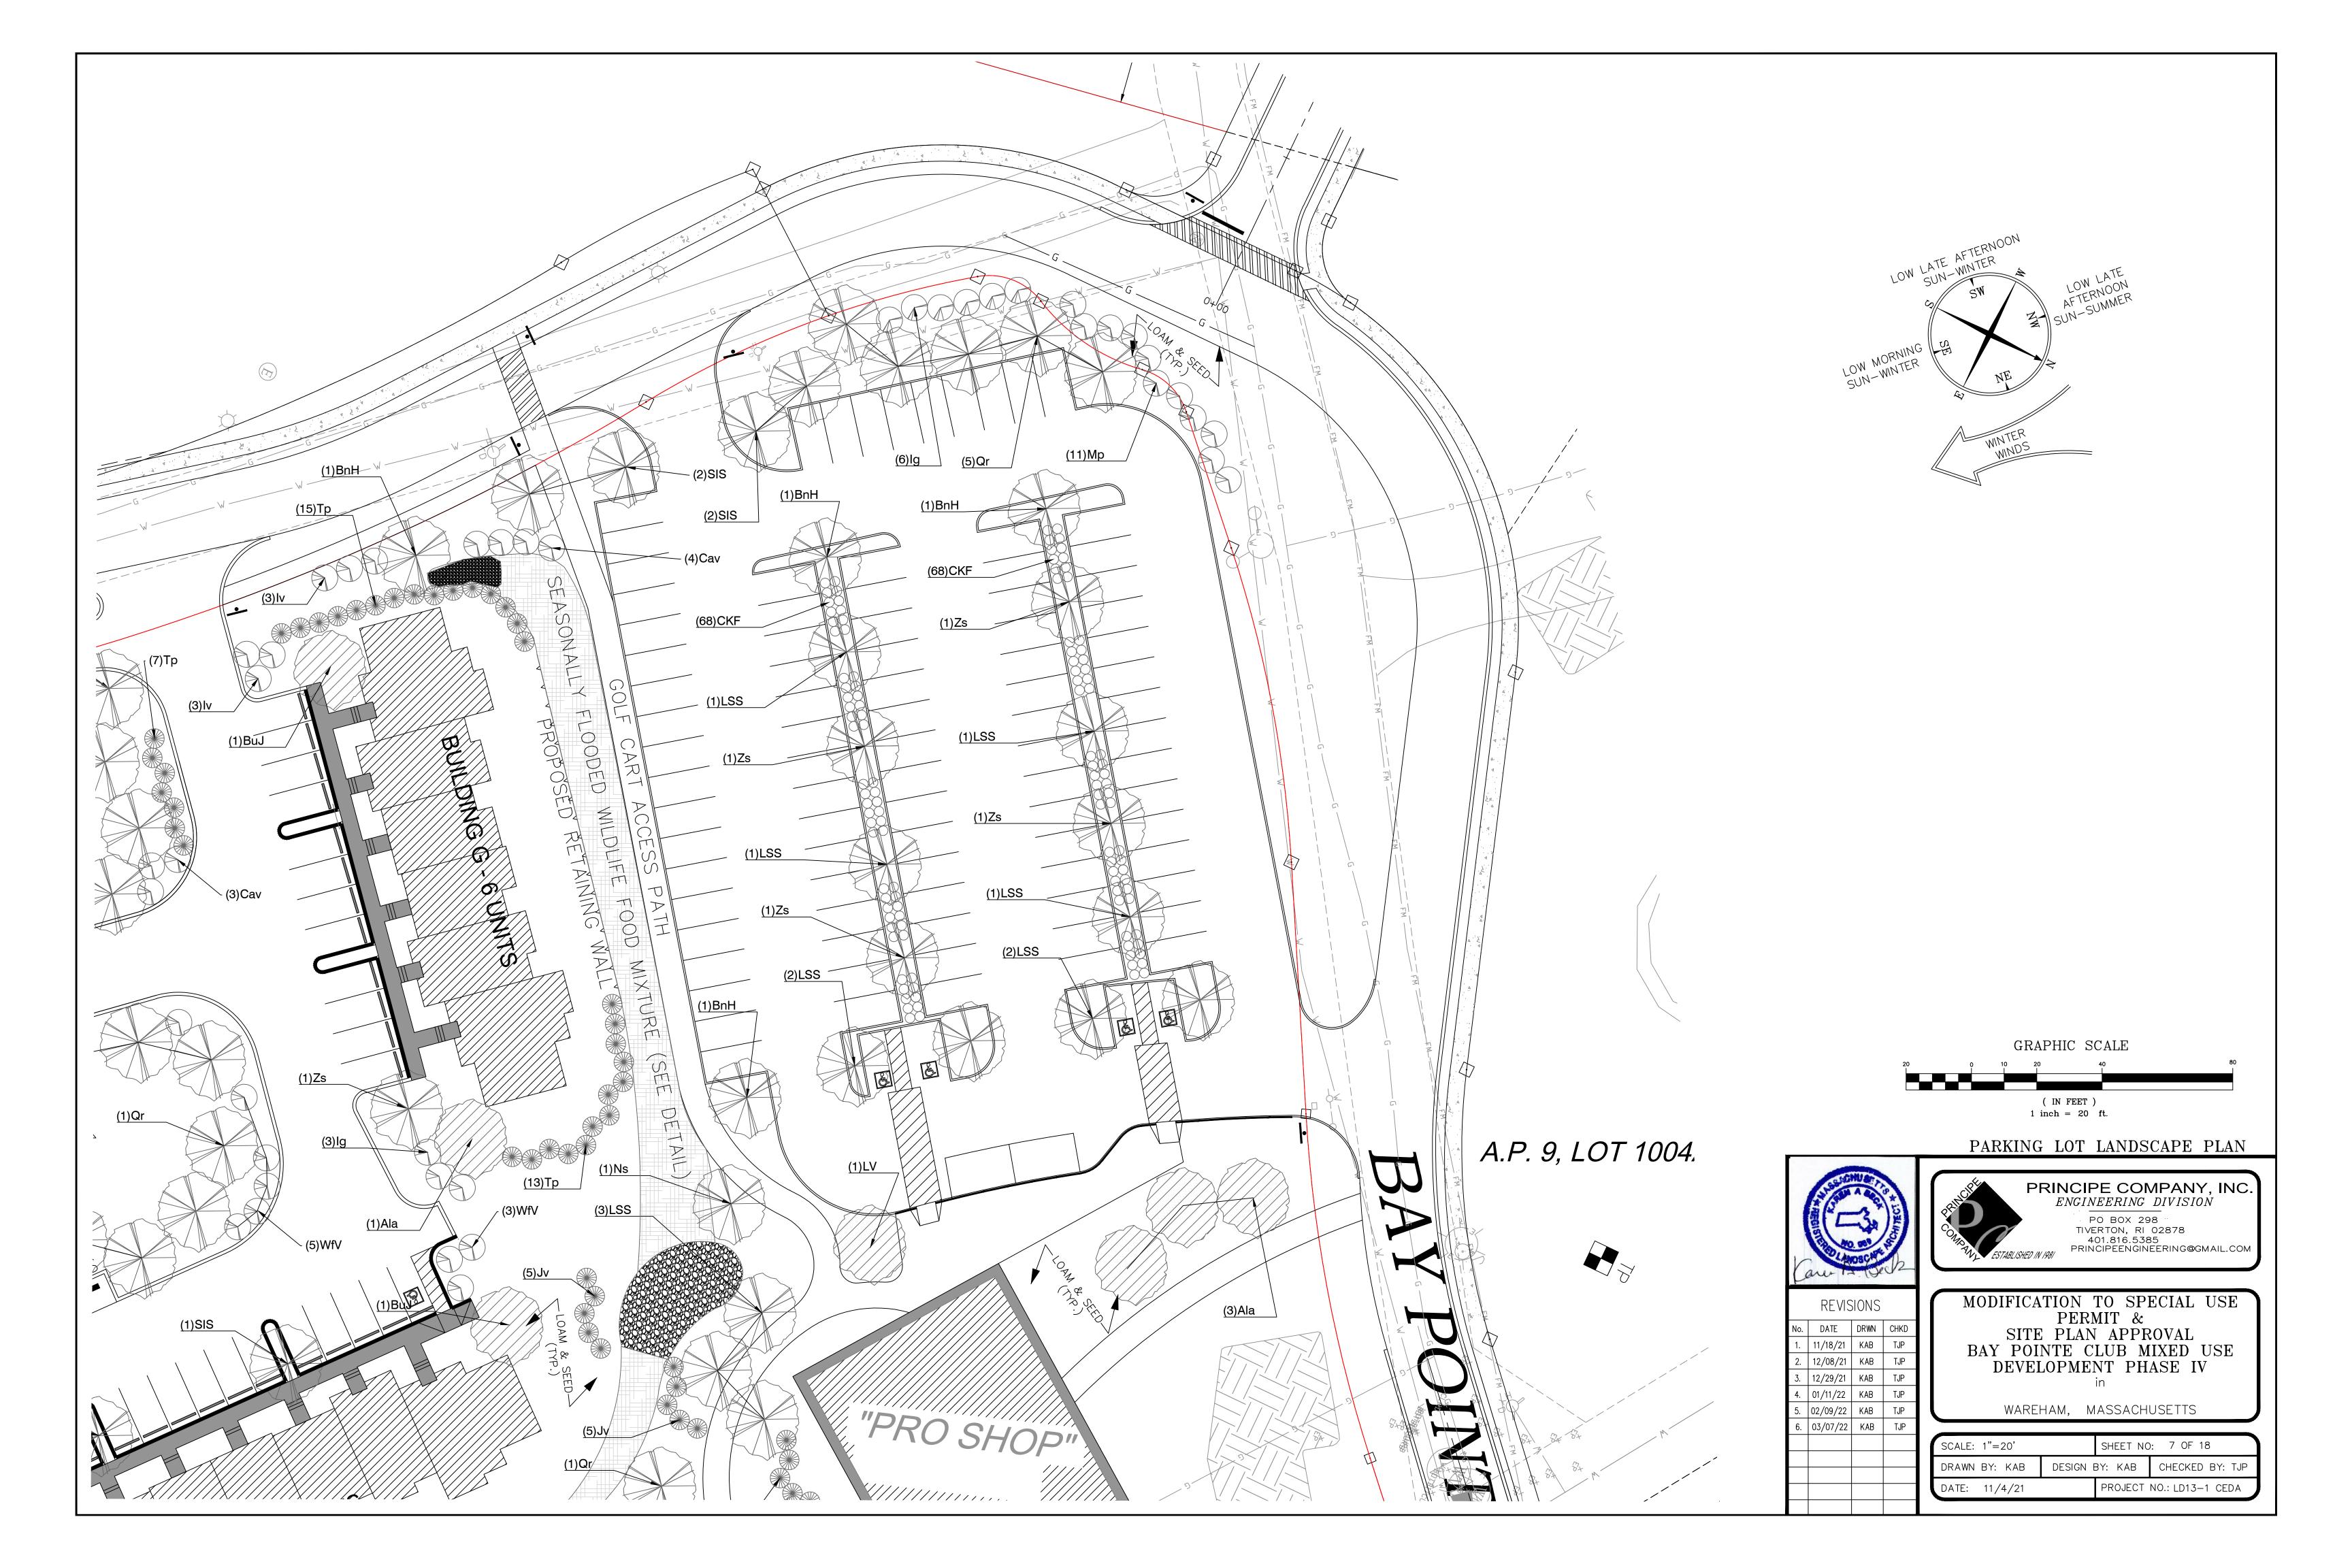

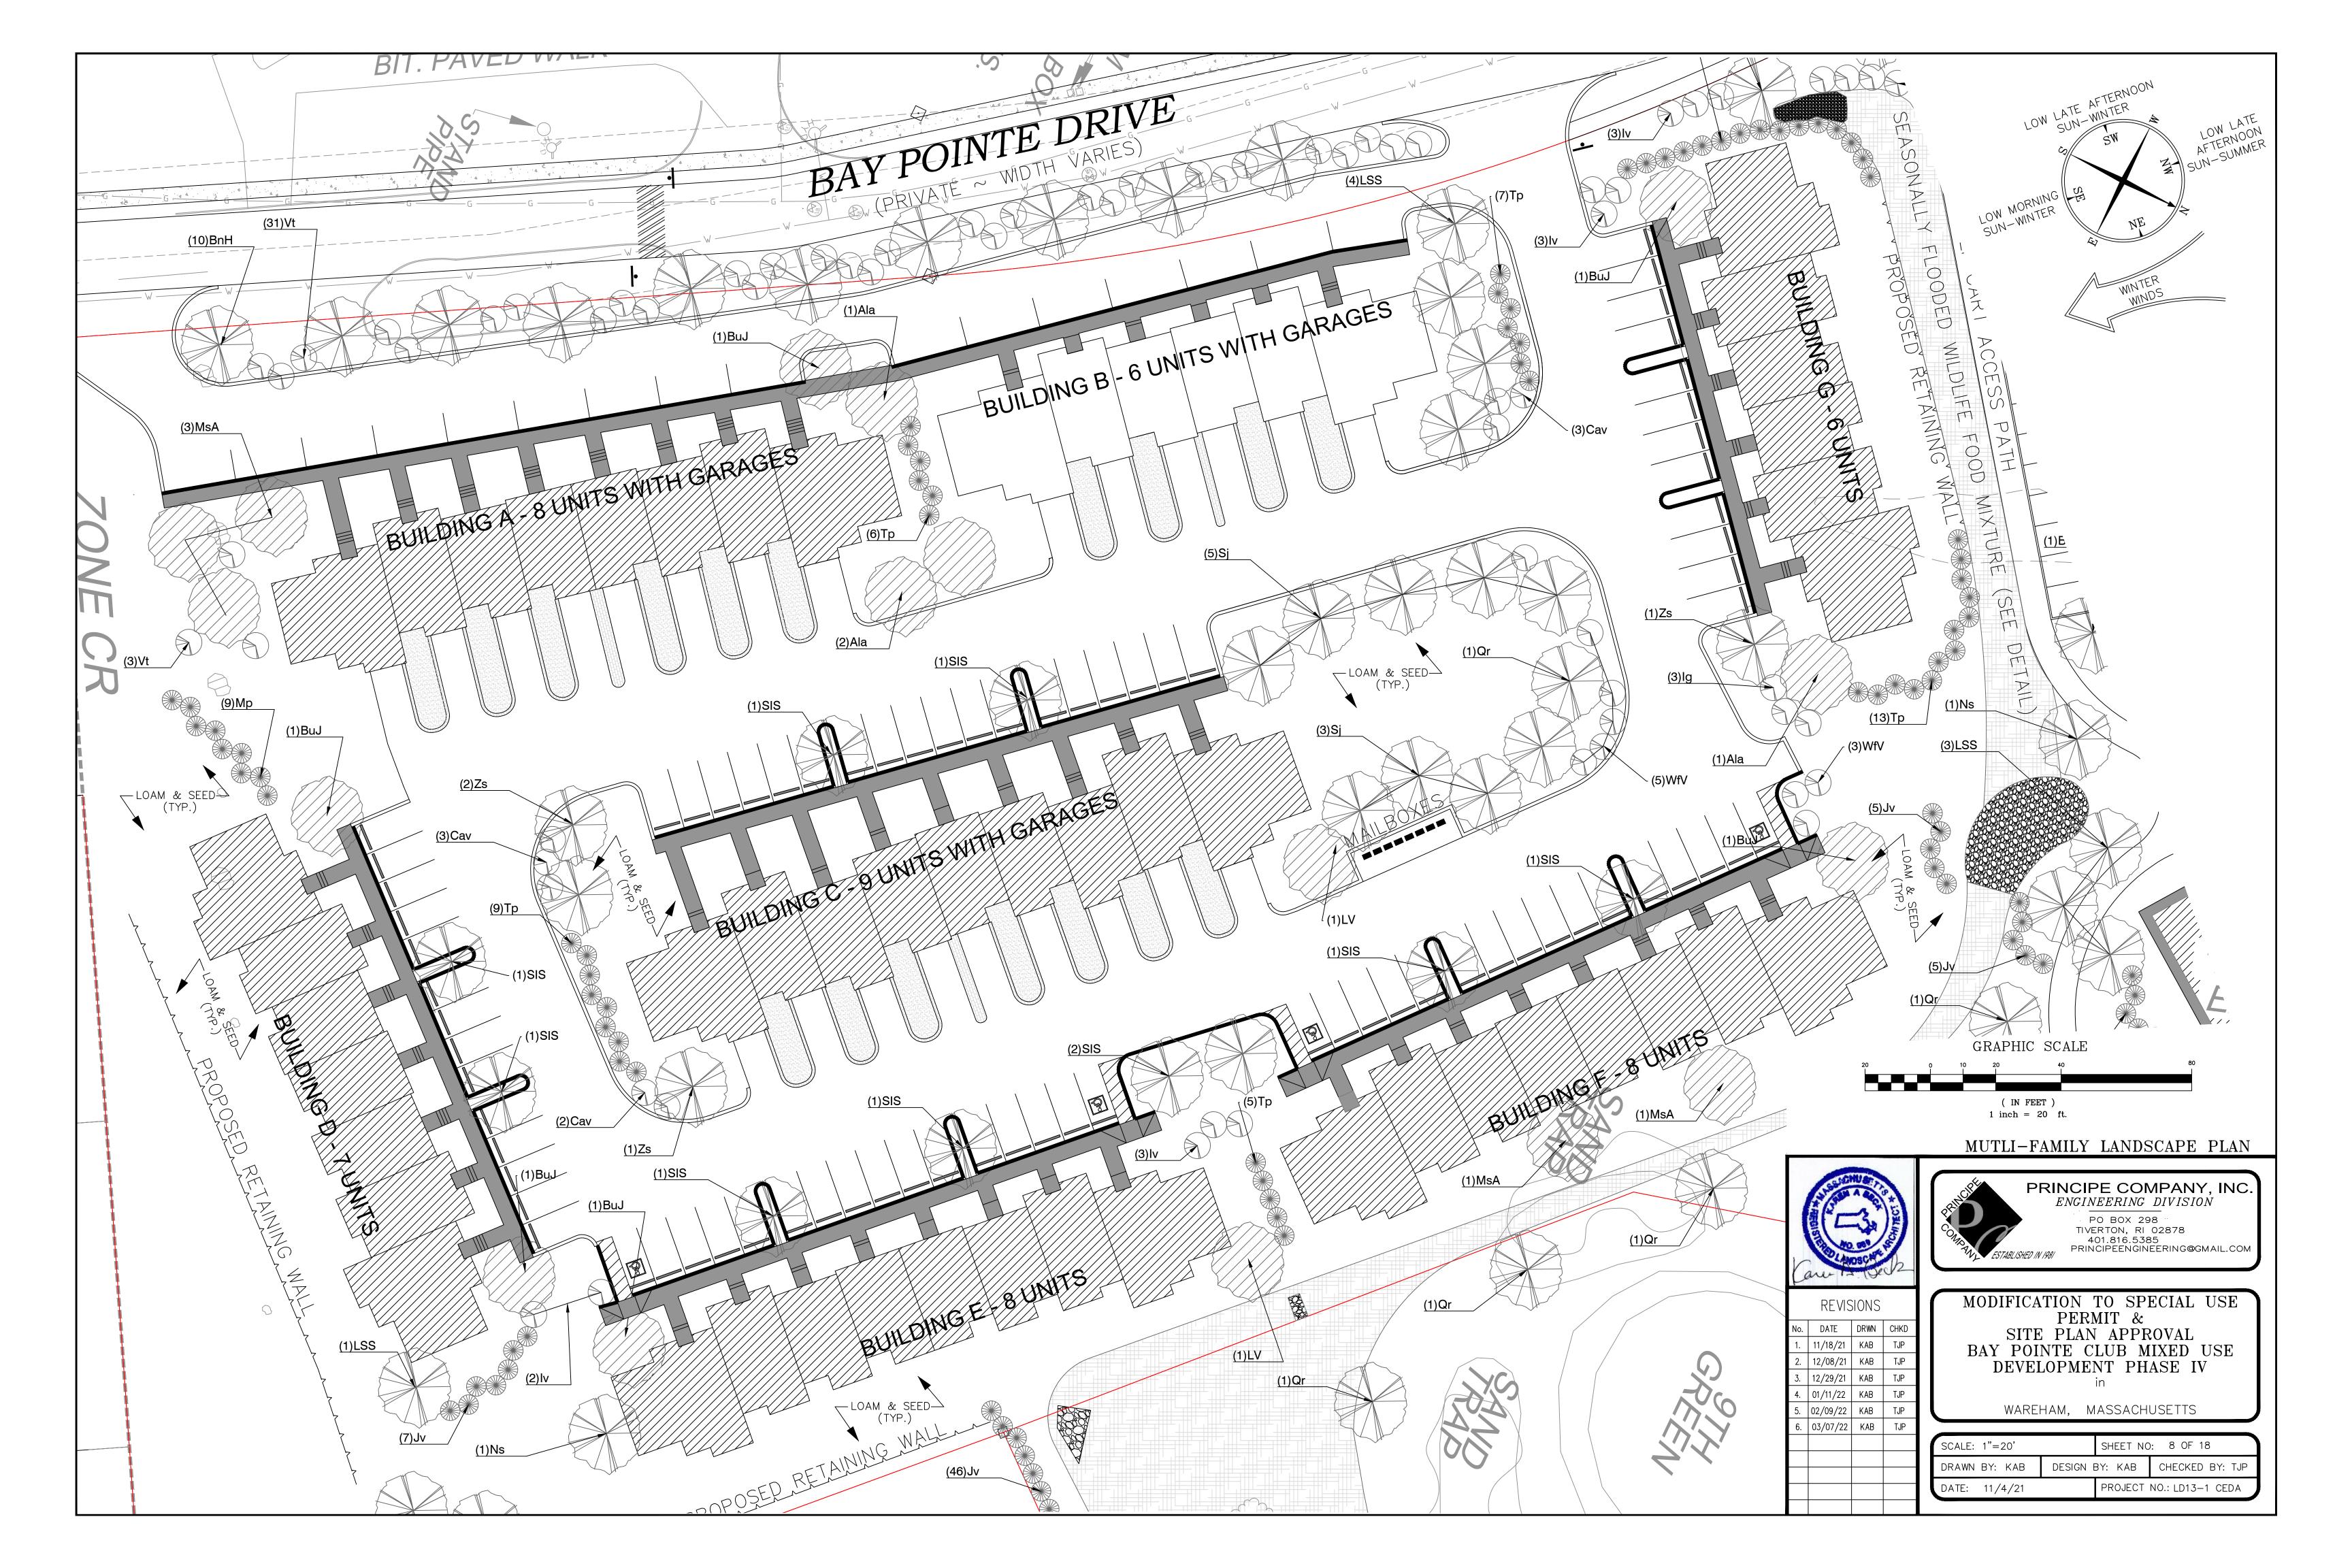

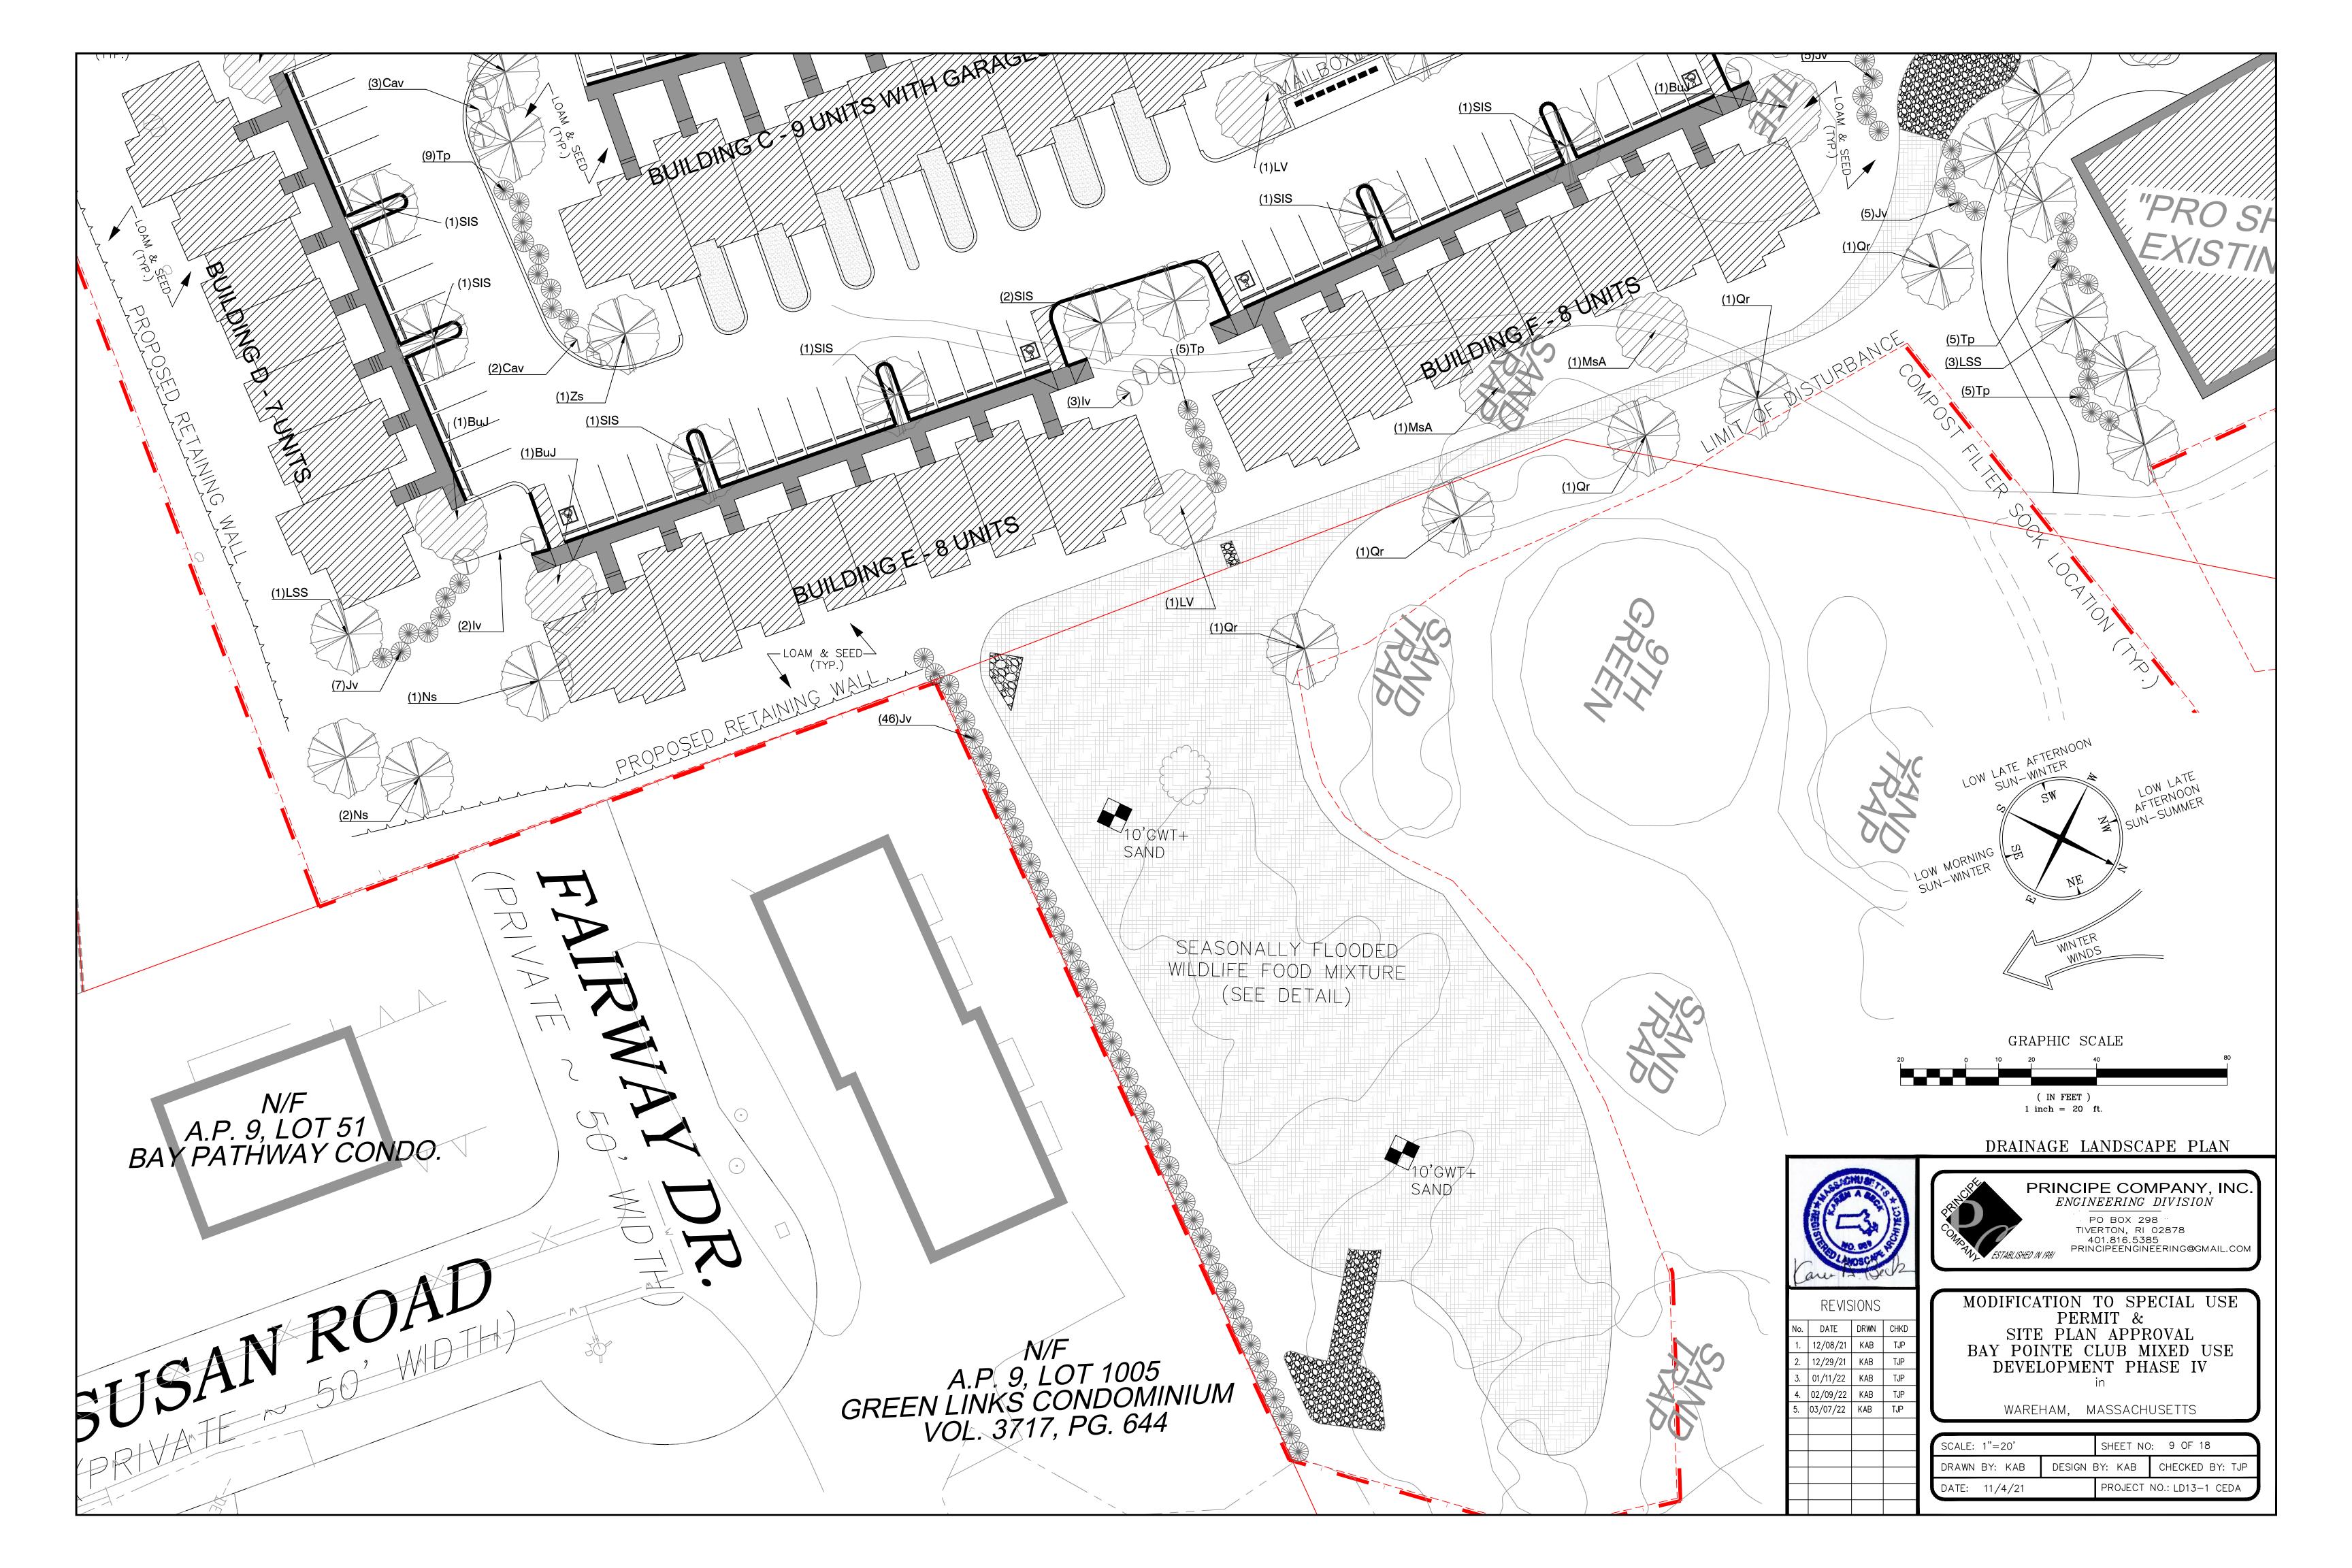

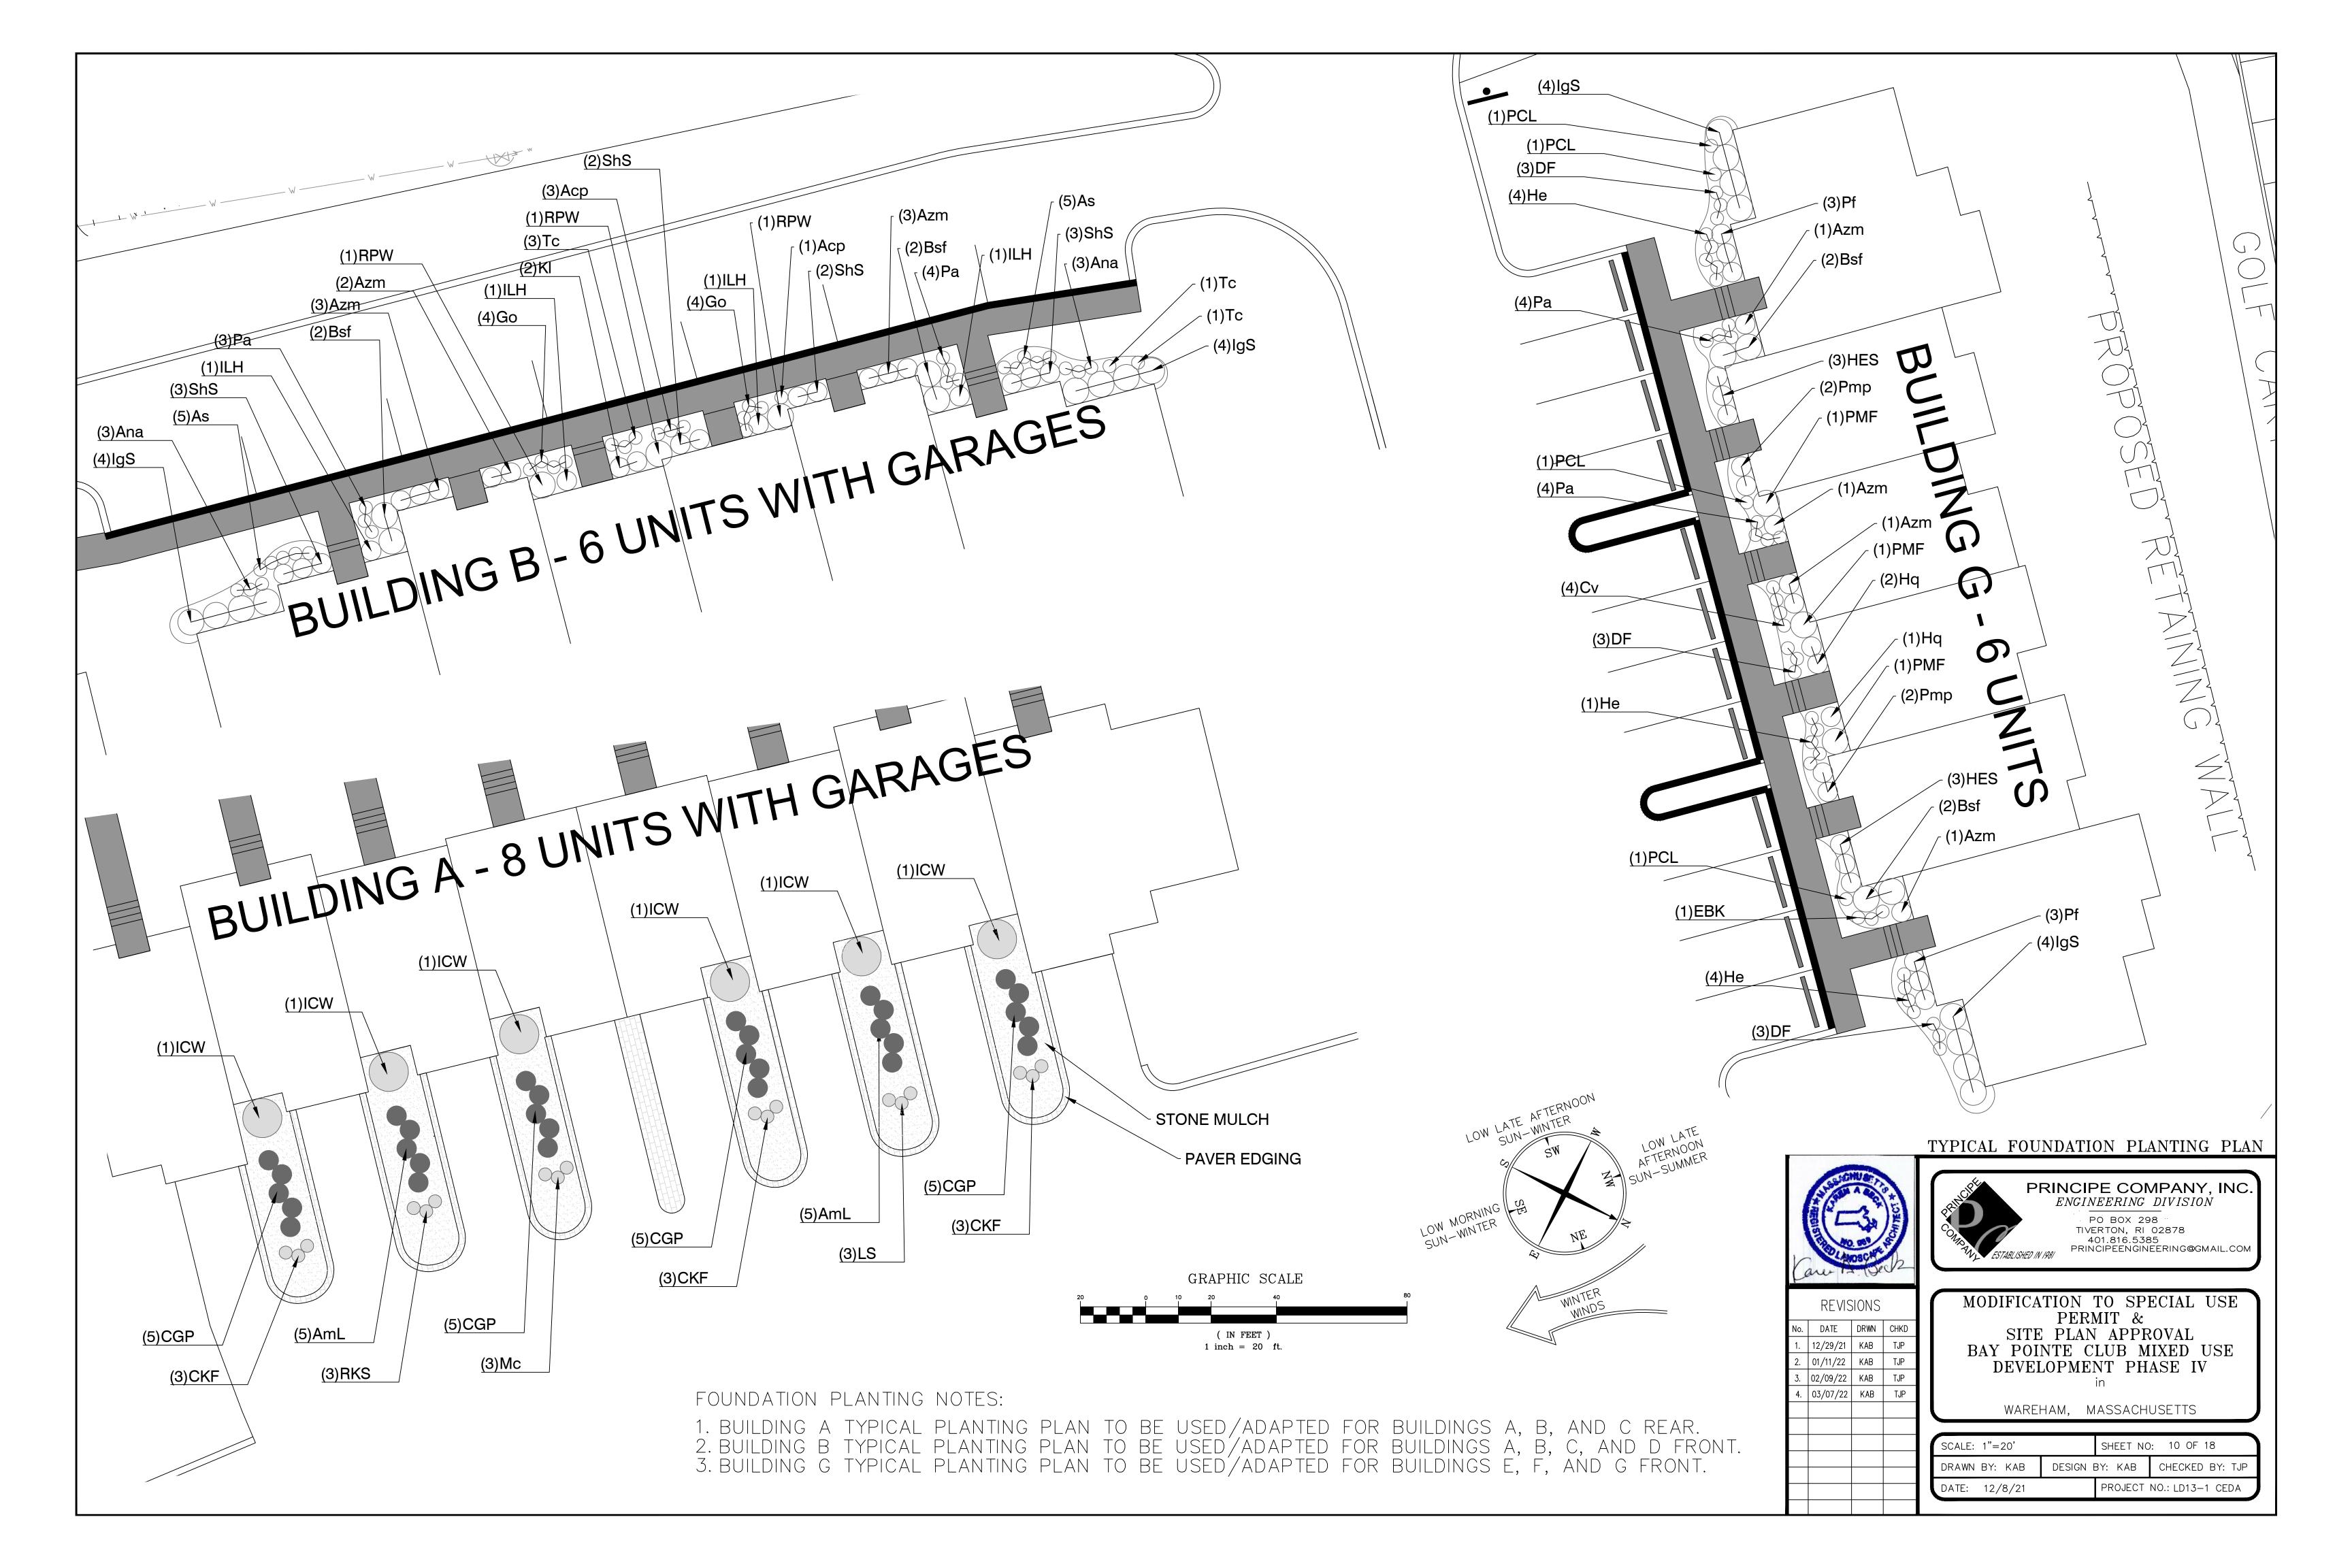

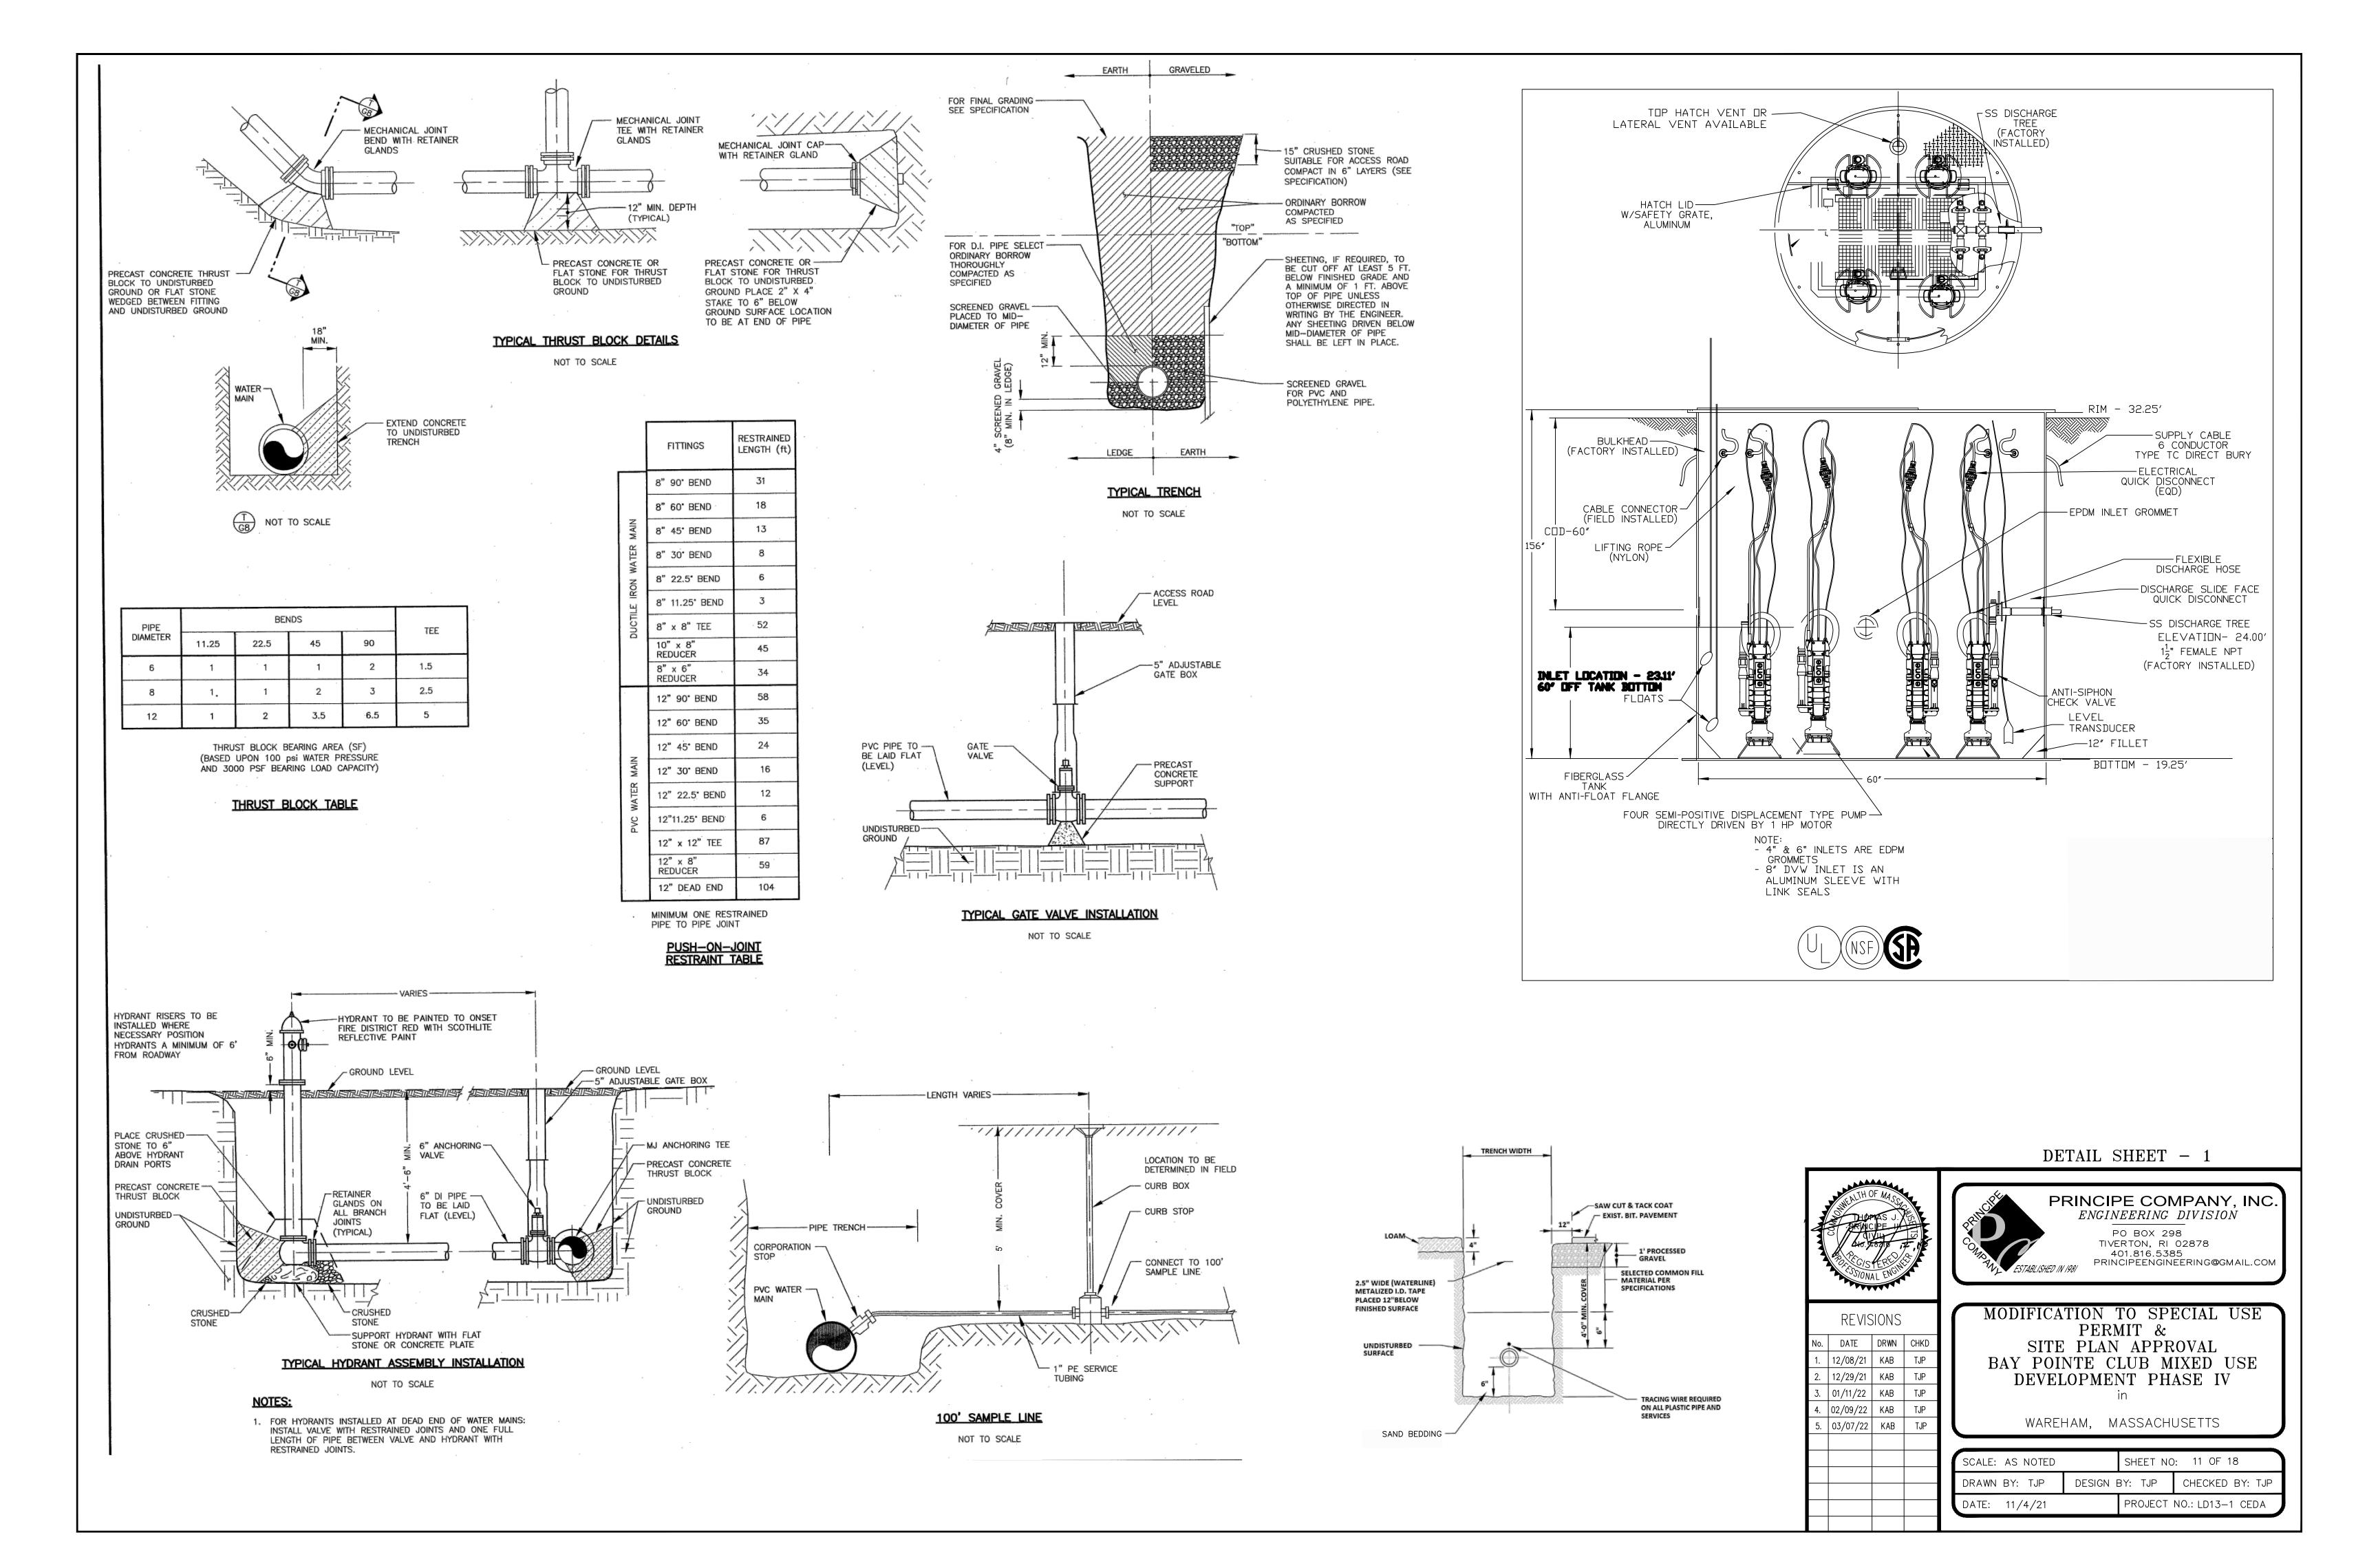

GENERAL NOTES:

1. IT SHALL BE THE CONTRACTOR'S SOLE RESPONSIBILITY TO FAMILIARIZE HIMSELF WITH ANY APPLICABLE LOCAL, STATE AND FEDERAL LAWS GOVERNING HIS INTENDED ACTIVITIES. OSHA REGULATIONS ARE APPLICABLE OF PROJECT SITE CONSTRUCTION ACTIVITIES.

2. ALL CONSTRUCTION WILL BE UNDERTAKEN IN ACCORDANCE WITH THE APPLICABLE REQUIREMENTS OF THE TOWN OF WARREN.

3. IT SHALL BE THE CONTRACTOR'S SOLE RESPONSIBILITY TO MAINTAIN THE INTEGRITY OF ALL EXISTING UTILITIES, STRUCTURES, AND ABUTTING PROPERTIES. THE COST OF ANY REPAIR OR REPLACEMENT OF DAMAGED ITEMS SHALL BE BORNE BY THE CONTRACTOR.

4. IF THE MUNICIPALITY REQUIRES A PROJECT PRE-CONSTRUCTION CONFERENCE, THE PROJECT DEVELOPER AND THE PROJECT CONTRACTOR WILL ATTEND AND WILL PROVIDE ALL REQUESTED MATERIALS PRIOR TO COMMENCING ANY WORK.

5. IF CEMENT CONCRETE MIX TRUCKS ARE TO BE WASHED OUT ON SITE, THE CONTRACTOR IS RESPONSIBLE FOR ESTABLISHING AND MAINTAINING A WASH OUT AREA WITH APPROPRIATE PROTECTION CONTROLS.

6. THE CONTRACTOR IS RESPONSIBLE FOR PROVIDING AND MAINTAINING COLLECTION AND STORAGE LOCATIONS ON-SITE FOR ALL CONSTRUCTION DEBRIS AND TRASH SO THAT THIS MATERIAL DOES NOT BECOME A NEIGHBORHOOD NUISANCE.

7. ALL REQUIRED SITE IMPROVEMENTS SHALL BE INSPECTED BY THE TOWN ENGINEER TO ENSURE SATISFACTORY COMPLETION. IN NO CASE SHALL THE INSTALLATION OF ANY IMPROVEMENTS BE STARTED UNTIL PRIOR NOTIFICATION IS GIVEN TO THE TOWN ENGINEER. AT LEAST A 48-HOUR NOTICE SHALL BE GIVEN TO THE TOWN ENGINEER PRIOR TO ANY SUCH START OF CONSTRUCTION. A FINAL INSPECTION OF ALL SITE IMPROVEMENTS, UTILITIES AND GRADING WILL BE MADE TO DETERMINE WHETHER THE WORK IS SATISFACTORY AND IN SUBSTANTIAL AGREEMENT WITH THE APPROVED FINAL CONSTRUCTION DRAWING AND THE TOWN SPECIFICATIONS.

8. LOCATION AND DEPTH OF EXISTING UTILITIES ARE APPROXIMATE AND HAVE BEEN PLOTTED FROM THE BEST AVAILABLE INFORMATION. THE CONTRACTOR SHALL CHECK AND VERIFY LOCATIONS OF ALL EXISTING UTILITIES BOTH UNDERGROUND AND OVERHEAD. ANY DAMAGE TO EXISTING UTILITIES AS SHOWN OR NOT SHOWN ON THE PLANS SHALL BE THE CONTRACTOR'S RESPONSIBILITY. COSTS OF SUCH DAMAGE SHALL BE BORNE BY THE CONTRACTOR. NO EXCAVATION SHALL BE DONE UNTIL ALL INVOLVED UTILITY COMPANIES ARE NOTIFIED 48-HOURS IN ADVANCE. THE CONTRACTOR SHALL BE RESPONSIBLE TO NOTIFY DIG-SAFE (1-800-344-7233) A MINIMUM OF 48 WORKING HOURS, EXCLUDING WEEKENDS AND HOLIDAYS, PRIOR TO THE START OF ANY EXCAVATION AND/OR BLASTING WORK. THE NAME OF THE COMPANY PERFORMING THE EXCAVATION AND/OR BLASTING WORK MUST BE SUPPLIED TO DIG-SAFE, IF IT IS DIFFERENT FROM THE CALLER.

9. IT SHALL BE THE CONTRACTOR'S SOLE RESPONSIBILITY TO OBTAIN ANY AND ALL PERMITS REQUIRED BY, BUT NOT LIMITED TO, THE COMMONWEALTH OF MASSACHUSETTS, THE FEDERAL GOVERNMENT, THE TOWN OF NORTH ATTLEBOROUGH AND ALL INDIVIDUAL UTILITY COMPANIES PRIOR TO COMMENCING

10. ALL MATERIAL FOR FILL SHALL BE CLEAN AND FREE OF MATTER WHICH COULD POLLUTE ANY DOWN STREAM WATERCOURSE.

11. FILL MATERIAL SHALL BE COMPACTED IN ONE FOOT (MAXIMUM) LIFTS TO AT LEAST 95% OF THE MAXIMUM DRY DENSITY AS DETERMINED IN ACCORDANCE WITH ASTM D-1557 (MODIFIED PROCTOR TEST).

Seasonally Flooded Wildlife Food Mix (LIMITS SHOWN ON LANDSCAPE PLAN SHEETS 5-8).

21.5% Panicum clandestinum, Tioga (Deertongue, Tioga) 20.0% Elymus virginicus, Madison-NY Ecotype (Virginia Wildrye, Madison-NY Ecotype)

16.6% Andropogon gerardii, 'Niagara' (Big Bluestem, 'Niagara')

15.0% Echinochloa crusgalli var. frumentacea (Japanese Millet) 10.0% Carex vulpinoidea, PA Ecotype (Fox Sedge, PA Ecotype)

8.0% Panicum virgatum, 'Shawnee' (Switchgrass, 'Shawnee')

4.0% Chamaecrista fasciculata. PA Ecotype (Partridge Pea. PA Ecotype)

1.5% Verbena hastata, PA Ecotype (Blue Vervain, PA Ecotype)

1.0% Heliopsis helianthoides, PA Ecotype (Oxeye Sunflower, PA Ecotype)

1.0% Juncus effusus (Soft Rush) 0.8% Agrostis perennans, Albany Pine Bush-NY Ecotype (Autumn Bentarass, Albany Pine Bush-NY Ecotype)

0.1% Asclepias incarnata, PA Ecotype (Swamp Milkweed, PA Ecotype)

0.1% Aster novae—angliae, PA Ecotype (New England Aster, PA Ecotype)

0.1% Eupatorium fistulosum, PA Ecotype (Joe Pye Weed, PA Ecotype) 0.1% Eupatorium perfoliatum, PA Ecotype (Boneset, PA Ecotype)

0.1% Monarda fistulosa, Fort Indiantown Gap—PA Ecotype (Wild Bergamot, Fort Indiantown Gap—PA Ecotype) 0.1% Pycnanthemum tenuifolium (Narrowleaf Mountainmint)

This combination of annual and perennial grasses, forbs and grass—like plants provide food and cover in wet or flooded riparian areas, as well as in draw-down areas in retention basins or wetlands. Seed from October-May. Mix formulations are subject to change without notice depending on the availability of existing and new products. While the

Item Number: ERNMX—128

Product Categories:

Height: 0.3 -7.0 Ft

grain rye (1 Sep to 30 Apr; 30 lbs/acre), Japanese millet (1 May to 31 Aug; 10 lbs/acre), or barnyard grass (1 May to 31 Aug; 10 lbs/acre).

VEGETATIVE COVER AND PLANTING

1. THE NORMAL ACCEPTABLE SEASONABLE SEEDING DATES ARE APRIL 1ST THROUGH OCTOBER 15TH.

2. TOP SOIL FOR PERMANENT OR LONG TERM TEMPORARY SEEDING SHOULD HAVE A SANDY LOAM TEXTURE, RELATIVELY FREE OF SUBSOIL MATERIAL, STONES, ROOTS, LUMPS OF SOIL, TREE LIMBS, TRASH OR CONSTRUCTION DEBRIS. TOP SOIL SHALL CONFORM WITH RHODE ISLAND SPECIFICATIONS M18.01.

3. THE DESIGN SEED MIX UTILIZED IN ALL DISTURBED AREAS TO BE SEEDED SHALL BE COMPRISED OF THE FOLLOWING:

TYPE	% BY WEIGHT	SEEDING DATE
CREEPING RED FESCUE	70	
ASTORIA BENTGRASS	5	APRIL 1 — JUNE 15
BIRDFOOT TREFOIL	15	AUG. 15 — OCT. 15
PERENNIAL RYE GRASS	10	

APPLICATION RATE - 100 LBS PER ACRE

EDGE OF

BITUMINOUS BINDER -

BITUMINOUS SURFACE COURSE—

6"LOAM →

6" SUITABLE FILL-

PAVEMENT-

SEED MIX SHALL BE INOCULATED WITHIN 24 - HOURS BEFORE MIXING AND PLANTING, WITH APPROPRIATE INOCULATION FOR EACH SEED VARIETY. ALTERNATE SEED TYPES DUE TO SITE SPECIFIC CONDITIONS AND SOILS ARE ACCEPTABLE WITH THE ENGINEER'S APPROVAL.

4. IN TOPSOIL SEEDING AREAS, THE CONTRACTOR WILL LIME AND FERTILIZE AS REQUIRED TO COMPLIMENT OR UPGRADE SOIL CONDITIONS.

5. THE CONTRACTOR MUST REPAIR AND/OR RESEED ANY PERMANENT VEGETATIVE COVER AREAS THAT DO NOT DEVELOP OR WHICH ERODE WITHIN A ONE (1) YEAR PERIOD.

-GRASS


VARIES

1'-6"

TYPICAL GRASSED SWALE

NOT TO SCALE

NOTE: WHERE INDICATED ON THE PLANS, CATCH BASIN GRATE SHALL INITIALLY BE SET 1'-0" HIGHER THAN DESIGN ELEVATION TO ALLOW FOR SEDIMENTATION. AFTER VEGETATIVE COVER HAS BEEN ESTABLISHED, RIM SHALL BE LOWERED TO DESIGN ELEVATION.

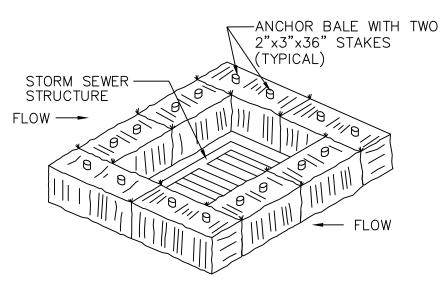

STRAW BALE CATCH BASIN PROTECTION NOT TO SCALE

-EDGE OF

PAVEMENT

GRADE

BASE COURSE


-EXISTING SOIL


TOE OF SLOPE

POINT OF GRADE —

SLOPE


VARIES

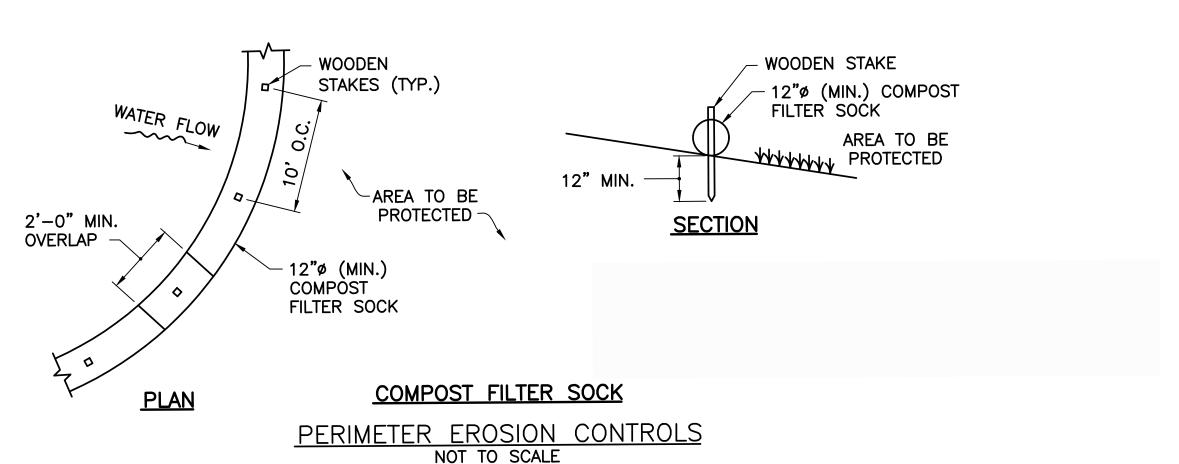

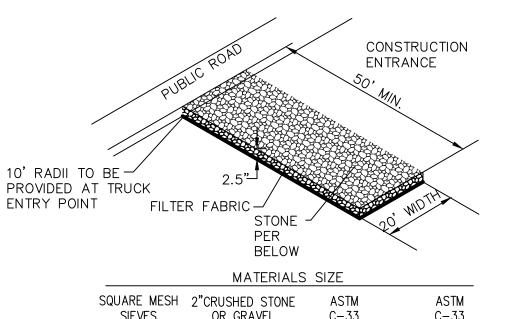


	MATERIALS	SIZE	
SQUARE MESH SIEVES	2"CRUSHED STONE OR GRAVEL	ASTM C-33 NO. 2	ASTM C-33 NO. 3
	% FINER	% FINER	% FINER
2-1/2 INCHES 2 INCHES 1-1/2 INCHES 1-1/4 INCHES 1 INCH 3/4 INCH 1/2 INCH 3/8 INCH	100 95-100 30-55 0-25 0-5 - -	90-100 35-70 0-15 - - 0-5 -	100 90-100 35-70 - 0-15 - 0-5 -


RIP-RAP STABILIZATION PAD @ CONSTRUCTION ENTRANCE NOT TO SCALE

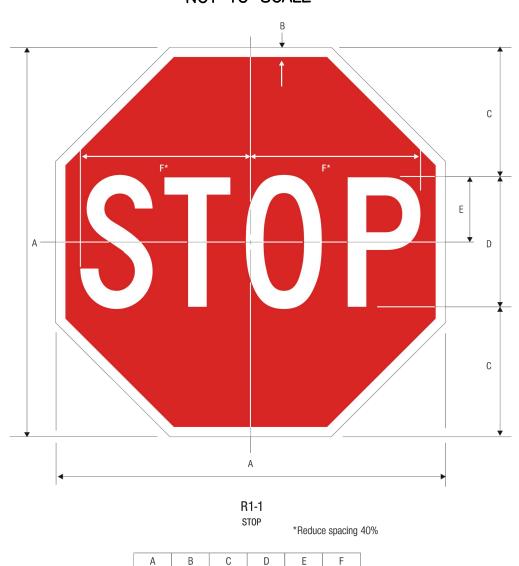

30 .75 10 10 C 5 12.5

48 1.25 16 16 C 8 20

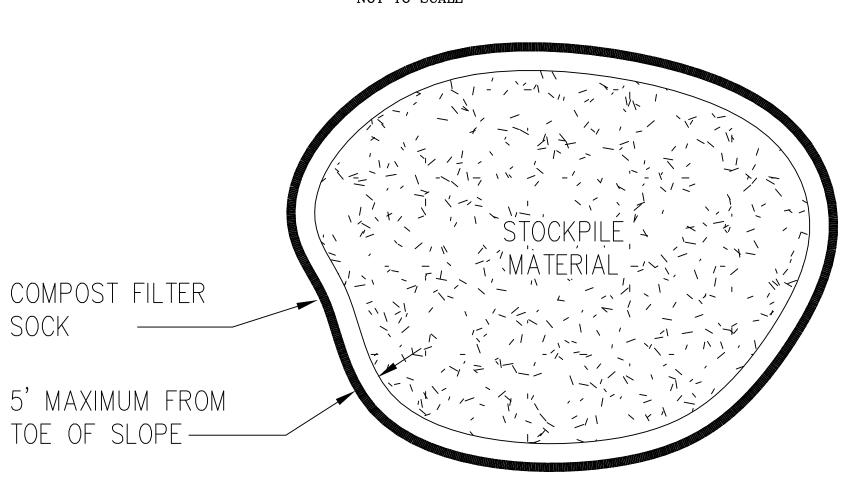

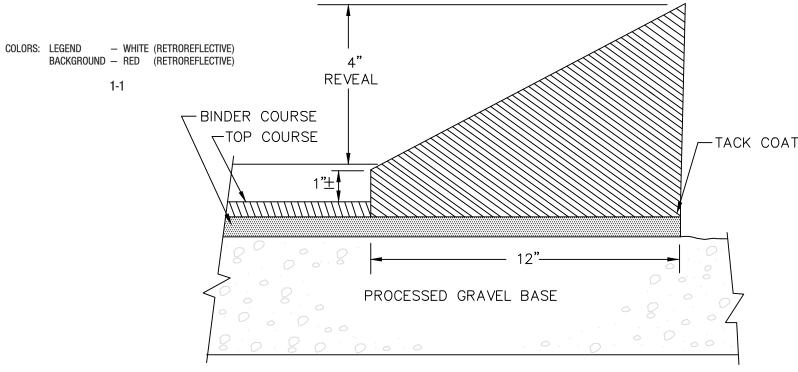

CAPE COD BERM

DETAIL SHEET - 2

General Product Information: INSTALLATION formula may change, the guiding philosophy and function of the mix will not. * REMOVE DRAIN GRATE * INSERT SILTSACK * REPLACE GRATE TO HOLD SILTSACK IN POSITION Wet Meadows & Wetlands, Wildlife Habitat & Food Plots * REMOVE FILLED SILTSACKS * CLEAN AND REUSE AS MAINUFACTURED BY Seeding Rate: 20 lb per acre, or 1/2 lb per 1,000 sq ft with a cover crop. For a cover crop use one of the following: ACF ENVIROMENTAL OR APPROVED EQUAL SILTSACK DETAIL NOT TO SCALE

EROSION CONTROL, SOIL STABILIZATION AND SEDIMENT CONTROL PLAN

1. PRIOR TO THE COMMENCEMENT OF ANY CLEARING, GRUBBING, DEMOLITION OR EARTHWORK ACTIVITY, TEMPORARY EROSION AND SEDIMENT CONTROL MEASURES AS INDICATED ON THE PLANS ARE TO BE INSTALLED BY THE CONTRACTOR. 2. CONSTRUCTION ACCESS STABILIZATION ENTRANCE PADS ARE TO BE INSTALLED PRIOR TO THE COMMENCEMENT OF SITE GRUBBING OR EARTHWORK ACTIVITY.

3. EXISTING CATCH BASINS ARE TO BE PROTECTED WITH HAY BALES AND/OR SILT SACS PRIOR TO THE START OF SITE GRUBBING, EARTHWORK OR UNDERGROUND UTILITY AND DRAINAGE INFRASTRUCTURE INSTALLATION TO SERVE THE DEVELOPMENT SITE.

4. THE PROJECT CONSTRUCTION SEQUENCE, TO THE EXTENT PRACTICAL, SHOULD REQUIRE THE INSTALLATION OF DOWN GRADE AND OFF SITE STORM DRAINAGE SYSTEM IMPROVEMENTS BEFORE THE START OF SITE GRUBBING AND EARTHWORK ACTIVITY.

5. TEMPORARY SITE SLOPE TREATMENTS FOR SOIL STABILIZATION SHALL CONSIST OF HAY, STRAW, FIBER MULCH, RIP RAP OR PROTECTIVE COVERS SUCH AS MAT OR FIBER LINING (BURLAP, JUTE, FIBERGLASS NETTING, AND EXCELSIOR OR EQUAL PRODUCTS). THESE AND OTHER ACCEPTABLE MEASURES SHALL BE INCORPORATED INTO THE SITE WORK AS WARRANTED OR AS ORDERED BY THE ENGINEER. 6. CONSTRUCTION SITES ARE DYNAMIC, THE CONTRACTOR IS RESPONSIBLE FOR THE INSTALLATION AND OR MOVEMENT AND MAINTENANCE OF EROSION CONTROLS, SOIL STABILIZATION AND SEDIMENT CONTROL MEASURES AS NEEDED TO MAXIMIZE THE INTENT OF THE PLAN FOR ALL SITE CONDITIONS

7. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PERIODIC INSPECTION, MAINTENANCE, REPAIR, AND REPLACEMENT OF EROSION CONTROL DEVICES UNTIL AN ACCEPTABLE PERMANENT VEGETATIVE GROWTH IS ESTABLISHED. THE CONTRACTOR SHALL MAINTAIN A DETAIL LOG OF ALL EROSION CONTROL INSPECTIONS, COMPLAINTS RELATED TO EROSION OR SEDIMENT, AND CORRECTIVE REMEDIAL MEASURES TAKEN THROUGHOUT THE COURSE OF THE PROJECT CONSTRUCTION.

8. SOIL EROSION AND SEDIMENT CONTROL IS NOT LIMITED TO DAMAGES CAUSED BY WATER BUT ALSO INCLUDES EROSION AND SEDIMENT RESULTING FROM WINDS. MEASURES, SUCH AS TEMPORARY GROUND COVERS, WATER AND CALCIUM APPLICATIONS ARE TO BE UNDERTAKEN AS NEEDED TO MINIMIZE WIND RELATED SOIL AND DUST CONTROL.

9. STOCK PILES OF EARTH MATERIALS SHALL NOT BE LOCATED NEAR WATERWAYS OR WETLANDS. STOCK PILES SHALL BE SURROUNDED ON THE DOWN GRADIENT OF THE EXISTING GROUND SURFACE BY HAY BALES OR SILT FENCE. THE STOCK PILES SHALL ALSO BE SEEDED OR STABILIZED IN SOME MANOR TO PREVENT SOIL EROSION.

10. THE SMALLEST POSSIBLE SITE AREAS SHALL BE DISTURBED OR EXPOSED AT ONE TIME AND DENUDED SLOPES OR WORK AREAS SHALL NOT BE LEFT EXPOSED FOR EXCESSIVE PERIODS OF TIME, SUCH AS INACTIVE PERIODS OR SITE WORK SHUT DOWNS.

11. TO THE EXTENT POSSIBLE, ALL DISTURBED AREAS MUST BE SEEDED OR STABILIZED WITHIN THE CONSTRUCTION SEASON. STABILIZATION OF ONE FORM OR ANOTHER SHALL BE ACHIEVED WITHIN FIFTEEN (15) DAYS OF FINAL GRADING.

12. EXPOSED STEEP OR LONG SLOPES SHOULD BE TREATED WITH "CRIMPING" OR "TRACKING" TO REDUCE EROSION AND SEDIMENT AND TO TACK DOWN SEEDING OR MULCH APPLICATIONS.


13. IF CONCRETE IS TO BE USED ON SITE, THE CONTRACTOR MUST ESTABLISH AND MAINTAIN SPECIFIC WASHOUT AREAS FOR THE CONCRETE TRUCKS WITH APPROPRIATE PROTECTION CONTROLS.


14. THE CONTRACTOR IS RESPONSIBLE FOR PROVIDING AND MAINTAINING COLLECTION AND STORAGE LOCATIONS ON-SITE FOR ALL CONSTRUCTION DEBRIS AND TRASH SO THAT THIS MATERIAL DOES NOT BECOME A NEIGHBORHOOD NUISANCE.


15. EXISTING TREES AND VEGETATION WILL BE RETAINED WHENEVER FEASIBLE.

16. SITE SOIL EROSION AND SOIL STABILIZATION AND SEDIMENT CONTROLS MUST CONFORM TO ALL REQUIREMENTS OF THE APPLICABLE LOCAL COMMUNITY ORDINANCES AND STATE REGULATIONS.

STOCKPILE DETAIL NOT TO SCALE

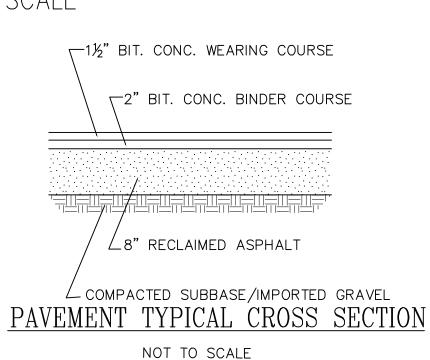



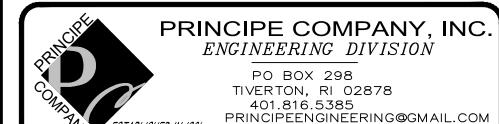


	REVIS	SIONS			
0.	DATE	DRWN	CHKD		
	12/08/21	KAB	TJP		
<u>2</u> .	12/29/21	KAB	TJP		
3.	01/11/22	KAB	TJP		
ŀ.	02/09/22	KAB	TJP		
<u>5</u> .	03/07/22	KAB	TJP		
				1	SC
					DF

MODIFICATION TO SPECIAL USE PERMIT & SITE PLAN APPROVAL BAY POINTE CLUB MIXED USE DEVELOPMENT PHASE IV

WAREHAM, MASSACHUSETTS

					_
	1	SCALE: AS NOTED		SHEET NO	: 12 OF 18
		DRAWN BY: TJP	DESIGN 1	BY: TJP	CHECKED BY: TJP
	l	DATE: 11/4/21		PROJECT	NO.: LD13-1 CEDA

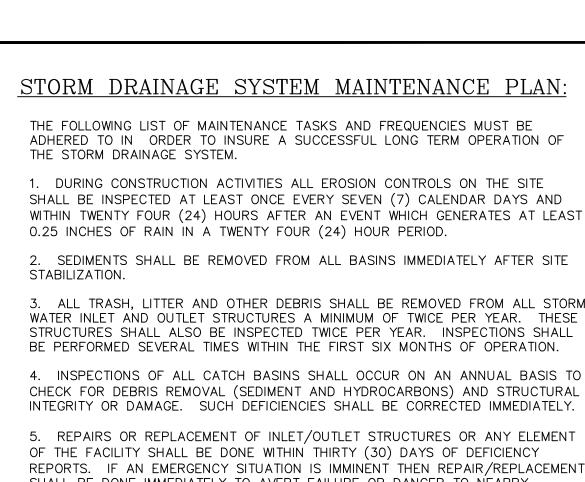

CHECK FOR DEBRIS REMOVAL (SEDIMENT AND HYDROCARBONS) AND STRUCTURAL INTEGRITY OR DAMAGE. SUCH DEFICIENCIES SHALL BE CORRECTED IMMEDIATELY. 5. REPAIRS OR REPLACEMENT OF INLET/OUTLET STRUCTURES OR ANY ELEMENT OF THE FACILITY SHALL BE DONE WITHIN THIRTY (30) DAYS OF DEFICIENCY

REPORTS. IF AN EMERGENCY SITUATION IS IMMINENT THEN REPAIR/REPLACEMENT SHALL BE DONE IMMEDIATELY TO AVERT FAILURE OR DANGER TO NEARBY

6. MAKE REPAIRS IMMEDIATELY USING APPROPRIATE STONE SIZES. DO NOT PLACE STONES ABOVE FINISHED GRADE.

7. ALL REMOVED SEDIMENTS AND DEBRIS SHALL BE DISPOSED OF OFF SITE IN ACCORDANCE WITH STATE AND LOCAL REGULATIONS.

8. ALL OUTLET STRUCTURES AND OUTFLOW CHANNELS WILL BE INSPECTED ANNUALLY. INSPECTIONS WILL BE ACCOMPLISHED SEVERAL TIMES DURING THE FIRST SIX MONTHS OF OPERATION, ESPECIALLY AFTER RAINFALL EVENTS TO CHECK FOR CLOGGING OR, CONVERSELY, TOO RAPID OF A RELEASE.

REPAIRS OR REPLACEMENT OF INLET/OUTLET STRUCTURES, RIP-RAP CHANNELS, FENCES, OR OTHER ELEMENTS OF THE FACILITY WILL BE DONE WITHIN 30 DAYS OF DEFICIENCY REPORTS. IF AN EMERGENCY SITUATION IS IMMINENT THEN REPAIR/REPLACEMENT MUST BE DONE IMMEDIATELY TO AVERT FAILURE OR DANGER TO NEARBY RESIDENTS.

10. ALL SEDIMENT GENERATED DURING CONSTRUCTION AND AS A RESULT OF MAINTENANCE OF THE DRAINAGE SYSTEM MUST BE DISPOSED OF PROPERLY. SEDIMENT SHALL NOT BE DISPOSED OF IN OR NEAR STATE OR FEDERAL REGULATED WATERS.

11. ADDITIONAL BMP INSPECTION/MAINTENANCE MEASURES OUTLINED WITHIN THE PROJECT STORMWATER POLUTION PREVENTION PLAN SHALL BE ADHERED TO.

DRAINAGE AND UTILITY NOTES:

1. UTILITY LOCATION VERIFICATION IS TO INCLUDE TEST HOLES AS NEEDED.


2. WATER MAINS AND APPURTENANCES, INCLUDING SERVICE CONNECTIONS SHALL BE INSTALLED IN CONFORMITY WITH THE SPECIFICATIONS OF THE ONSET WATER DEPARTMENT AND IN ACCORDANCE WITH THE TOWN'S MASTER OR STUDY WATER PLAN.


3. THE CONTRACTOR IS REQUIRED TO SCHEDULE AND COORDINATE WATER SERVICE INSTALLATIONS, SHUT DOWNS AND DISRUPTIONS WHICH AFFECT THE SITE AND SITE ADJACENT USERS WITH THE LOCAL WATER AUTHORITY AND THE LOCAL FIRE DEPARTMENT.


4. UNDERGROUND UTILITIES, ELECTRIC, TELEPHONE, FIRE ALARM CABLE, TELEVISION AND GAS SERVICES SHALL BE INSTALLED PER THE REQUIREMENTS OF THE APPLICABLE SITE UTILITY PROVIDER

5. METALLIC WARNING TAPE SHALL BE INSTALLED 12" ABOVE ALL STORM DRAIN AND OTHER UTILITIES.


6. IT SHALL BE THE CONTRACTOR'S SOLE RESPONSIBILITY TO MAINTAIN THE INTEGRITY OF ALL EXISTING UTILITIES, STRUCTURES AND ABUTTING PROPERTIES. THE COST OF ANY REPAIR OR REPLACEMENT OF DAMAGED ITEMS SHALL BE BORNE BY THE CONTRACTOR.

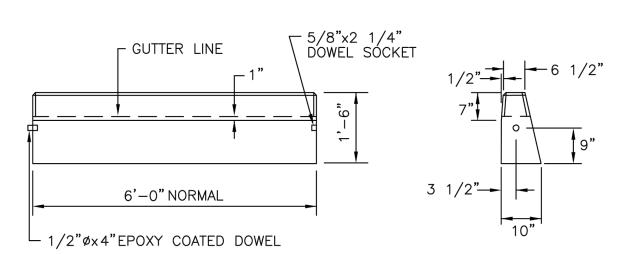





CIRCULAR CURB

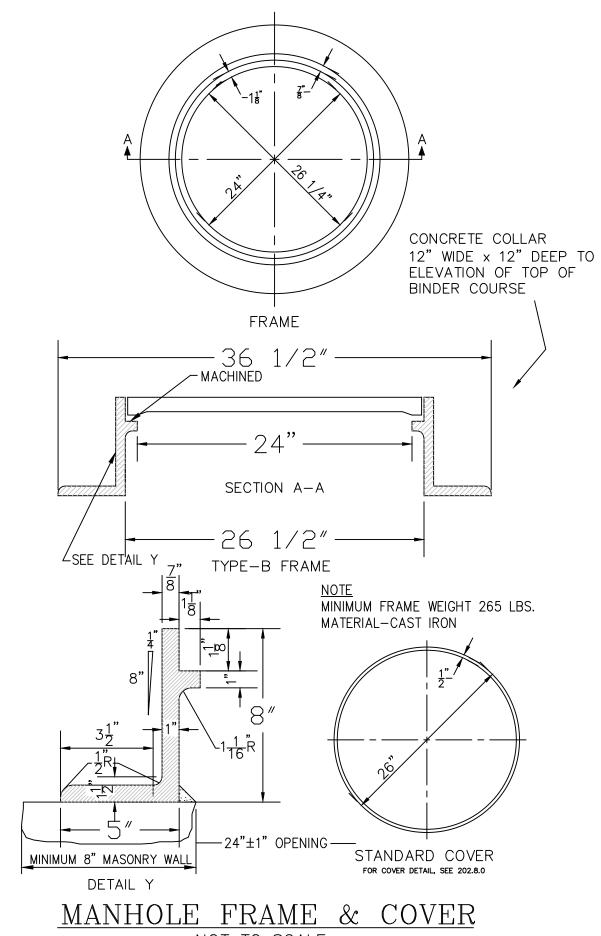


NOT TO SCALE NOTE: DRAIN MANHOLE COVERS SHALL HAVE THE

WORD "DRAIN" CAST INTO THEM WITH THREE INCH LETTERING

(2) #4 REBAR

18" LONG

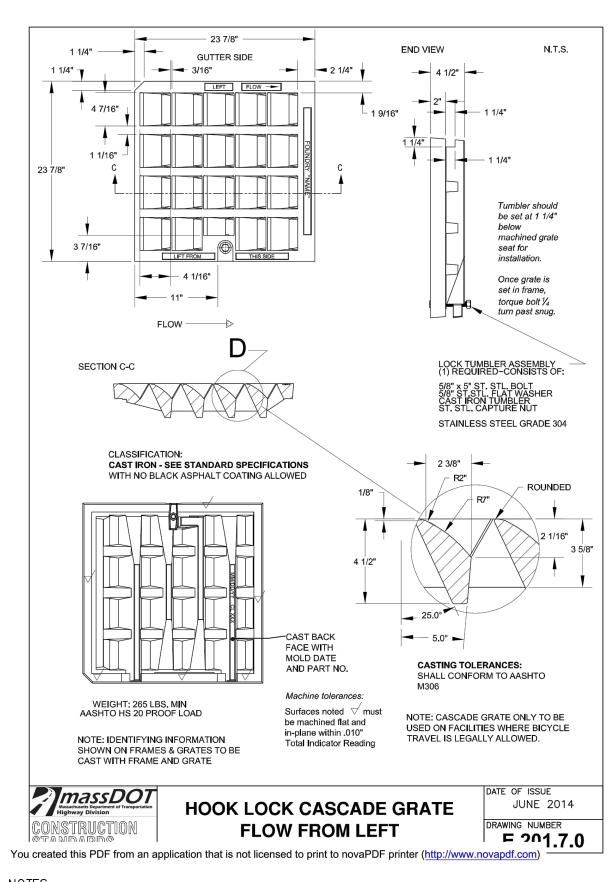

1. THE MASSACHUSETTS STANDARD FRAME IS TO BE USED, DETAILS AND DIMENSIONS NOT SHOWN ABOVE ARE TO BE THE SAME AS THOSE SHOWN ON CONSTRUCTION

STANDARD 201.6.0. A (3)THREE FLANGE FRAME IS TO BE USED WHEN A CURB INLET IS REQUIRED. 3. GRATE DETAILS ARE SHOWN ON CONSTRUCTION STANDARD 201.7.0.

4. THE GRATE AS PLACED ABOVE IS FOR WATER COMING FROM THE RIGHT. TURN THE GRATE 180° FOR A WATER FLOW FROM THE LEFT. SEE NOTE No. 2 ON CONSTRUCTION STANDARD 201.7.0.

(TO BE USED AT ALL CATCH BASINS) 5. THE GRATE IS ONLY SHOWN SCHEMATICALLY.

(2) 1" DIA. HOLES


NOTE: CURB STOP TO BE OFFSET TWO FEET (2') FROM PROPOSED CONCRETE CURBING/SIDEWALK

THROUGH

FRAME FOR MASSACHUSETTS <u>CASCADE GRATE</u> NOT TO SCALE


> GRAVEL — CORE (MIN.) NON-WOVEN -FILTER FABRIC R-3 RIP-RAP-(6"ø MIN.)

INFILTRATION BASIN SEDIMENT FOREBAY BARRIER DETAIL NOT TO SCALE

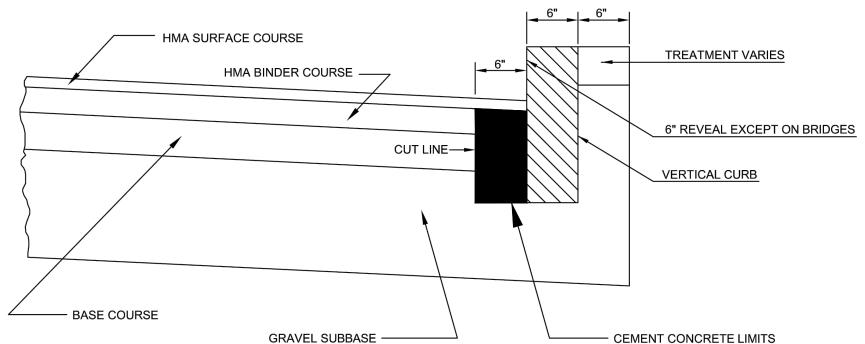

NOT TO SCALE

TYPICAL CONCRETE CURB STOP DETAIL

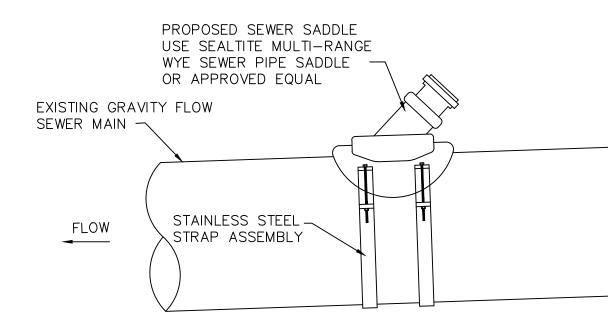

SEWER PIPE SADDLE DETAIL

6" REVEAL PAVEMENT-F"CEMENT CONCRETE SIDEWALK -8" GRAVEL BORROW CEMENT CONCRETE SIDEWALK NOT TO SCALE NOTES:

PAVEMENT SECTION (SEE TYPICAL CROSS SECTION)

HANCOR HDPE -

HAUNCHING/INITIAL

BACKFILL: CLASS

INSTALLED PER

PIPE DIAMETER

IN. (MM)

- 8 (100-200)

10 (250)

12 (300)

15 (375)

18 (450)

SIDE VIEW

ASTM D2321

I, II, III

BACKFILL

MATERIAL

PIPE

METALLIC

WARNING TAPE

NOTE: METALLIC WARNING TAPE SHALL BE INSTALLED 4-6" ABOVE ALL STORM DRAIN LINES.

RECOMMENDED MINIMUM TRENCH WIDTH

* USUALLY BASED ON SMALLEST BUCKET SIZE AVAILABLE

PIPE DIAMETER

IN. (MM)

30 (750)

42 (1050)

48 (1200)

54 (1350)

60 (1500)

PIPE DIAMETER (INCHES)

DIAMETER | 10/12 | 15 | 18 | 24 | 30 | 36

A 42 41 49 59.5 88 88

B 14.5 19 22 28 36 43 C 33 34 43 48 63.5 66.5
D 6 6 6 6 6 6

FRONT VIEW

REFERENCE ASTM D2321, "STANDARD PRACTICE FOR UNDERGROUND INSTALLATION

OF THERMOPLASTIC PIPE FOR SEWERS AND OTHER GRAVITY-FLOW APPLICATIONS."

HDPE TRENCH INSTALLATION DETAIL

NOT TO SCALE

TRENCH WIDTH

IN. (M)

24 (0.6)

28 (0.7)

35 (0.9)

43 (1.1)

56 (1.4)

HDPE PIPE END FLARED END SECTION

NOT TO SCALE

- 1. CONCRETE SCORING PATTERN TO BE APPROVED BY OWNER.
- 2. UNLESS SPECIFIED ON PROJECT DRAWINGS, CONTROL JOINTS SHALL
- 3. UNLESS SPECIFIED OTHERWISE, ISOLATION JOINTS SHALL OCCUR AT THE FOLLOWING LOCATIONS:


OCCUR AT THE SAME DIMENSION AS THE SIDEWALK WIDTH.

 BETWEEN CURB AND WALK INTERSECTION OF WALKS


CONCRETE CURB-


- BETWEEN WALK AND BUILDING WALLS
- BETWEEN WALK AND ALL STRUCTURES, I.E., WALLS AND PLANTERS - ON CONTINUOUS WALKS, ISOLATION JOINTS SHALL BE AT A
- MAXIMUM OF (30') THIRTY FEET APART.
- 4. CONCRETE WALKS AND DRIVEWAYS SHALL BE ACCORDANCE WITH SECTION MASSDOT SPECIFICATIONS.
- 5. CONCRETE SHALL BE 5% AIR ENTRAINED, 4000 PSI WITH 3/4" STONE.


6. SAME REQUIREMENT WITHOUT CURB

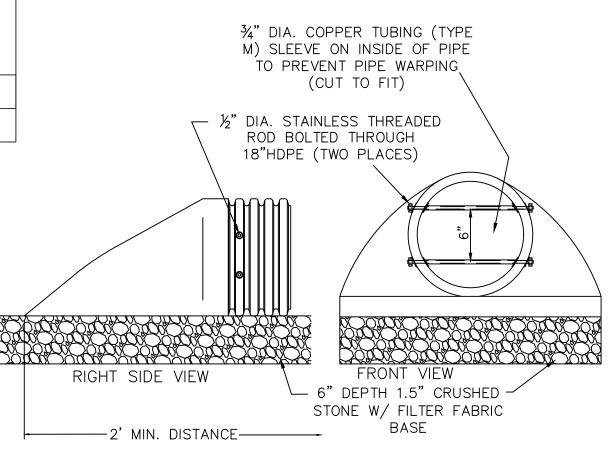

TRASH RACK DETAIL FOR HDPE FLARED END SECTION

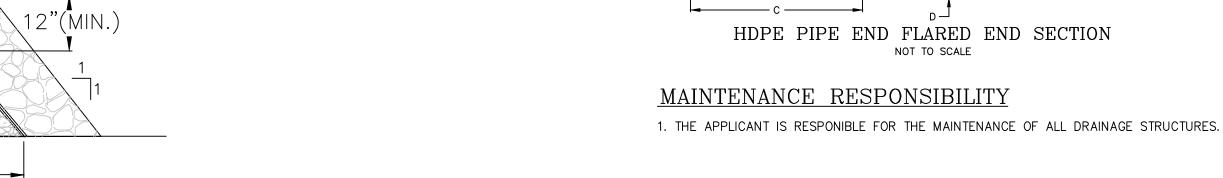

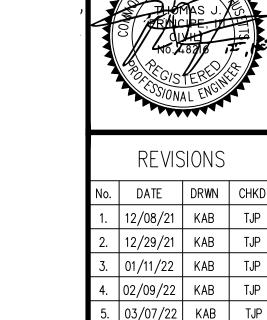



PO BOX 298 TIVERTON, RI 02878 401.816.5385 PRINCIPEENGINEERING@GMAIL.COM

PERVIOUS SECTION

MAINTAIN UNIFORM

MIN. 12" ABOVE

---MINIMUM BEDDING

TRENCH WIDTH

IN. (M)

60 (1.5)

65 (1.7)

84 (2.1)

91 (2.3)

97 (2.5)

103 (2.6)

THICKNESS 4"-6"

TOP OF PIPE

TRENCH WIDTH TO


MODIFICATION TO SPECIAL USE PERMIT & SITE PLAN APPROVAL BAY POINTE CLUB MIXED USE DEVELOPMENT PHASE IV


WAREHAM, MASSACHUSETTS


SHEET NO: 13 OF 18 SCALE: AS NOTED DESIGN BY: TJP CHECKED BY: TJP DRAWN BY: TJP PROJECT NO.: LD13-1 CEDA DATE: 11/4/21


TYPICAL CONCRETE CURB DETAILS NOT TO SCALE

NOT TO SCALE SHOP DRAWING SUBMITTAL REQUIRED

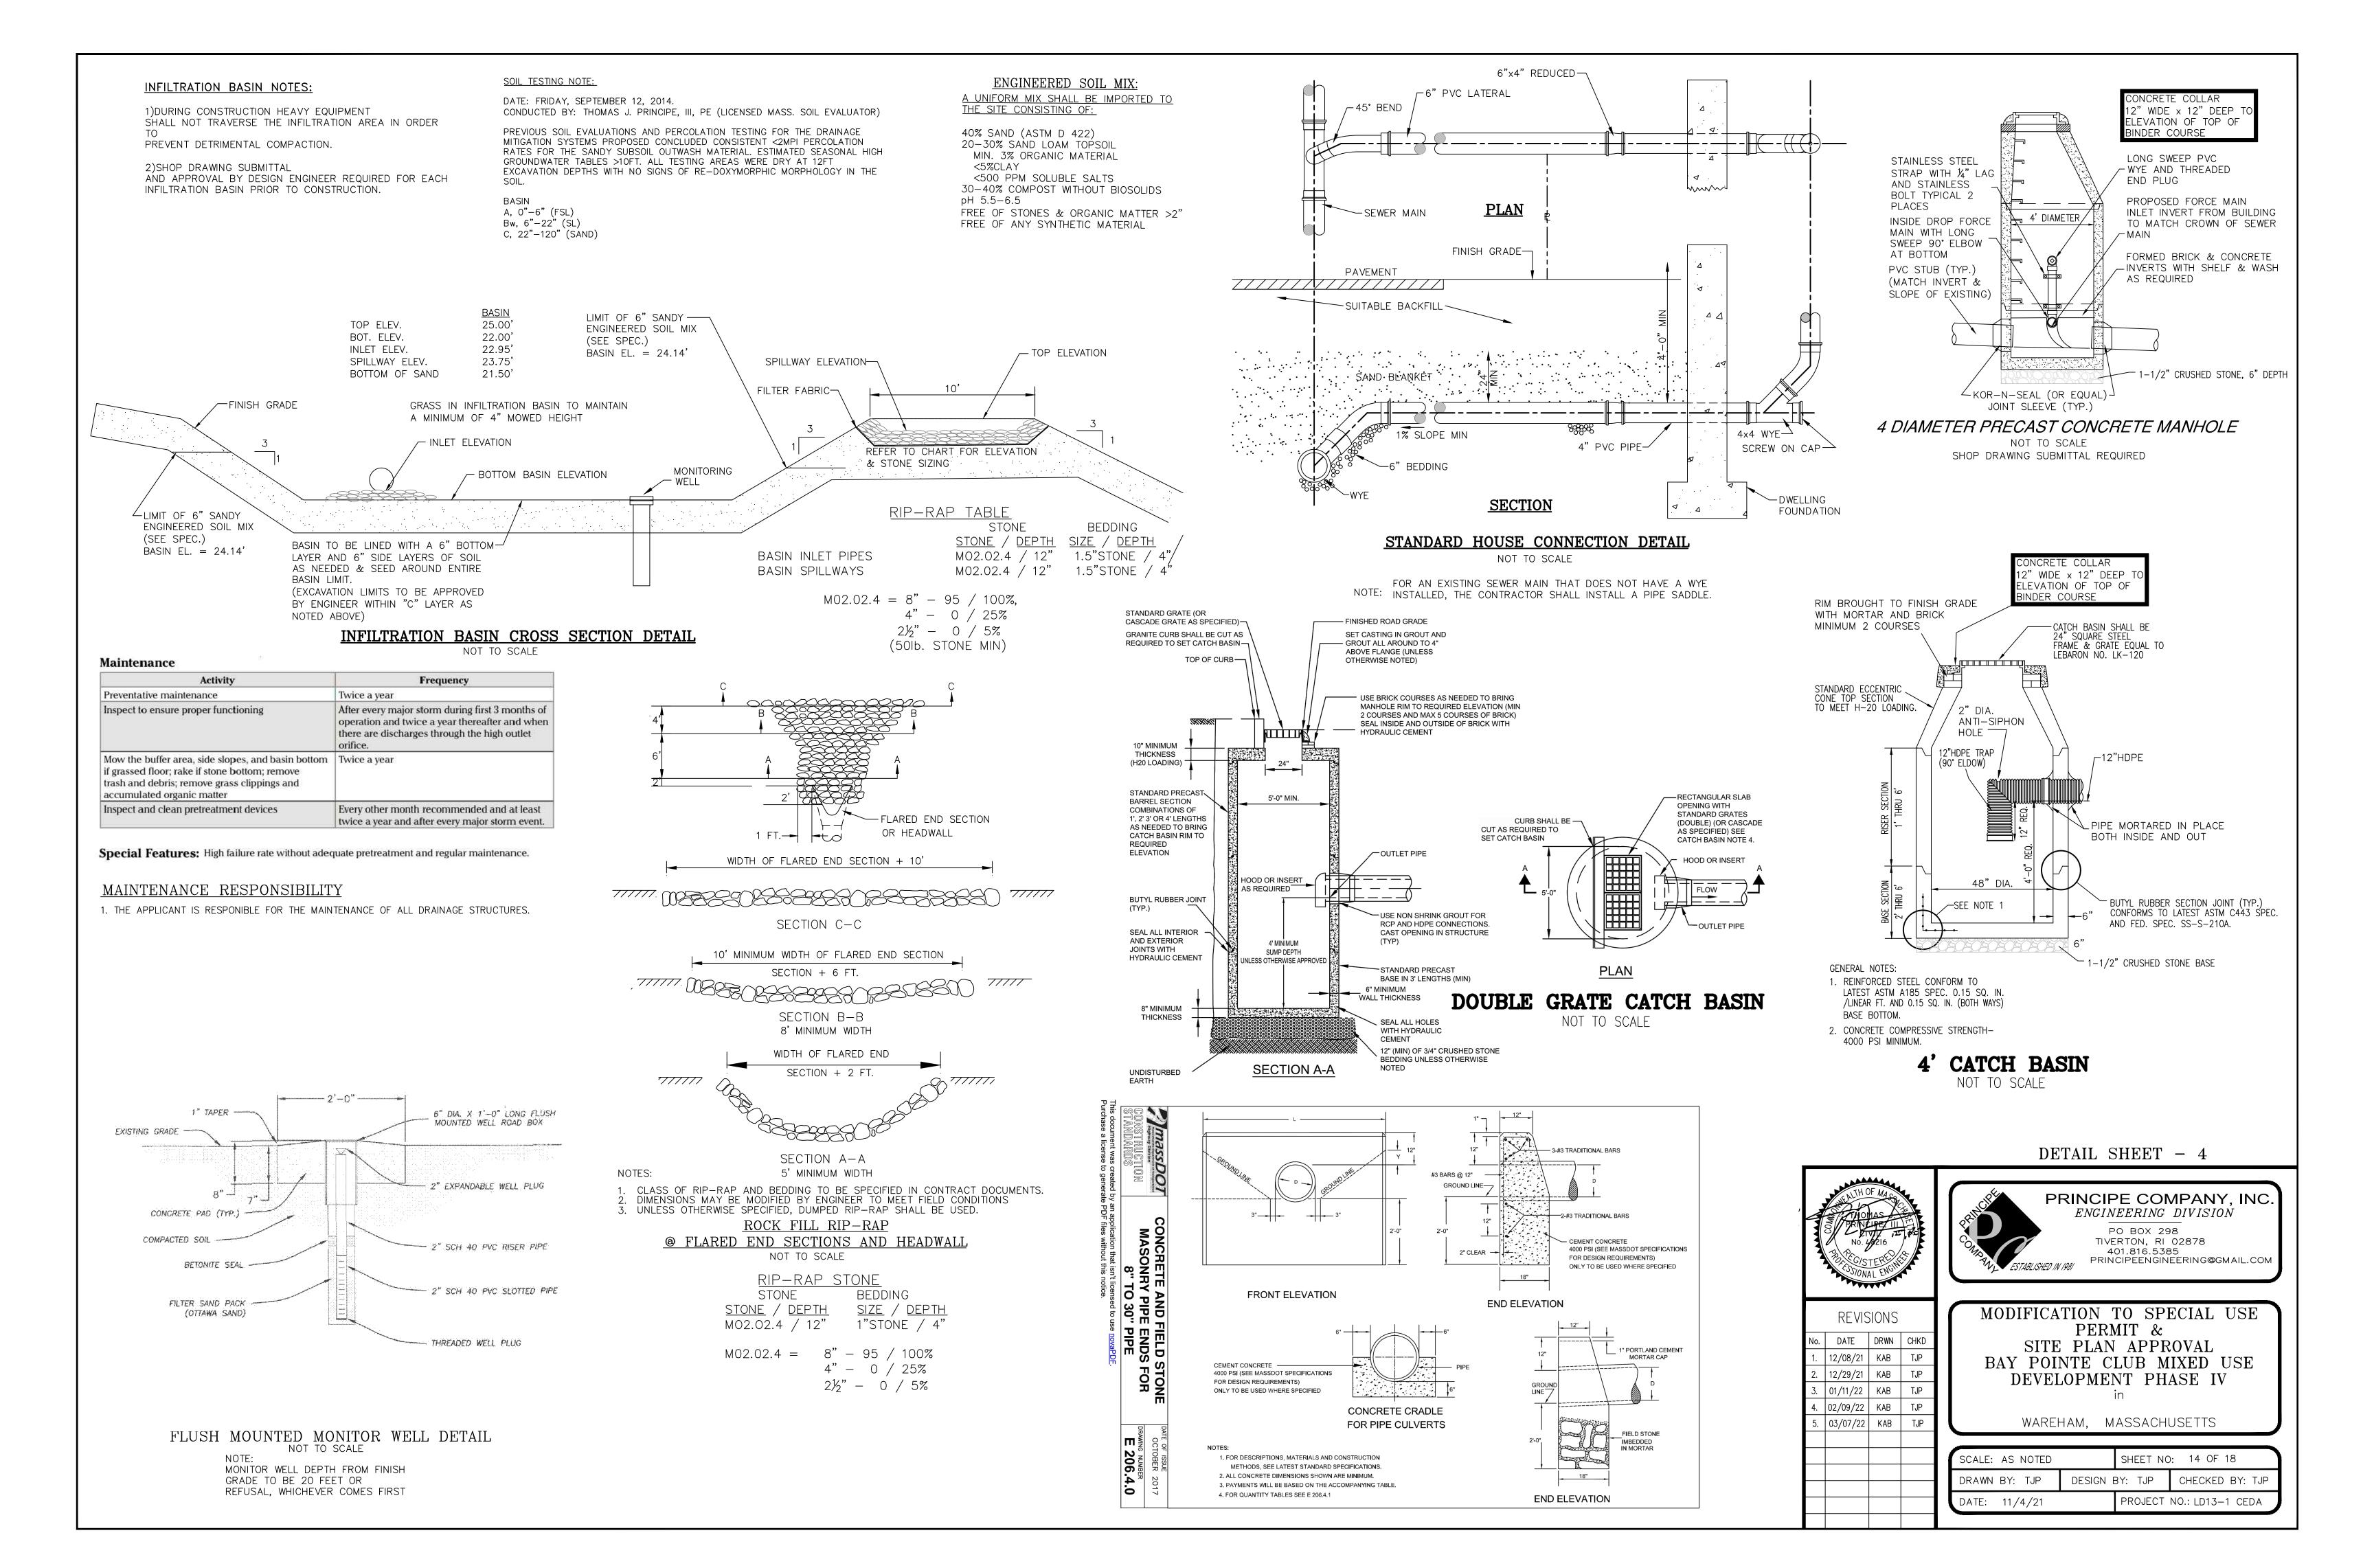

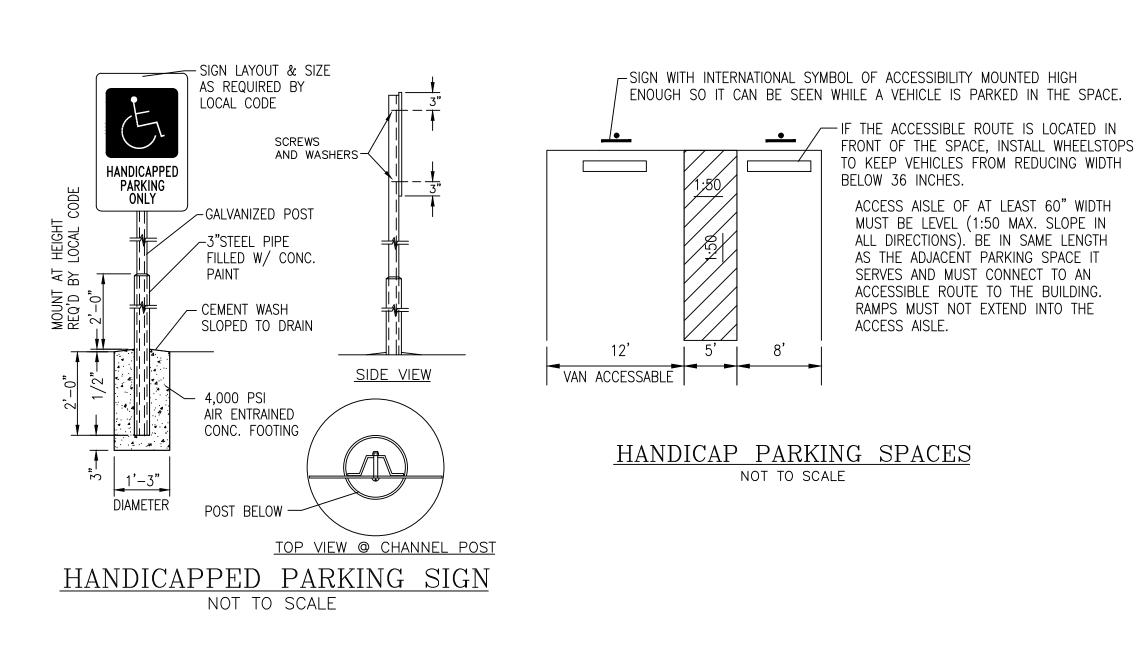

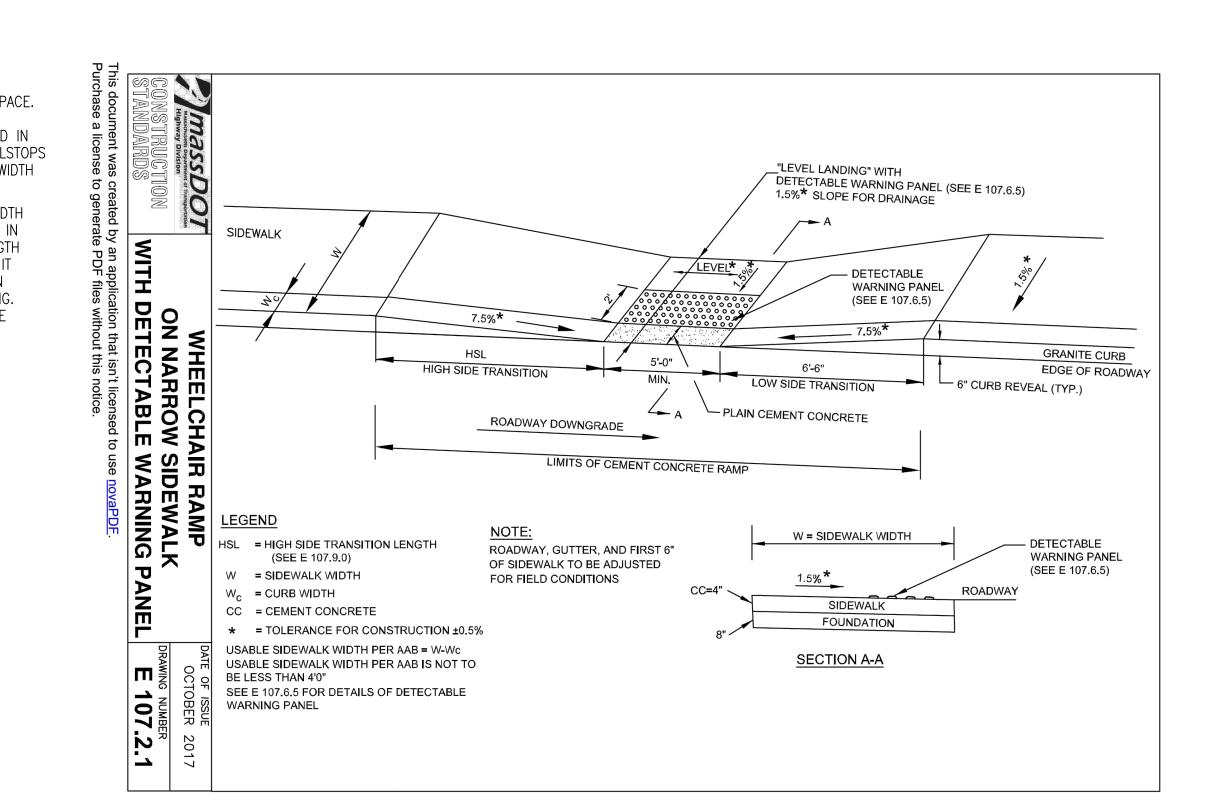

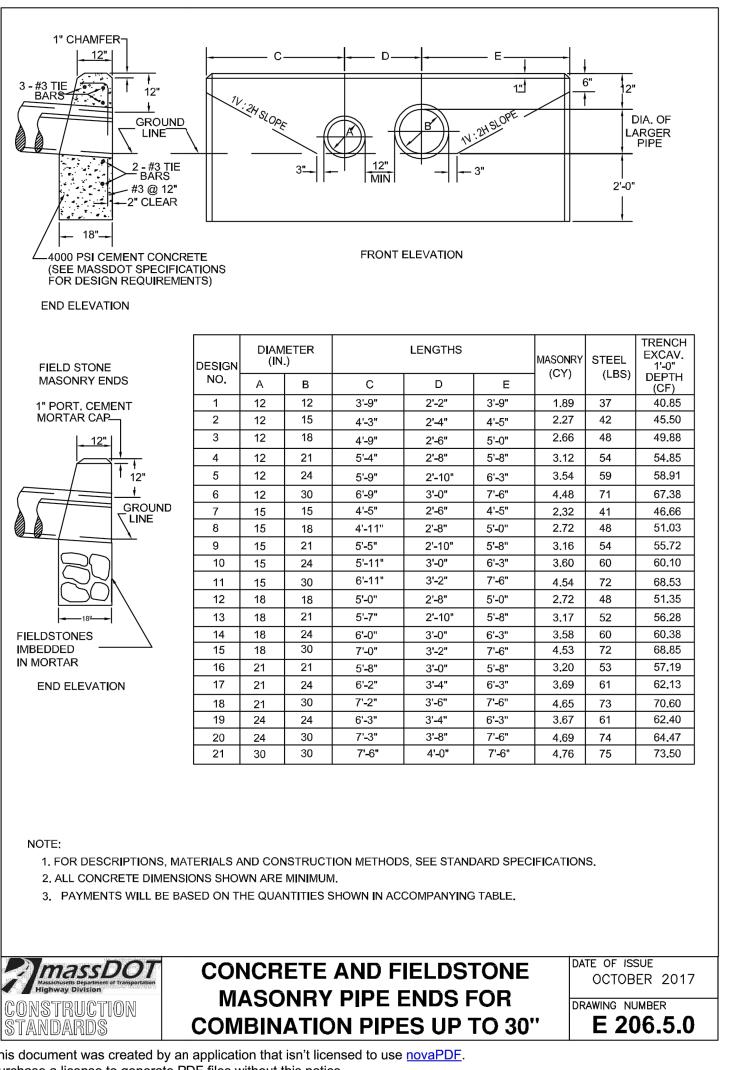


This document was created by an application that isn't licensed to use <u>novaPDF</u>.

Purchase a license to generate PDF files without this notice.



PROJECT NO.: LD13-1 CEDA

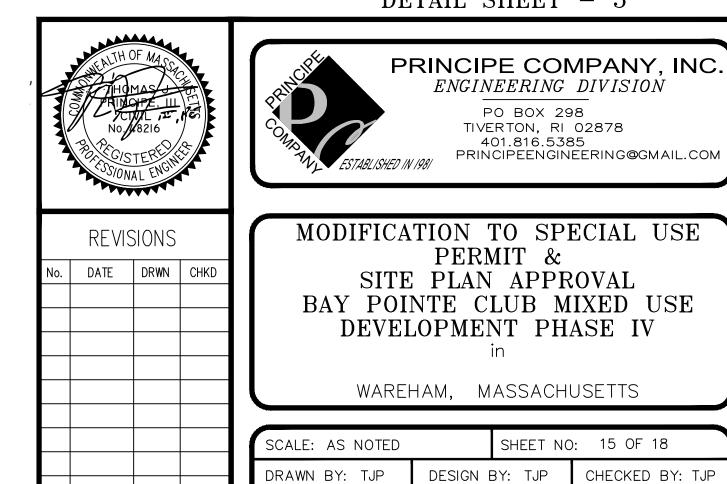

DATE: 11/4/21


SYMBOL	QTY.	BOTANICAL NAME	COMMON NAME	SIZE	ROOT	REMARKS
 Ala	7	Amelanchier laevis	Alleghany shadblow	5-6' clump	B&B	SPECIMEN
AmL	30	Aronia melanocarpa Lowscape	Lowscape black chokeberry	#3	CAN	
As	30	Asarum splendens	Splendens ginger	#1	CAN	
Ana	18	Aster novae—angliae	New England aster	#1	CAN	
Аср	45	Astilbe chinensis pumila	False spiraea	#1	CAN	
Azm	40	Azalea ReBloom Marie Hoffman	Marie Hoffman azalea	#2	CAN	
BnH	14	Betula nigra Cully	Heritage river birch	7-8' clump	B&B	SPECIMEN
BuJ	6	Betula utilis Jacquemontii	Himalayan birch	8-10'	B&B	SPECIMEN
Bsf	28	Buxus sempervirens fastigiata	Upright common boxwood	2.5-3'	B&B	
CKF	135	Calamagrostis Karl Foerster	Karl Foerster feather reed grass	#2	CAN	
Cv	16	Coreopsis verticillata Zagreb	Zagreb tickseed	#1	CAN	
Cav	12	Cornus alba variegata	Variegated redtwig dogwood	#5	CAN	
CGP	30	Cryptomeria japonica Golden Promise	Golden Promise cryptomeria	#3	CAN	
DF	36	Dianthus Firewitch	Firewitch pink	#1	CAN	
EBK	12	Echinacea Butterfly Kisses	Butterfly Kisses coneflower	#1	CAN	
Go	24	Galium odoratum	Sweet woodruff	#1	CAN	
 Не	52	Hemerocallis Stella D'Oro	Stella D'Oro daylily	#1	CAN	
HES	24	Hydrangea macro. Endless Summer	Endless Summer hydrangea	#2	CAN	
Hq	12	Hydrangea quercifolia PeeWee	PeeWee oakleaf hydrangea	#2	CAN	
 IgS	65	llex glabra Shamrock	Shamrock inkberry	2.5-3'	B&B	
 Iv	11	llex verticillata	Winterberry	#3	CAN	
ICW	12	llex x. meserveae Castle Wall	Castle Wall holly	#3	CAN	
ILH	12	Itea virginca Little Henry	Little Henry sweetspire	#3	CAN	
Jv	46	Juniperus virginiana Emerald Sentinel	Emerald Sentinel red cedar	6-7'	B&B	
KI	6	Kalmia latifolia Minuet	Minuet mountain laurel	#3	CAN	
LV	3	Laburnum x. watereri Vossi	Vossi hybrid goldenchain tree	#25	CAN	SPECIMEI
LS	9	Lavandula Sensational	Sensational lavender	#1	CAN	
LSS	17	Liquidambar styraciflua Slender Silhouette	Slender Silhouette sweetgum	2-2.5" cal.	B&B	SPECIMEI
MsA	5	Magnolia x. soulangeana Alexandrina	Alexandrina magnolia	7-8' clump	B&B	SPECIMEI
Мс	9	Muhlenbergia capillaris	Pink hair grass	#1	CAN	
Мр	20	Myrica pensylvanica	Bayberry	2.5-3'	B&B	
<u> </u>	500	Narcissus	Daffodils		bulb	
Ns	4	Nyssa sylvatica	Tupelo	7-8'	B&B	SPECIME
PCL	16	Paeonia Itoh Cora Louise	Cora Louise Itoh peony	#2	CAN	
PMF	12	Pieris Mountain Fire	Mountain Fire andromeda	#3	CAN	
Pmp	16	Pinus mugo pumilio	Dwarf mugo pine	#3	CAN	
 	53	Polystichum acrostichioides	Christmas fern	#1	CAN	
Pf	24	Potentillla fruiticosa Goldfinger	Goldfinger potentilla	#2	CAN	
Qr	10	Quercus rubra	Red oak	2.5-3" cal.	B&B	5' STD.
RPW	9	Rhododendron Percy Wiseman	Percy Wiseman rhododendron	#3	CAN	
RKS	9	Rosa Knockout Sunny	Sunny Knockout rose	#3	CAN	
ShS	30	Sarcococca humilis Sarsid1	Fragrant Valley sweet box	#3	CAN	
SIS	15	Syringa reticulata Ivory Silk	Ivory Silk tree lilac	$\frac{\pi^{\circ}}{2.5-3}$ " cal.	B&B	5' STD.
Sj	7	Styphnolobium japonicum Regent	Regent scholar tree	2.5-3" cal.	B&B	5' STD.
 Тр	65	Thuja plicata Green Giant	Green Giant arbor-vitae	7-8'	B&B	
 Тс	15	Tiarella cordifolia	Foamflower	#1	CAN	
Vt	34	Viburnum trilobum	Highbush cranberry	#7	CAN	
 Wf∨	8	Weigela florida Variegatum	Variegated weigela	#3	CAN	
TT 1 V		Zelkova serrata Green Vase	Green Vase zelkova	# 5	LOAN	5' STD.


***Narcissus to be planted randomly in all plant beds.


LANDSCAPE NOTES:


- 1) ALL PLANT MATERIAL TO CONFORM TO AAN/ANSI STANDARDS.
- 2) ALL PLANT MATERIAL TO RECEIVE THREE INCHES OF SHREDDED PINE BARK MULCH, EXCEPT FOR THOSE PLANT MATERIALS WITHIN THE AREAS TO BE GRAVEL MULCHED.
- 3) GRAVEL MULCH AREAS TO RECEIVE THREE INCHES OF 3/8" INCH CRUSHED STONE,
- TAN IN COLOR. COLOR SAMPLE TO BE APPROVED BY LANDSCAPE ARCHITECT.
- 4) ALL PLANT MATERIAL TO BE GUARANTEED TO SURVIVE AT LEAST ONE GROWING SEASON,
- OR THEY SHALL BE REPLACED AT THE LANDSCAPE CONTRACTOR'S EXPENSE. 5) ALL PLANT MATERIAL SUBJECT TO VERIFICATION AS TO LOCATION AND SPECIES.
- 6) THERE WILL BE NO PLANT MATERIAL SUBSTITUTIONS WITHOUT THE WRITTEN CONSENT
- OF THE LANDSCAPE ARCHITECT.
- 7) DISTURBED SOILS WITHIN THE PROJECT LIMITS ARE TO BE LOAMED AND SEEDED WITH APPLICABLE MIXTURE. 8) PROPOSED LANDSCAPE STONES/BOULDERS ARE TO BE NATURALLY—COLORED, BURIED AT
- LEAST ONE-THIRD OF THEIR OVERALL HEIGHT AND APPROVED IN PLACE BY THE LANDSCAPE ARCHITECT.

- SHRUB PER PLAN -REMOVE ALL DEADWOOD (DO NOT REMOVE ANY OTHER VEGETATION) — 3" MULCH - MOUND WITH BACKFILL EXCAVATED SOIL COMPACTED TO 85%-TO 3" ABOVE FINISH GRADE PLANT SHRUB AT -DEPTH EQUAL TO GENTLY HAND 2" LESS THAN THE LOOSEN SOIL FROM DISTANCE FROM AROUND ROOTBALL BOTTOM OF WITHOUT SEVERING ROOTBALL TO MAIN ROOTS ROOT COLLAR 2 x ROOTBALL DIAMETER (MIN.) SPREAD ROOTS OVER UNDISTURBED SUBGRADE CONTAINER GROWN SHRUB DETAIL

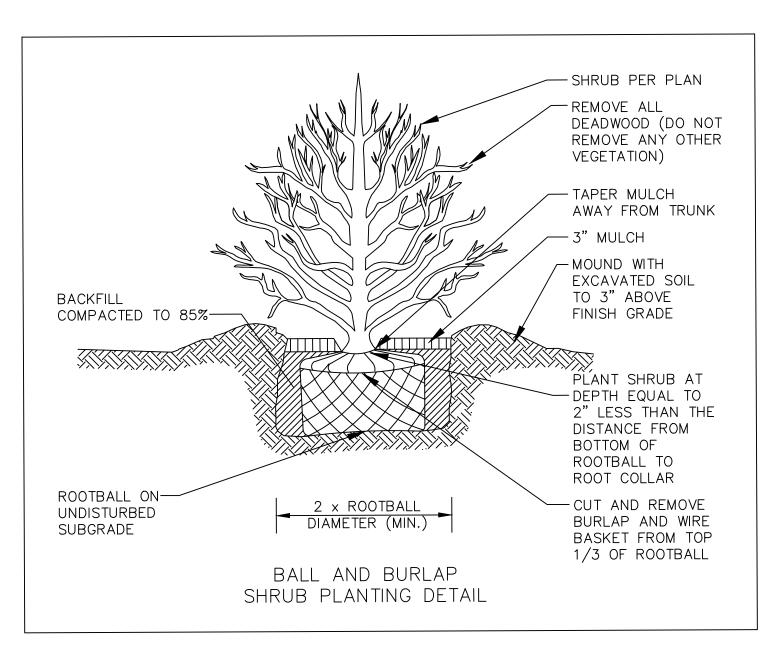

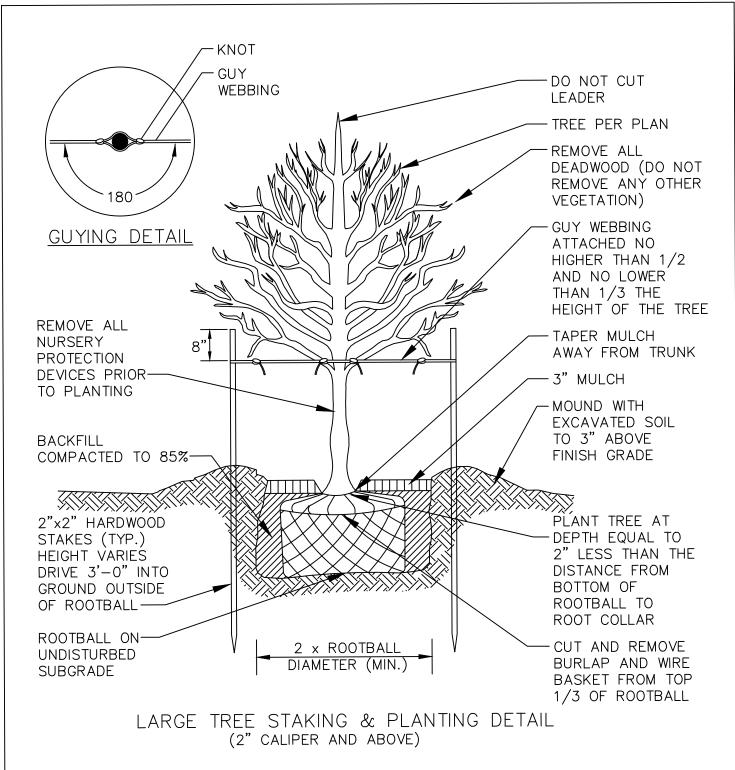


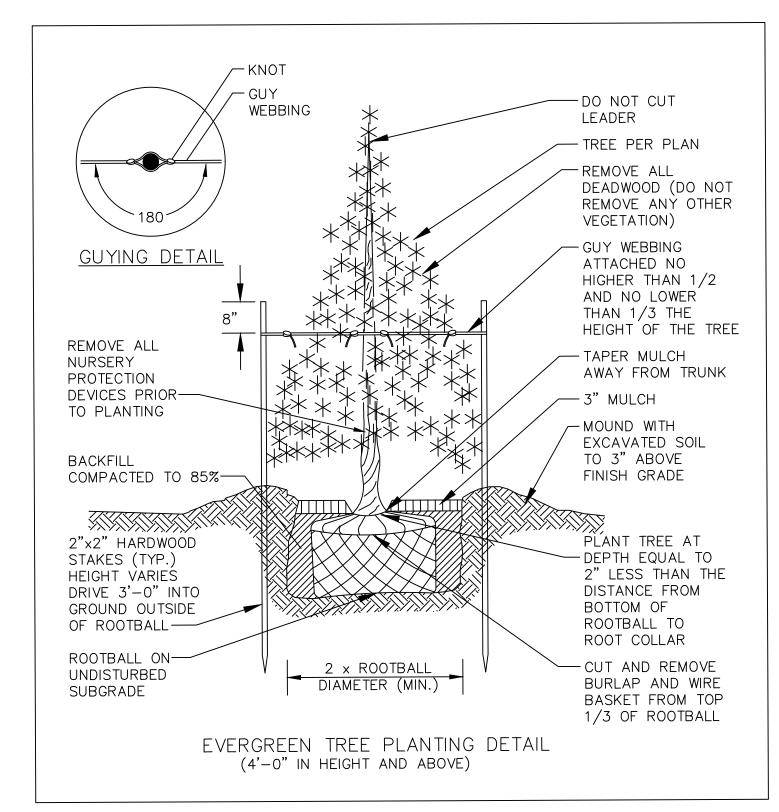


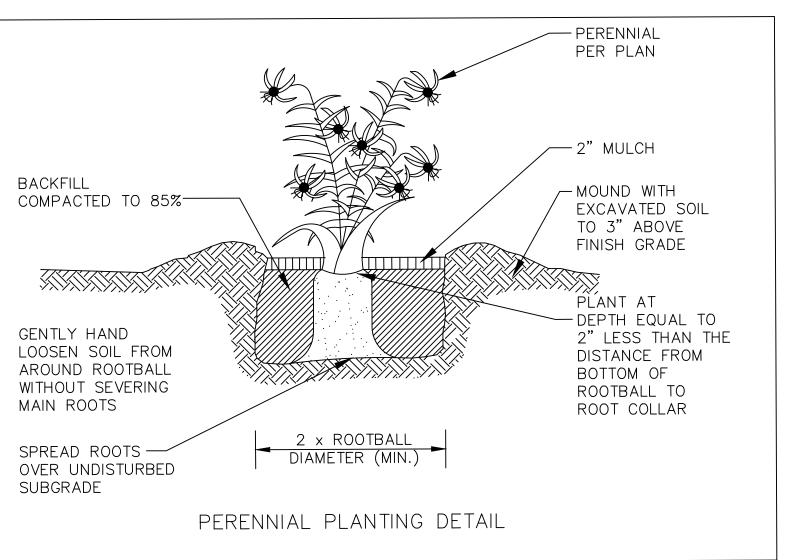


LANDSCAPE DETAILS



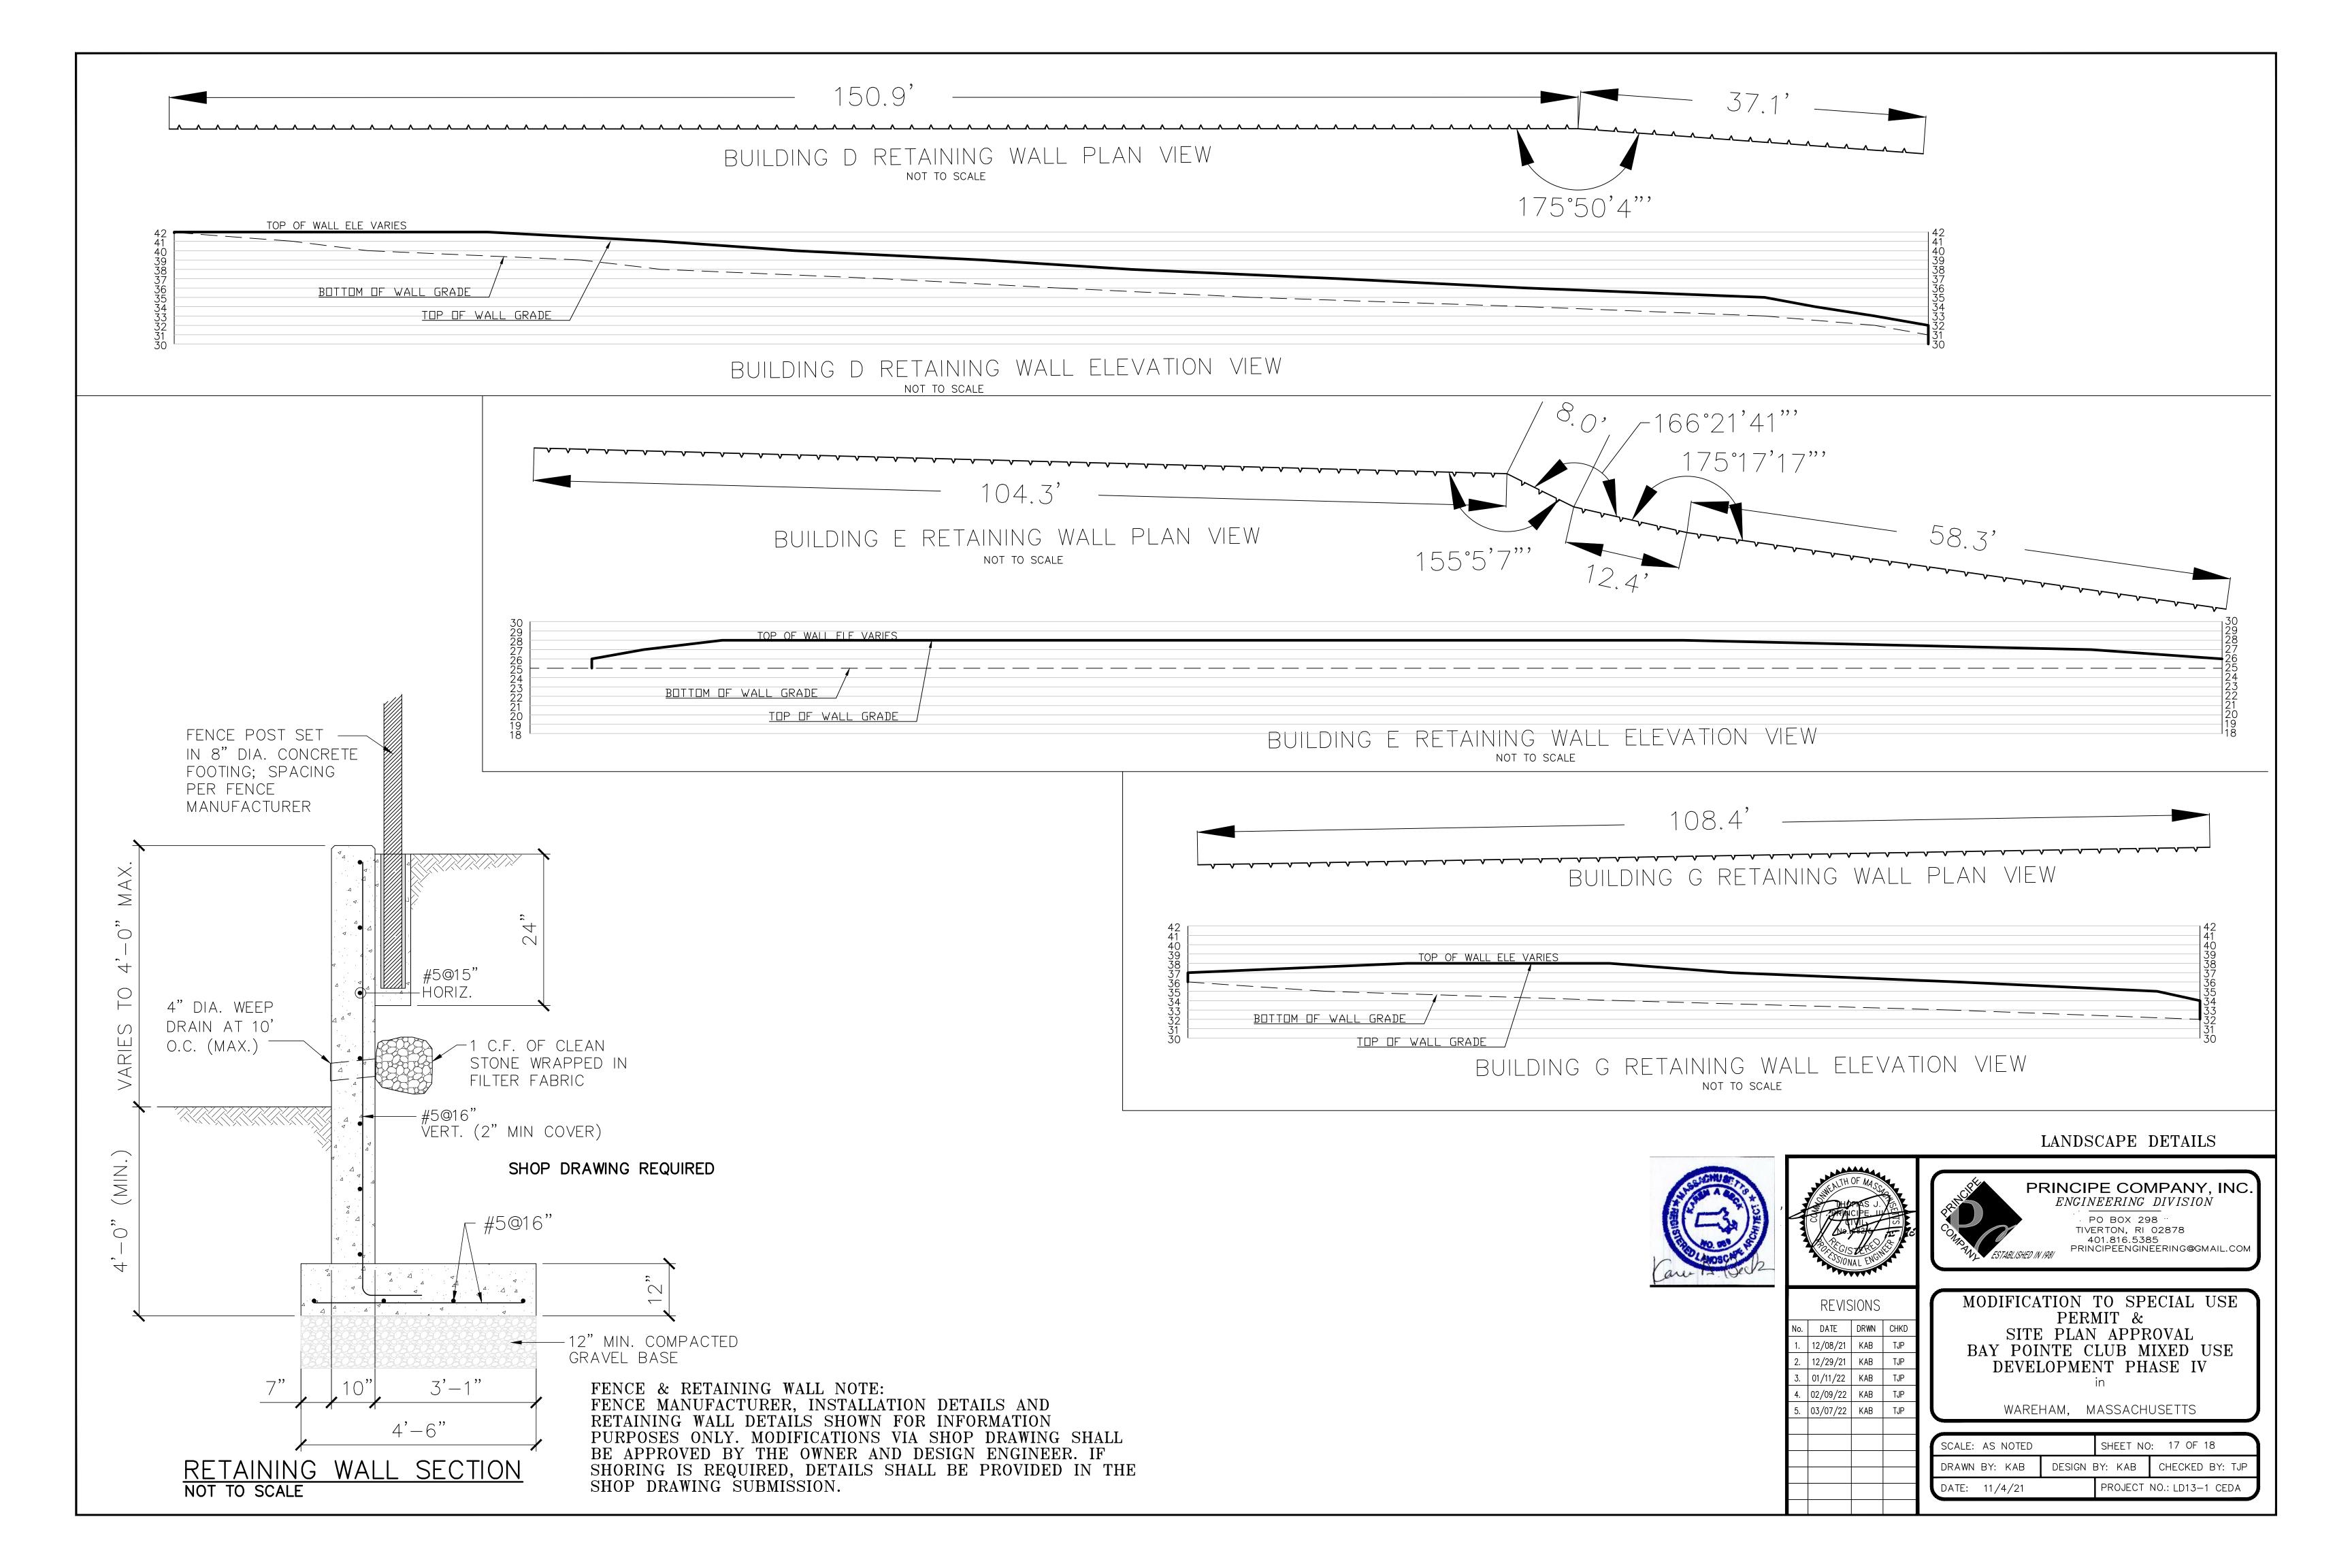


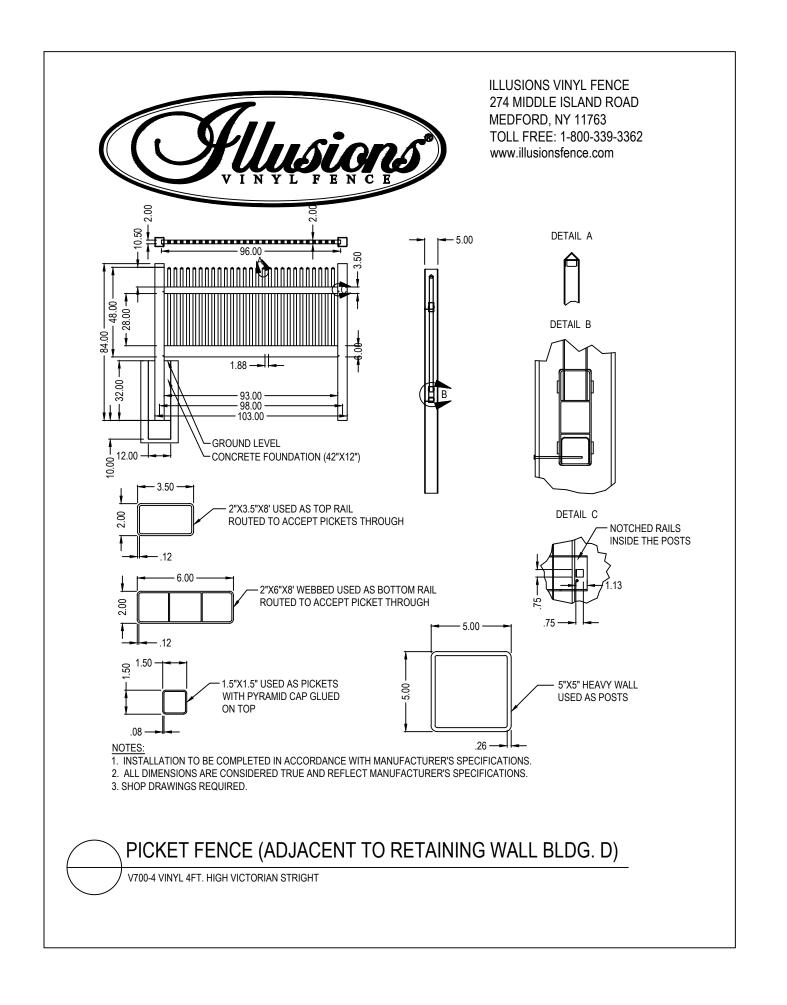

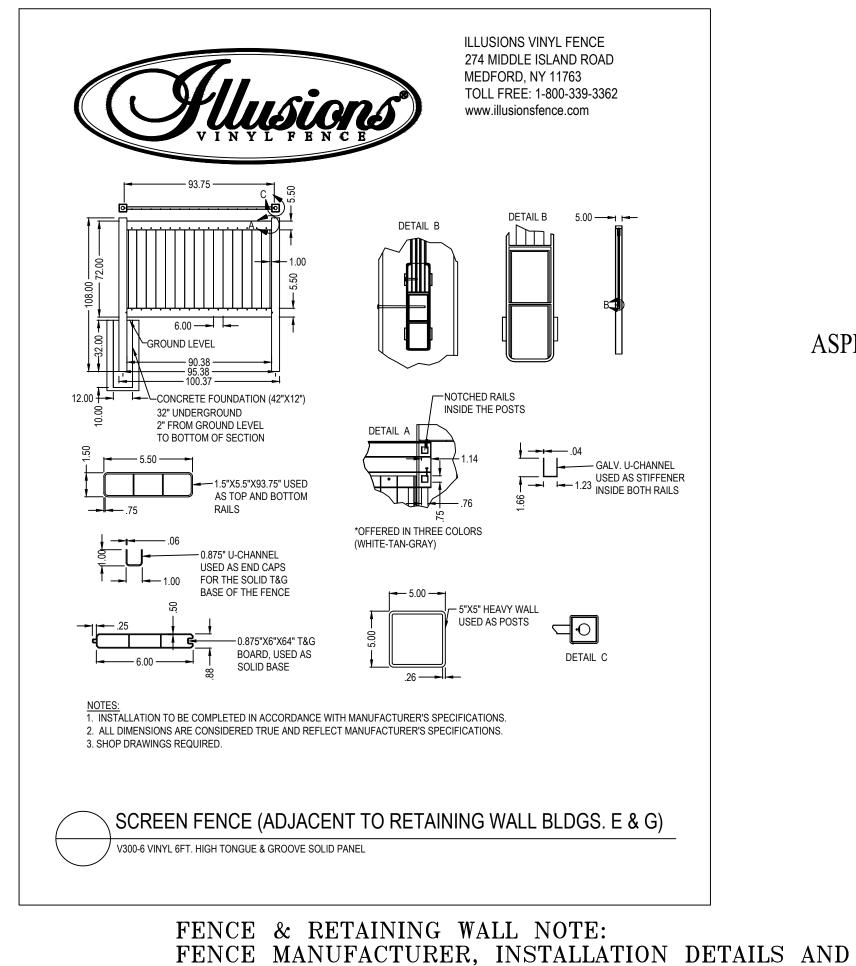

RETAINING WALL DETAILS SHOWN FOR INFORMATION

PURPOSES ONLY. MODIFICATIONS VIA SHOP DRAWING SHALL

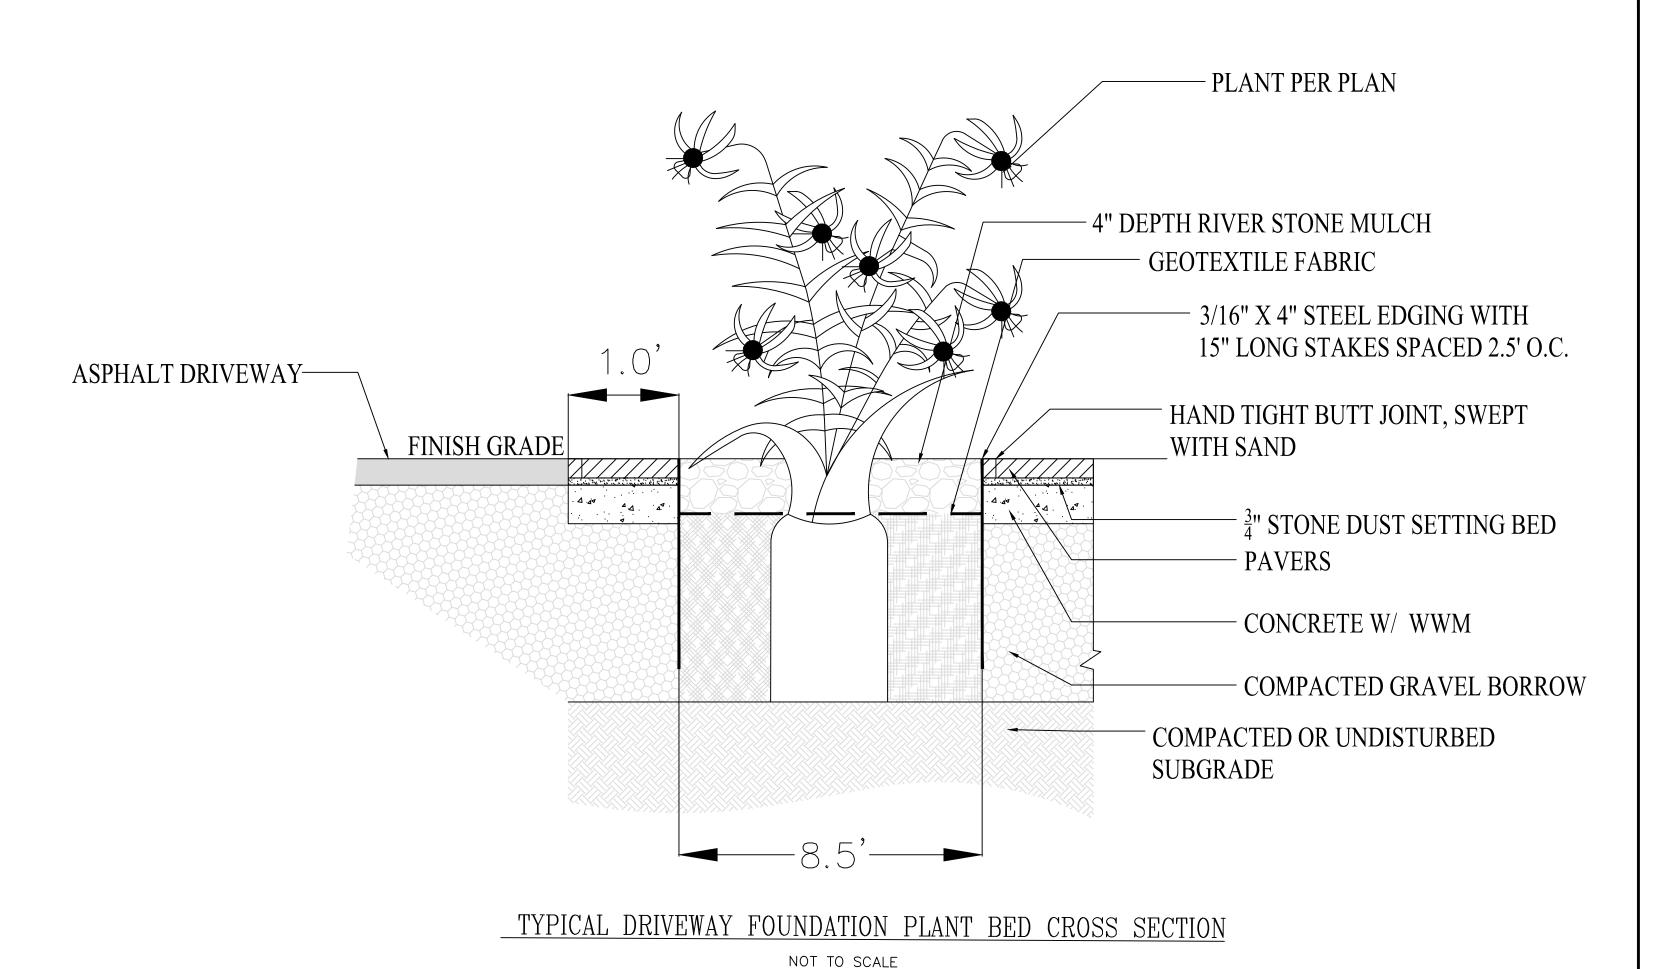

Seasonally Flooded Wildlife Food Mix

Mix Composition

21.5% Panicum clandestinum, Tioga (Deertongue, Tioga)

20.0% Elymus virginicus, Madison—NY Ecotype (Virginia Wildrye, Madison—NY Ecotype)

16.6% Andropogon gerardii, 'Niagara' (Big Bluestem, 'Niagara')

15.0% Echinochloa crusgalli var. frumentacea (Japanese Millet)

10.0% Carex vulpinoidea, PA Ecotype (Fox Sedge, PA Ecotype)

8.0% Panicum virgatum, 'Shawnee' (Switchgrass, 'Shawnee')

4.0% Chamaecrista fasciculata, PA Ecotype (Partridge Pea, PA Ecotype)

1.5% Verbena hastata, PA Ecotype (Blue Vervain, PA Ecotype)

1.0% Heliopsis helianthoides, PA Ecotype (Oxeye Sunflower, PA Ecotype)

1.0% Juncus effusus (Soft Rush)

0.8% Agrostis perennans, Albany Pine Bush-NY Ecotype (Autumn Bentgrass, Albany Pine Bush-NY Ecotype)

0.1% Asclepias incarnata, PA Ecotype (Swamp Milkweed, PA Ecotype)

0.1% Aster novae—angliae, PA Ecotype (New England Aster, PA Ecotype)

0.1% Eupatorium fistulosum, PA Ecotype (Joe Pye Weed, PA Ecotype)

0.1% Eupatorium perfoliatum, PA Ecotype (Boneset, PA Ecotype)

0.1% Monarda fistulosa, Fort Indiantown Gap—PA Ecotype (Wild Bergamot, Fort Indiantown Gap—PA Ecotype)

0.1% Pycnanthemum tenuifolium (Narrowleaf Mountainmint)

Item Number: ERNMX-128

Product Categories:

Wet Meadows & Wetlands, Wildlife Habitat & Food Plots

Height: 0.3 - 7.0 Ft

Seeding Rate: 20 lb per acre, or 1/2 lb per 1,000 sq ft with a cover crop. For a cover crop use one of the following: grain rye (1 Sep to 30 Apr; 30 lbs/acre), Japanese millet (1 May to 31 Aug; 10 lbs/acre), or barnyard grass (1 May to 31 Aug; 10 lbs/acre).

