

# Site Plans

Issued for	Local Approvals
Date Issued	August 2, 2021
Latest Issue	January 20, 2023

## Proposed Large-Scale Ground-Mounted Solar Photovoltaic Installation

0 Route 25  
Wareham, MA



101 Walnut Street  
PO Box 9151  
Watertown, MA 02471  
617.924.1770

### Designer/Developer/Electrical Engineer

Wareham PV I, LLC  
330 Congress Street, 6th Floor  
Boston, MA 02210  
617.377.4301

### Owner

David Fletcher  
PO Box 829  
Plymouth, MA 02362

### Applicant

Wareham PV I, LLC  
330 Congress Street  
6th Floor  
Boston, MA 02210


**Assessor's Map 115: Lot 1000**

### Sheet Index

No.	Drawing Title	Latest Issue
C1.00	Legend and General Notes	August 2, 2021
C2.00	Overall Site Plan	January 20, 2023
C2.01-2.03	Layout, Grading, Drainage, and Erosion Control Plan	January 20, 2023
C3.01-3.02	Site Details	December 22, 2022

### Reference Drawings

No.	Drawing Title	Latest Issue
Sv-1 - Sv-6	Existing Conditions Plan of Land	January 12, 2021

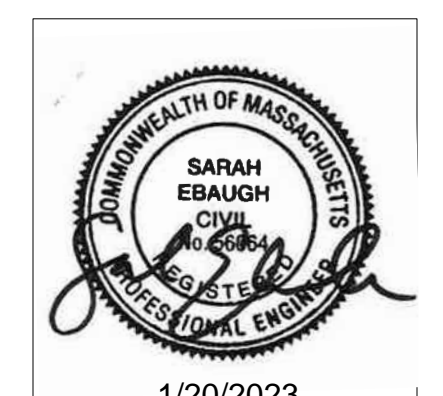



101 Walnut Street  
PO Box 9151  
Watertown, MA 02471  
617.924.1770

Legend

Legend table with columns: Exist., Prop., and descriptions for various site features like Property Line, Pavement, Buildings, Elevation, etc.

Abbreviations

Abbreviations table with columns: General, and descriptions for terms like ABAN (ABANDON), ACR (ACCESSIBLE CURB RAMP), ADJ (ADJUST), etc.

Notes

- CONTRACTOR SHALL NOTIFY "DIG-SAFE" (1-888-344-7233) AT LEAST 72 HOURS BEFORE EXCAVATING.
CONTRACTOR SHALL BE RESPONSIBLE FOR SITE SECURITY AND JOB SAFETY. CONSTRUCTION ACTIVITIES SHALL BE IN ACCORDANCE WITH OSHA STANDARDS AND LOCAL REQUIREMENTS.
ACCESSIBLE ROUTES, PARKING SPACES, RAMPS, SIDEWALKS AND WALKWAYS SHALL BE CONSTRUCTED IN CONFORMANCE WITH THE FEDERAL AMERICANS WITH DISABILITIES ACT AND WITH STATE AND LOCAL LAWS AND REGULATIONS (WHICHEVER ARE MORE STRINGENT).
AREAS DISTURBED DURING CONSTRUCTION AND NOT RESTORED WITH IMPERVIOUS SURFACES (BUILDINGS, PAVEMENTS, WALKS, ETC.) SHALL RECEIVE 6 INCHES LOAM AND SEED.
WITHIN THE LIMITS OF THE BUILDING FOOTPRINT, THE SITE CONTRACTOR SHALL PERFORM EARTHWORK OPERATIONS REQUIRED UP TO SUBGRADE ELEVATIONS.
WORK WITHIN THE LOCAL RIGHTS-OF-WAY SHALL CONFORM TO LOCAL MUNICIPAL STANDARDS. WORK WITHIN STATE RIGHTS-OF-WAY SHALL CONFORM TO THE LATEST EDITION OF THE STATE HIGHWAY DEPARTMENTS STANDARD SPECIFICATIONS FOR HIGHWAYS AND BRIDGES.
UPON AWARD OF CONTRACT, CONTRACTOR SHALL MAKE NECESSARY CONSTRUCTION NOTIFICATIONS AND APPLY FOR AND OBTAIN NECESSARY PERMITS, PAY FEES, AND POST BONDS ASSOCIATED WITH THE WORK INDICATED ON THE DRAWINGS, IN THE SPECIFICATIONS, AND IN THE CONTRACT DOCUMENTS. DO NOT CLOSE OR OBSTRUCT ROADWAYS, SIDEWALKS, AND FIRE HYDRANTS, WITHOUT APPROPRIATE PERMITS.
TRAFFIC SIGNAGE AND PAVEMENT MARKINGS SHALL CONFORM TO THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES.
AREAS OUTSIDE THE LIMITS OF PROPOSED WORK DISTURBED BY THE CONTRACTOR'S OPERATIONS SHALL BE RESTORED BY THE CONTRACTOR TO THEIR ORIGINAL CONDITION AT THE CONTRACTOR'S EXPENSE.
IN THE EVENT THAT SUSPECTED CONTAMINATED SOIL, GROUNDWATER, AND OTHER MEDIA ARE ENCOUNTERED DURING EXCAVATION AND CONSTRUCTION ACTIVITIES BASED ON VISUAL, OLFACTORY, OR OTHER EVIDENCE, THE CONTRACTOR SHALL STOP WORK IN THE VICINITY OF THE SUSPECT MATERIAL TO AVOID FURTHER SPREADING OF THE MATERIAL, AND SHALL NOTIFY THE OWNER IMMEDIATELY SO THAT THE APPROPRIATE TESTING AND SUBSEQUENT ACTION CAN BE TAKEN.
CONTRACTOR SHALL PREVENT DUST, SEDIMENT, AND DEBRIS FROM EXITING THE SITE AND SHALL BE RESPONSIBLE FOR CLEANUP, REPAIRS AND CORRECTIVE ACTION IF SUCH OCCURS.
DAMAGE RESULTING FROM CONSTRUCTION LOADS SHALL BE REPAIRED BY THE CONTRACTOR AT NO ADDITIONAL COST TO OWNER.
CONTRACTOR SHALL CONTROL STORMWATER RUNOFF DURING CONSTRUCTION TO PREVENT ADVERSE IMPACTS TO OFF SITE AREAS, AND SHALL BE RESPONSIBLE TO REPAIR RESULTING DAMAGES, IF ANY, AT NO COST TO OWNER.
THIS PROJECT DISTURBS MORE THAN ONE ACRE OF LAND AND FALLS WITHIN THE NPDES CONSTRUCTION GENERAL PERMIT (CGP) PROGRAM AND EPA JURISDICTION. PRIOR TO THE START OF CONSTRUCTION, CONTRACTOR IS TO FILE A CGP NOTIFICATION WITH THE EPA AND PREPARE A STORMWATER POLLUTION PREVENTION PLAN IN ACCORDANCE WITH THE NPDES REGULATIONS. CONTRACTOR SHALL CONFIRM THE OWNER HAS ALSO FILED A NOTICE OF INTENT WITH THE EPA.
THE LOCATIONS, SIZES, AND TYPES OF EXISTING UTILITIES ARE SHOWN AS AN APPROXIMATE REPRESENTATION ONLY. THE OWNER OR ITS REPRESENTATIVE(S) HAVE NOT INDEPENDENTLY VERIFIED THIS INFORMATION AS SHOWN ON THE PLANS. THE UTILITY INFORMATION SHOWN DOES NOT GUARANTEE THE ACTUAL EXISTENCE, SERVICEABILITY, OR OTHER DATA CONCERNING THE UTILITIES, NOR DOES IT GUARANTEE AGAINST THE POSSIBILITY THAT ADDITIONAL UTILITIES MAY BE PRESENT THAT ARE NOT SHOWN ON THE PLANS. PRIOR TO ORDERING MATERIALS AND BEGINNING CONSTRUCTION, THE CONTRACTOR SHALL VERIFY AND DETERMINE THE EXACT LOCATIONS, SIZES, AND ELEVATIONS OF THE POINTS OF CONNECTIONS TO EXISTING UTILITIES AND, SHALL CONFIRM THAT THERE ARE NO INTERFERENCES WITH EXISTING UTILITIES AND THE PROPOSED UTILITY ROUTES, INCLUDING ROUTES WITHIN THE PUBLIC RIGHTS OF WAY.
WHERE AN EXISTING UTILITY IS FOUND TO CONFLICT WITH THE PROPOSED WORK, OR EXISTING CONDITIONS DIFFER FROM THOSE SHOWN SUCH THAT THE WORK CANNOT BE COMPLETED AS INTENDED, THE LOCATION, ELEVATION, AND SIZE OF THE UTILITY SHALL BE ACCURATELY DETERMINED WITHOUT DELAY BY THE CONTRACTOR, AND THE INFORMATION FURNISHED IN WRITING TO THE OWNER'S REPRESENTATIVE FOR THE RESOLUTION OF THE CONFLICT AND CONTRACTOR'S FAILURE TO NOTIFY PRIOR TO PERFORMING ADDITIONAL WORK RELEASES OWNER FROM OBLIGATIONS FOR ADDITIONAL PAYMENTS WHICH OTHERWISE MAY BE WARRANTED TO RESOLVE THE CONFLICT.
SET CATCH BASIN RIMS, AND INVERTS OF SEWERS, DRAINS, AND DITCHES IN ACCORDANCE WITH ELEVATIONS ON THE GRADING AND UTILITY PLANS.
RIM ELEVATIONS FOR DRAIN AND SEWER MANHOLES, WATER VALVE COVERS, GAS GATES, ELECTRIC AND TELEPHONE PULL BOXES, AND MANHOLES, AND OTHER SUCH ITEMS, ARE APPROXIMATE AND SHALL BE SET/RESET AS FOLLOWS:
A. PAVEMENTS AND CONCRETE SURFACES: FLUSH
B. ALL SURFACES ALONG ACCESSIBLE ROUTES: FLUSH
C. LANDSCAPE, LOAM AND SEED, AND OTHER EARTH SURFACE AREAS: ONE INCH ABOVE SURROUNDING AREA AND TAPER EARTH TO THE RIM ELEVATION.
THE LOCATION, SIZE, DEPTH, AND SPECIFICATIONS FOR CONSTRUCTION OF PROPOSED PRIVATE UTILITY SERVICES SHALL BE INSTALLED ACCORDING TO THE REQUIREMENTS PROVIDED BY AND APPROVED BY THE RESPECTIVE UTILITY COMPANY (GAS, TELEPHONE, ELECTRIC, FIRE ALARM, ETC.). FINAL DESIGN LOADS AND LOCATIONS TO BE COORDINATED WITH OWNER AND ARCHITECT.
CONTRACTOR SHALL MAKE ARRANGEMENTS FOR AND SHALL BE RESPONSIBLE FOR PAYING FEES FOR POLE RELOCATION AND FOR THE ALTERATION AND ADJUSTMENT OF GAS, ELECTRIC, TELEPHONE, FIRE ALARM, AND ANY OTHER PRIVATE UTILITIES, WHETHER WORK IS PERFORMED BY CONTRACTOR OR BY THE UTILITIES COMPANY.
UTILITY PIPE MATERIALS SHALL BE AS FOLLOWS, UNLESS OTHERWISE NOTED ON THE PLAN:
A. STORM DRAINAGE PIPES SHALL BE HIGH DENSITY POLYETHYLENE (HDPE)
B. PIPE INSTALLATION AND MATERIALS SHALL COMPLY WITH THE STATE PLUMBING CODE WHERE APPLICABLE. CONTRACTOR SHALL COORDINATE WITH LOCAL PLUMBING INSPECTOR PRIOR TO BEGINNING WORK.
CONTRACTOR SHALL COORDINATE WITH ELECTRICAL CONTRACTOR AND SHALL FURNISH EXCAVATION, INSTALLATION, AND BACKFILL OF ELECTRICAL FURNISHED SITEWORK RELATED ITEMS SUCH AS PULL BOXES, CONDUITS, DUCT BANKS, LIGHT POLE BASES, AND CONCRETE PADS. SITE CONTRACTOR SHALL FURNISH CONCRETE ENCASUREMENT OF DUCT BANKS IF REQUIRED BY THE UTILITY COMPANY AND AS INDICATED ON THE DRAWINGS.
CONTRACTOR SHALL EXCAVATE AND BACKFILL TRENCHES FOR GAS IN ACCORDANCE WITH GAS COMPANY'S REQUIREMENTS.
ALL DRAINAGE AND SANITARY STRUCTURE INTERIOR DIAMETERS (4" MIN.) SHALL BE DETERMINED BY THE MANUFACTURER BASED ON THE PIPE CONFIGURATIONS SHOWN ON THESE PLANS AND LOCAL MUNICIPAL STANDARDS. FOR MANHOLES THAT ARE 20 FEET IN DEPTH AND GREATER, THE MINIMUM DIAMETER SHALL BE 5 FEET.
CONTRACTOR SHALL PROVIDE COMPLETE MAINTENANCE OF THE LAWNS AND PLANTINGS. NO IRRIGATION IS PROPOSED FOR THIS SITE. THE CONTRACTOR SHALL SUPPLY SUPPLEMENTAL WATERING FOR NEW LAWNS AND PLANTINGS DURING THE ONE YEAR PLANT GUARANTEE PERIOD.
CONTRACTOR SHALL PROVIDE ALL MATERIALS, LABOR, AND EQUIPMENT FOR THE COMPLETE LANDSCAPE MAINTENANCE WORK. WATER SHALL BE PROVIDED BY THE CONTRACTOR.
WATERING SHALL BE REQUIRED DURING THE GROWING SEASON, WHEN NATURAL RAINFALL IS BELOW ONE INCH PER WEEK.
WATER SHALL BE APPLIED IN SUFFICIENT QUANTITY TO THOROUGHLY SATURATE THE SOIL IN THE ROOT ZONE OF EACH PLANT.
CONTRACTOR SHALL REPLACE DEAD OR DYING PLANTS AT THE END OF THE ONE YEAR GUARANTEE PERIOD. CONTRACTOR SHALL TURN OVER MAINTENANCE TO THE FACILITY MAINTENANCE STAFF AT THAT TIME.

Layout and Materials

- DIMENSIONS ARE FROM THE FACE OF CURB, FACE OF BUILDING, FACE OF WALL, AND CENTER LINE OF PAVEMENT MARKINGS, UNLESS OTHERWISE NOTED.
SEE ARCHITECTURAL DRAWINGS FOR EXACT BUILDING DIMENSIONS AND DETAILS CONTIGUOUS TO THE BUILDING, INCLUDING SIDEWALKS, RAMPS, BUILDING ENTRANCES, STAIRWAYS, UTILITY PENETRATIONS, CONCRETE DOOR PADS, COMPACTOR PAD, LOADING DOCKS, BOLLARDS, ETC.
PROPOSED BOUNDS AND ANY EXISTING PROPERTY LINE MONUMENTATION DISTURBED DURING CONSTRUCTION SHALL BE SET OR RESET BY A PROFESSIONAL LAND SURVEYOR.
PRIOR TO START OF CONSTRUCTION, CONTRACTOR SHALL VERIFY EXISTING PAVEMENT ELEVATIONS AT INTERFACE WITH PROPOSED PAVEMENTS, AND EXISTING GROUND ELEVATIONS ADJACENT TO DRAINAGE OUTLETS TO ASSURE PROPER TRANSITIONS BETWEEN EXISTING AND PROPOSED FACILITIES.

Demolition

- CONTRACTOR SHALL REMOVE AND DISPOSE OF EXISTING MANMADE SURFACE FEATURES WITHIN THE LIMIT OF WORK INCLUDING BUILDINGS, STRUCTURES, PAVEMENTS, SLABS, CURBING, FENCES, UTILITY POLES, SIGNS, ETC. UNLESS INDICATED OTHERWISE ON THE DRAWINGS. REMOVE AND DISPOSE OF EXISTING UTILITIES, FOUNDATIONS AND UNSUITABLE MATERIAL BENEATH AND FOR A DISTANCE OF 10 FEET BEYOND THE PROPOSED BUILDING FOOTPRINT INCLUDING EXTERIOR COLUMNS.
EXISTING UTILITIES SHALL BE TERMINATED, UNLESS OTHERWISE NOTED, IN CONFORMANCE WITH LOCAL, STATE AND INDIVIDUAL UTILITY COMPANY STANDARD SPECIFICATIONS AND DETAILS. THE CONTRACTOR SHALL COORDINATE UTILITY SERVICE DISCONNECTS WITH THE UTILITY REPRESENTATIVES.
CONTRACTOR SHALL DISPOSE OF DEMOLITION DEBRIS IN ACCORDANCE WITH APPLICABLE FEDERAL, STATE AND LOCAL REGULATIONS, ORDINANCES AND STATUTES.
THE DEMOLITION LIMITS DEPICTED IN THE PLANS IS INTENDED TO AID THE CONTRACTOR DURING THE BIDDING AND CONSTRUCTION PROCESS AND IS NOT INTENDED TO DEPICT EACH AND EVERY ELEMENT OF DEMOLITION. THE CONTRACTOR IS RESPONSIBLE FOR IDENTIFYING THE DETAILED SCOPE OF DEMOLITION BEFORE SUBMITTING ITS BID/PROPOSAL TO PERFORM THE WORK AND SHALL MAKE NO CLAIMS AND SEEK NO ADDITIONAL COMPENSATION FOR CHANGED CONDITIONS OR UNFORESEEN OR LATENT SITE CONDITIONS RELATED TO ANY CONDITIONS DISCOVERED DURING EXECUTION OF THE WORK.
UNLESS OTHERWISE SPECIFICALLY PROVIDED ON THE PLANS OR IN THE SPECIFICATIONS, THE ENGINEER HAS NOT PREPARED DESIGNS FOR AND SHALL HAVE NO RESPONSIBILITY FOR THE PRESENCE, DISCOVERY, REMOVAL, ABATEMENT OR DISPOSAL OF HAZARDOUS MATERIALS, TOXIC WASTES OR POLLUTANTS AT THE PROJECT SITE. THE ENGINEER SHALL NOT BE RESPONSIBLE FOR ANY CLAIMS OF LOSS, DAMAGE, EXPENSE, DELAY, INJURY OR DEATH ARISING FROM THE PRESENCE OF HAZARDOUS MATERIAL AND CONTRACTOR SHALL INDEMNIFY AND HOLD HARMLESS THE ENGINEER FROM ANY CLAIMS MADE IN CONNECTION WITH THE WORK. HOWEVER, THE ENGINEER SHALL HAVE NO ADMINISTRATIVE OBLIGATIONS OF ANY TYPE WITH REGARD TO ANY CONTRACTOR AMENDMENT INVOLVING THE ISSUES OF PRESENCE, DISCOVERY, REMOVAL, ABATEMENT OR DISPOSAL OF ASBESTOS OR OTHER HAZARDOUS MATERIALS.

Erosion Control

- PRIOR TO STARTING ANY OTHER WORK ON THE SITE, THE CONTRACTOR SHALL NOTIFY APPROPRIATE AGENCIES AND SHALL INSTALL SEDIMENT CONTROL MEASURES AS SHOWN ON THE PLANS AND AS IDENTIFIED IN FEDERAL, STATE, AND LOCAL APPROVAL DOCUMENTS PERTAINING TO THIS PROJECT.
CONTRACTOR SHALL INSPECT AND MAINTAIN EROSION PREVENTION AND SEDIMENT CONTROL MEASURES ON A WEEKLY BASIS (MINIMUM) OR AS REQUIRED PER THE STORMWATER POLLUTION PREVENTION PLAN (SWPPP). THE CONTRACTOR SHALL ADDRESS DEFICIENCIES AND MAINTENANCE ITEMS WITHIN TWENTY-FOUR HOURS OF INSPECTION. CONTRACTOR SHALL PROPERLY DISPOSE OF SEDIMENT SUCH THAT IT DOES NOT ENCUMBER OTHER DRAINAGE STRUCTURES AND PROTECTED AREAS.
CONTRACTOR SHALL BE FULLY RESPONSIBLE TO CONTROL CONSTRUCTION SUCH THAT SEDIMENTATION SHALL NOT AFFECT REGULATORY PROTECTED AREAS, WHETHER SUCH SEDIMENTATION IS CAUSED BY WATER, WIND, OR DIRECT DEPOSIT.
CONTRACTOR SHALL PERFORM CONSTRUCTION SEQUENCING SUCH THAT EARTH MATERIALS ARE EXPOSED FOR A MINIMUM OF TIME BEFORE THEY ARE COVERED, SEEDED, OR OTHERWISE STABILIZED TO PREVENT EROSION. REFER TO PROJECT SWPPP FOR SPECIFIC TIMEFRAMES.
UPON COMPLETION OF CONSTRUCTION AND ESTABLISHMENT OF PERMANENT GROUND COVER, CONTRACTOR SHALL REMOVE AND DISPOSE OF SEDIMENT CONTROL MEASURES AND CLEAN SEDIMENT AND DEBRIS FROM ENTIRE DRAINAGE AND SEWER SYSTEMS.

Existing Conditions Information

- BASE PLAN: "EXISTING CONDITIONS PLAN OF LAND" DATED JANUARY 12 2021, PREPARED BY VHB.
TOPOGRAPHY: ELEVATIONS ARE BASED ON NAVD 1988.

Document Use

- THESE PLANS AND CORRESPONDING CADD DOCUMENTS ARE INSTRUMENTS OF PROFESSIONAL SERVICE, AND SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE OTHER THAN FOR WHICH IT WAS CREATED WITHOUT THE EXPRESSED, WRITTEN CONSENT OF VHB. ANY UNAUTHORIZED USE, REUSE, MODIFICATION OR ALTERATION, INCLUDING AUTOMATED CONVERSION OF THIS DOCUMENT SHALL BE AT THE USER'S SOLE RISK WITHOUT LIABILITY OR LEGAL EXPOSURE TO VHB.
CONTRACTOR SHALL NOT RELY SOLELY ON ELECTRONIC VERSIONS OF PLANS, SPECIFICATIONS, AND DATA FILES THAT ARE OBTAINED FROM THE DESIGNERS, BUT SHALL VERIFY LOCATION OF PROJECT FEATURES IN ACCORDANCE WITH THE PAPER COPIES OF THE PLANS AND SPECIFICATIONS THAT ARE SUPPLIED AS PART OF THE CONTRACT DOCUMENTS.
SYMBOLS AND LEGENDS OF PROJECT FEATURES ARE GRAPHIC REPRESENTATIONS AND ARE NOT NECESSARILY SCALED TO THEIR ACTUAL DIMENSIONS OR LOCATIONS ON THE DRAWINGS. THE CONTRACTOR SHALL REFER TO THE DETAIL SHEET DIMENSIONS, MANUFACTURERS' LITERATURE, SHOP DRAWINGS AND FIELD MEASUREMENTS OF SUPPLIED PRODUCTS FOR LAYOUT OF THE PROJECT FEATURES.

Planting Notes

- ALL PROPOSED PLANTING LOCATIONS SHALL BE STAKED AS SHOWN ON THE PLANS FOR FIELD REVIEW AND APPROVAL BY THE LANDSCAPE ARCHITECT PRIOR TO INSTALLATION.
CONTRACTOR SHALL VERIFY LOCATIONS OF ALL BELOW GRADE AND ABOVE GROUND UTILITIES AND NOTIFY OWNERS REPRESENTATIVE OF CONFLICTS.
NO PLANT MATERIALS SHALL BE INSTALLED UNTIL ALL GRADING AND CONSTRUCTION HAS BEEN COMPLETED IN THE IMMEDIATE AREA. CONTRACTOR SHALL NOTIFY OWNER'S REPRESENTATIVE OF ANY CONFLICT.
CONTRACTOR SHALL BE BALLED AND BURLAPPED, UNLESS OTHERWISE NOTED IN THE DRAWINGS OR SPECIFICATION, OR APPROVED BY THE OWNER'S REPRESENTATIVE.
FINAL QUANTITY FOR EACH PLANT TYPE SHALL BE AS GRAPHICALLY SHOWN ON THE PLAN. THIS NUMBER SHALL TAKE PRECEDENCE IN CASE OF ANY DISCREPANCY BETWEEN QUANTITIES SHOWN ON THE PLANT LIST AND ON THE PLAN. THE CONTRACTOR SHALL REPORT ANY DISCREPANCIES BETWEEN THE NUMBER OF PLANTS SHOWN ON THE PLANT LIST AND PLANT LABELS PRIOR TO BIDDING.
ANY PROPOSED PLANT SUBSTITUTIONS MUST BE REVIEWED BY LANDSCAPE ARCHITECT AND APPROVED IN WRITING BY THE OWNER'S REPRESENTATIVE.
ALL PLANT MATERIALS INSTALLED SHALL MEET THE SPECIFICATIONS OF THE "AMERICAN STANDARDS FOR NURSERY STOCK" BY THE AMERICAN ASSOCIATION OF NURSERYMEN AND CONTRACT DOCUMENTS.
ALL PLANT MATERIALS SHALL BE GUARANTEED FOR ONE YEAR FOLLOWING DATE OF FINAL ACCEPTANCE.
AREAS DESIGNATED "LOAM & SEED" SHALL RECEIVE MINIMUM 6" OF LOAM AND SPECIFIED SEED MIX. LAWNS OVER 2:1 SLOPE SHALL BE PROTECTED WITH EROSION CONTROL FABRIC.
ALL DISTURBED AREAS NOT OTHERWISE NOTED ON CONTRACT DOCUMENTS SHALL BE LOAM AND SEEDED OR MULCHED AS DIRECTED BY OWNER'S REPRESENTATIVE.
THIS PLAN IS INTENDED FOR PLANTING PURPOSES. REFER TO SITE / CIVIL DRAWINGS FOR ALL OTHER SITE CONSTRUCTION INFORMATION.

Plant Maintenance Notes

- CONTRACTOR SHALL PROVIDE COMPLETE MAINTENANCE OF THE LAWNS AND PLANTINGS. NO IRRIGATION IS PROPOSED FOR THIS SITE. THE CONTRACTOR SHALL SUPPLY SUPPLEMENTAL WATERING FOR NEW LAWNS AND PLANTINGS DURING THE ONE YEAR PLANT GUARANTEE PERIOD.
CONTRACTOR SHALL PROVIDE ALL MATERIALS, LABOR, AND EQUIPMENT FOR THE COMPLETE LANDSCAPE MAINTENANCE WORK. WATER SHALL BE PROVIDED BY THE CONTRACTOR.
WATERING SHALL BE REQUIRED DURING THE GROWING SEASON, WHEN NATURAL RAINFALL IS BELOW ONE INCH PER WEEK.
WATER SHALL BE APPLIED IN SUFFICIENT QUANTITY TO THOROUGHLY SATURATE THE SOIL IN THE ROOT ZONE OF EACH PLANT.
CONTRACTOR SHALL REPLACE DEAD OR DYING PLANTS AT THE END OF THE ONE YEAR GUARANTEE PERIOD. CONTRACTOR SHALL TURN OVER MAINTENANCE TO THE FACILITY MAINTENANCE STAFF AT THAT TIME.

Proposed Large-Scale Ground-Mounted Solar Photovoltaic Installation


0 Route 25 Wareham, MA

Table with columns: No., Revision, Date, Apprd.

Designed by: SKE Checked by: JRG

Issued for: Local Approvals Date: August 2, 2021

Legend and General Notes


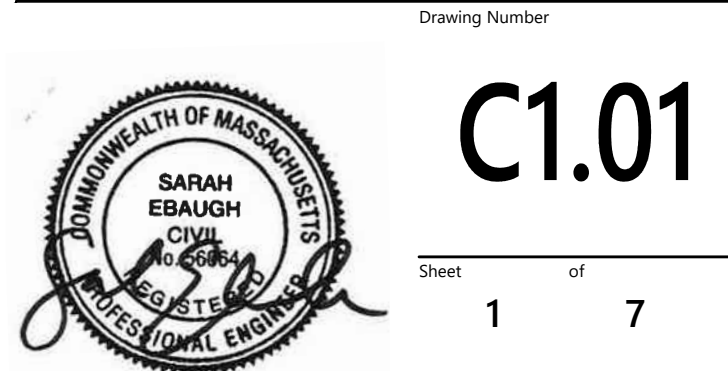


C1.01

Sheet 1 of 7

1/20/2023

Project Number 15225.01

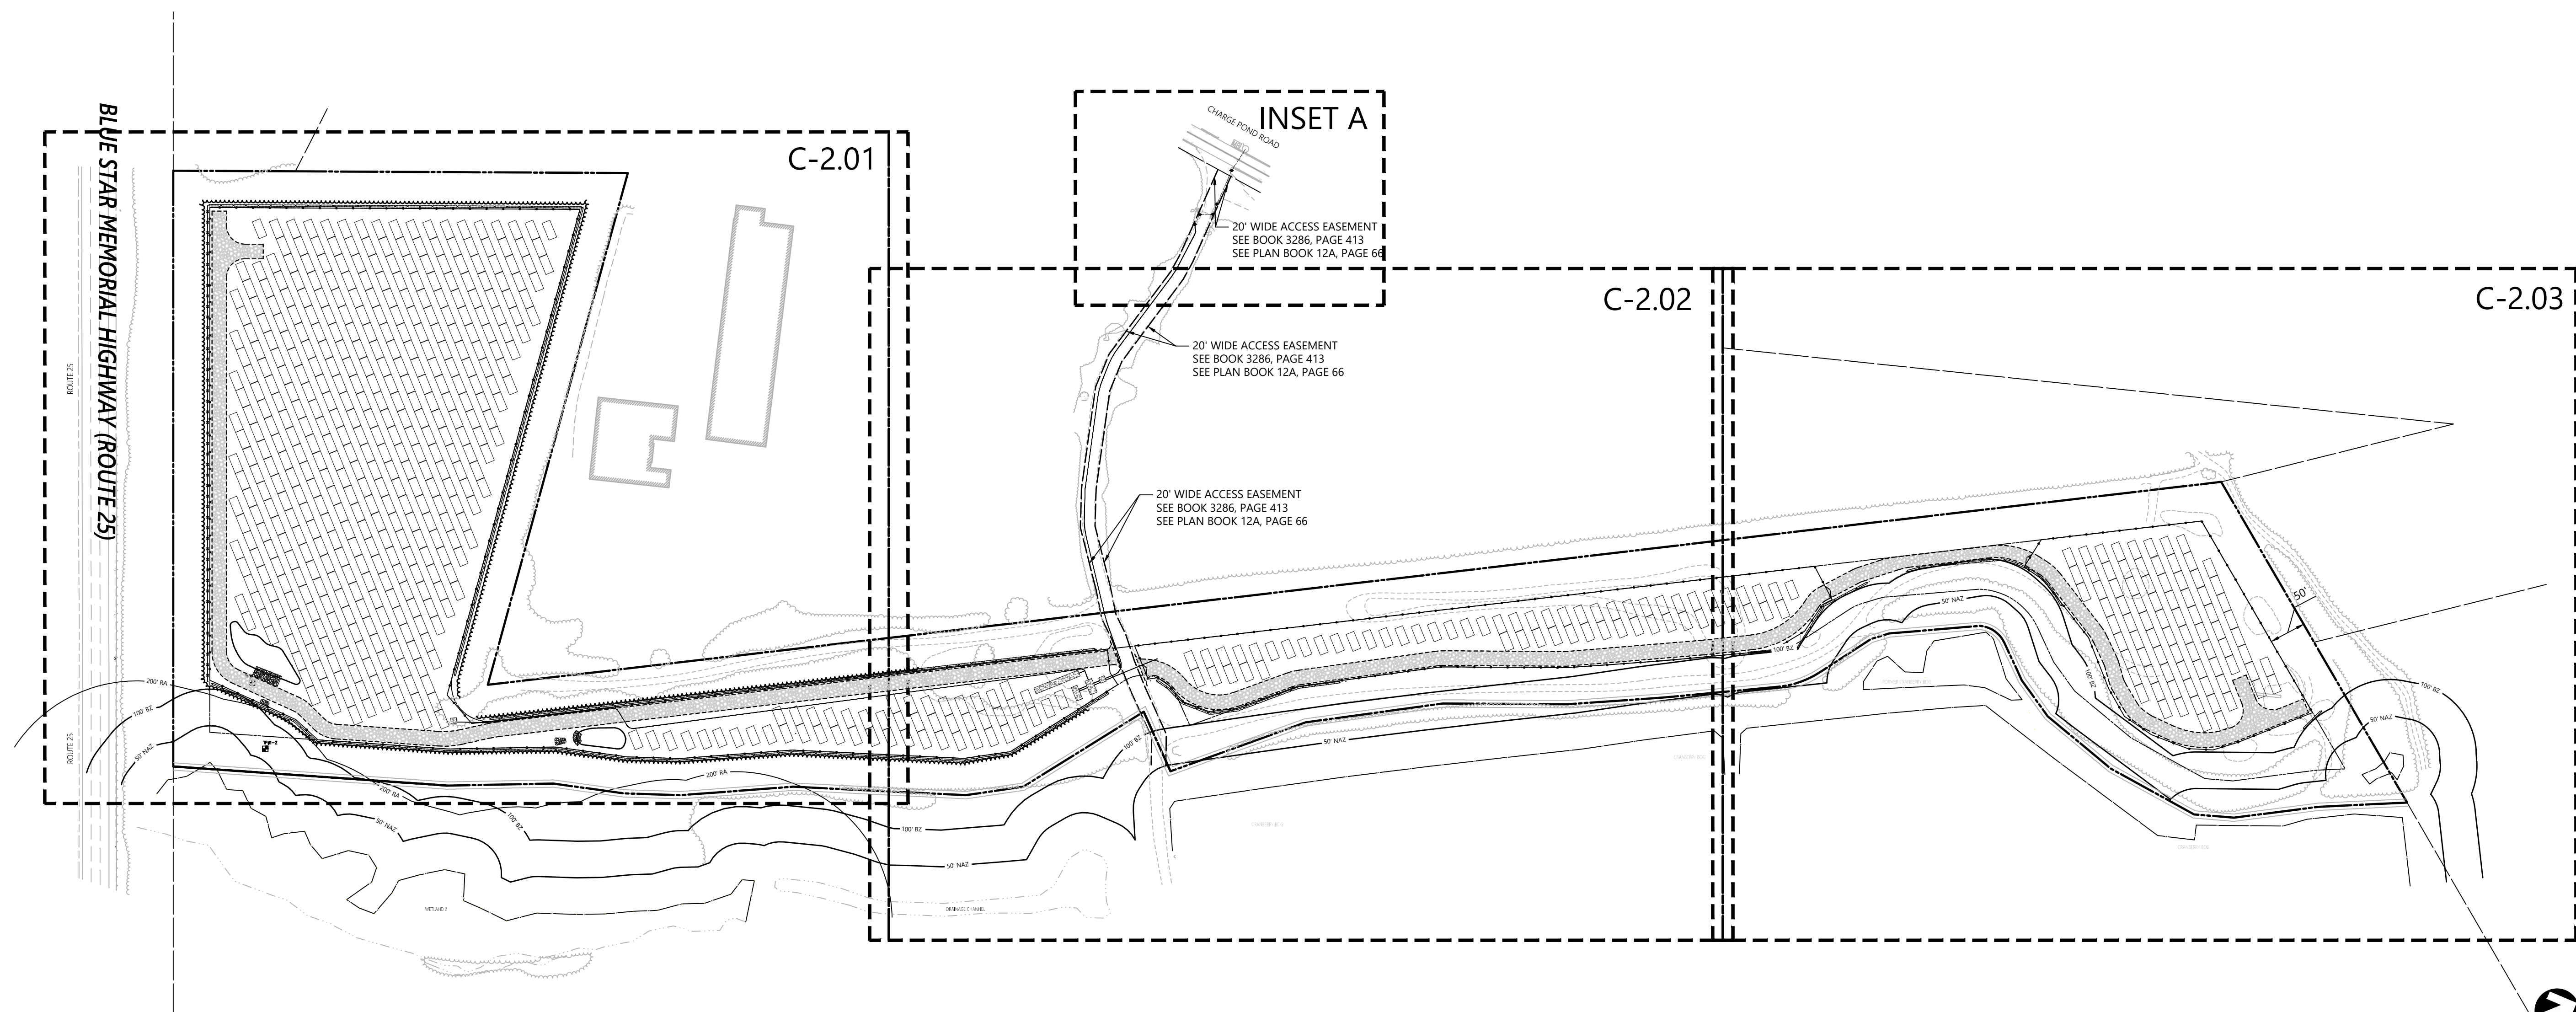

**SOLAR FARM SEED MIX**

% SEED	BOTANICAL NAME	COMMON NAME
30%	Festuca rubra	Creeping Red Fescue
30%	Festuca ovina 'Whisper'	Sheep Fescue 'Whisper'
15%	Festuca ovina var. duriuscula (F. longifolia) 'Heron'	Hard Fescue 'Heron'
15%	Festuca brevipila 'Chariot'	Hard Fescue 'Chariot'
10%	Lolium multiflorum (L. perenne var. italicum)	Annual Ryegrass
Total 100%		

NOTE:  
SEEDING RATE TO BE 6 LB PER 1,000 SF. SEED MIX TO BE  
ERNMX-186 "SOLAR FARM SEED MIX" AS MANUFACTURED BY  
ERNST CONSERVATION SEEDS, 8884 MERCER PIKE, MEADVILLE PA,  
16335  
(800) 873-3321.

**Zoning Summary Chart**

Zoning District(s):	Residential 130 (R-130)	
Zoning Regulation Requirements	Required <sup>1</sup>	Provided
MINIMUM LOT AREA <sup>2</sup>	≥3 Acres	22.4 Acres
FRONTAGE <sup>3</sup>	Not Applicable	Not Applicable
MINIMUM FRONT YARD SETBACK	50 Feet	Not Applicable
MINIMUM SIDE YARD SETBACK	50 Feet	50 Feet
MINIMUM REAR YARD SETBACK	50 Feet	Not Applicable
MAXIMUM BUILDING HEIGHT <sup>4</sup>	35 Feet	Not Applicable

(1) Zoning requirements as specified in "Zoning By-Laws Town of Wareham Massachusetts" (revised October 2018) (hereinafter "Zoning By-Laws").  
(2) Per Section 594.1.1 of Zoning By-Laws.  
(3) Per Section 611 of Zoning By-Laws, R-130 district minimum frontage requirement is not applicable because proposed project is not "principal building" or "accessory building" as those terms are defined in Article 16 of Zoning By-Laws.  
(4) Per Section 611 of Zoning By-Laws, R-130 district maximum allowed height requirement is not applicable because proposed project is not "principal building" or "accessory building" as those terms are defined in Article 16 of Zoning By-Laws.

**Proposed Large-Scale  
Ground-Mounted Solar  
Photovoltaic Installation**  
0 Route 25  
Wareham, MA

No.	Revision	Date	Appvd.
1	Response to Comments	05/25/2022	SKE
2	Buffer Zone Adjustments	06/13/2022	SKE
3	Buffer Zone Adjustments	11/16/2022	SKE
4	Planning Board Comments	12/22/2022	SKE
5	Electrical Equipment Pad Adjustment	01/20/2023	SKE

Designed by: **SKE** Checked by: **JRG**  
Issued for: \_\_\_\_\_ Date: \_\_\_\_\_  
**Local Approvals** August 2, 2021

**Overall Site Plan**

Drawing Number: \_\_\_\_\_  
**C2.00**  
Sheet 2 of 7



1/20/2023


Project Number  
15225.01



101 Walnut Street  
PO Box 9151  
Wareham, MA 02471  
617.924.1770

See Sheet C2.02

Match Line

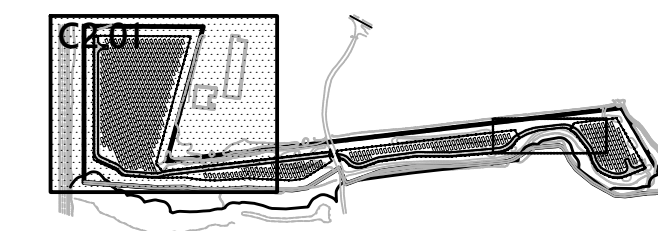

**Key**

Not To Scale



**Proposed Large-Scale  
Ground-Mounted Solar  
Photovoltaic Installation**

0 Route 25  
Wareham, MA

No.	Revision	Date	Appvd.
1	Response to Comments	05/25/2022	SKE
2	Buffer Zone Adjustments	06/13/2022	SKE
3	Buffer Zone Adjustments	11/16/2022	SKE

Designed by	Checked by
SKE	JRG

Issued for: Local Approvals Date: August 2, 2021

**Layout, Grading,  
Drainage, and Erosion  
Control Plan**


Drawing Number: **C2.01**

Sheet 3 of 7

Project Number: 15225.01

ROUTE 25  
BLUE STAR MEMORIAL HIGHWAY (ROUTE 25)

ROUTE 25


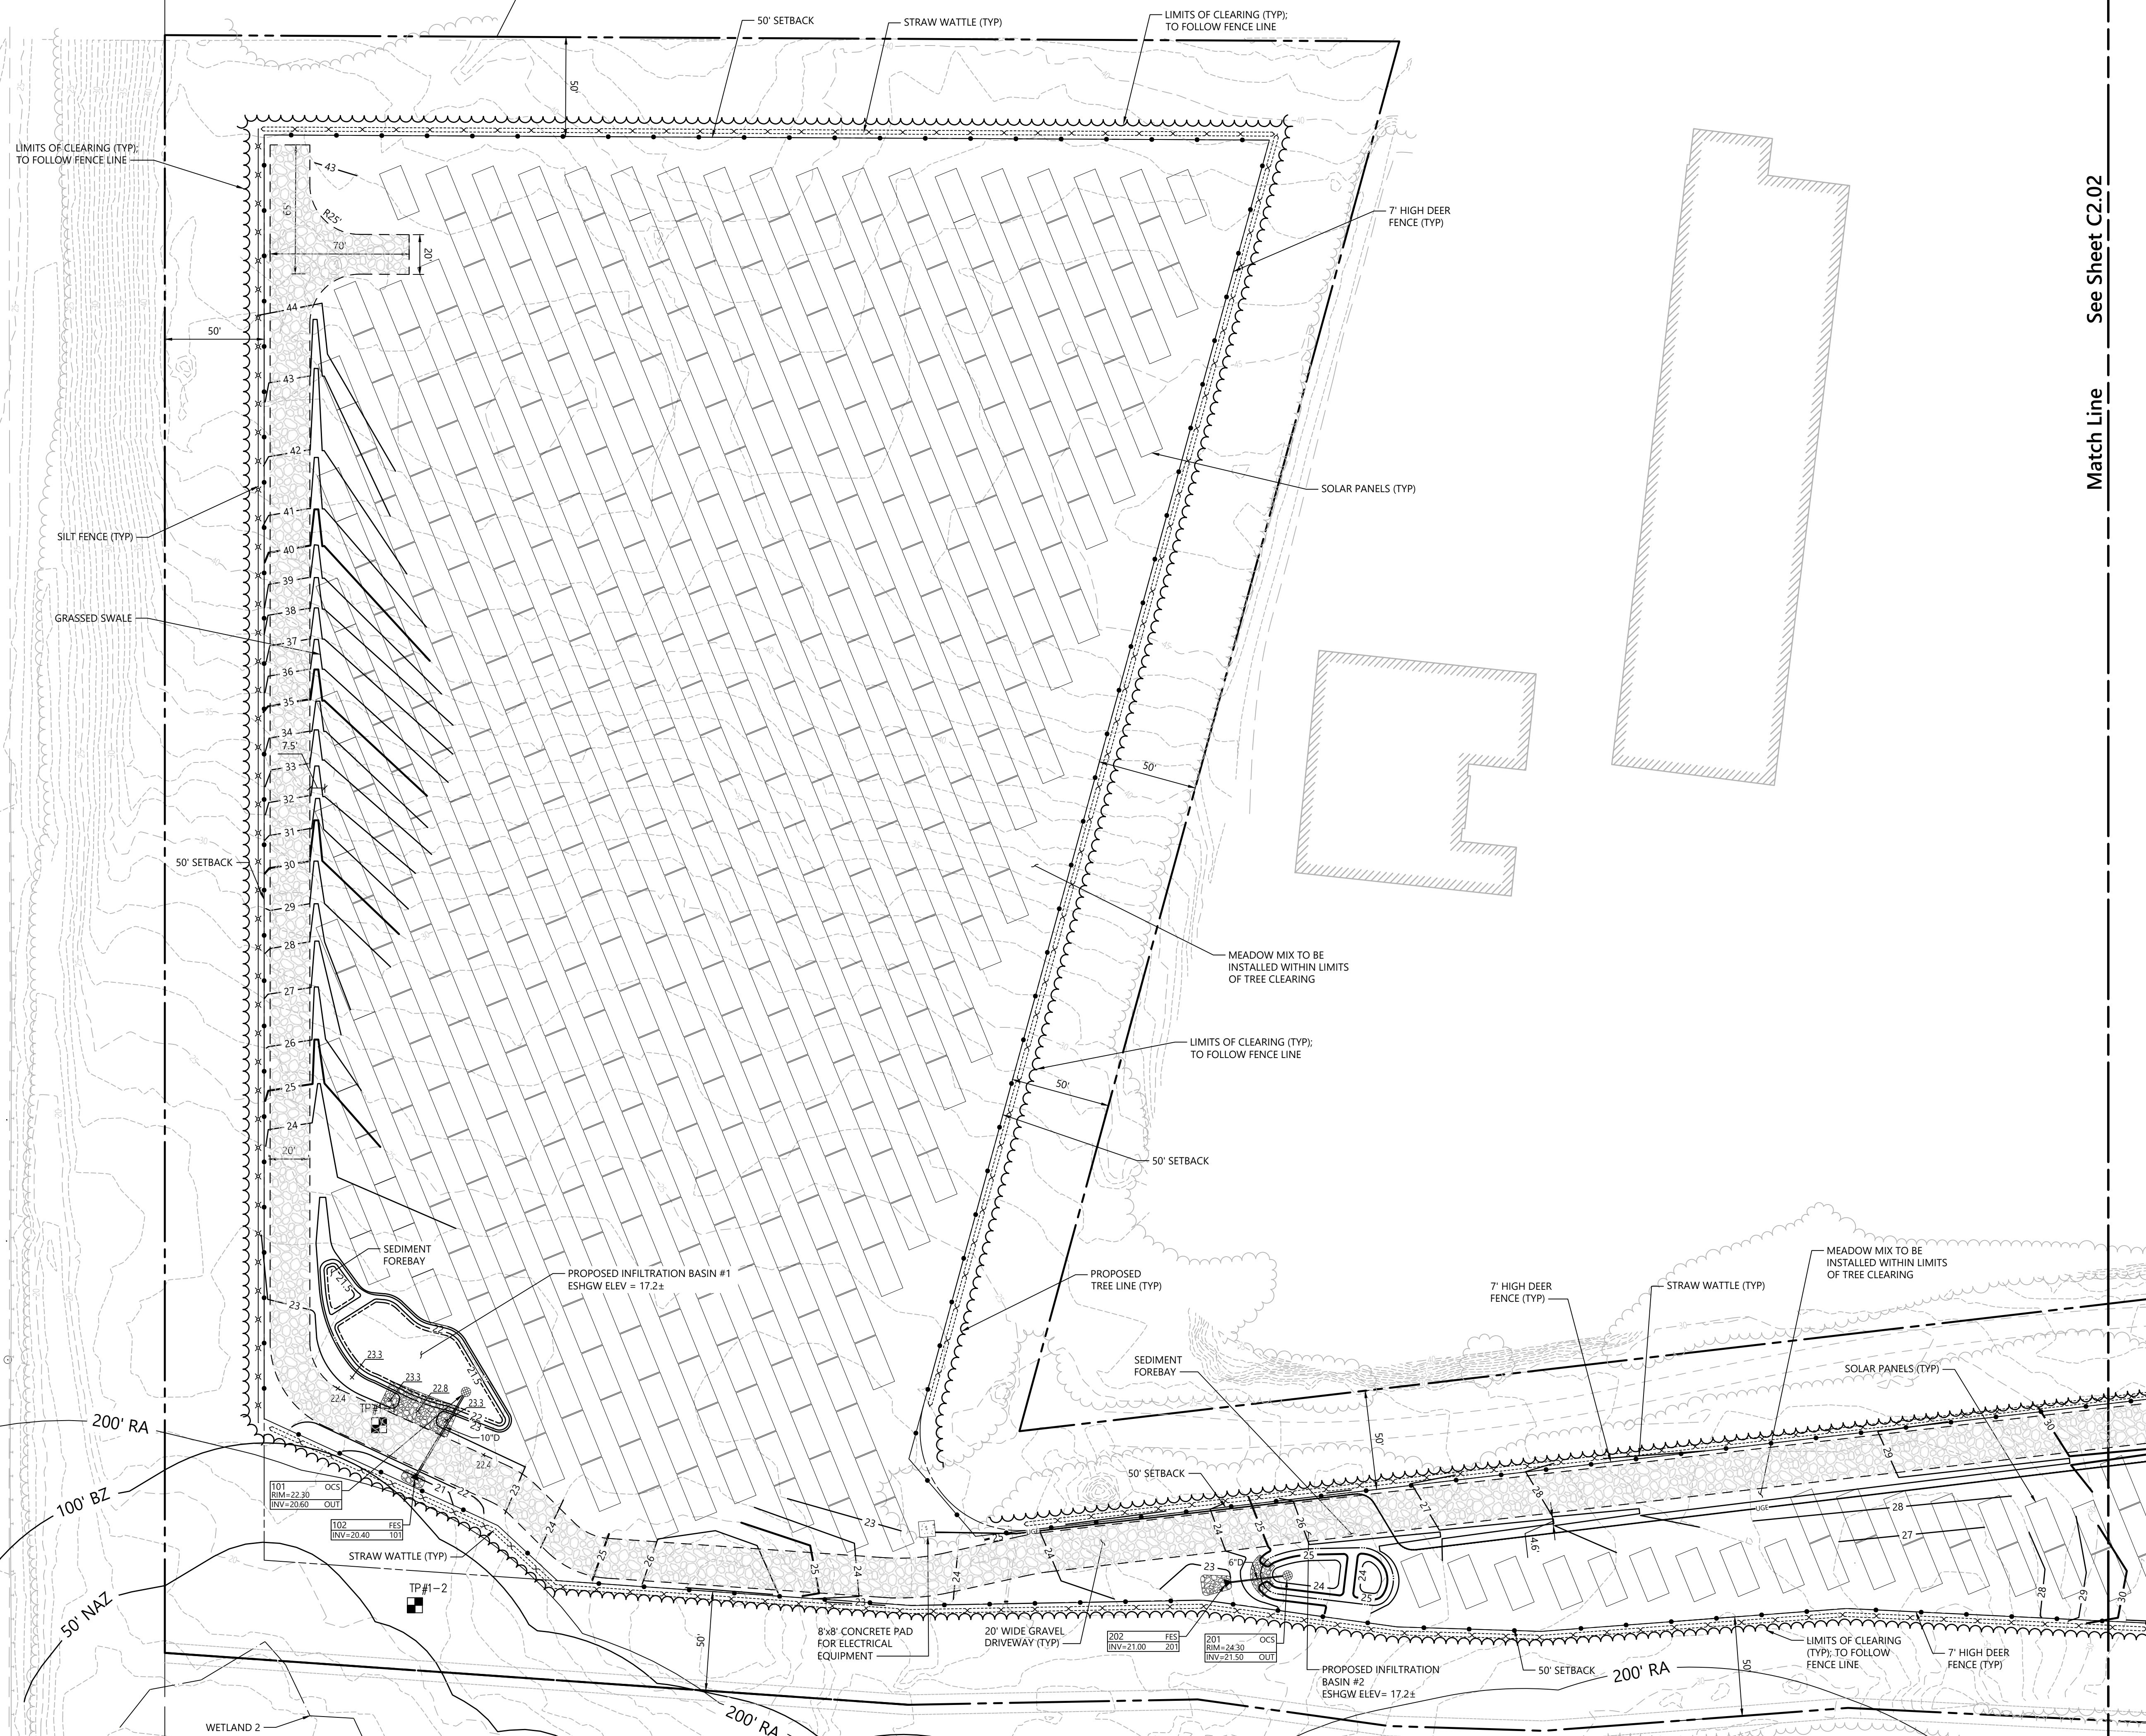




101 Walnut Street  
PO Box 9151  
Watertown, MA 02471  
617.924.1770

Match Line See Sheet C2.01

Match Line See Sheet C2.03

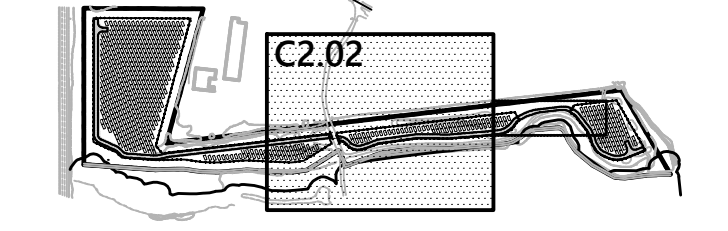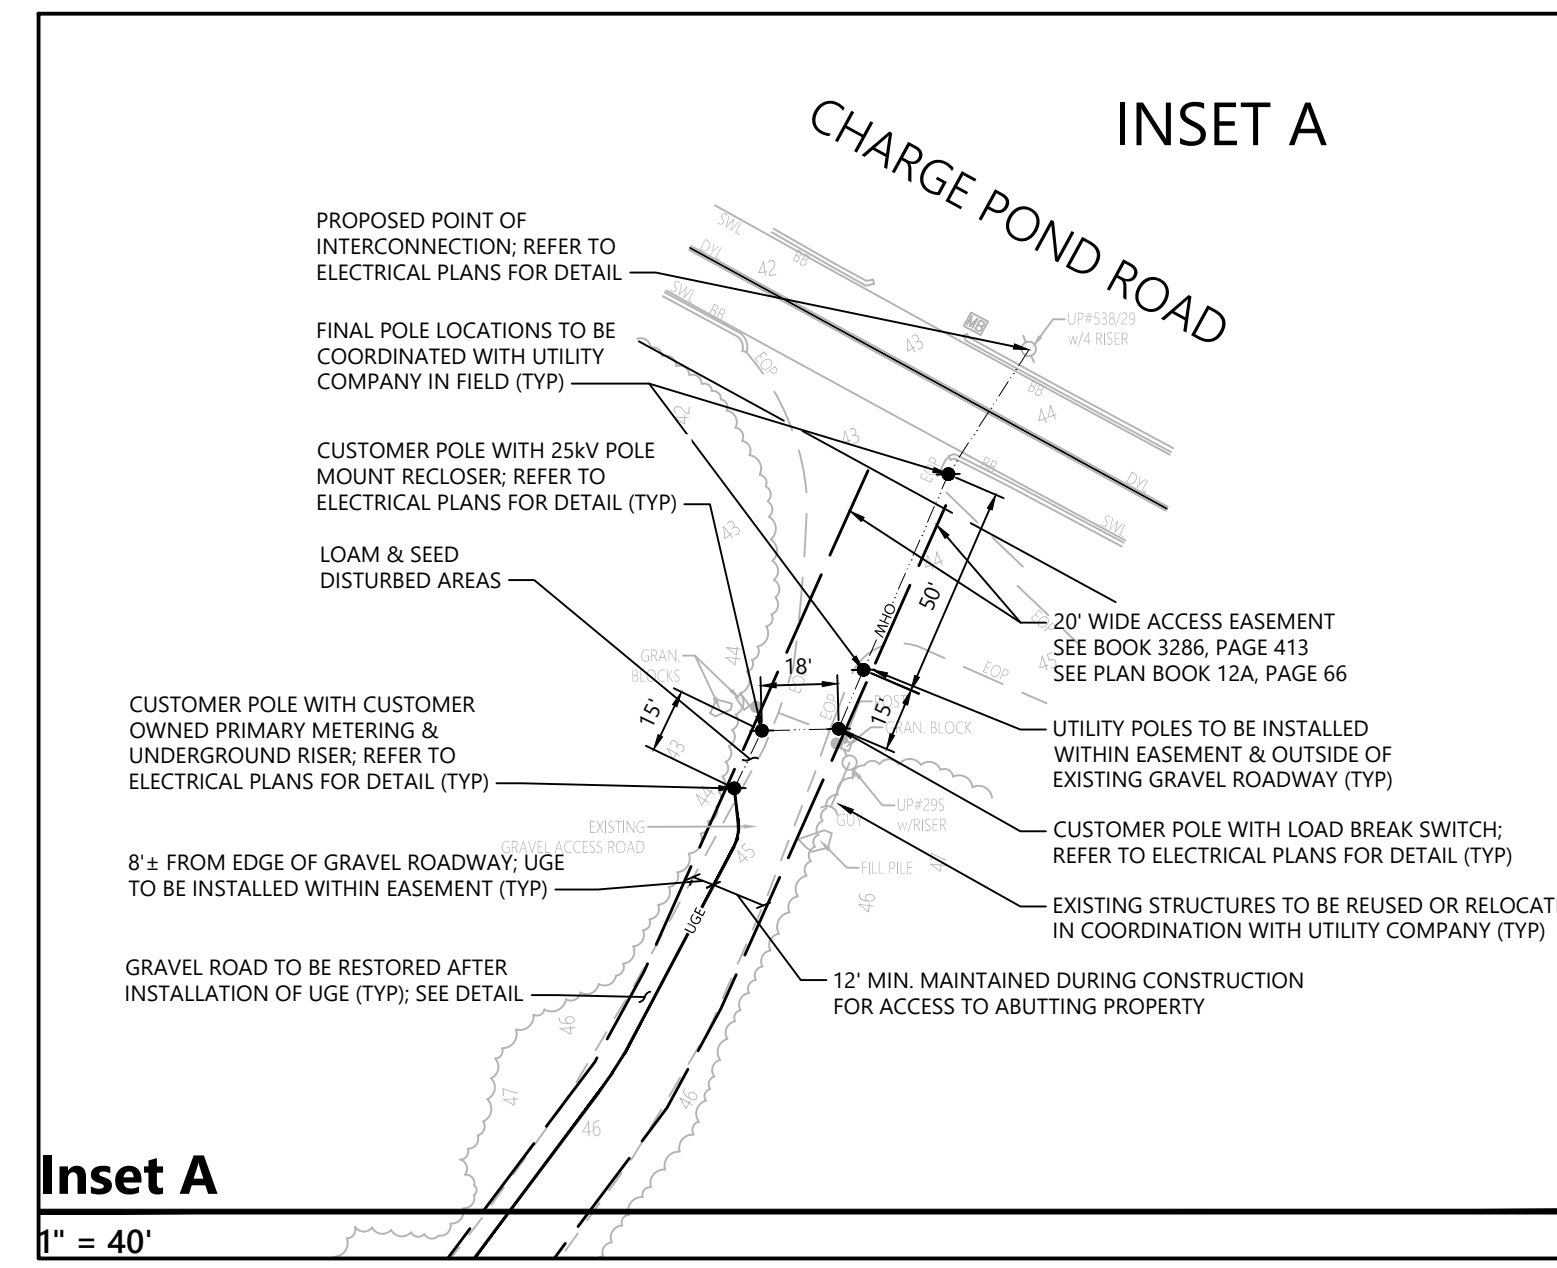

**Key**

Not To Scale




**Proposed Large-Scale Ground-Mounted Solar Photovoltaic Installation**  
0 Route 25  
Wareham, MA

No.	Revision	Date	App'd
1	Response to Comments	05/25/2022	SKE
2	Buffer Zone Adjustments	06/13/2022	SKE
3	Buffer Zone Adjustments	11/16/2022	SKE
4	Planning Board Comments	12/22/2022	SKE
5	Electrical Equipment Pad Adjustment	01/20/2023	SKE

Designed by: **SKE** Checked by: **JRG**  
Issued for: **Local Approvals** Date: **August 2, 2021**

**Layout, Grading, Drainage, and Erosion Control Plan**


Drawing Number: **C2.02**  
Sheet: **4** of **7**  
Project Number: **15225.01**  
Date: **1/20/2023**

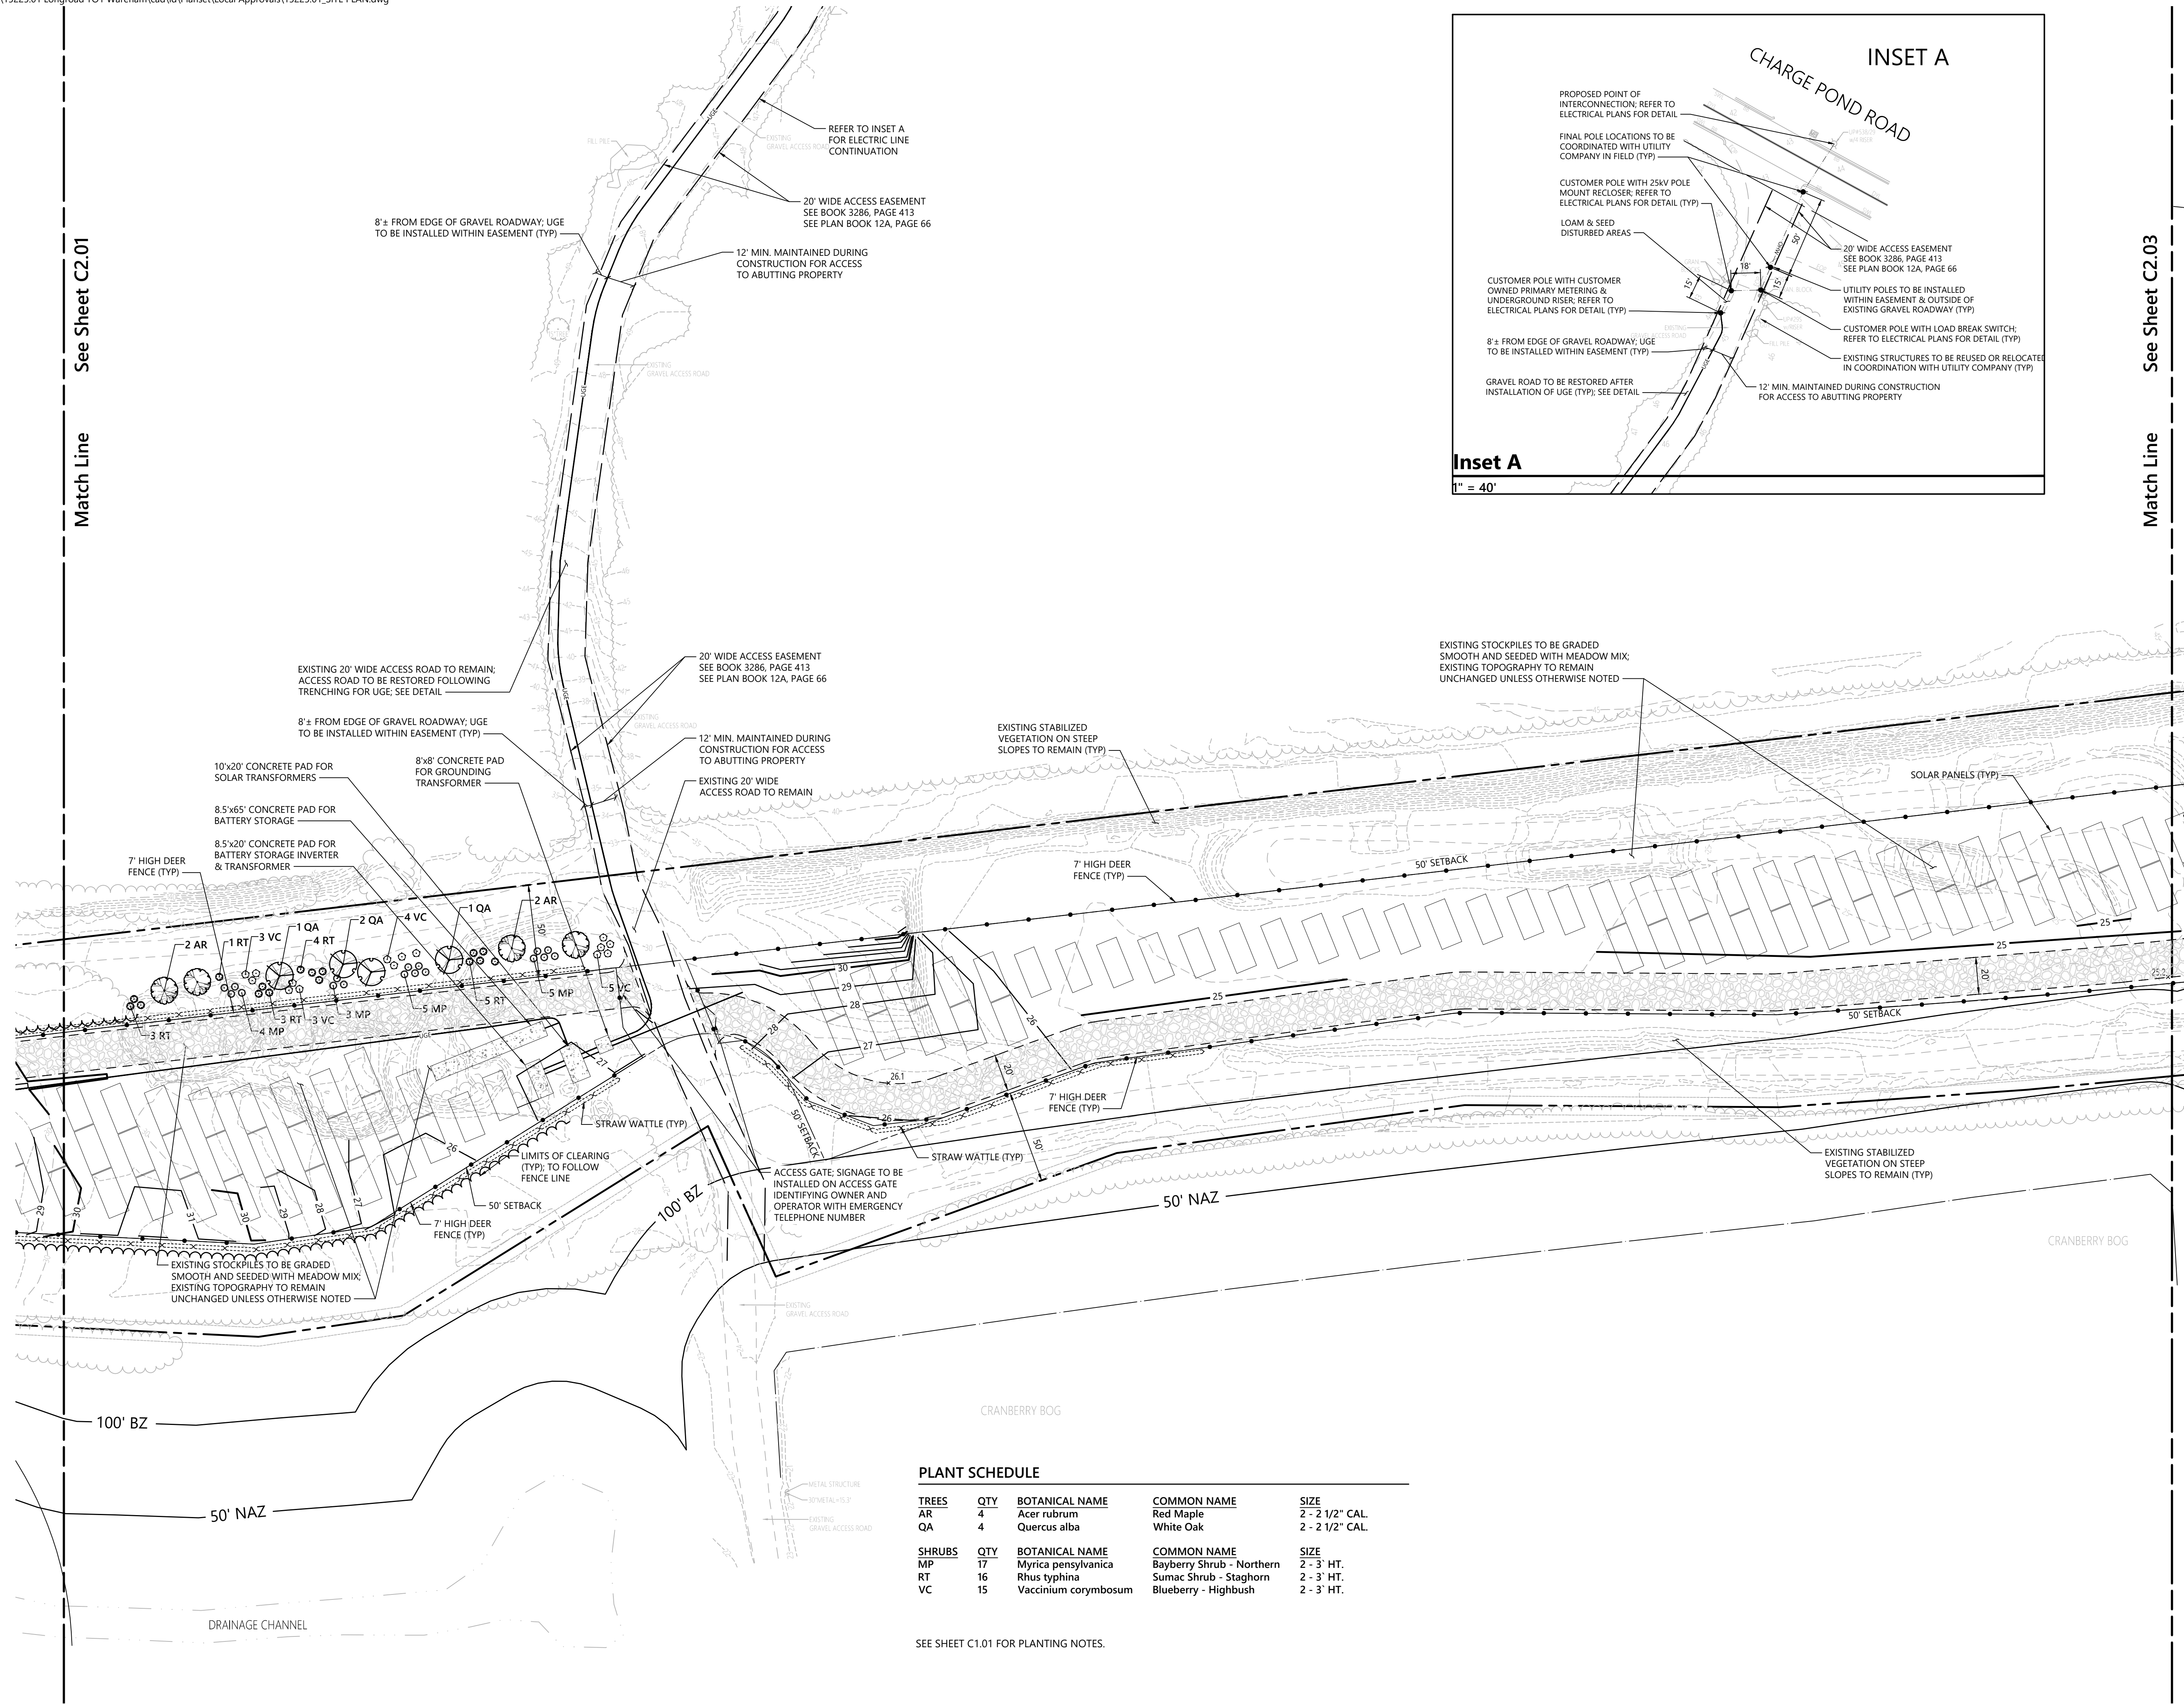


**PLANT SCHEDULE**

TREES	QTY	BOTANICAL NAME	COMMON NAME	SIZE
AR	4	Acer rubrum	Red Maple	2 - 2 1/2" CAL.
QA	4	Quercus alba	White Oak	2 - 2 1/2" CAL.
SHRUBS	QTY	BOTANICAL NAME	COMMON NAME	SIZE
MP	17	Myrica pensylvanica	Bayberry Shrub - Northern	2 - 3' HT.
RT	16	Rhus typhina	Sumac Shrub - Staghorn	2 - 3' HT.
VC	15	Vaccinium corymbosum	Blueberry - Highbush	2 - 3' HT.

SEE SHEET C1.01 FOR PLANTING NOTES.

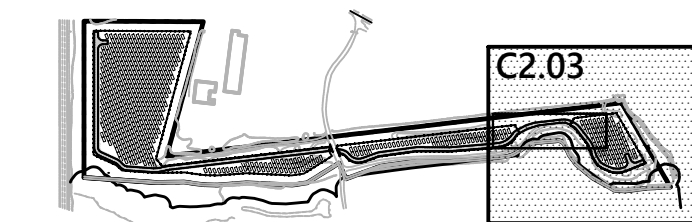

**Key**  
Not To Scale

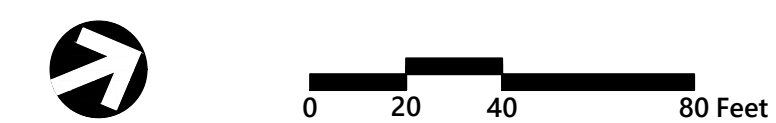

**Proposed Large-Scale  
Ground-Mounted Solar  
Photovoltaic Installation**  
0 Route 25  
Wareham, MA

No.	Revision	Date	Appr'd
1	Response to Comments	05/25/2022	SKE
2	Buffer Zone Adjustments	06/13/2022	SKE
3	Buffer Zone Adjustments	11/16/2022	SKE

Designed by: SKE  
Checked by: JRG  
Issued for: Local Approvals  
Date: August 2, 2021

**Layout, Grading,  
Drainage, and Erosion  
Control Plan**





C2.03

Sheet 5 of 7

1/20/2023  
Project Number: 15225.01

See Sheet C2.02  
Match Line

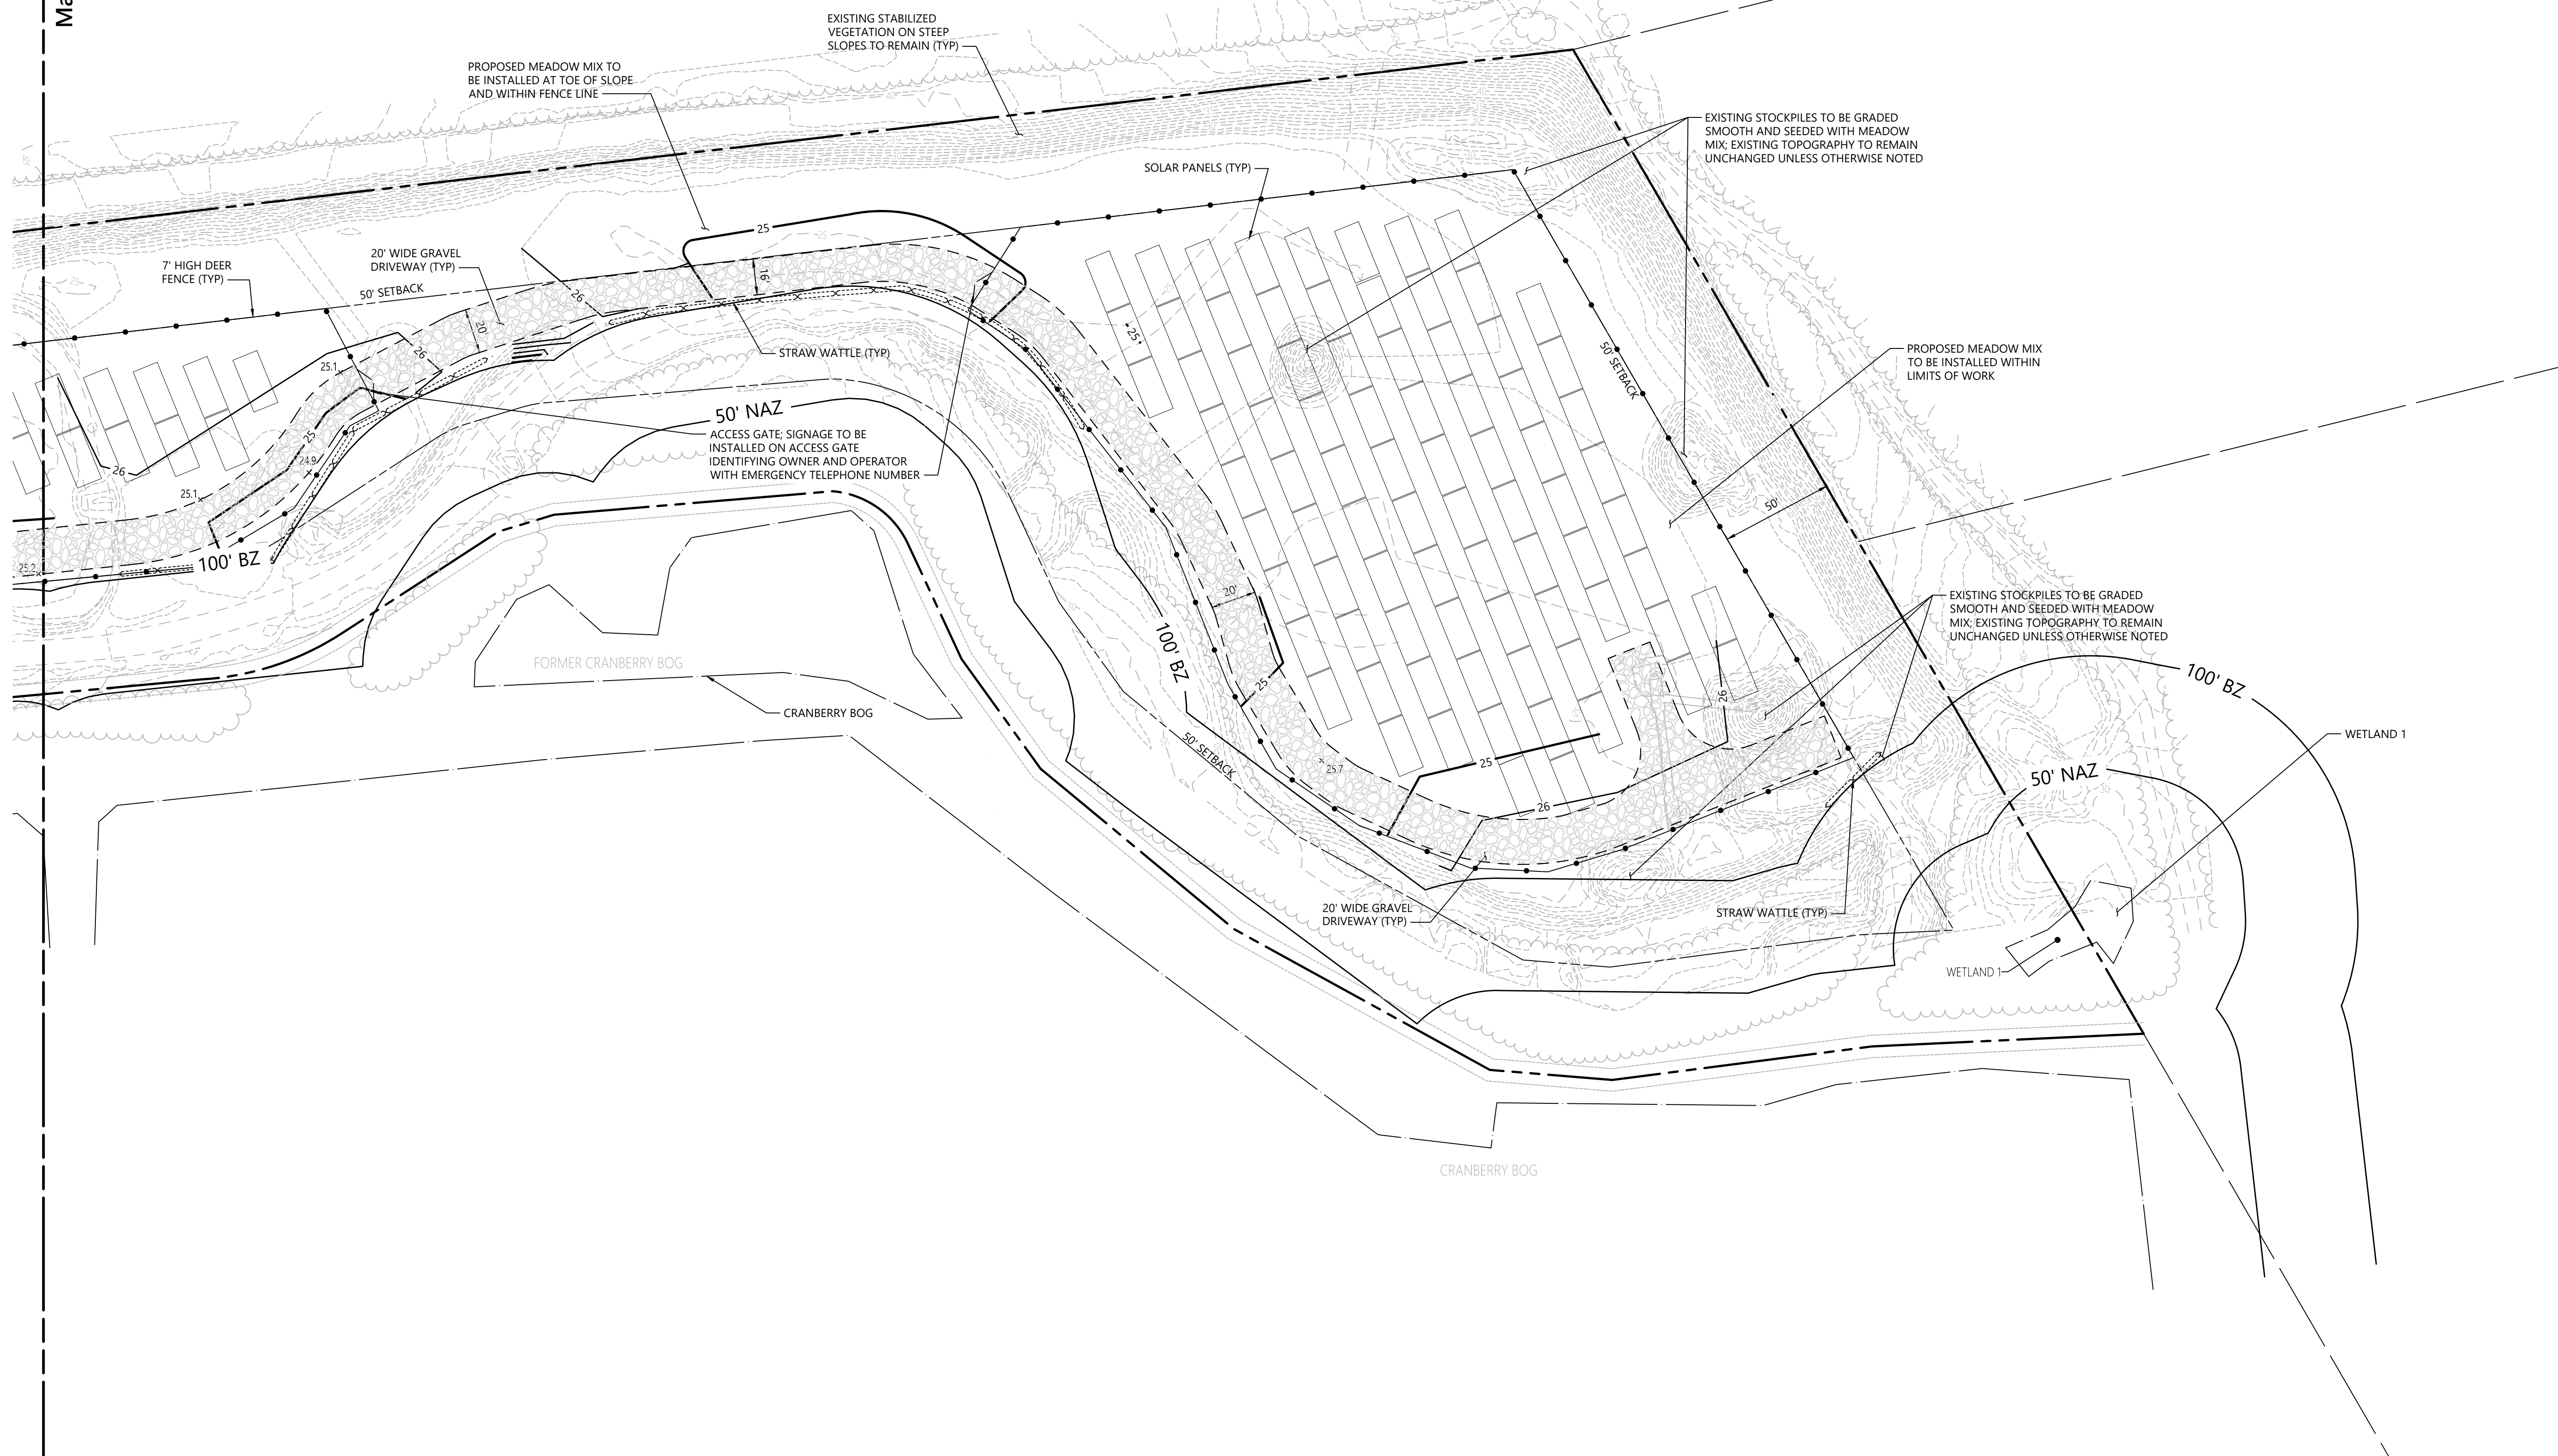

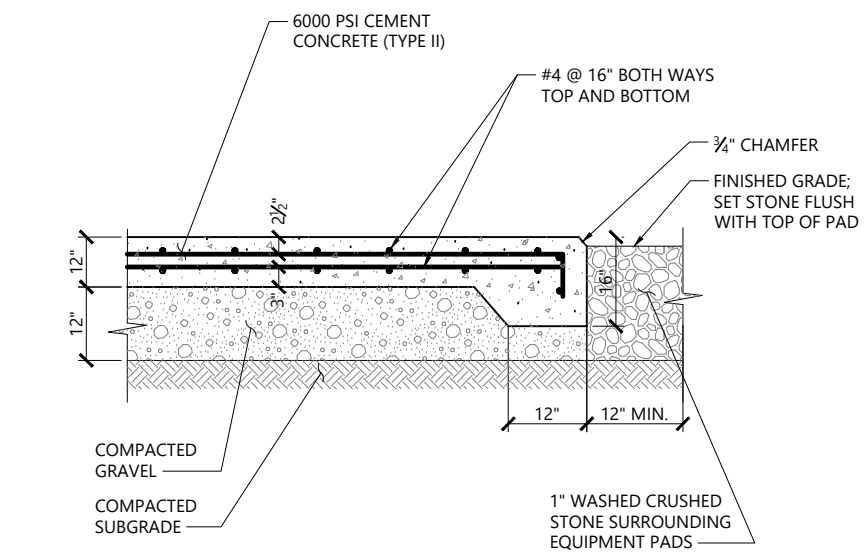

- NOTES**
1. SIZE OF EQUIPMENT PAD TO BE AS INDICATED ON PLANS.
  2. CONSTRUCTION JOINTS SHALL BE SPACED NO MORE THAN 30 FEET ON CENTER AND SHALL BE EQUALLY SPACED OVER THE LENGTH AND WIDTH OF THE PAD.
  3. SHOWN FOR REFERENCE; FINAL PAD DESIGN TO BE PROVIDED PRIOR TO CONSTRUCTION


**SPECIFICATIONS**

1. GRAVEL SHALL CONSIST OF INERT MATERIAL THAT IS HARD, DURABLE STONE AND COARSE SAND, FREE FROM LOAM, CLAY, SURFACE COATINGS AND DELETERIOUS MATERIALS, AND SHALL CONFORM TO THE FOLLOWING GRADATION:

Sieve (ASTM D421)	Percent Passing by Weight
No. 10	100
No. 20	90
No. 40	75
No. 60	55
No. 100	35
No. 200	10


\* Three (3) inches when placed as subgrade within four (4) feet below pavements and also (MassDOT Specifications M1.03.0) Type 10 and one-half inches (1/2") when placed as pavement base and pipe bedding and under top to 24 inches above pipe (MassDOT Specifications M1.03.0 Type 40 and above two inch (2") base (3/4" thickness).

**Concrete Pad** 1/16  
N.T.S. Source: VHB LD\_712A

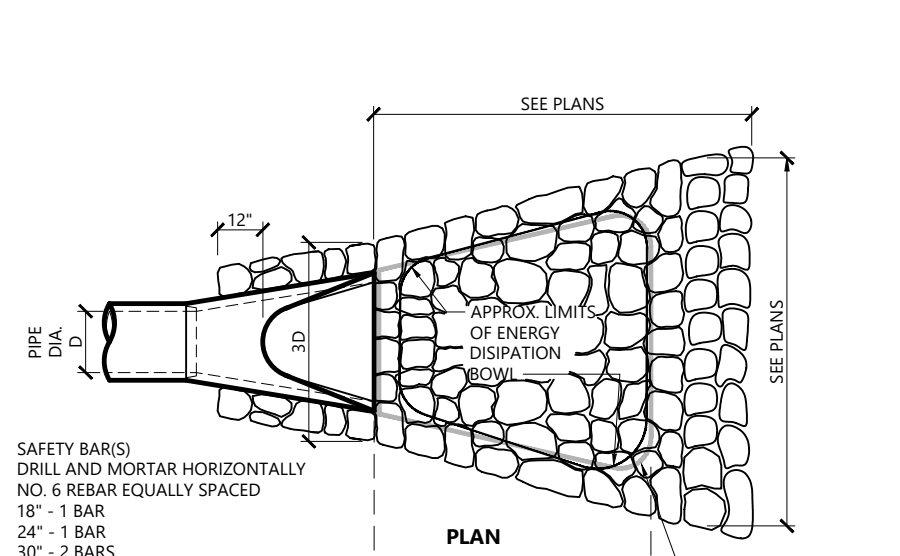


- PLAN**
- SAFETY BARS: DRILL AND MORTAR HORIZONTALLY NO. 4 REBAR EQUALLY SPACED  
18" - 1 BAR  
24" - 1 BAR  
30" - 2 BARS  
36" - 2 BARS  
48" - 3 BARS
- NOTES: SAFETY BARS TO BE OMITTED WHERE INDICATED ON PLANS.
- APPROXIMATE LIMIT OF ENERGY DISSIPATION BOWL
- APPROX. EDGE TO BE SET LEVEL WITH FLARED END INVERT ELEVATION (TYP.)
- PRECAST CONCRETE FLARED END SECTION  
SLOPE 1:1 (MAX)
- STONE FOR PIPE ENDS
- MEDIAN STONE SIZE: 6" MAXIMUM STONE SIZE: 9"
- FINISH GRADE
- ENERGY DISSIPATION BOWL
- FILTER FABRIC
- CRUSHED STONE BEDDING (2" STONE SIZE)
- COMPACTED SUBGRADE

**Flared End Section (FES) with Stone Protection** 3/19  
N.T.S. Source: VHB REV LD\_134

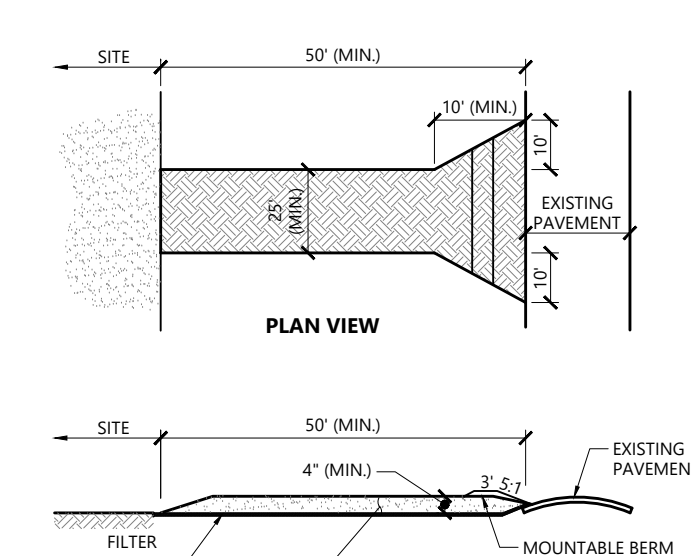


- CROSS-SECTION**
- NOTES**
1. EXIT WIDTH SHALL BE A TWENTY-FIVE (25) FOOT MINIMUM, BUT NOT LESS THAN THE FULL WIDTH AT POINTS WHERE INGRESS OR EGRESS OCCURS.
  2. THE EXIT SHALL BE MAINTAINED IN A CONDITION WHICH SHALL PREVENT TRACKING OR BLOWING OF SEDIMENT ONTO PUBLIC RIGHTS-OF-WAY. THIS MAY REQUIRE PERIODIC TOP PRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND AND REPAIR OR CLEANOUT OF ANY MEASURES USED TO TRAP SEDIMENT. ALL SEDIMENT SPILLED, DROPPED, WASHED OR TRACKED ONTO PUBLIC RIGHTS-OF-WAY MUST BE REMOVED IMMEDIATELY. REPAIR SHALL BE PERMITTED. PERIODIC INSPECTION AND MAINTENANCE SHALL BE PROVIDED AS NEEDED.
  3. STABILIZED CONSTRUCTION EXIT SHALL BE REMOVED PRIOR TO FINAL FINISH MATERIALS BEING INSTALLED.

**Stabilized Construction Exit** 1/16  
N.T.S. Source: VHB LD\_682

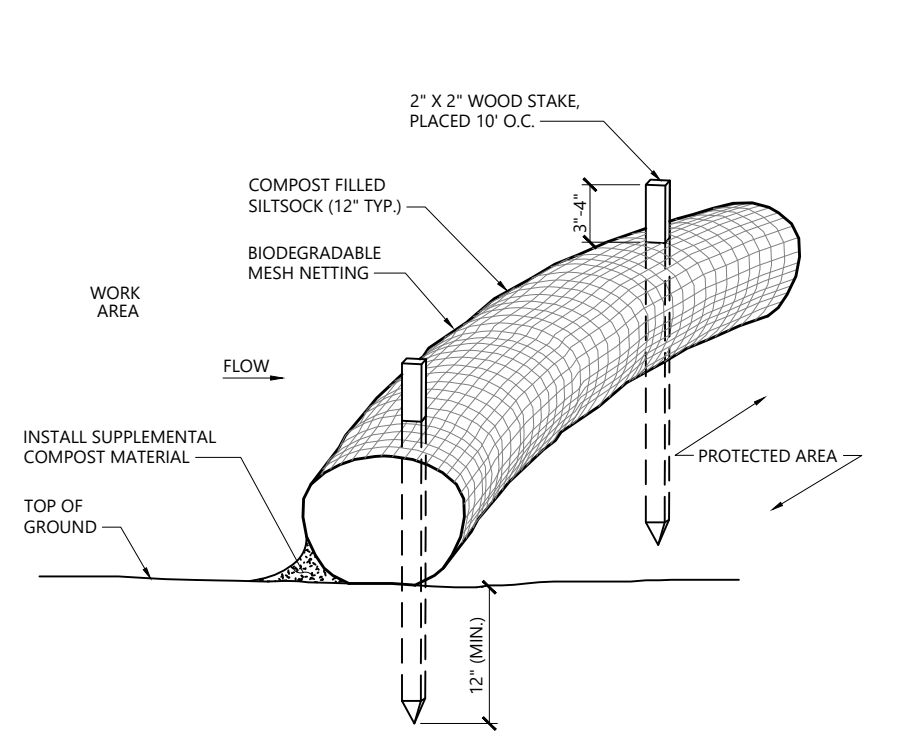


- NOTES**
1. SILT SOCK SHALL BE FILTEREXX SILT SOCK, OR APPROVED EQUAL.
  2. SILT SOCKS SHALL OVERLAP A MINIMUM OF 12 INCHES.
  3. SILT SOCK SHALL BE INSPECTED PERIODICALLY AND AFTER ALL STORM EVENTS, AND REPAIR OR REPLACEMENT SHALL BE PERFORMED PROMPTLY AS NEEDED.
  4. COMPOST MATERIAL SHALL BE DISPERSED ON SITE, AS DETERMINED BY THE ENGINEER.
  5. IF NON BIODEGRADABLE NETTING IS USED THE NETTING SHALL BE COLLECTED AND DISPOSED OF OFFSITE.

**Silt sock - Sediment Control Barrier** 1/16  
N.T.S. Source: VHB REV LD\_658

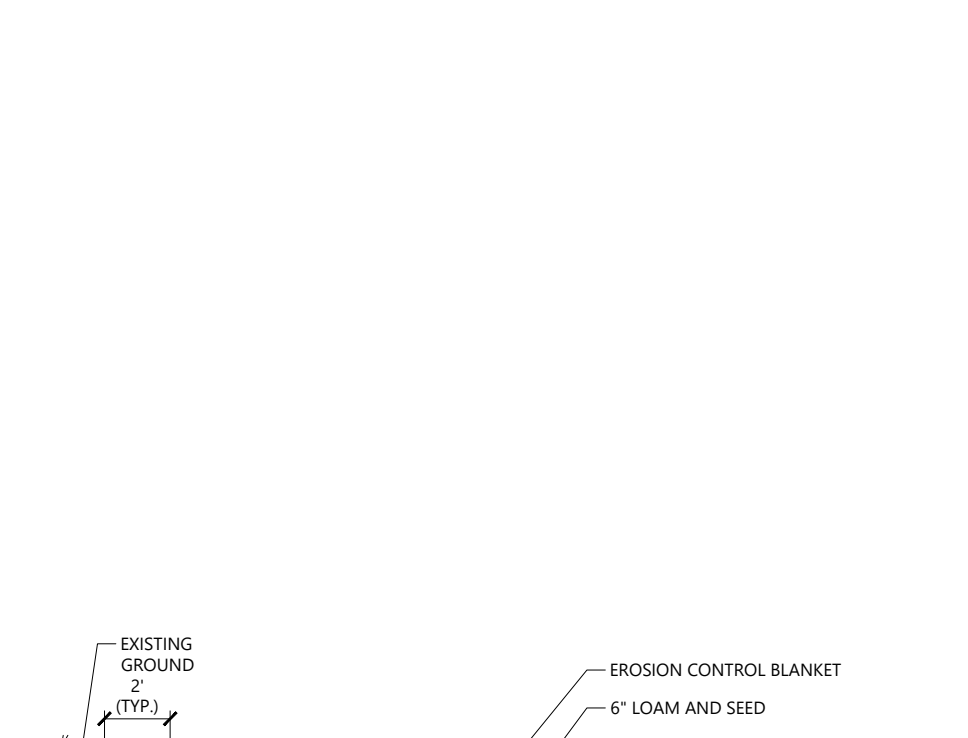


- NOTES**
1. GRAVEL ACCESS ROAD SHALL HAVE A SURFACE BEARING CAPACITY OF 20,000 LBS. (MIN).
  2. STONE MATRESS TO BE INSTALLED AS NEEDED TO PROVIDE FOR ADEQUATE DRAINAGE OF SURFACE RUNOFF AND PREVENT EROSION.
  3. DETAIL TO BE USED FOR INTERNAL ACCESS DRIVE THROUGHOUT SITE AS WELL AS RECONSTRUCTION OF GRAVEL ROAD WITHIN ACCESS EASEMENT TO CHARGE POND ROAD.


**Grassed Swale** 1/16  
N.T.S. Source: VHB REV LD\_171

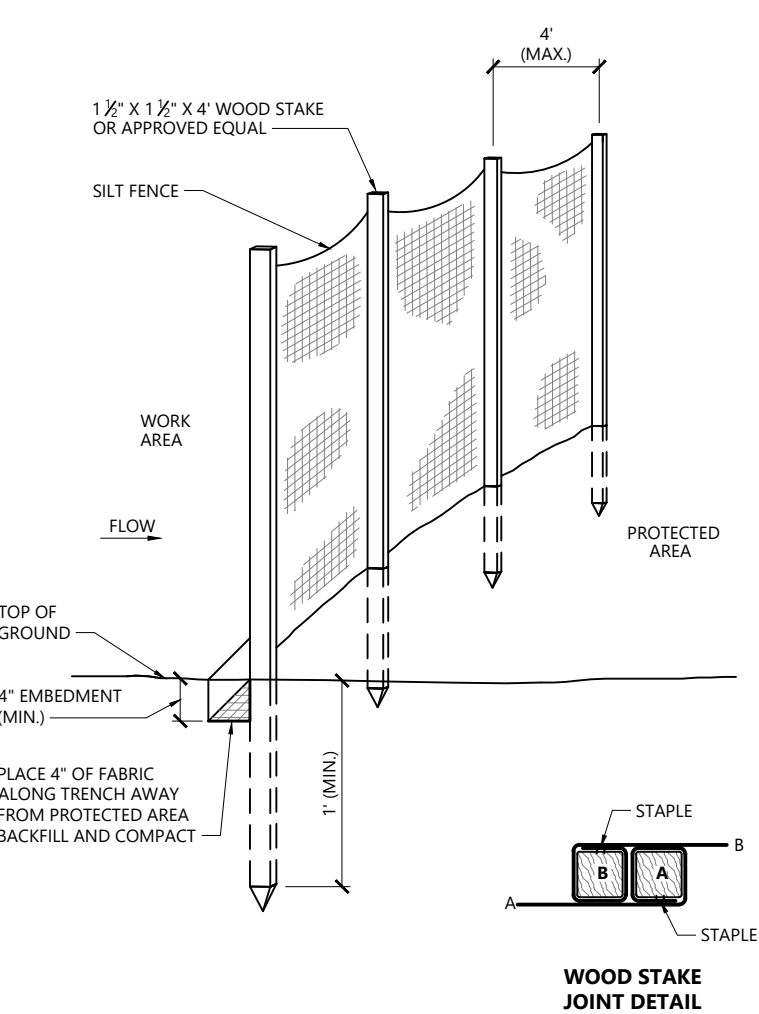

**Silt Fence Barrier** 1/16  
N.T.S. Source: VHB LD\_650

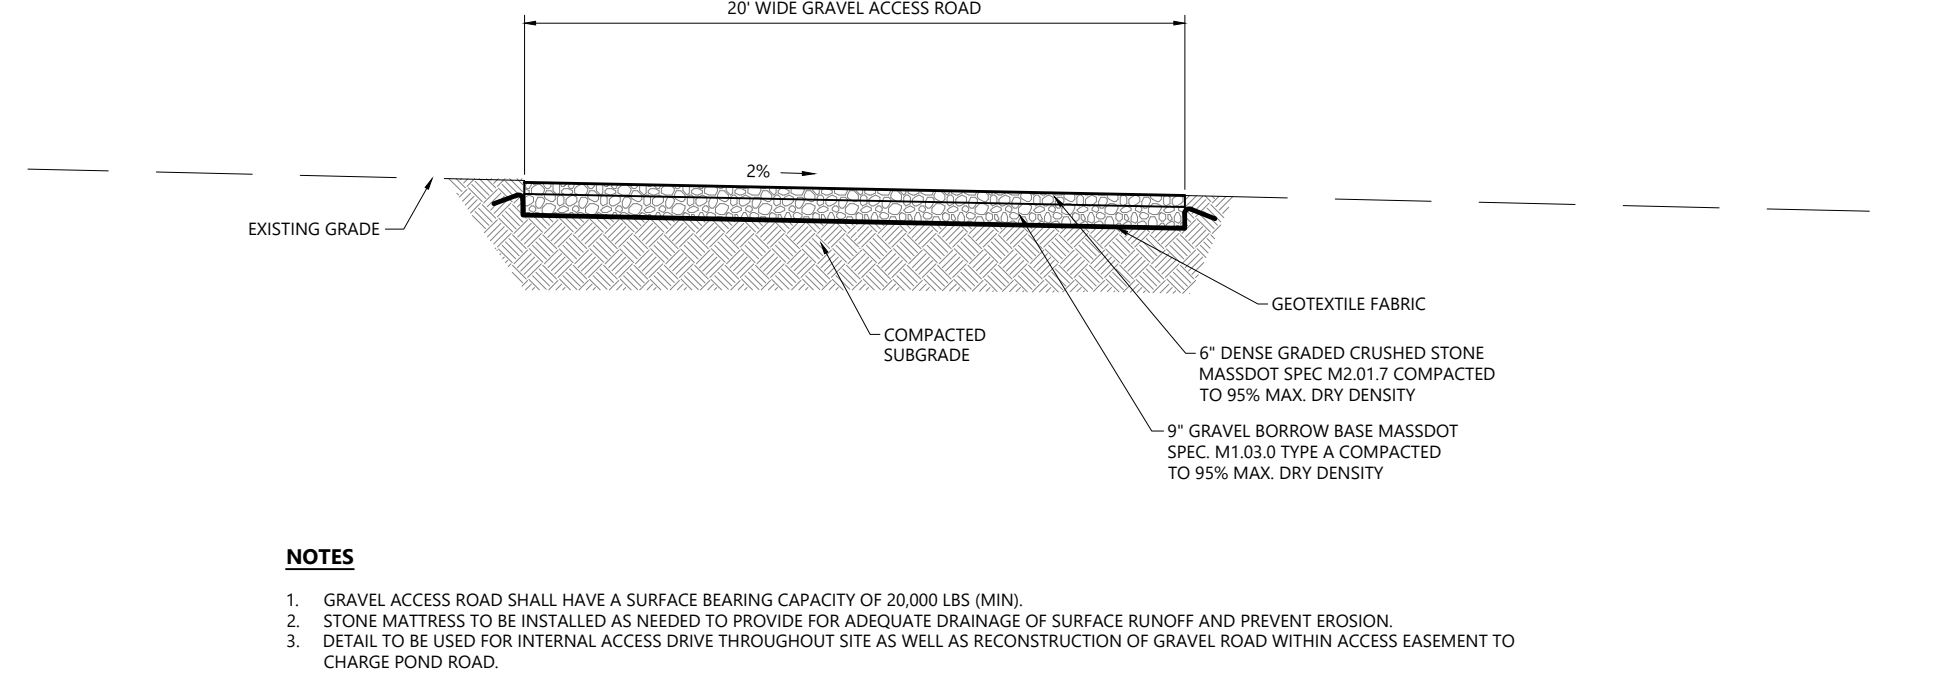


**Gravel Access Road - Typical Section** 1/16  
N.T.S. Source: VHB

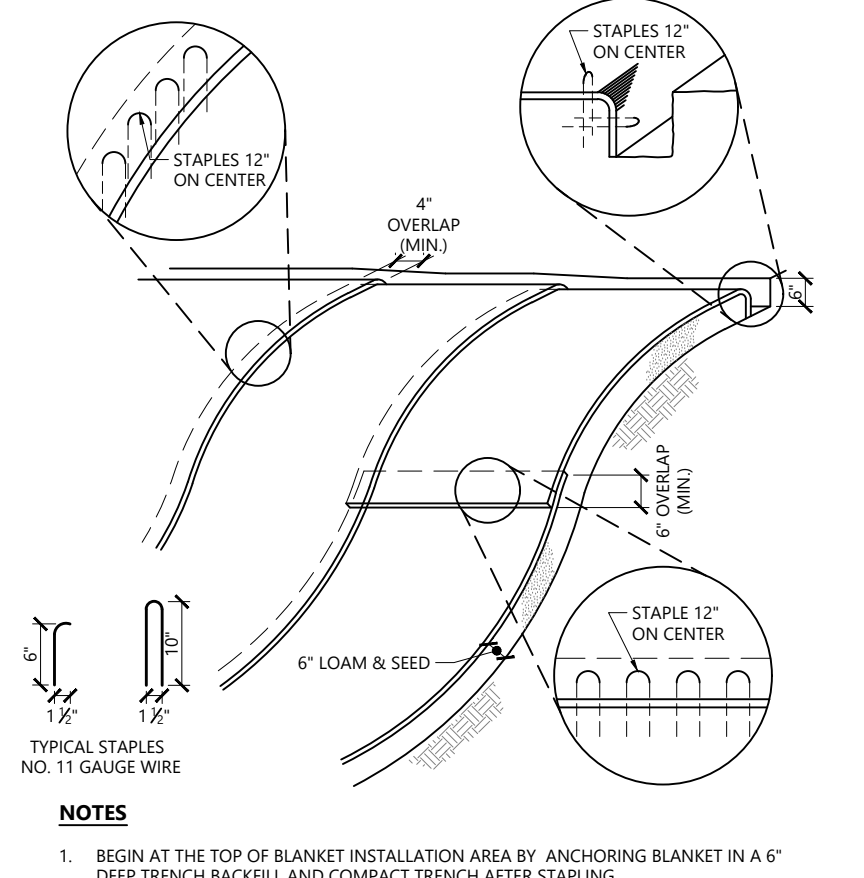


- NOTES**
1. BEGIN AT THE TOP OF BLANKET INSTALLATION AREA BY ANCHORING BLANKET IN A 6" DEEP TRENCH BACKFILL AND COMPACT TRENCH AFTER STAPLING.
  2. ROLL THE BLANKET DOWN THE SWALE IN THE DIRECTION OF THE WATER FLOW.
  3. THE EDGES OF BLANKETS MUST BE STAPLED WITH APPROX. 4 INCH OVERLAP WHERE 2 OR MORE STRIP WIDTHS ARE REQUIRED.
  4. WHEN BLANKETS MUST BE SPICED DOWN THE SWALE, PLACE UPPER BLANKET END OVER LOWER END WITH 6 INCH (MIN) OVERLAP AND STAPLE BOTH TOGETHER.
  5. METHOD OF INSTALLATION SHALL BE AS PER MANUFACTURER'S RECOMMENDATIONS.
  6. EROSION CONTROL BLANKETS SHALL BE USED IN ALL AREAS WHERE SLOPES EXCEED 3:1.

**Erosion Control Blanket Slope Installation** 1/16  
N.T.S. Source: VHB LD\_680

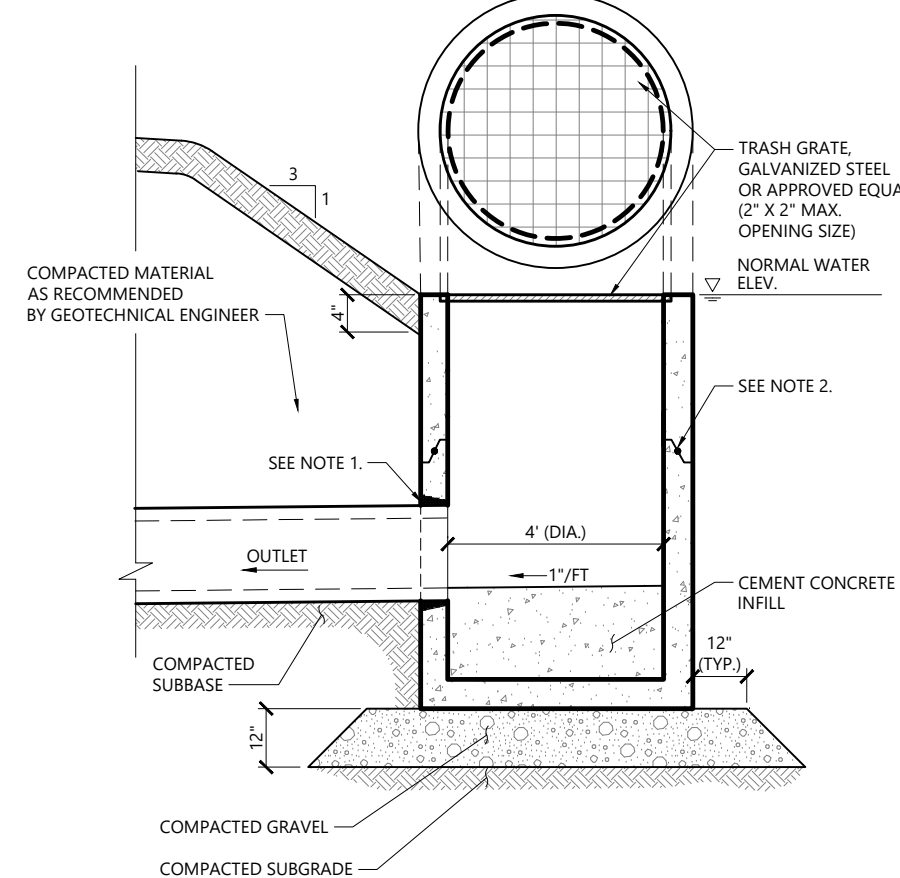


- NOTES**
1. PROVIDE OPENINGS FOR PIPES WITH 2" MAX. CLEARANCE TO OUTSIDE OF PIPE. MORTAR ALL PIPE CONNECTIONS.
  2. JOINT SEALANT BETWEEN PRECAST SECTIONS SHALL BE PERFORMED BUTYL RUBBER.

**Outlet Control Structure** 1/16  
N.T.S. Source: VHB LD\_163

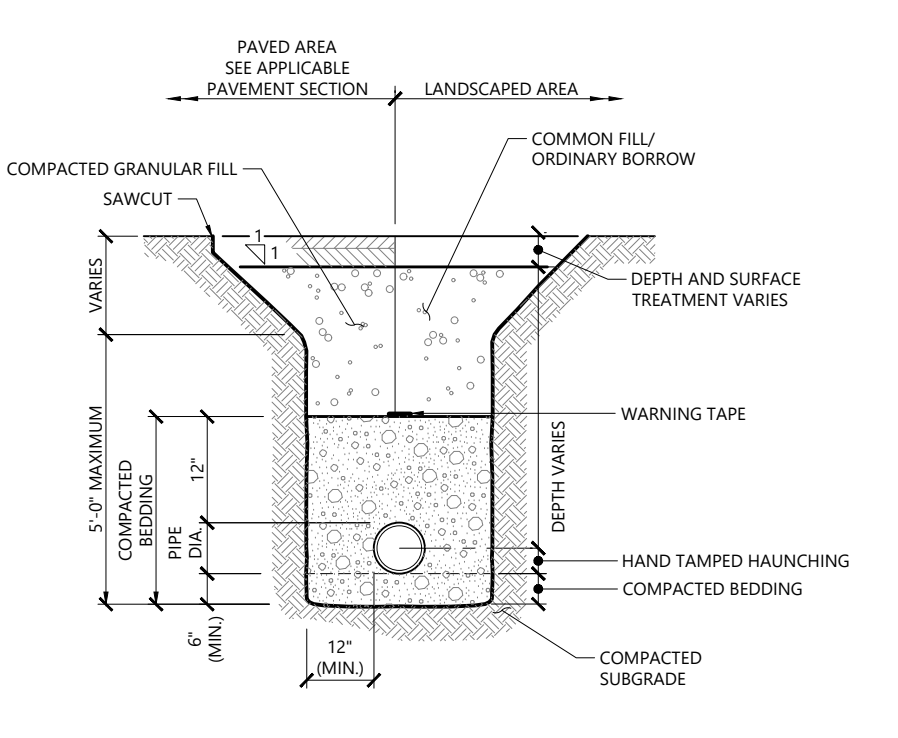

- NOTES**
1. WHERE UTILITY TRENCHES ARE CONSTRUCTED THROUGH DETENTION BASIN BERMS OR OTHER SUCH SPECIAL SECTIONS, PLACE TRENCH BACKFILL WITH MATERIALS SIMILAR TO THE SPECIAL SECTION REQUIREMENTS.
  2. USE METALLIC TRACING/WARNING TAPE OVER ALL PIPES.

**Utility Trench** 1/16  
N.T.S. Source: VHB LD\_300

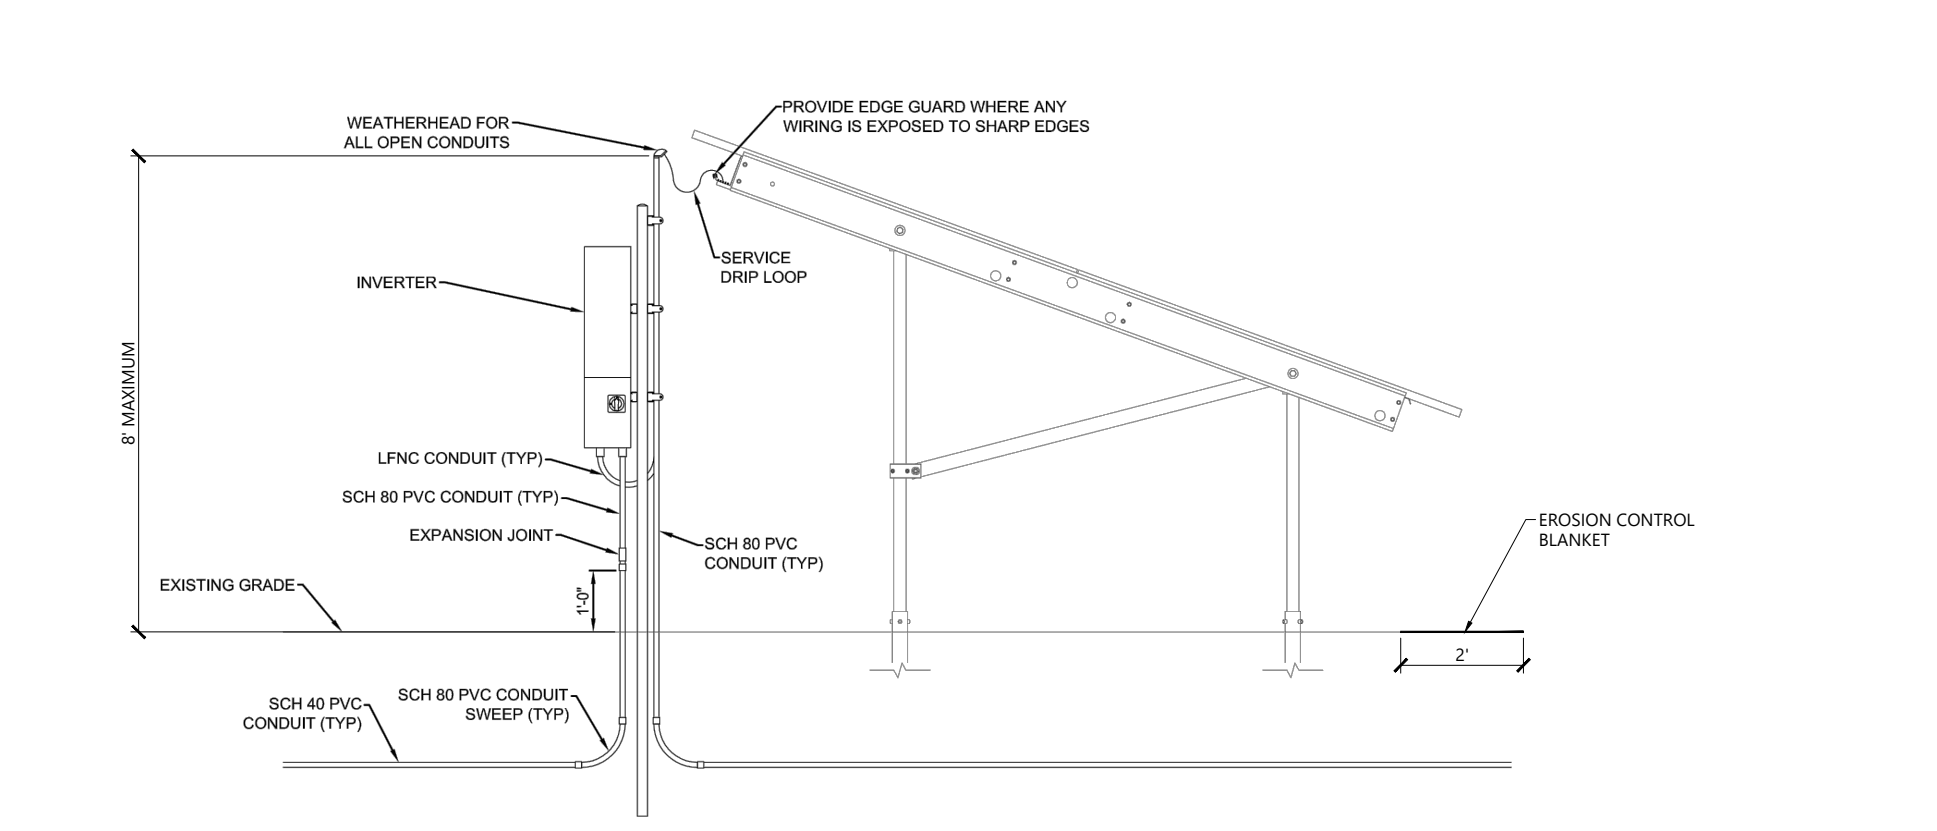


**Inverter and Array Detail (Side)** 1/16  
N.T.S. Source: Ameresco Inc.

**Proposed Large-Scale Ground-Mounted Solar Photovoltaic Installation**  
0 Route 25  
Wareham, MA


No.	Revision	Date	Appr'd
1	Response to Comments	05/25/2022	SKE
2	Buffer Zone Adjustments	11/16/2022	SKE
3	Planning Board Comments	12/22/2022	SKE

Designed by **SKE** Checked by **JRG**  
Issued for **Local Approvals** Date **August 2, 2021**

**Site Details**



**C3.01**  
Sheet 6 of 7  
Project Number 15225.01  
1/20/2023

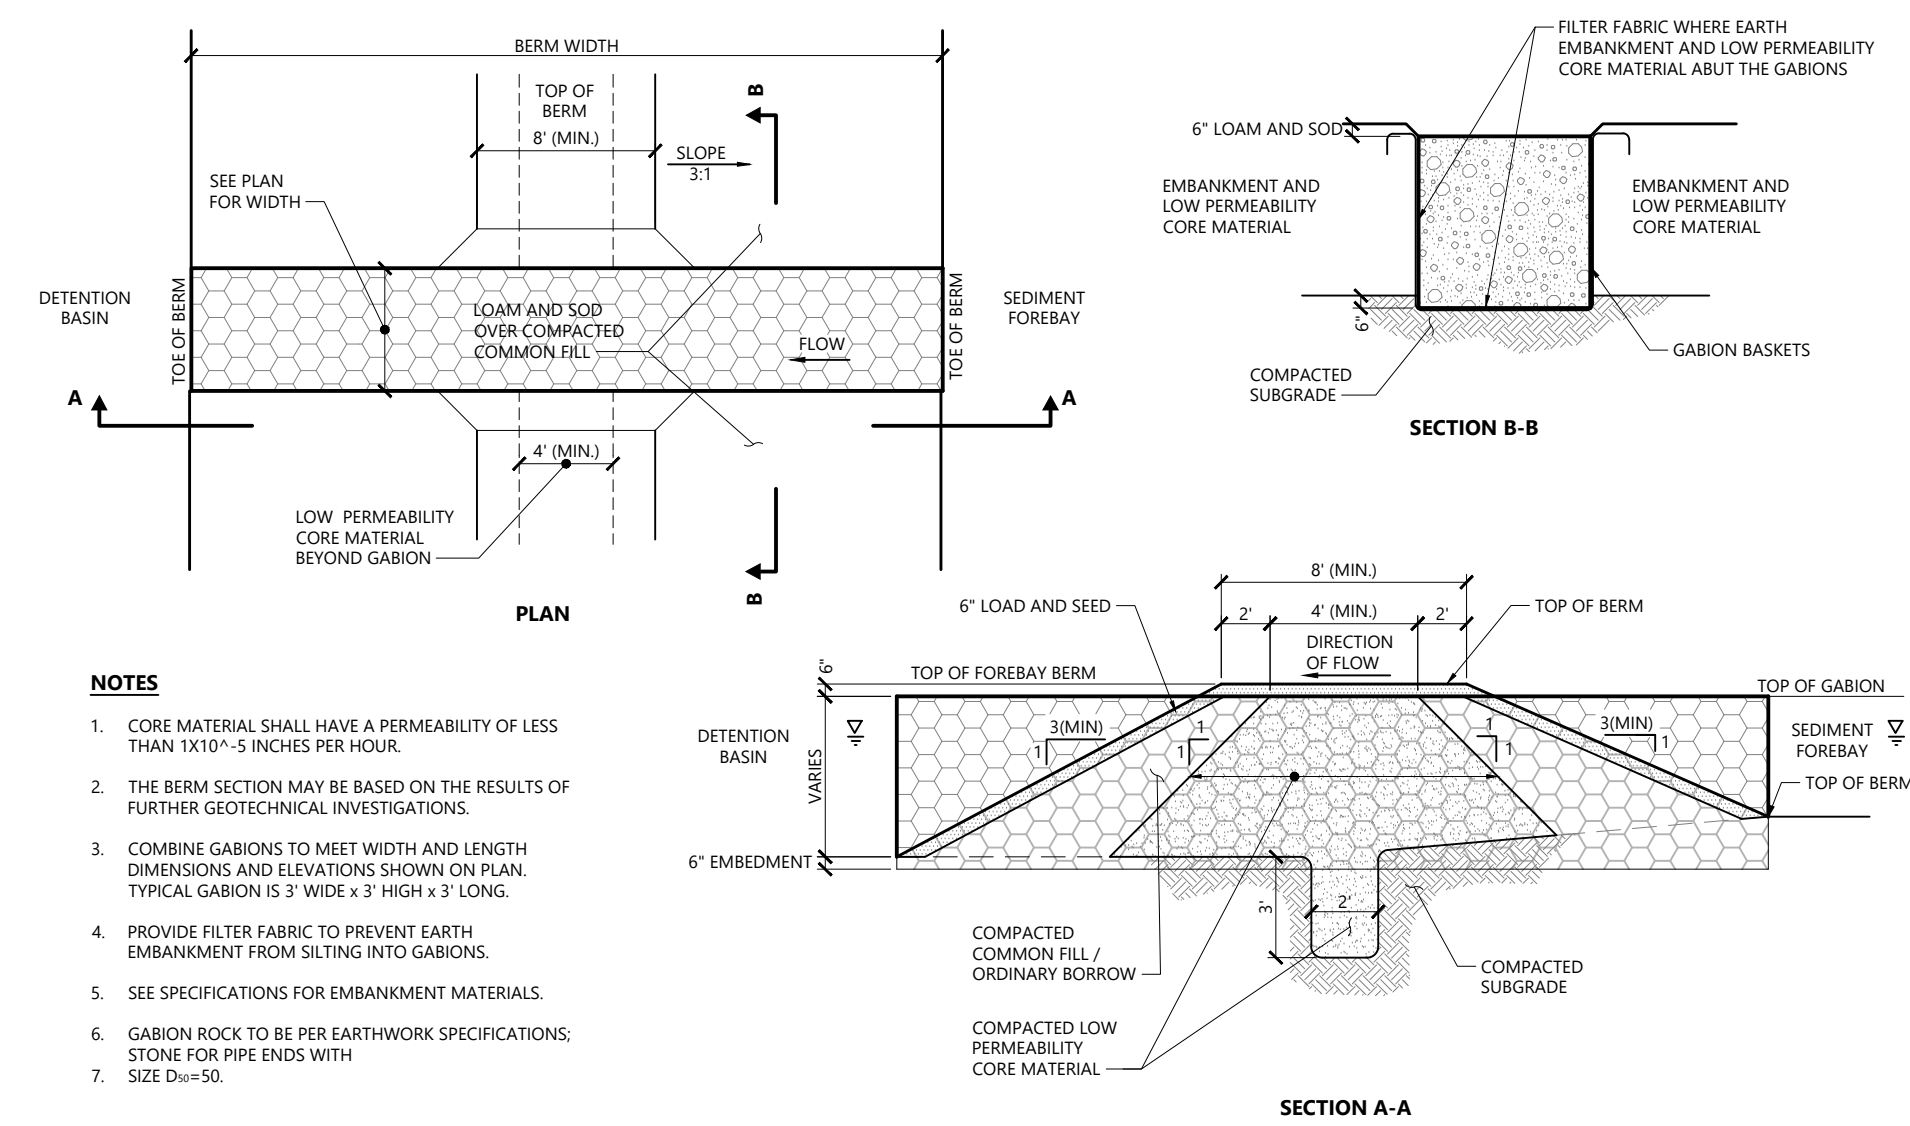


- NOTES**
- CORE MATERIAL SHALL HAVE A PERMEABILITY OF LESS THAN 1X10<sup>-5</sup> INCHES PER HOUR.
  - THE BERM SECTION MAY BE BASED ON THE RESULTS OF FURTHER GEOTECHNICAL INVESTIGATIONS.
  - COMBINE GABIONS TO MEET WIDTH AND LENGTH DIMENSIONS AND ELEVATIONS SHOWN ON PLAN. TYPICAL GABION IS 3' WIDE x 3' HIGH x 3' LONG.
  - PROVIDE FILTER FABRIC TO PREVENT EARTH EMBANKMENT FROM SILTING INTO GABIONS.
  - SEE SPECIFICATIONS FOR EMBANKMENT MATERIALS.
  - GABION ROCK TO BE PER EARTH-WORK SPECIFICATIONS. STONE FOR PIPE ENDS WITH SIZE D<sub>50</sub>.

**Sediment Forebay Berm**

N.T.S.

Source: VHB

1/16  
LD\_164

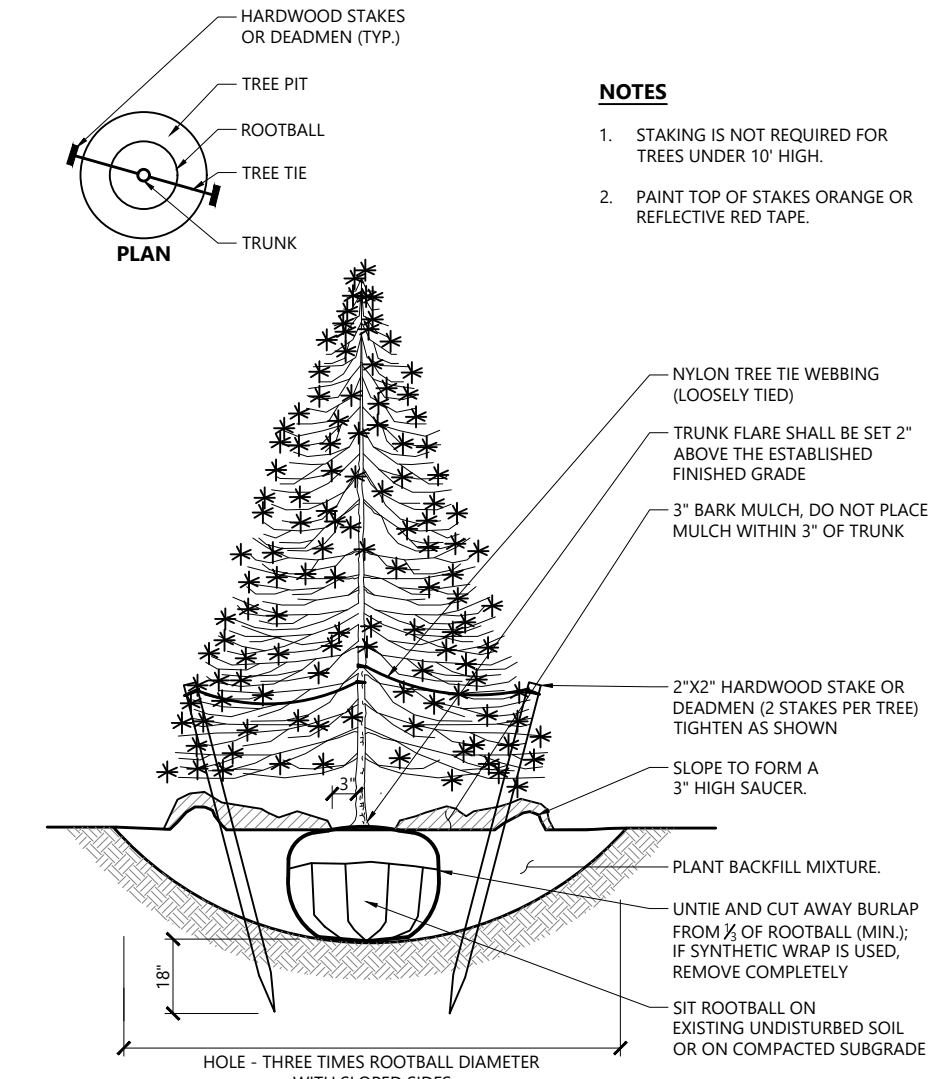


- NOTES**
- STAKING IS NOT REQUIRED FOR TREES UNDER 10' HIGH.
  - PAINT TOP OF STAKES ORANGE OR REFLECTIVE RED TAPE.

**Evergreen Tree Planting**

N.T.S.

Source: VHB

1/16  
LD\_604

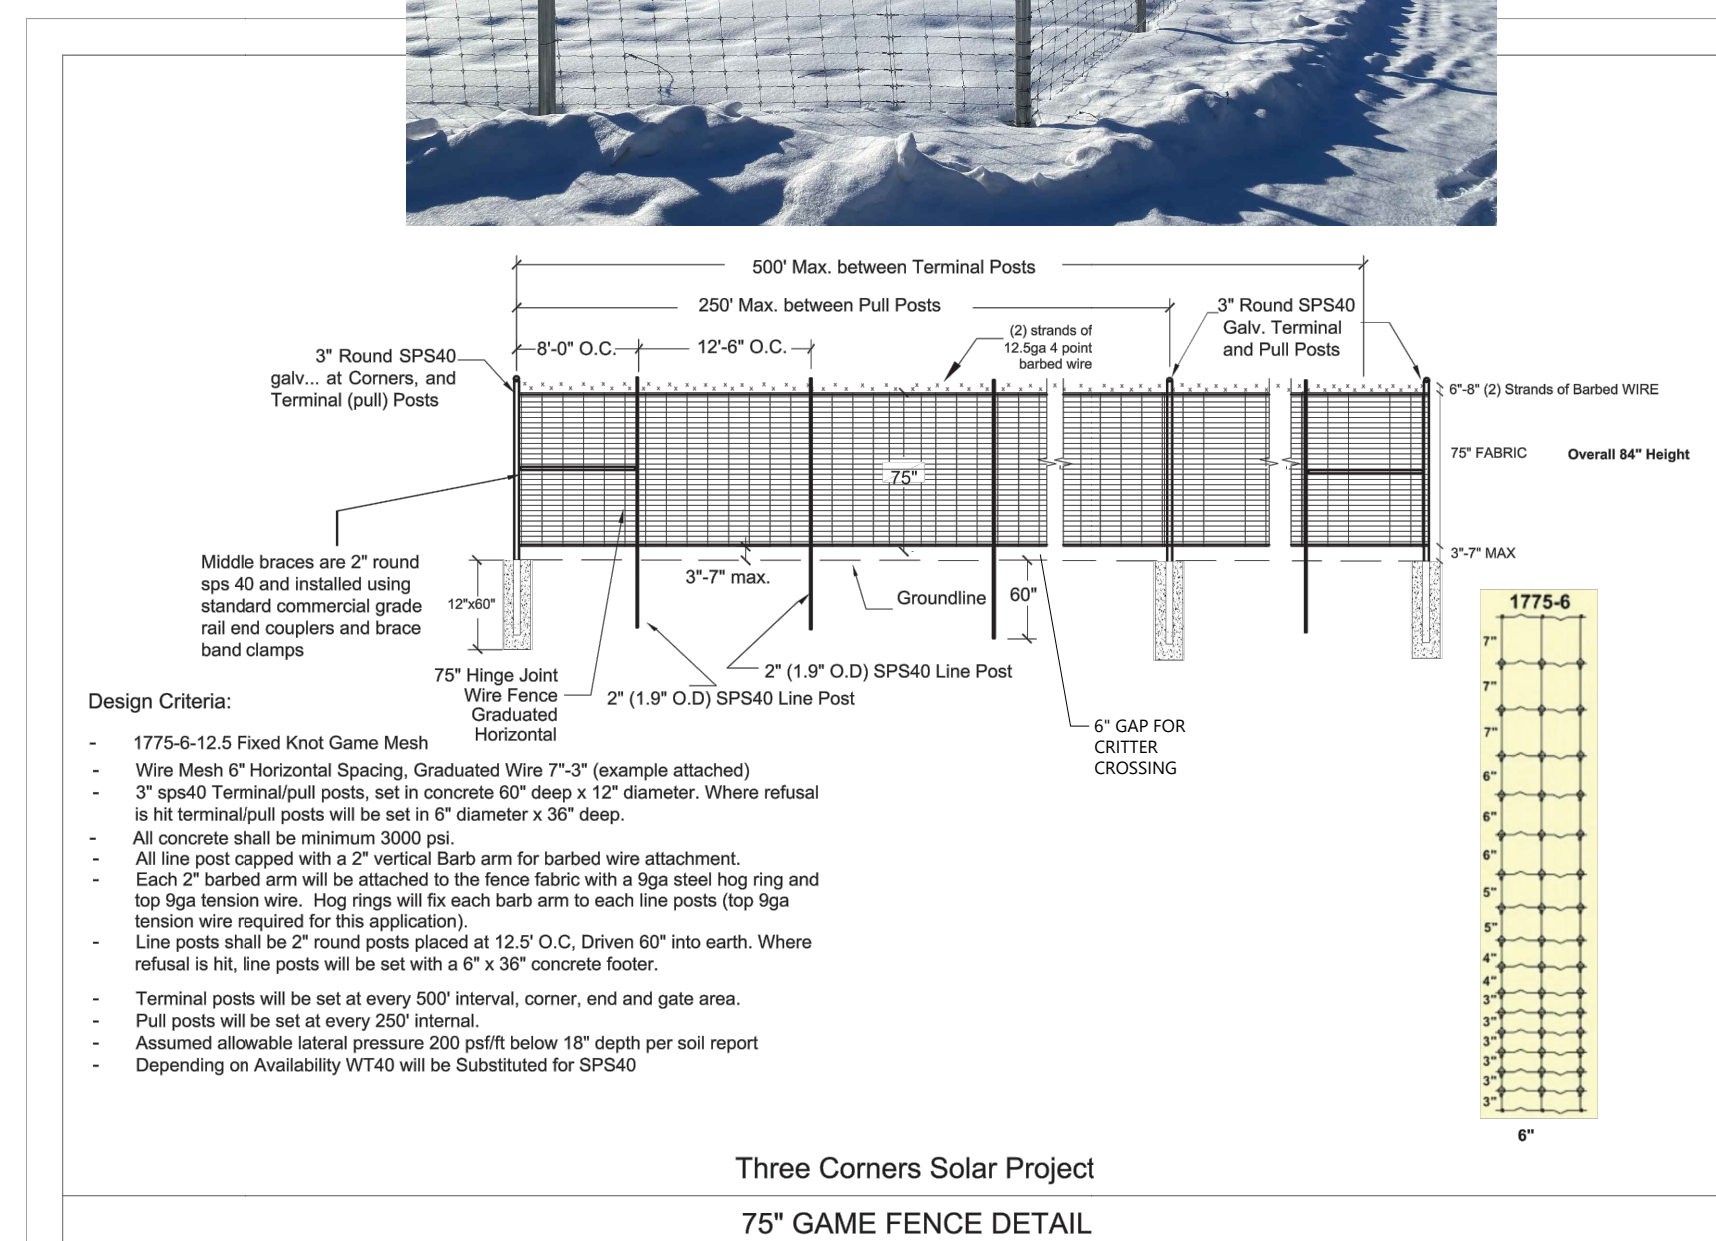


- Design Criteria:**
- 1775-6-12.5 Fixed Knot Game Mesh
  - Wire Mesh 6" Horizontal Spacing, Graduated Wire 7"-3" (example attached)
  - 3" sps40 Terminal/pull posts, set in concrete 60" deep x 12" diameter. Where refusal is hit terminal/pull posts will be set in 6" diameter x 36" deep.
  - All concrete shall be minimum 3000 psi.
  - All line post capped with a 2" vertical barb arm for barbed wire attachment.
  - Each 2" barbed arm will be attached to the fence fabric with a 9ga steel hog ring and top 9ga tension wire. Hog rings will fix each barb arm to each line posts (top 9ga tension wire required for this application).
  - Line posts shall be 2" round posts placed at 12' O.C. Driven 60" into earth. Where refusal is hit, line posts will be set with a 6" x 36" concrete footer.
  - Terminal posts will be set at every 500' interval, corner, end and gate area.
  - Pull posts will be set at every 250' interval.
  - Assumed allowable lateral pressure 200 psf/bt below 18" depth per soil report
  - Depending on availability WT40 will be substituted for SPS40

**Deer Fencing**

N.T.S.

**Three Corners Solar Project  
75° GAME FENCE DETAIL**

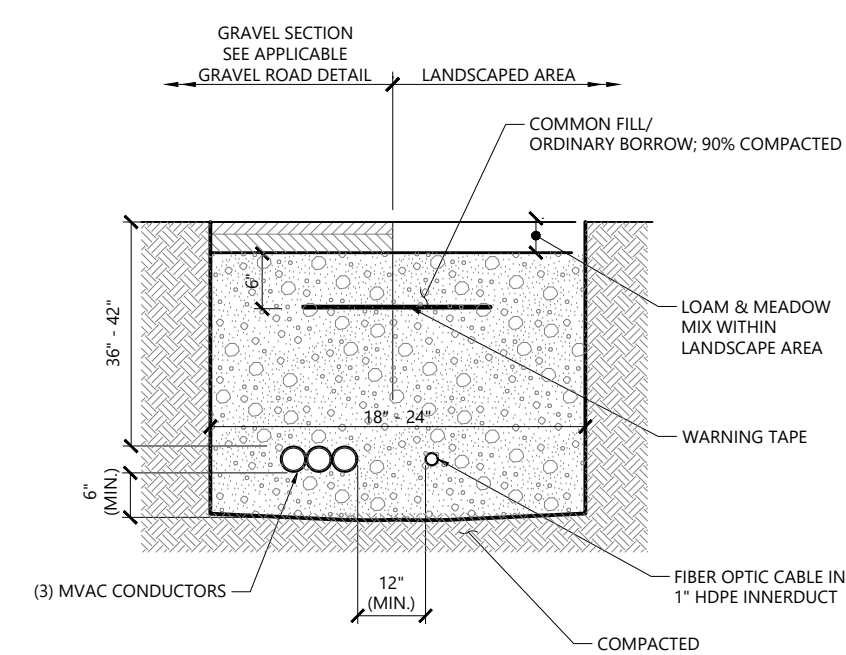


- NOTES**
- WHERE UTILITY TRENCHES ARE CONSTRUCTED THROUGH DETENTION BASIN BERMS OR OTHER SUCH SPECIAL SECTIONS. PLACE TRENCH BACKFILL WITH MATERIALS SIMILAR TO THE SPECIAL SECTION REQUIREMENTS.
  - USE METALLIC TRACING/WARNING TAPE OVER ALL PIPES.

**Underground Electric Trench**

N.T.S.

Source: Longroad


REV

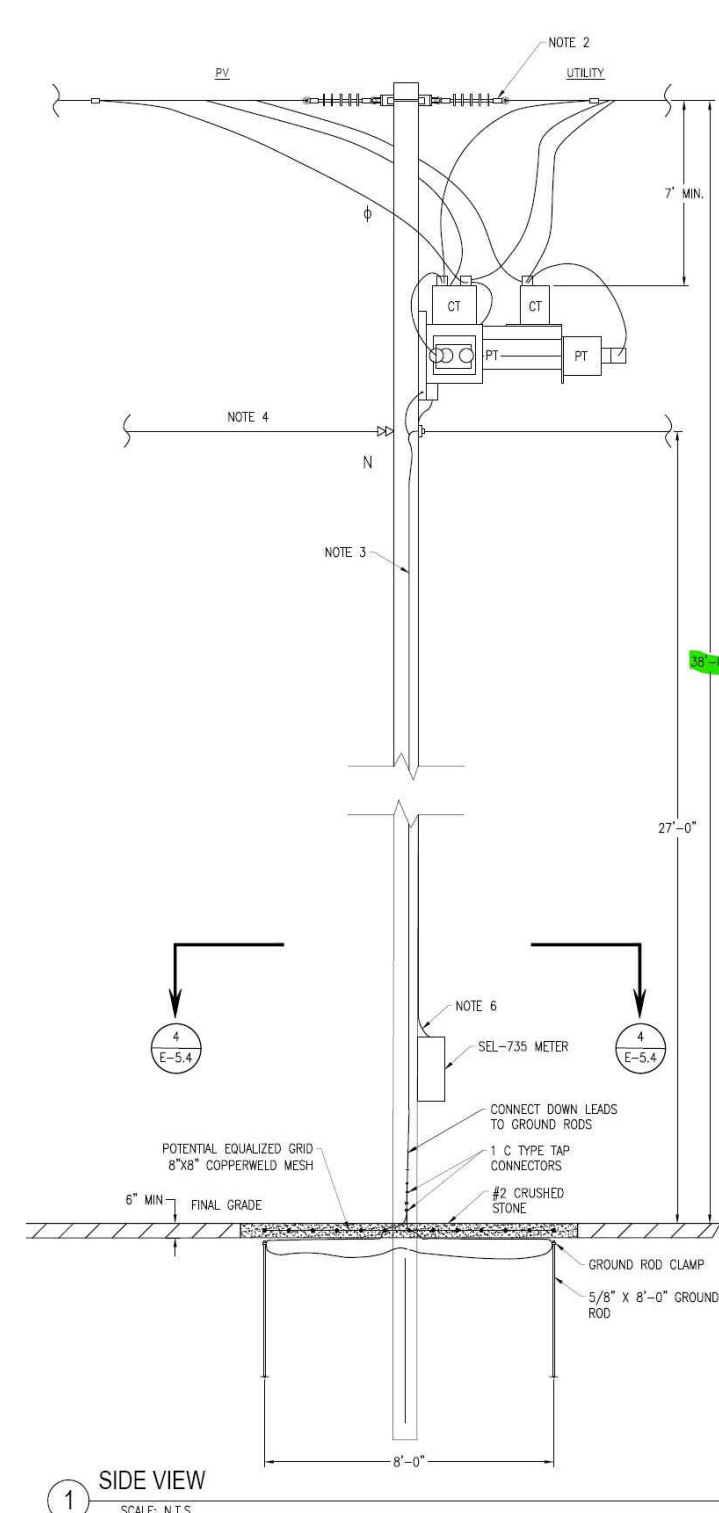

**PRIMARY METERING CLUSTER**

1


SCALE: N.T.S.

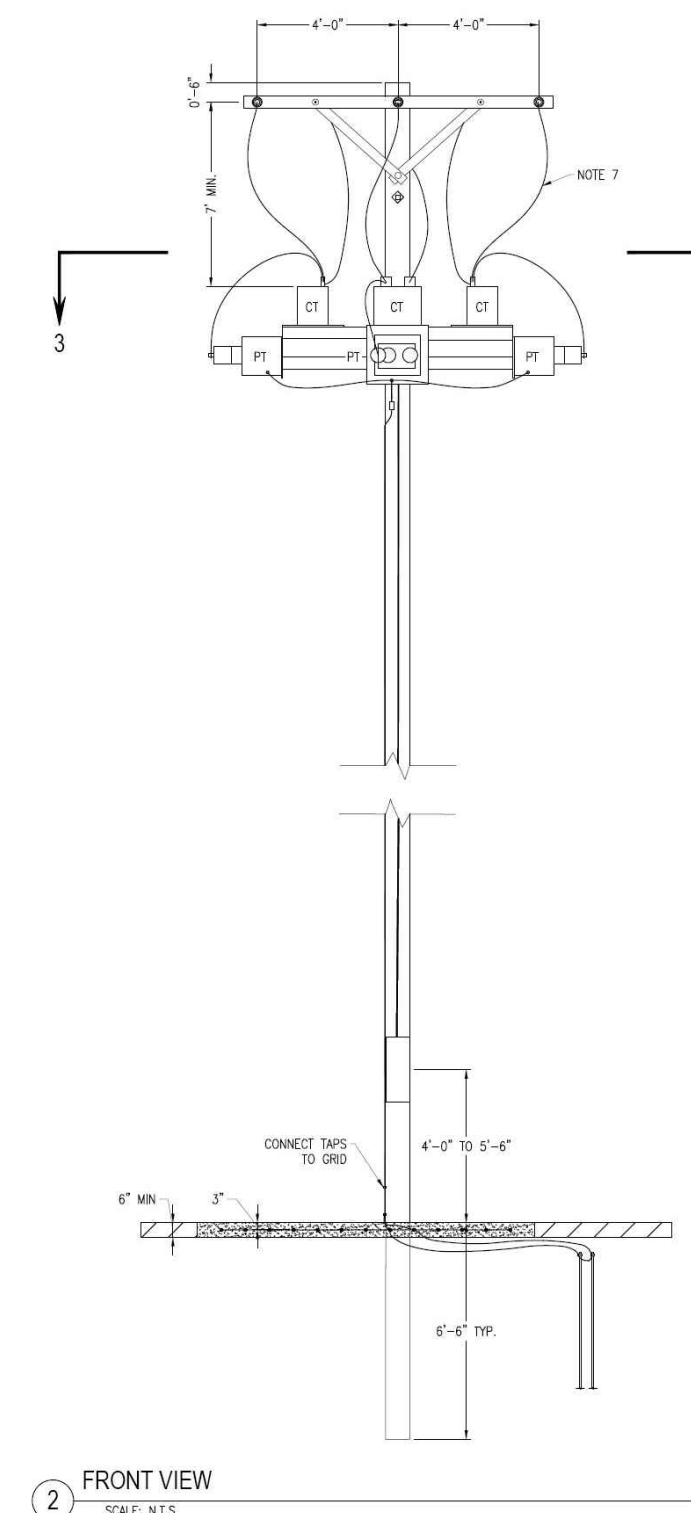

**Primary Meter & Riser TYP Details**

N.T.S.


Source: Longroad

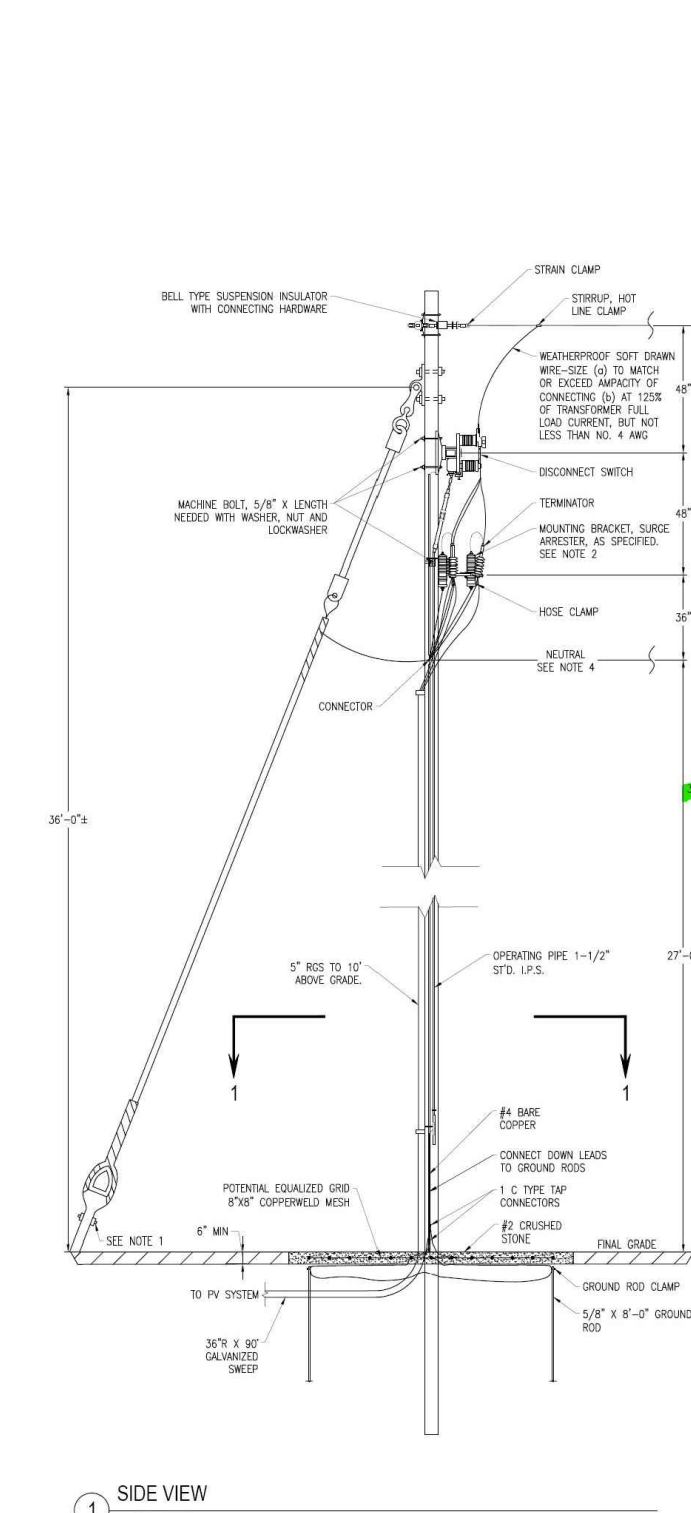

**RISER POLE**

1

SCALE: N.T.S.

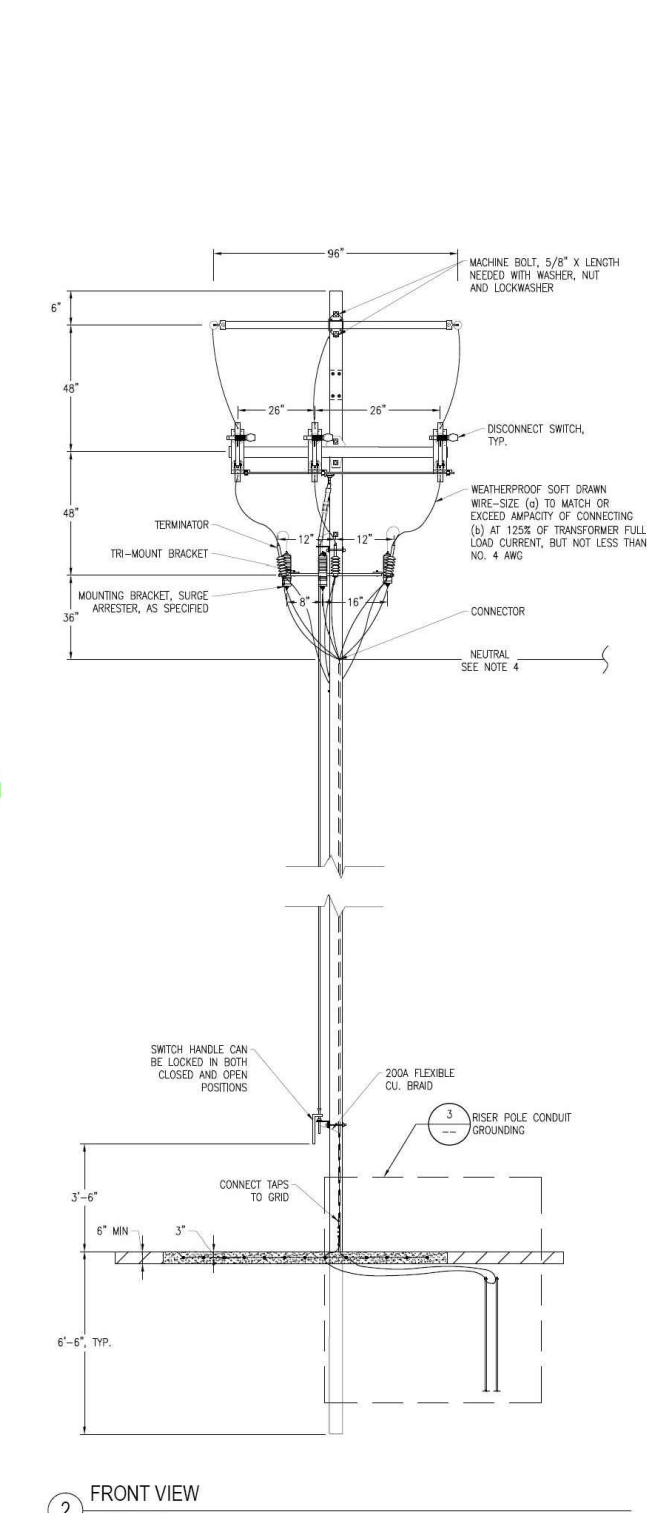

**RISER POLE**

2

SCALE: N.T.S.

**Proposed Large-Scale  
Ground-Mounted Solar  
Photovoltaic Installation**  
0 Route 25  
Wareham, MA

No.	Revision	Date	Appr'd.
1	Response to Comments	05/25/2022	SKE
2	Buffer Zone Adjustments	11/16/2022	SKE
3	Planning Board Comments	12/22/2022	SKE

Designed by: **SKE** Checked by: **JRG**  
Issued for: \_\_\_\_\_ Date: \_\_\_\_\_

**Local Approvals** August 2, 2021

**Site Details**



**C3.02**

Sheet 7 of 7

1/20/2023

Project Number  
15225.01



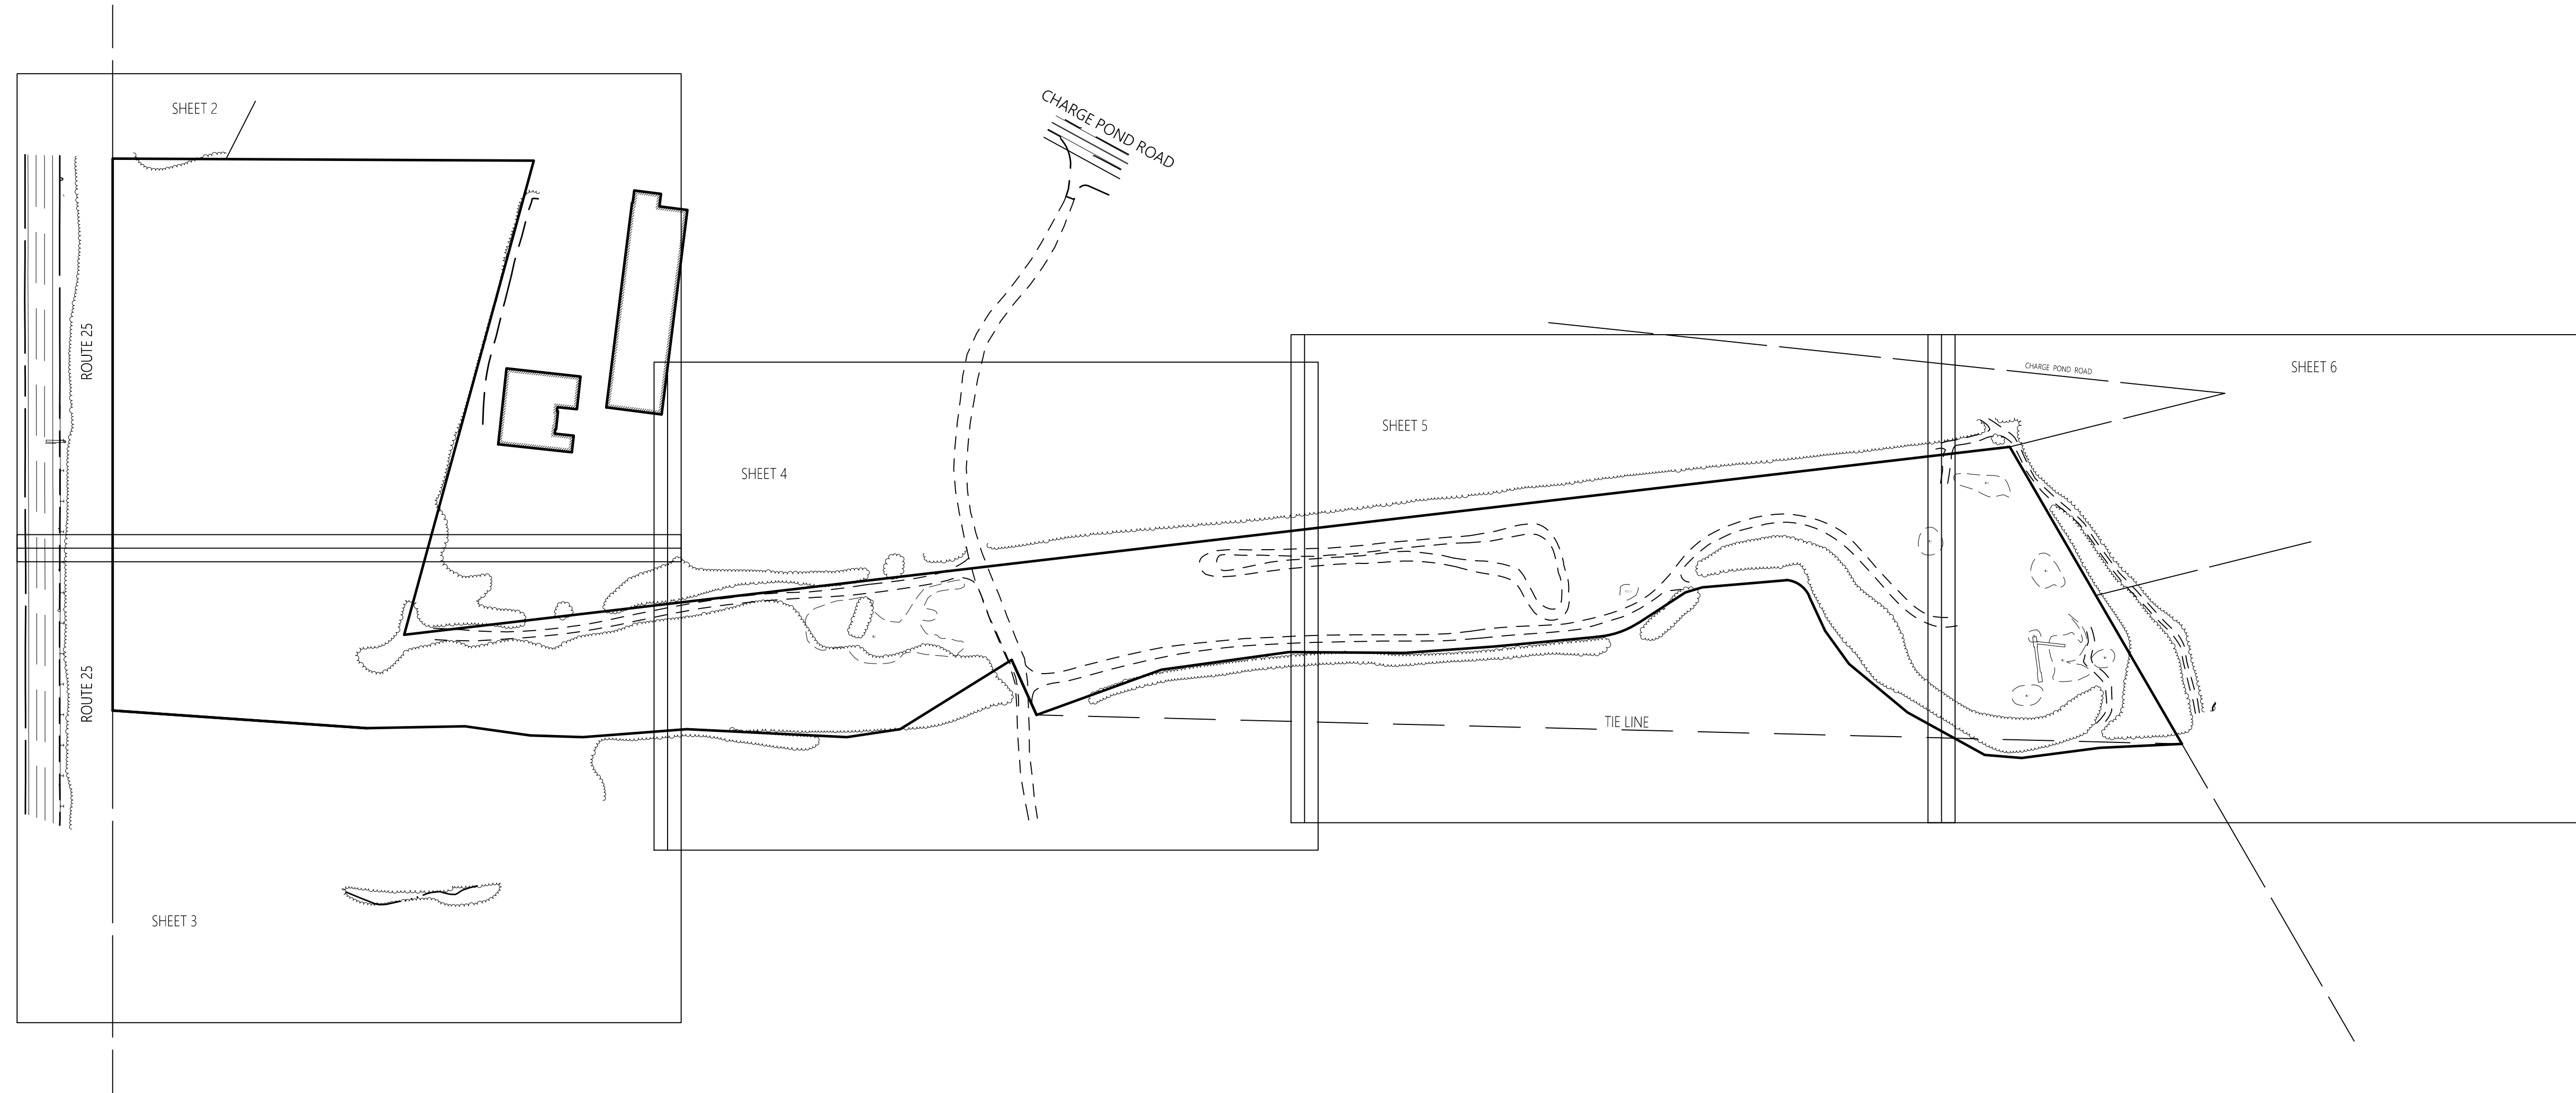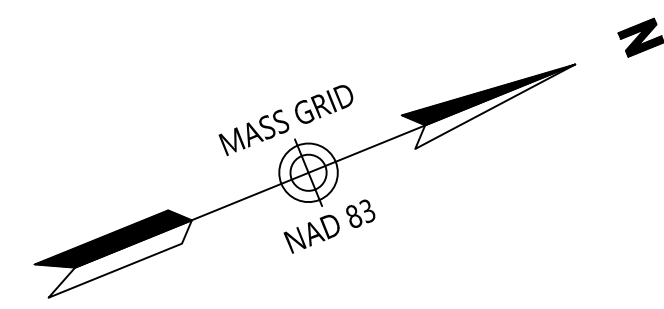

**Legend**

- ⊕ DRAIN MANHOLE
- ⊗ CATCH BASIN
- ⊙ SEWER MANHOLE
- ⊕ ELECTRIC MANHOLE
- ⊙ TELEPHONE MANHOLE
- MANHOLE
- HH □ HAND HOLE
- ⊙ WATER GATE
- ⊕ FIRE HYDRANT
- ⊙ GAS GATE
- BOLLARD w/LIGHT
- ⊙ STREET SIGN
- ⊕ LIGHT POLE
- ⊙ UTILITY POLE
- GUY POLE
- ⊙ GUY WIRE
- ⊙ MONITORING WELL
- ⊕ FLOOD LIGHT
- ⊙ WELL
- ⊙ MARSH
- ⊕ F.F.E. #45.27'
- ⊕ FINISHED FLOOR ELEVATION
- ⊕ COULD NOT OPEN
- NPV NO PIPES VISIBLE
- DYL DOUBLE YELLOW LINE
- DWL DASHED WHITE LINE
- SYL SINGLE YELLOW LINE
- LSA LANDSCAPED AREA
- EOP — EDGE OF PAVEMENT
- CC — CONCRETE CURB
- VSG — VERTICAL GRANITE CURB
- SGE — SLOPED GRANITE EDGE
- BB — BITUMINOUS BERM
- BC — BITUMINOUS CURB
- ⊕ GUARD RAIL
- ⊕ CHAIN LINK FENCE
- DRAINAGE LINE
- SEWER LINE
- OHW — OVERHEAD WIRE
- E — UNDERGROUND ELECTRIC
- T — TELEPHONE LINE
- G — GAS LINE
- W — WATER LINE
- ○ — STONE WALL
- ○ — TREE LINE
- 100'RA — 100-FT RIVER FRONT AREA
- 200'RA — 200-FT RIVER FRONT AREA
- ○ — LIMIT MEAN ANNUAL HIGH WATER
- □ — LIMIT OF BANK
- Δ — VEGETATED WETLAND BOUNDARY

**Proposed Solar Array**

**Route 25  
Wareham, Massachusetts**

No.	Revision	Date	App'd.
Designed by		Checked by	
Issued for		Date	January 12, 2021

**General Notes**

- 1) THE PROPERTY LINES SHOWN ON THIS PLAN ARE BASED UPON AN ACTUAL FIELD SURVEY CONDUCTED BY VHB, INC. IN DECEMBER, 2020 AND FROM DEEDS AND PLANS OF RECORD.
- 2) THE EXISTING CONDITIONS SHOWN ON THIS PLAN WERE DEVELOPED FROM A COMBINED EFFORT OF AERIAL PHOTOGRAMMETRIC AND LIDAR METHOD MAPPING BY EASTERN TOPOGRAPHICS, INC., BASED ON AERIAL PHOTOGRAPHS TAKEN ON NOVEMBER 29, 2020 AND FROM AN ACTUAL ON-THE-GROUND INSTRUMENT SURVEY PERFORMED BY VHB, INC. IN MAY, 2021.
- 3) THE LOCATIONS OF EXISTING UNDERGROUND UTILITIES SHOWN ON THIS PLAN ARE BASED ON FIELD OBSERVATIONS AND INFORMATION OF RECORD. THEY ARE NOT WARRANTED TO BE EXACTLY LOCATED NOR IS IT WARRANTED THAT ALL UNDERGROUND UTILITIES OR OTHER STRUCTURES ARE SHOWN ON THIS PLAN.
- 4) HORIZONTAL DATUM IS BASED ON MASS. GRID SYSTEM, NAD 1983. ELEVATIONS SHOWN ON THIS PLAN REFER TO NAVD OF 1988.
- 5) THIS SURVEY WAS PREPARED WITHOUT THE BENEFIT OF A CURRENT TITLE REPORT AND MAY BE SUBJECT TO ADDITIONAL INFORMATION DISCLOSED IN SUCH.
- 6) THE WETLANDS SHOWN ON THIS PLAN WERE FLAGGED AND LOCATED (USING GPS) BY VHB ENVIRONMENTAL DEPARTMENT IN FEBRUARY, 2020.

**Record Owner**

DAVID FLETCHER  
 MAP 115 LOT 1000  
 BOOK 34514, PAGE 232

Existing Conditions  
Plan of Land

Drawing Title

**Sv-1**


Sheet 1 of 6

Project Number  
14668.03

8-3-2021



101 Walnut Street  
PO Box 9151  
Watertown, MA 02471  
617.924.1770

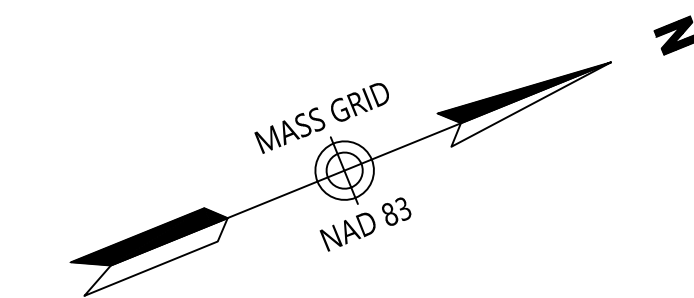

SHEET 2



Legend

- ⊙ DRAIN MANHOLE
- ⊕ CATCH BASIN
- ⊙ SEWER MANHOLE
- ⊙ ELECTRIC MANHOLE
- ⊙ TELEPHONE MANHOLE
- ⊙ MANHOLE
- HH □ HAND HOLE
- ⊙ WATER GATE
- ⊙ FIRE HYDRANT
- ⊙ GAS GATE
- ⊙ BOLLARD w/LIGHT
- ⊙ STREET SIGN
- ⊙ LIGHT POLE
- ⊙ UTILITY POLE
- ⊙ GUY POLE
- ⊙ GUY WIRE
- ⊙ MONITORING WELL
- ⊙ FLOOD LIGHT
- ⊙ WELL
- ⊙ MARSH
- ↑ F.F.E. = 45.27'
- ⊙ FINISHED FLOOR ELEVATION
- ⊙ COULD NOT OPEN
- NPV NO PIPES VISIBLE
- DYL DOUBLE YELLOW LINE
- DWL DASHED WHITE LINE
- SYL SINGLE YELLOW LINE
- LSA LANDSCAPED AREA
- CC EDGE OF PAVEMENT
- VSG CONCRETE CURB
- SGE VERTICAL GRANITE CURB
- BB BITUMINOUS BERM
- BC BITUMINOUS CURB
- GR GUARD RAIL
- CL CHAIN LINK FENCE
- DL DRAINAGE LINE
- SL SEWER LINE
- OHW OVERHEAD WIRE
- E UNDERGROUND ELECTRIC
- T TELEPHONE LINE
- G GAS LINE
- W WATER LINE
- STONE WALL
- TREE LINE
- 100'RZ 100-FT BUFFER ZONE
- 100'RA 100-FT RIVER FRONT AREA
- 200'RA 200-FT RIVER FRONT AREA
- LMA LIMIT MEAN ANNUAL HIGH WATER
- LB LIMIT OF BANK
- △ WFB-100 VEGETATED WETLAND BOUNDARY

Proposed Solar Array

Route 25  
Wareham, Massachusetts


No.	Revision	Date	Appr.

Designed by \_\_\_\_\_ Checked by \_\_\_\_\_  
Issued for \_\_\_\_\_ Date \_\_\_\_\_  
January 12, 2021


Drawing Title  
**Existing Conditions  
Plan of Land**  
Drawing Number

COMMONWEALTH OF MASSACHUSETTS  
REGISTERED PROFESSIONAL LAND SURVEYOR  
RUSSELL J. BOUSQUET  
NO. 35388

**Sv-2**  
Sheet 2 of 6  
Project Number  
14668.03  
8-3-2021

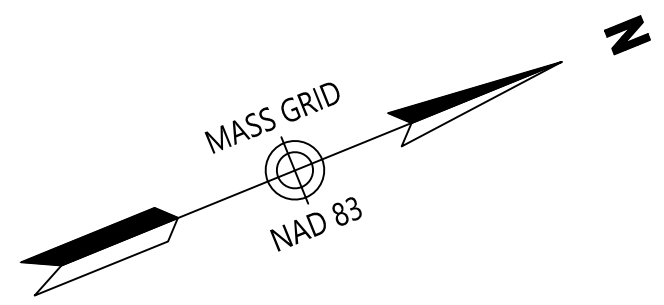

101 Walnut Street  
PO Box 9151  
Watertown, MA 02471  
617.924.1770

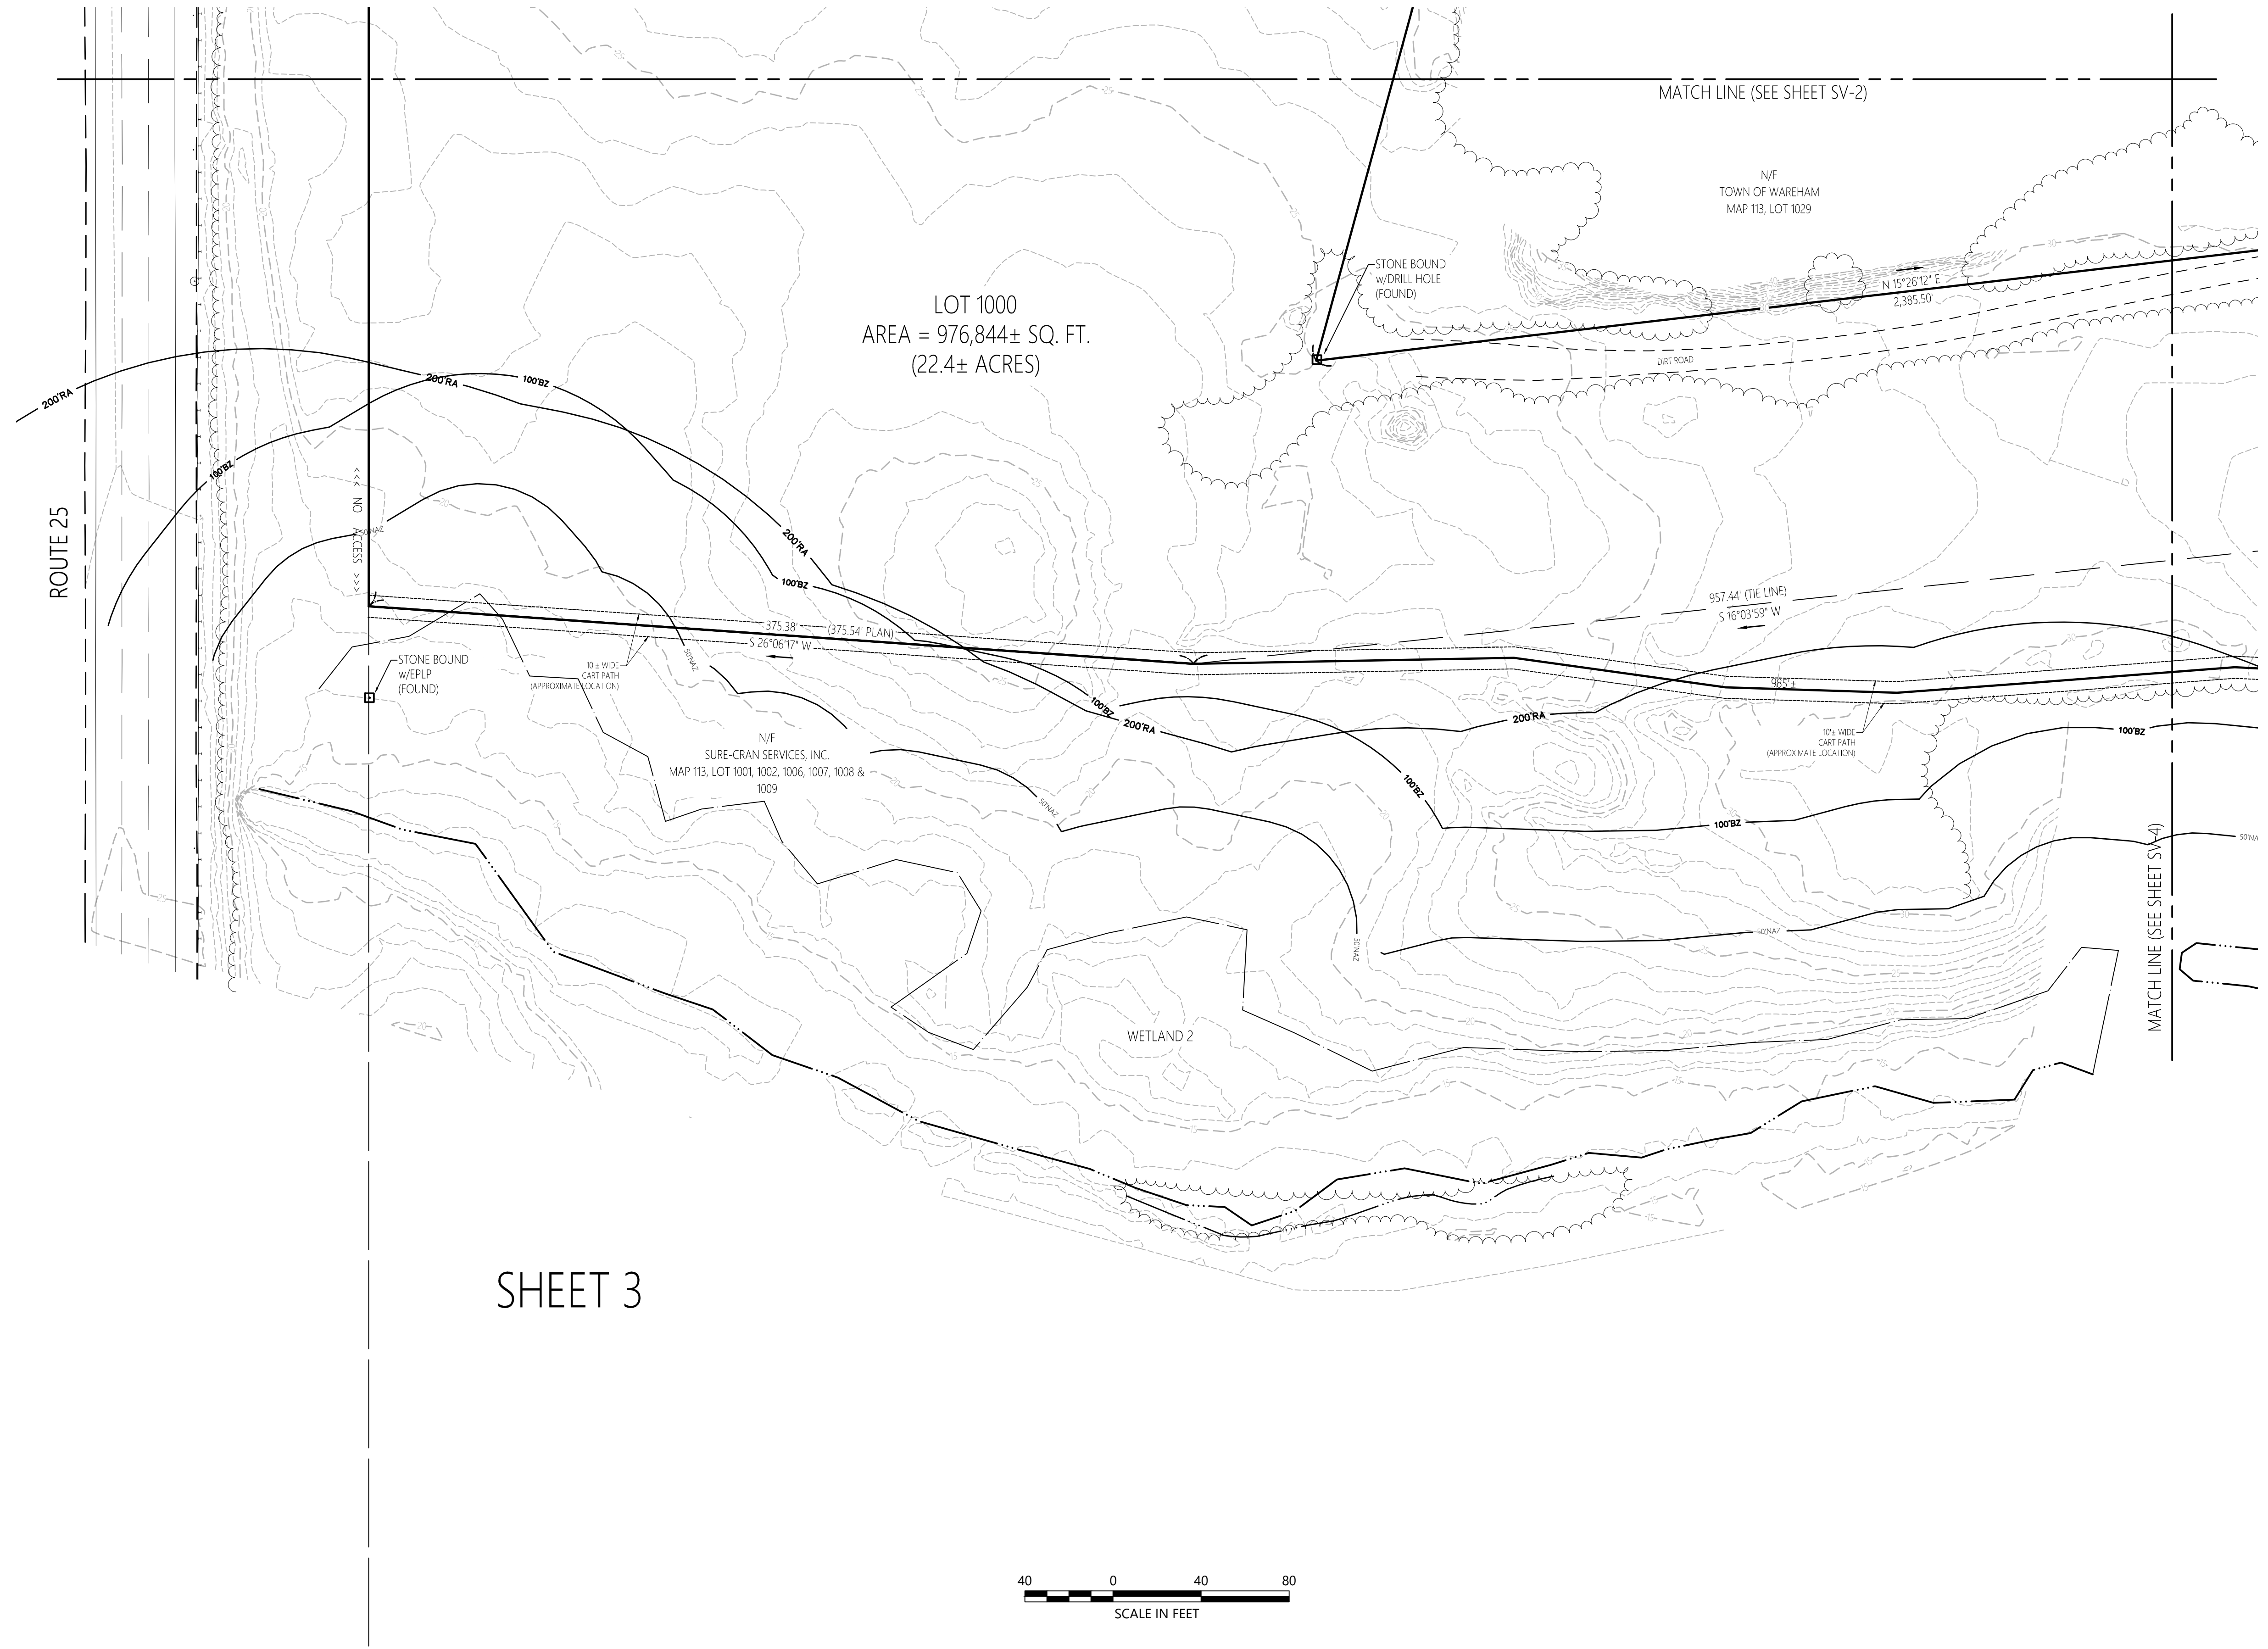

**Legend**

- ⊙ DRAIN MANHOLE
- ⊙ CATCH BASIN
- ⊙ SEWER MANHOLE
- ⊙ ELECTRIC MANHOLE
- ⊙ TELEPHONE MANHOLE
- ⊙ MANHOLE
- ⊙ HAND HOLE
- ⊙ WATER GATE
- ⊙ FIRE HYDRANT
- ⊙ GAS GATE
- ⊙ BOLLARD w/LIGHT
- ⊙ STREET SIGN
- ⊙ LIGHT POLE
- ⊙ UTILITY POLE
- ⊙ GUY POLE
- ⊙ GUY WIRE
- ⊙ MONITORING WELL
- ⊙ FLOOD LIGHT
- ⊙ WELL
- ⊙ MARSH
- ⊙ F.F.E. = 45.27'
- ⊙ FINISHED FLOOR ELEVATION
- ⊙ CNO COULD NOT OPEN
- ⊙ NPV NO PIPES VISIBLE
- ⊙ DYL DOUBLE YELLOW LINE
- ⊙ DWL DASHED WHITE LINE
- ⊙ SYL SINGLE YELLOW LINE
- ⊙ LSA LANDSCAPED AREA
- ⊙ EOP EDGE OF PAVEMENT
- ⊙ CC CONCRETE CURB
- ⊙ VSG VERTICAL GRANITE CURB
- ⊙ SGE SLOPED GRANITE CURB
- ⊙ BB BITUMINOUS BERM
- ⊙ BC BITUMINOUS CURB
- ⊙ GR GUARD RAIL
- ⊙ CLF CHAIN LINK FENCE
- ⊙ DL DRAINAGE LINE
- ⊙ SL SEWER LINE
- ⊙ OHW OVERHEAD WIRE
- ⊙ E UNDERGROUND ELECTRIC
- ⊙ T TELEPHONE LINE
- ⊙ G GAS LINE
- ⊙ W WATER LINE
- ⊙ SW STONE WALL
- ⊙ TL TREE LINE
- ⊙ 100' BZ 100-FT BUFFER ZONE
- ⊙ 100' RA 100-FT RIVER FRONT AREA
- ⊙ 200' RA 200-FT RIVER FRONT AREA
- ⊙ LMAHW LIMIT MEAN ANNUAL HIGH WATER
- ⊙ LBW LIMIT OF BANK
- ⊙ WFBV100 VEGETATED WETLAND BOUNDARY

SHEET 3



**Proposed Solar Array**  
Route 25  
Wareham, Massachusetts


No.	Revision	Date	App'd.

Designed by \_\_\_\_\_ Checked by \_\_\_\_\_  
Issued for \_\_\_\_\_ Date \_\_\_\_\_

**Existing Conditions**  
**Plan of Land**

Commonwealth of Massachusetts  
RUSSELL J. BOUSQUET  
NO. 35388  
REGISTERED PROFESSIONAL LAND SURVEYOR

**Sv-3**  
Sheet 3 of 6  
Project Number 14668.03

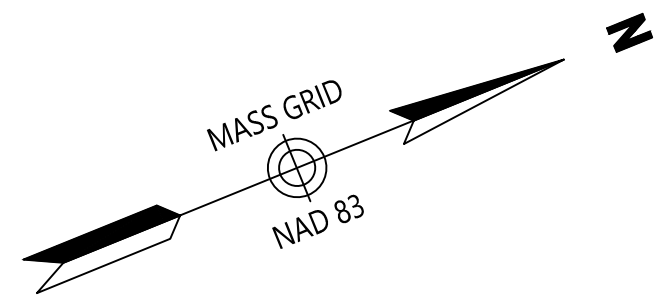


101 Walnut Street  
PO Box 9151  
Watertown, MA 02471  
617.924.1770

**Legend**

- ⊙ DRAIN MANHOLE
- ⊞ CATCH BASIN
- ⊙ SEWER MANHOLE
- ⊙ ELECTRIC MANHOLE
- ⊙ TELEPHONE MANHOLE
- ⊙ MANHOLE
- HH □ HAND HOLE
- ⊙ WATER GATE
- ⊙ FIRE HYDRANT
- ⊙ GAS GATE
- BOLLARD w/LIGHT
- ⊙ STREET SIGN
- ⊙ LIGHT POLE
- ⊙ UTILITY POLE
- ⊙ GUY POLE
- ⊙ GUY WIRE
- ⊙ MONITORING WELL
- ⊙ FLOOD LIGHT
- ⊙ WELL
- ⊙ MARSH
- ⊙ F.F.E. = 45.27'
- ⊙ FINISHED FLOOR ELEVATION
- ⊙ COULD NOT OPEN
- ⊙ NO PIPES VISIBLE
- ⊙ DYL DOUBLE YELLOW LINE
- ⊙ DWL DASHED WHITE LINE
- ⊙ SYL SINGLE YELLOW LINE
- ⊙ LSA LANDSCAPED AREA
- ⊙ EOP EDGE OF PAVEMENT
- ⊙ CC CONCRETE CURB
- ⊙ VSG VERTICAL GRANITE CURB
- ⊙ SGE SLOPED GRANITE EDGE
- ⊙ BB BITUMINOUS BERM
- ⊙ BC BITUMINOUS CURB
- ⊙ GR GUARD RAIL
- ⊙ CLF CHAIN LINK FENCE
- ⊙ DL DRAINAGE LINE
- ⊙ SL SEWER LINE
- ⊙ OHW OVERHEAD WIRE
- ⊙ E UNDERGROUND ELECTRIC
- ⊙ T TELEPHONE LINE
- ⊙ G GAS LINE
- ⊙ W WATER LINE
- ⊙ STW STONE WALL
- ⊙ TL TREE LINE
- ⊙ 100' BZ 100-FT BUFFER ZONE
- ⊙ 100'RA 100-FT RIVER FRONT AREA
- ⊙ 200'RA 200-FT RIVER FRONT AREA
- ⊙ LMAH LIMIT MEAN ANNUAL HIGH WATER
- ⊙ LB LIMIT OF BANK
- ⊙ WFB-100 VEGETATED WETLAND BOUNDARY

SHEET 4

LOT 1000  
AREA = 976,844± SQ. FT.  
(22.4± ACRES)

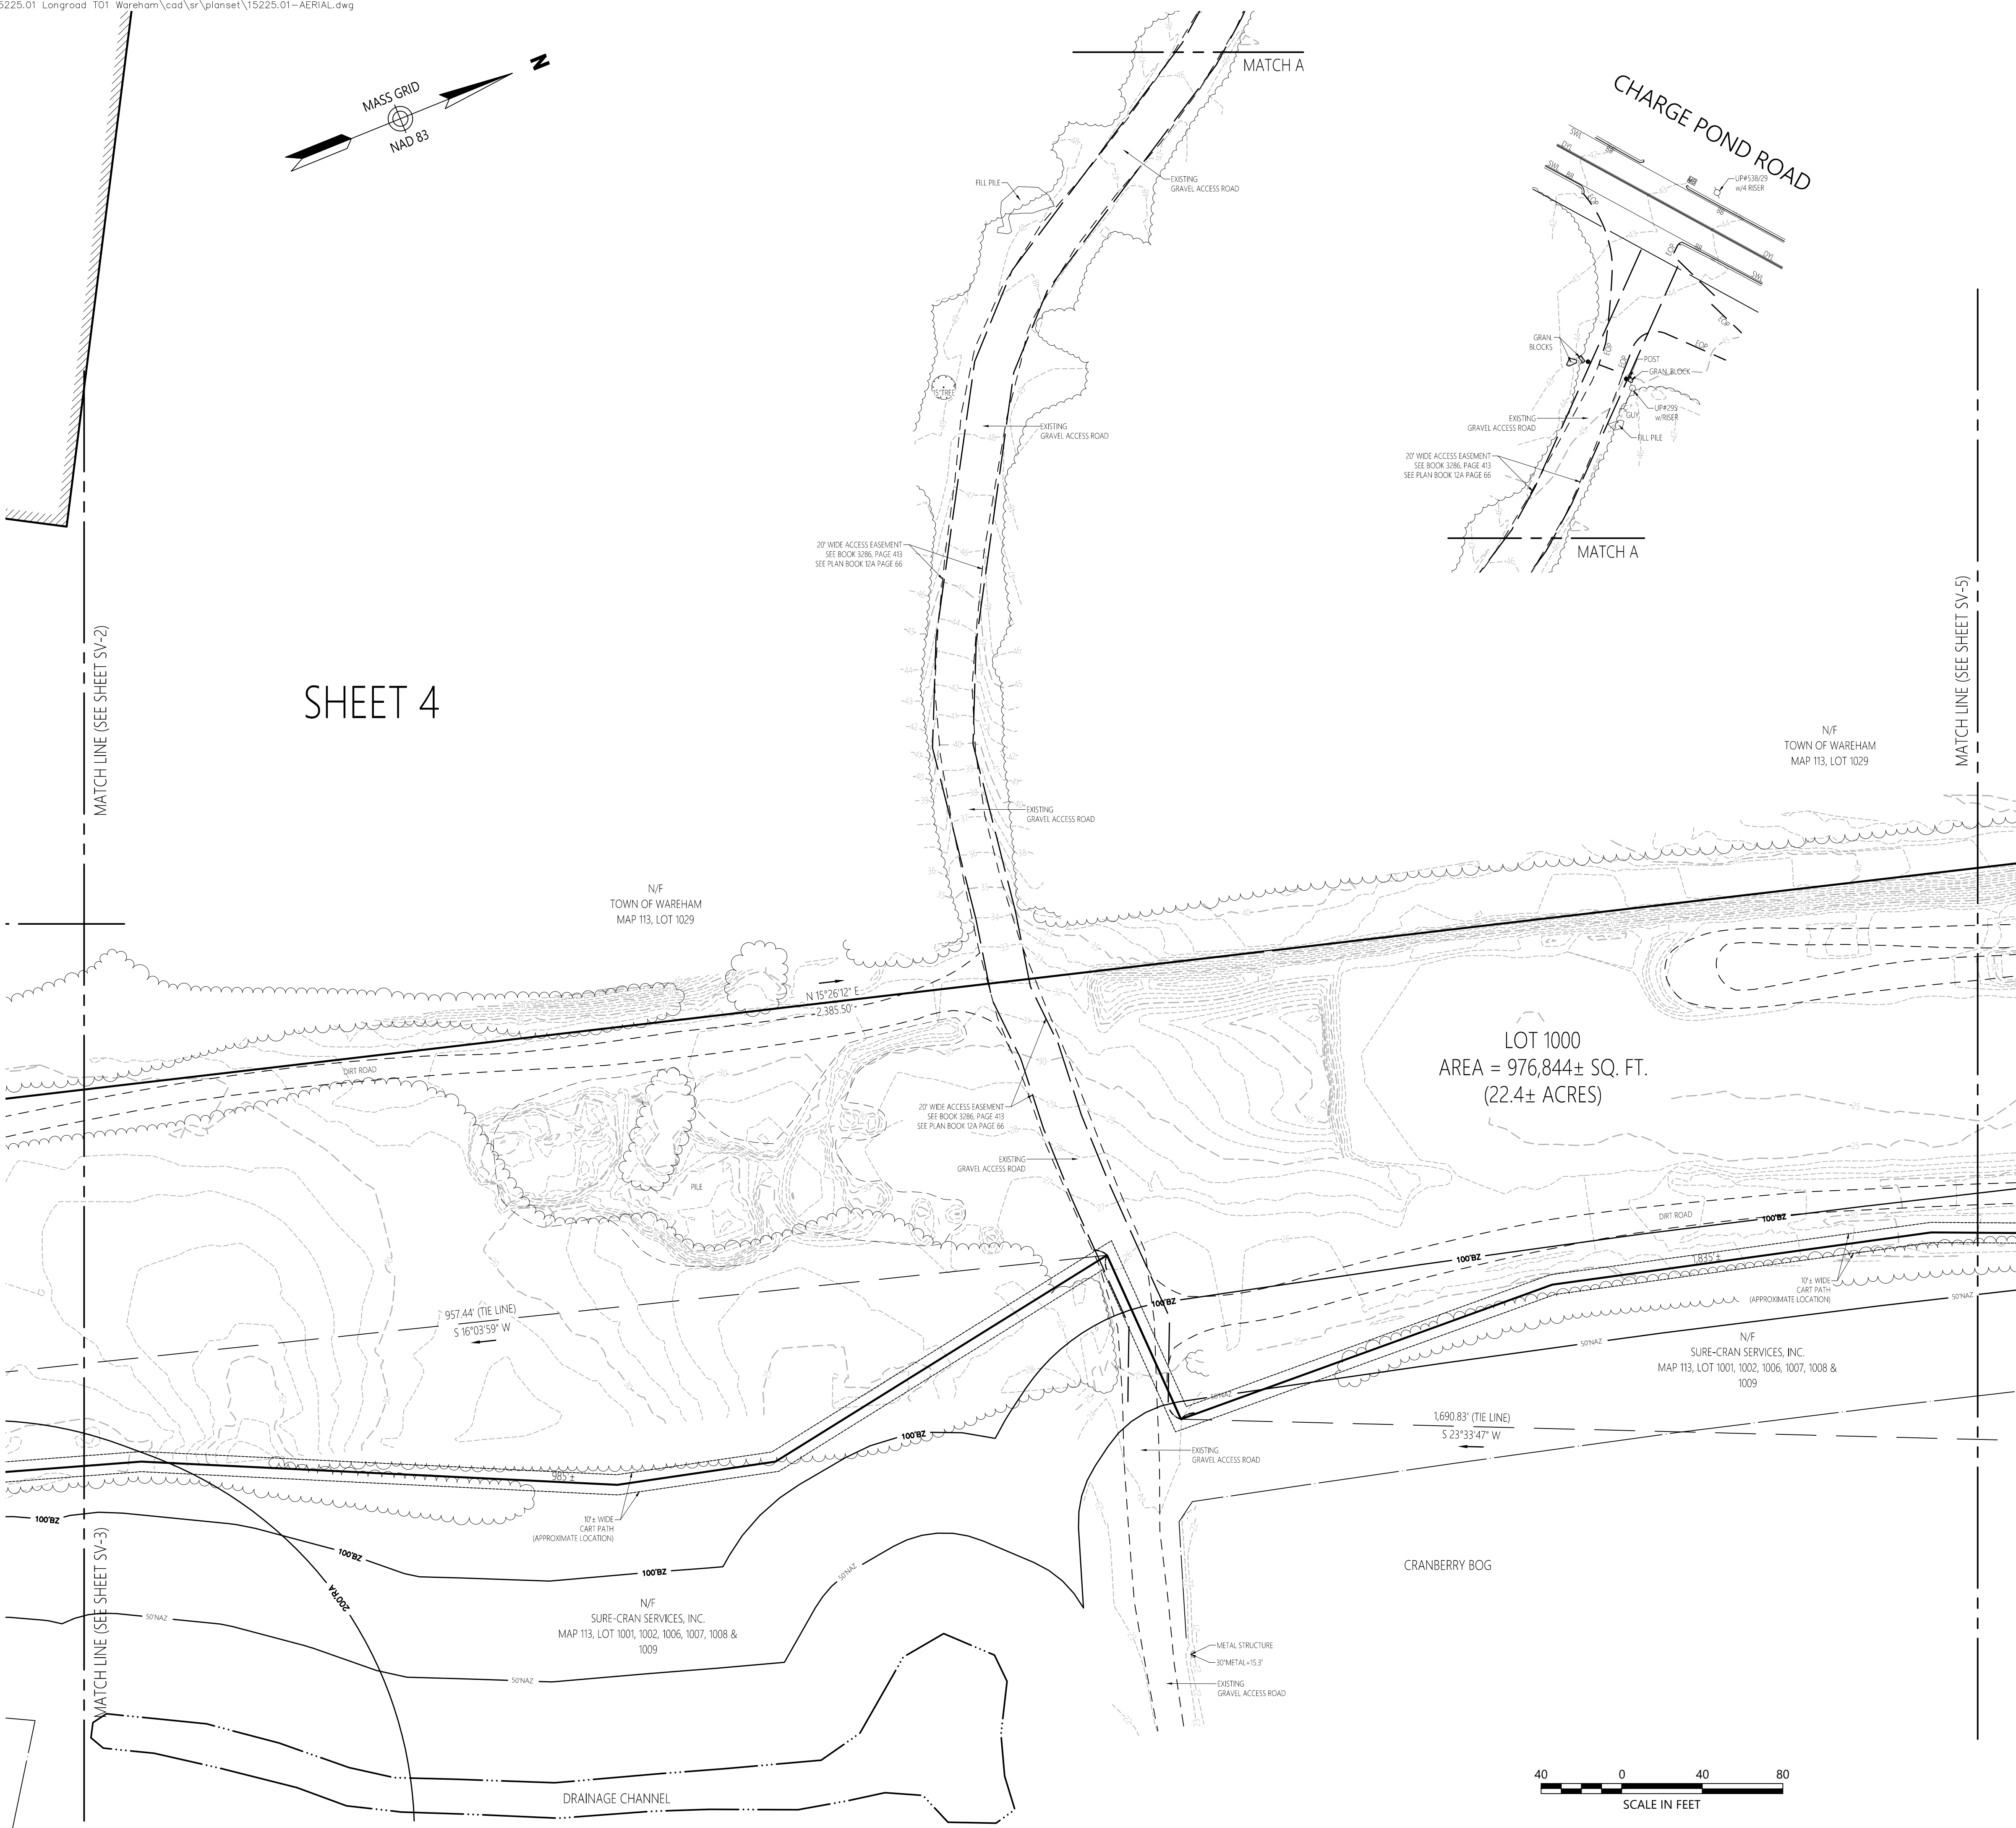

**Proposed Solar Array**

Route 25  
Wareham, Massachusetts

No.	Revision	Date	Appr.


Designed by: \_\_\_\_\_ Checked by: \_\_\_\_\_  
Issued for: \_\_\_\_\_ Date: **January 12, 2021**

**Existing Conditions  
Plan of Land**


Drawing Title: **Existing Conditions Plan of Land**  
Drawing Number: **Sv-4**  
Sheet **4** of **6**  
Project Number: **14668.03**  
Date: **8-3-2021**



101 Walnut Street  
PO Box 9151  
Watertown, MA 02471  
617.924.1770

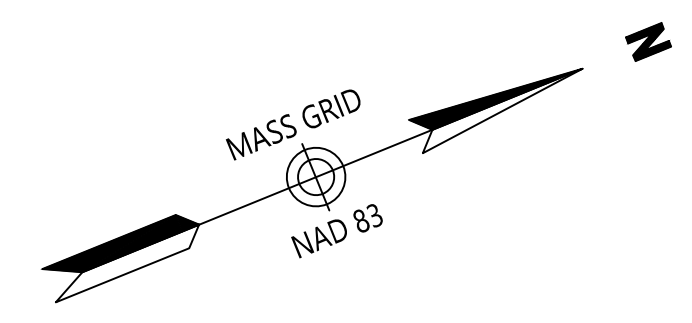

SHEET 5

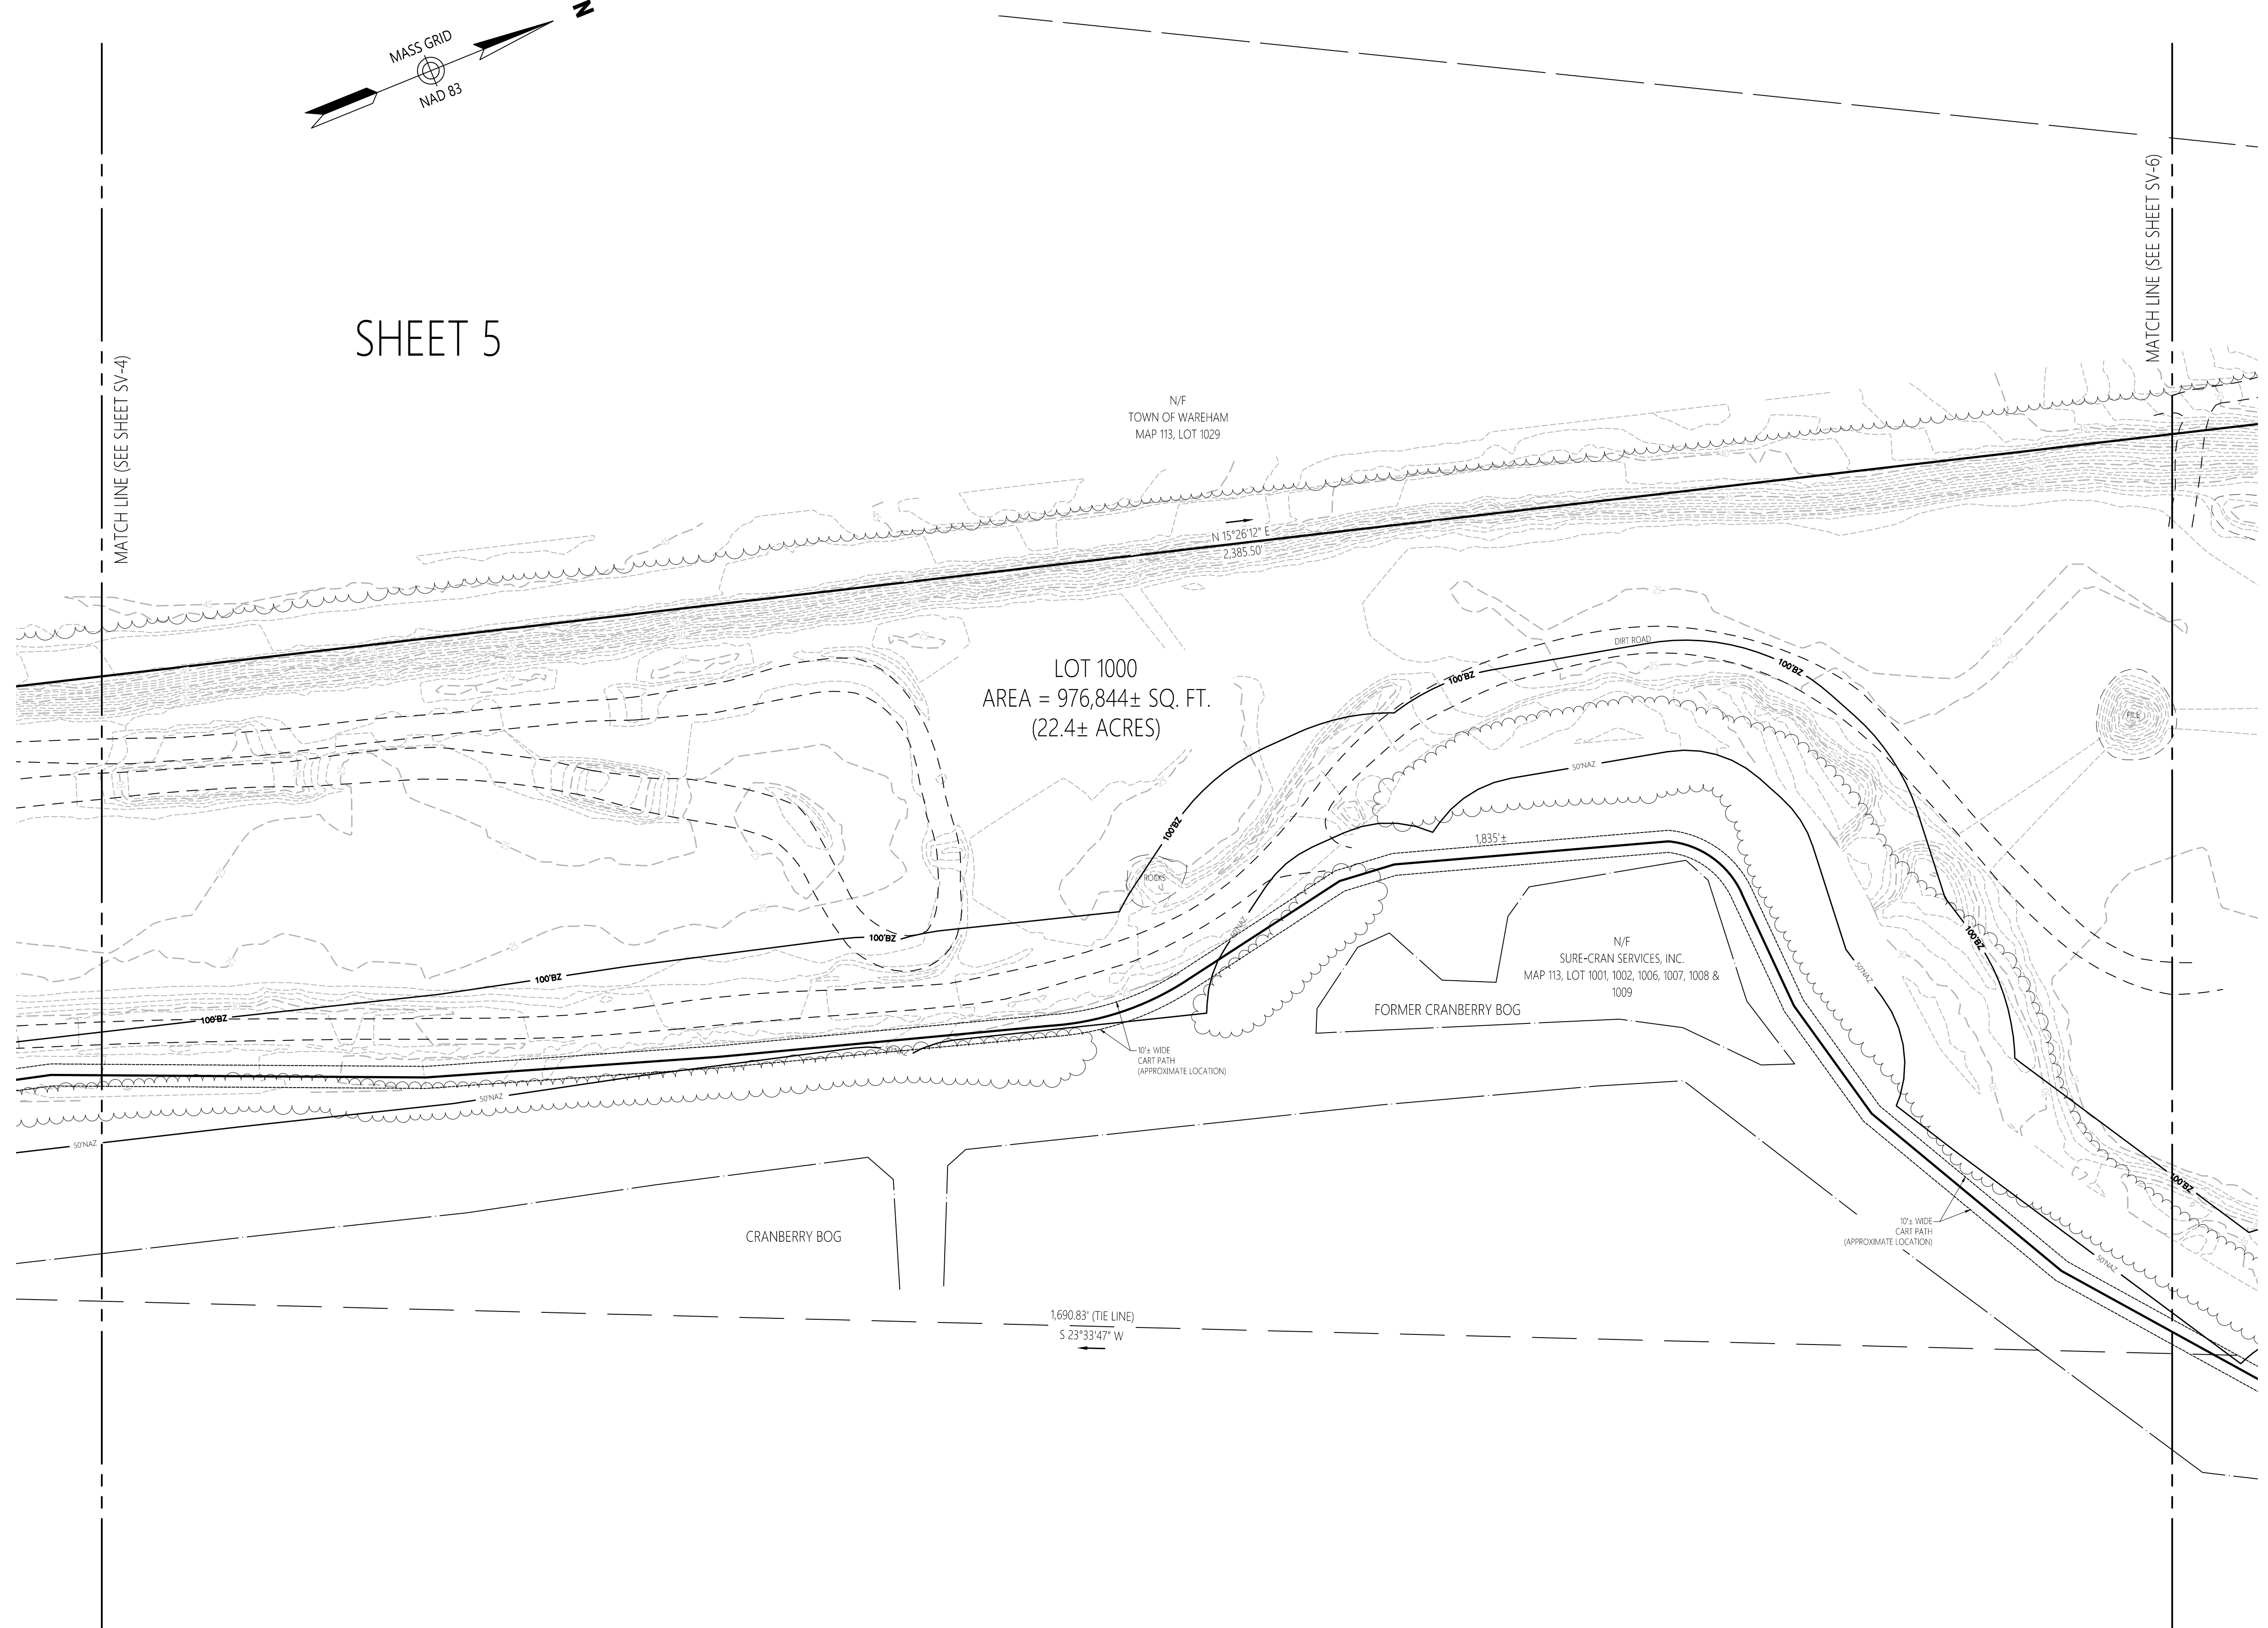

**Legend**

- ⊕ DRAIN MANHOLE
- ⊞ CATCH BASIN
- ⊙ SEWER MANHOLE
- ⊕ ELECTRIC MANHOLE
- ⊙ TELEPHONE MANHOLE
- ⊙ MANHOLE
- ⊕ HAND HOLE
- ⊙ WATER GATE
- ⊙ FIRE HYDRANT
- ⊙ GAS GATE
- ⊙ BOLLARD w/LIGHT
- ⊙ STREET SIGN
- ⊙ LIGHT POLE
- ⊙ UTILITY POLE
- ⊙ GUY POLE
- ⊙ GUY WIRE
- ⊙ MONITORING WELL
- ⊙ FLOOD LIGHT
- ⊙ WELL
- ⊙ MARSH
- ↑ F.F.E. = 45.27'
- ↑ FINISHED FLOOR ELEVATION
- ⊙ COULD NOT OPEN
- ⊙ NO PIPES VISIBLE
- ⊙ DOUBLE YELLOW LINE
- ⊙ DASHED WHITE LINE
- ⊙ SINGLE YELLOW LINE
- ⊙ LANDSCAPED AREA
- ⊙ EDGE OF PAVEMENT
- ⊙ CONCRETE CURB
- ⊙ VERTICAL GRANITE CURB
- ⊙ SLOPED GRANITE CURB
- ⊙ BITUMINOUS CURB
- ⊙ BITUMINOUS BERM
- ⊙ GUARD RAIL
- ⊙ CHAIN LINK FENCE
- ⊙ DRAINAGE LINE
- ⊙ SEWER LINE
- ⊙ OVERHEAD WIRE
- ⊙ UNDERGROUND ELECTRIC
- ⊙ TELEPHONE LINE
- ⊙ GAS LINE
- ⊙ WATER LINE
- ⊙ STONE WALL
- ⊙ TREE LINE
- ⊙ 100-FEET BUFFER ZONE
- ⊙ 100-FT RIVER FRONT AREA
- ⊙ 200-FT RIVER FRONT AREA
- ⊙ LIMIT MEAN ANNUAL HIGH WATER
- ⊙ LIMIT OF BANK
- ⊙ VEGETATED WETLAND BOUNDARY

**Proposed Solar Array**

Route 25  
Wareham, Massachusetts


No.	Revision	Date	Appvd.

Designed by \_\_\_\_\_ Checked by \_\_\_\_\_  
Issued for \_\_\_\_\_ Date \_\_\_\_\_  
January 12, 2021




Drawing Title  
**Existing Conditions  
Plan of Land**  
Drawing Number

COMMONWEALTH OF MASSACHUSETTS  
RUSSELL J. BOUSQUET  
NO. 35388  
REGISTERED PROFESSIONAL LAND SURVEYOR  
Sv-5  
Sheet 5 of 6  
Project Number 14668.03  
8-3-2021

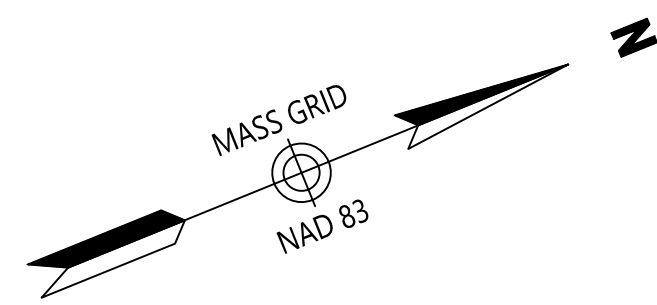

# SHEET 6

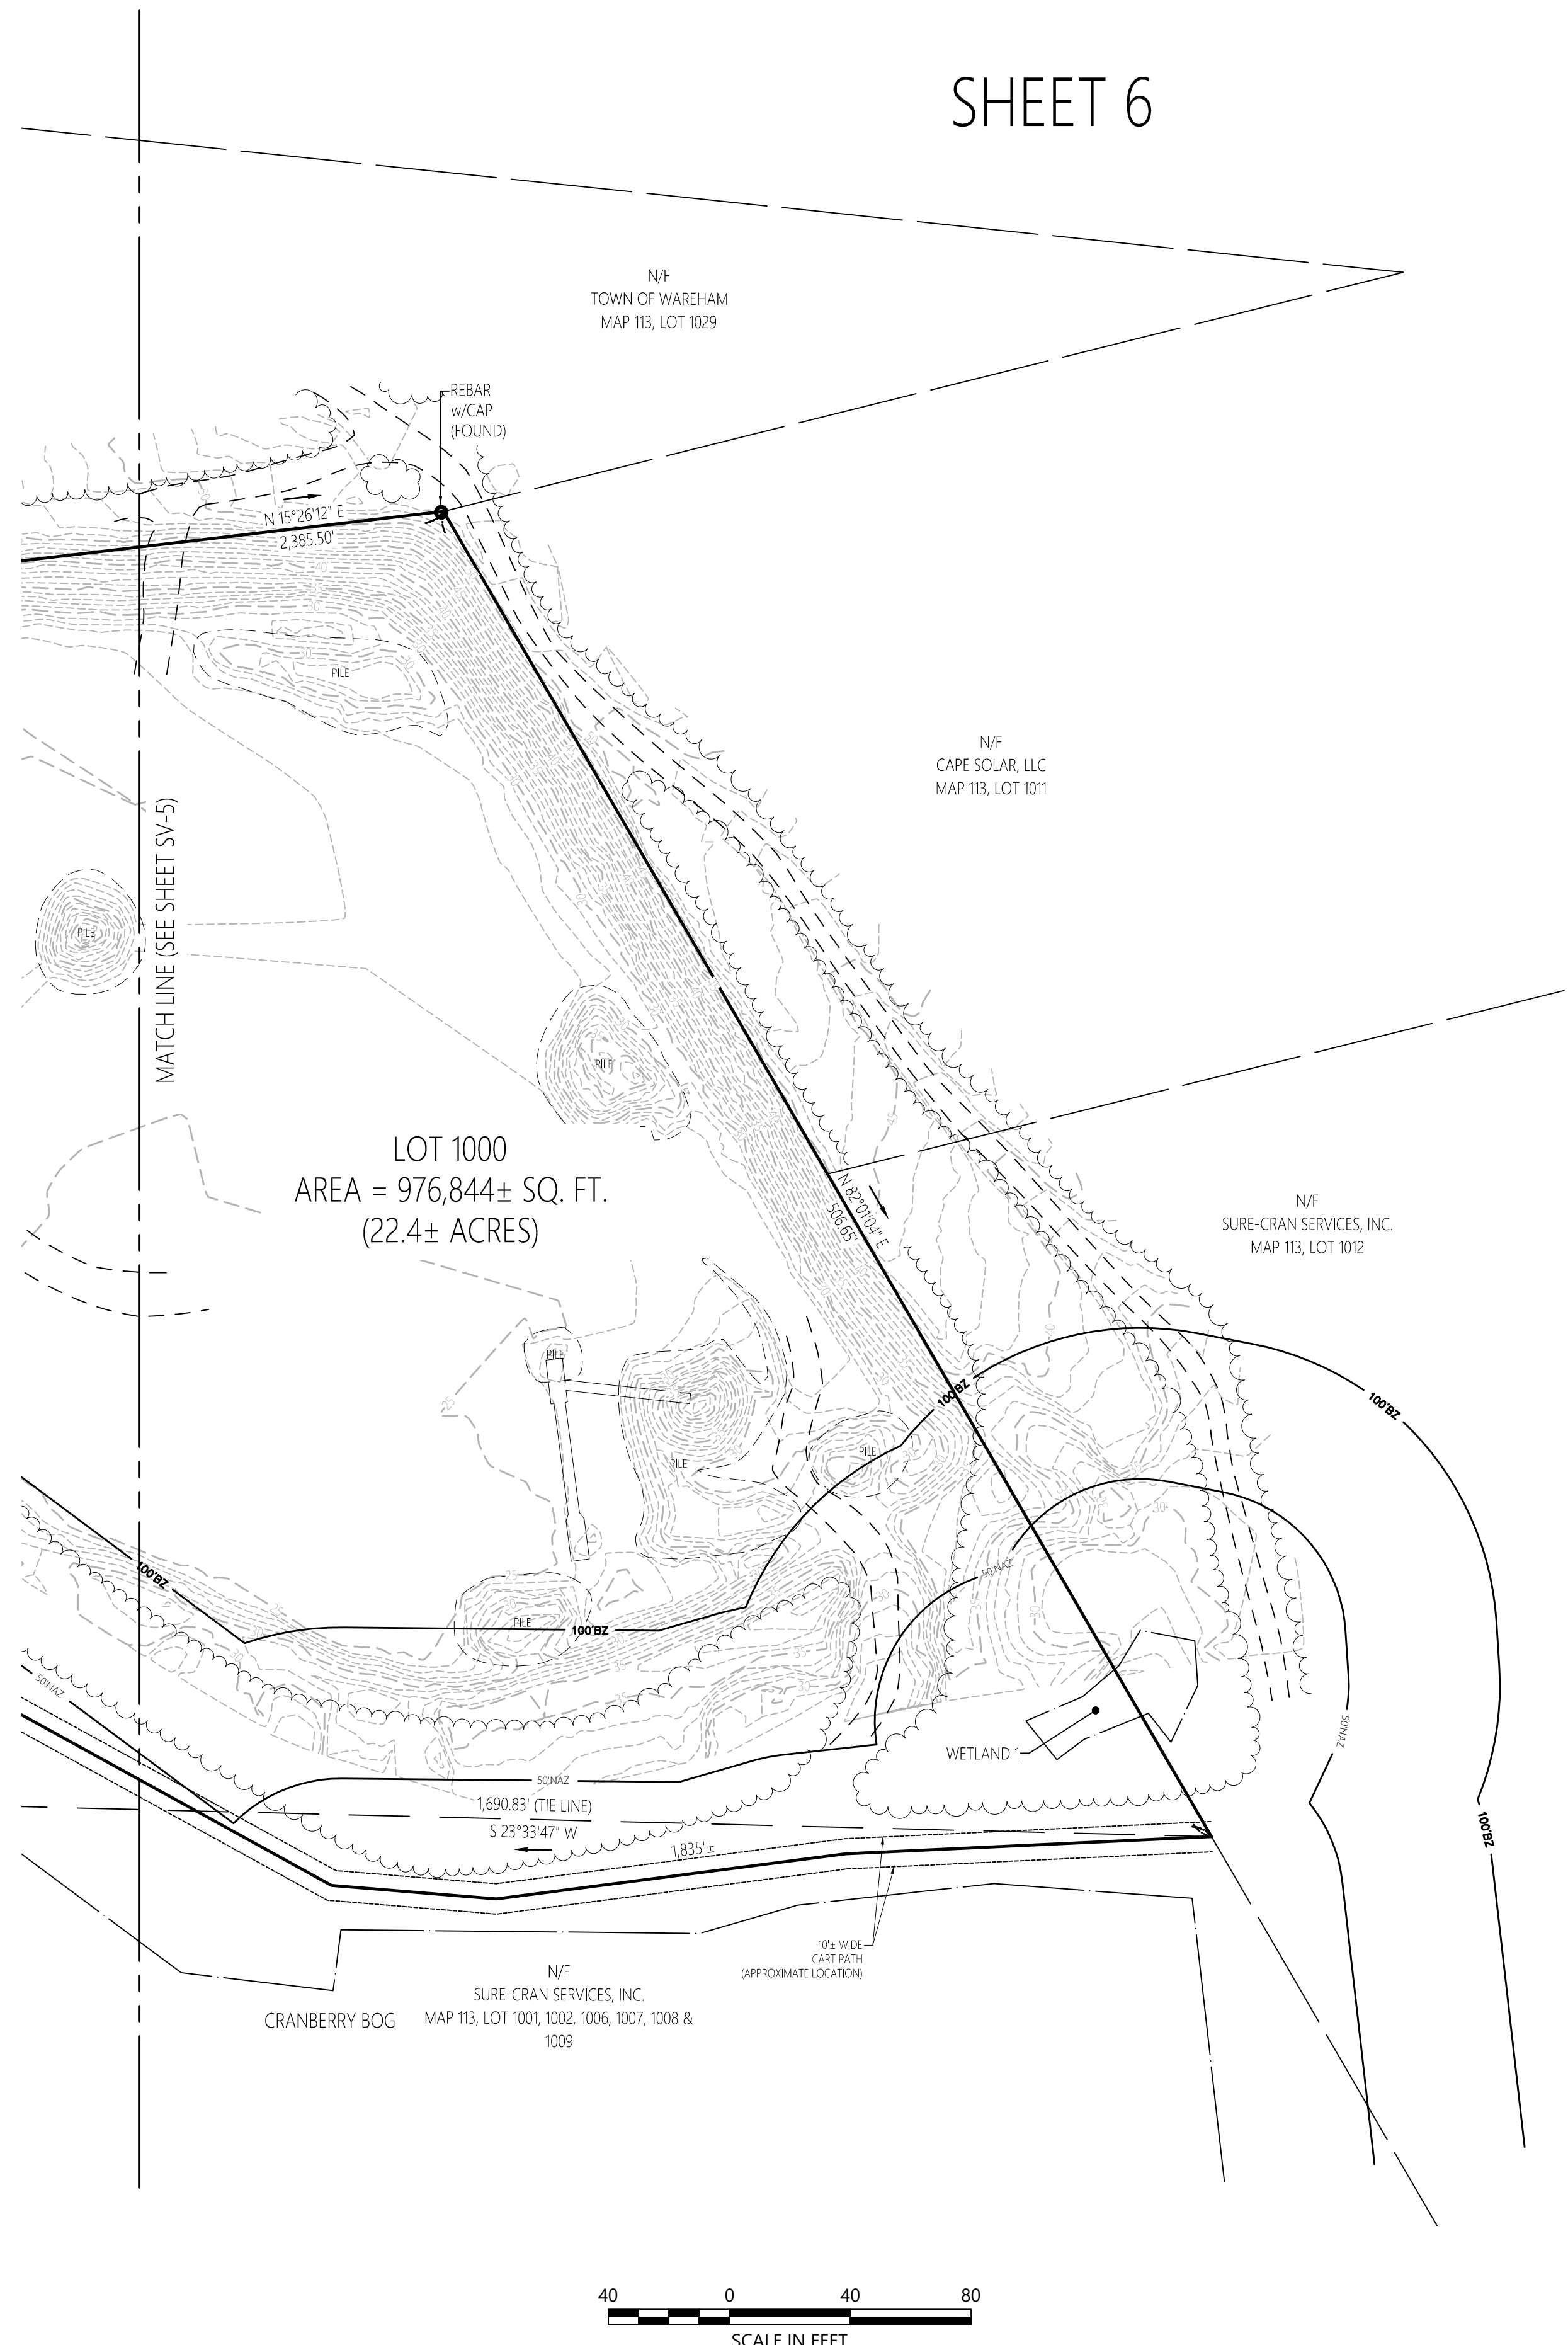

101 Walnut Street  
PO Box 9151  
Watertown, MA 02471  
617.924.1770

### Legend

- ⊙ DRAIN MANHOLE
- ⊞ CATCH BASIN
- ⊕ SEWER MANHOLE
- ⊕ ELECTRIC MANHOLE
- ⊕ TELEPHONE MANHOLE
- MANHOLE
- HH □ HAND HOLE
- ⊙ WATER GATE
- ⊕ FIRE HYDRANT
- GAS GATE
- BOLLARD w/LIGHT
- ⊕ STREET SIGN
- ⊕ LIGHT POLE
- ⊕ UTILITY POLE
- ⊕ GUY POLE
- ⊕ GUY WIRE
- ⊕ MONITORING WELL
- ⊕ FLOOD LIGHT
- ⊕ WELL
- ⊕ MARSH
- ⊕ F.F.E. = 45.2'
- ⊕ FINISHED FLOOR ELEVATION
- ⊕ COULD NOT OPEN
- ⊕ NO PIPES VISIBLE
- ⊕ DYL DOUBLE YELLOW LINE
- ⊕ DWL DASHED WHITE LINE
- ⊕ SYL SINGLE YELLOW LINE
- ⊕ LSA LANDSCAPED AREA
- ⊕ EOP EDGE OF PAVEMENT
- ⊕ CC CONCRETE CURB
- ⊕ VSG VERTICAL GRANITE CURB
- ⊕ SGE SLOPED GRANITE EDGE
- ⊕ BB BITUMINOUS BERM
- ⊕ BC BITUMINOUS CURB
- ⊕ GR GUARD RAIL
- ⊕ CLF CHAIN LINK FENCE
- ⊕ DL DRAINAGE LINE
- ⊕ SL SEWER LINE
- ⊕ OHW OVERHEAD WIRE
- ⊕ E UNDERGROUND ELECTRIC
- ⊕ T TELEPHONE LINE
- ⊕ G GAS LINE
- ⊕ W WATER LINE
- ⊕ STL STONE WALL
- ⊕ TL TREE LINE
- ⊕ 100BZ 100-FT BUFFER ZONE
- ⊕ 100RA 100-FT RIVER FRONT AREA
- ⊕ 200RA 200-FT RIVER FRONT AREA
- ⊕ LMAW LIMIT MEAN ANNUAL HIGH WATER
- ⊕ LB LIMIT OF BANK
- ⊕ WFB100 VEGETATED WETLAND BOUNDARY

## Proposed Solar Array

Route 25  
Wareham, Massachusetts

No.	Revision	Date	App'd.

Designed by	Checked by
Issued for	Date
	January 12, 2021

## Existing Conditions Plan of Land

Drawing Number

COMMONWEALTH OF MASSACHUSETTS  
REGISTERED PROFESSIONAL LAND SURVEYOR  
RUSSELL J. BOUSQUET  
NO. 35388

# Sv-6

Sheet 6 of 6

Project Number  
**14668.03**