

### SOIL TEST DATA


SOIL TESTING AND EVALUATION BY: JAMES GARFIELD, SE# 14162  
DATE: MARCH 12, 2020

TP-1	APPROX. GRADE EL.	TP-2	APPROX. GRADE EL.
EL. 100.7	4"	EL. 100.8	3"
EL. 100.2	10"	EL. 100.3	9"
EL. 93.0	96"	EL. 93.0	96"


WEPPING OBSERVED: NONE  
MOTTLING OBSERVED: NONE  
PERC. RATE: <2 MPI @ 30-48"  
ESHOW: 96" (EL. 93.0)



### 1,500 GAL. SEPTIC TANK (MONOLITHIC EXT. BASE) DETAIL

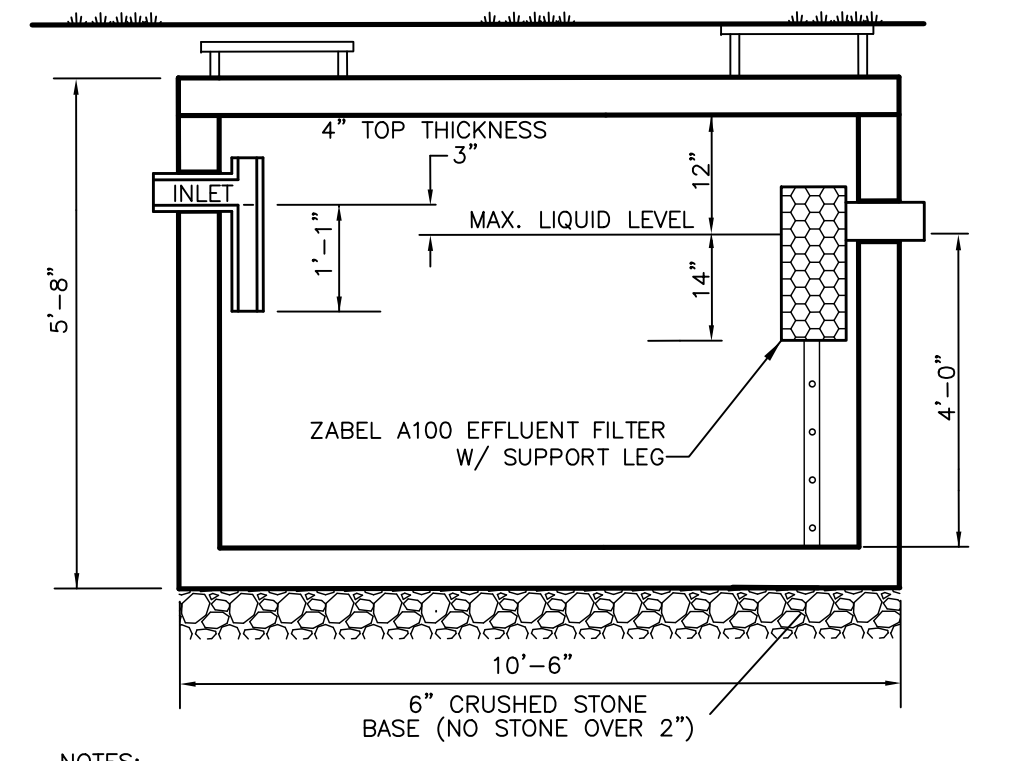

- NOTES:
- THE SEPTIC TANK INLET COVER SHALL BE EXTENDED TO WITHIN 6" OF FINISHED GRADE. THE SEPTIC TANK OUTLET COVER SHALL BE EXTENDED TO FINISHED GRADE & BE EQUIPPED WITH A FRAME & COVER (20" DIA.).
  - ALL PIPE CONNECTION AND CONSTRUCTION JOINTS SHALL BE SEALED WITH HYDRAULIC CEMENT.
  - SEPTIC TANK SHALL BE INSTALLED ON A LEVEL 6" CRUSHED STONE BASE.
  - OUTLET SHALL BE EQUIPPED WITH A ZABEL A100 EFFLUENT FILTER (OR APPROVED EQUAL).

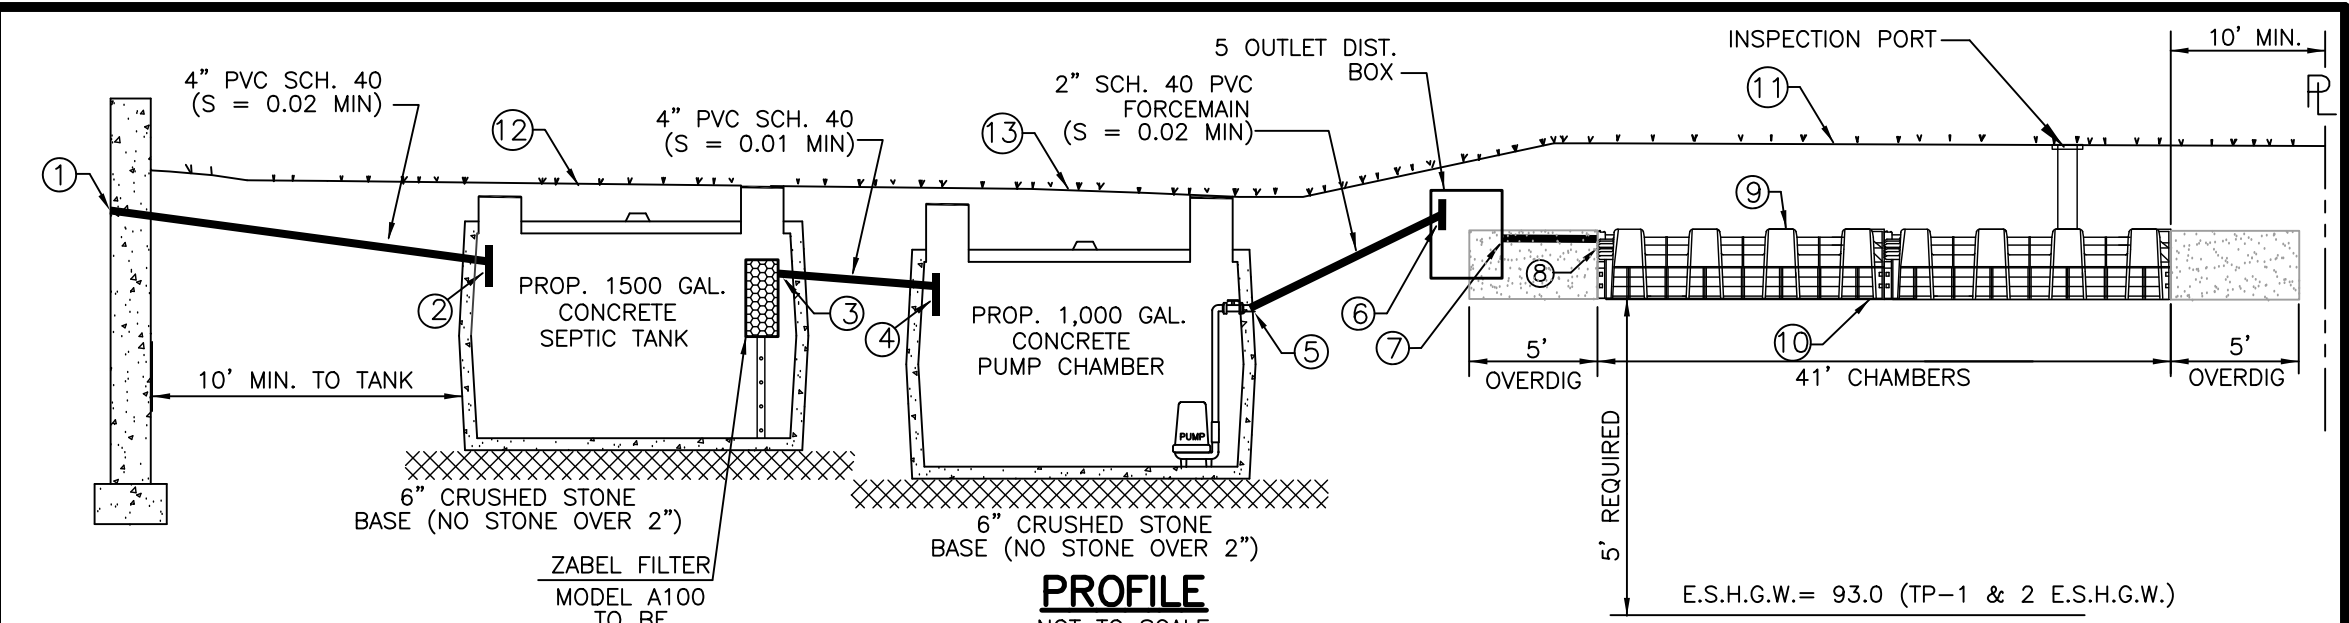


### SCHEDULE OF ELEVATIONS

1. INV. OF PIPE AT FOUNDATION = 97.3 MIN. (CONTRACTOR TO VERIFY PRIOR TO CONSTRUCTION)	8. INV. OF 4" PIPE @ CHAMBER INLET = 98.59
2. INV. OF PIPE AT SEPTIC TANK INLET = 96.25	9. TOP OF CHAMBER (BREAKOUT) = 99.08
3. INV. OF PIPE AT SEPTIC TANK OUTLET = 96.00	10. BOTTOM OF CHAMBER = 98.00
4. INV. OF PIPE AT PUMP CHAMBER INLET = 95.95	11. FINISHED GRADE OVER LEACHING CHAMBERS = 100.1(MIN.) - 102.1(MAX.)
5. INV. OF PIPE AT PUMP CHAMBER OUTLET = 96.20	12. FINISHED GRADE OVER SEPTIC TANK = 98.0(MIN.) - 100.3(MAX.)
6. INV. OF 2" FORCEMAIN AT DIST. BOX INLET = 98.82	13. FINISHED GRADE OVER PUMP CHAMBER = 98.0(MIN.) - 100.2(MAX.)
7. INV. OF 4" PIPE AT DIST. BOX OUTLET = 98.65	

### ZONING: RESIDENTIAL DISTRICT R-130


	REQUIRED	EXISTING	PROPOSED
MIN. LOT AREA (S.F.):	130,000 S.F.	327,571 S.F.	NO CHANGE
FRONTAGE (FT.):	200'	419.3'	NO CHANGE
FRONT YARD SETBACK (FT.):	100'	1,247.9'	1,233.5'
LEFT SIDE YARD SETBACK (FT.):	30'	12.0'	30.4'
RIGHT SIDE YARD SETBACK (FT.):	30'	43.4'	30.4'
REAR YARD SETBACK (FT.):	30'	55.4'	63.7'
BUILDING HEIGHT (FT.):	35'	<35'	<35'

### 5 OUTLET DISTRIBUTION BOX

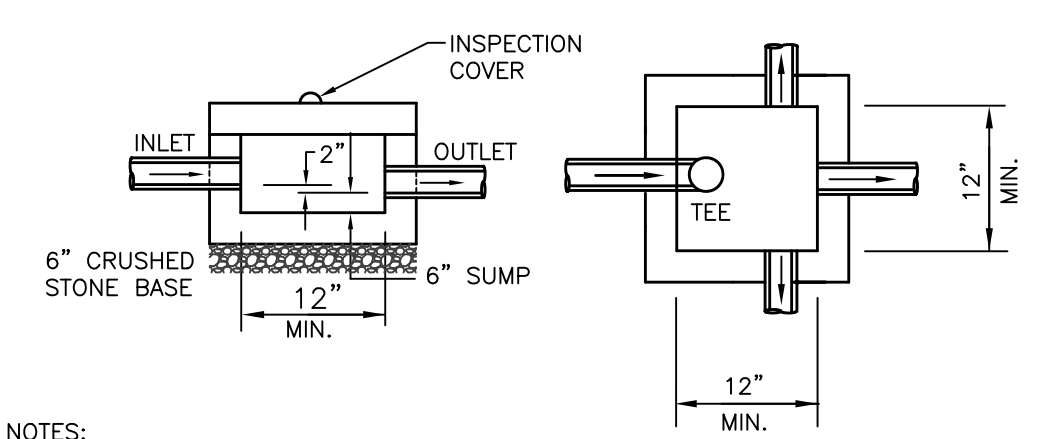

- NOTES:
- DISTRIBUTION BOX COVER SHALL BE EQUIPPED WITH RISERS AS NECESSARY TO BRING THE COVER TO WITHIN 6" OF FINISHED GRADE.
  - ALL PIPE CONNECTION AND CONSTRUCTION JOINTS SHALL BE SEALED WITH HYDRAULIC CEMENT.
  - DISTRIBUTION BOX TO BE INSTALLED ON A LEVEL 6" CRUSHED STONE BASE. THE FIRST 2 FT. OF PIPE EXITING THE DISTRIBUTION BOX SHALL BE INSTALLED LEVEL.
  - THE INLET SHALL BE EQUIPPED W/2" PVC TEE.


### 1,000 GAL. PUMP CHAMBER DETAIL

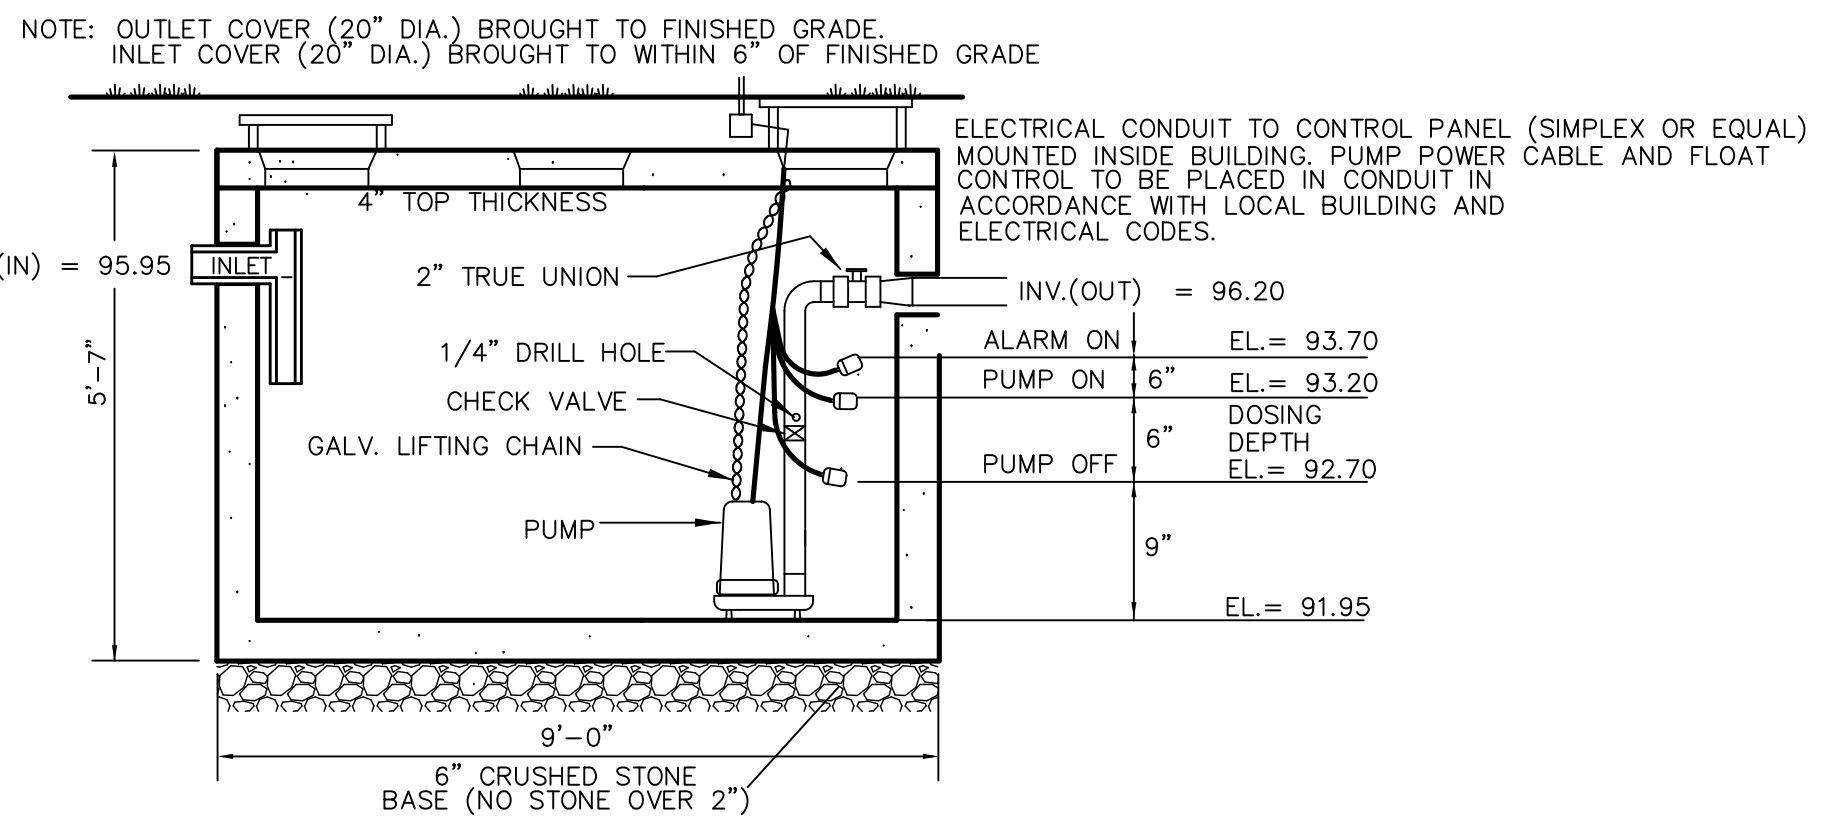


### PUMP DESIGN NOTES:

- THE PUMP CONTROLS SHALL BE DESIGNED TO ALLOW THE FIELD TO BE DOSED WITH 124 GAL. PER DOSE (APPROX. 2.9 TIMES IN A 24-HOUR PERIOD UNDER NORMAL OPERATING CONDITIONS).
  - USE GOULDS SUBMERSIBLE EFFLUENT PUMP W503B, 1/3 HP, 2" DISCHARGE, 2" SOLIDS CAPACITY, T.D.H. = 8.0 FT. @ 15 GPM OR APPROVED EQUAL.
  - INSTALL HIGH WATER MERCURY FLOAT LEVEL CONTROL IN PUMP CHAMBER WITH VISIBLE FLASHING AND AUDIBLE ALARMS. CONTRACTOR TO COORDINATE LOCATIONS WITH HOMEOWNER. PUMP POWER SHALL BE LOCATED ON SEPARATE CIRCUIT FROM THE ALARM CIRCUIT. ALL ELECTRICAL WORK SHALL BE PERFORMED BY A LICENSED ELECTRICIAN WITH A VALID ELECTRICAL PERMIT AND TO BE INSPECTED BY THE TOWN OF SCITUATE WIRING INSPECTOR.
- 24-HOUR EMERGENCY STORAGE (330 GAL. MIN.)  
EL = 95.95 INVERT IN  
EL = 93.70 ALARM ON  
2'25" AVAILABLE STORAGE  
x 250 GAL./VERT. FOOT = 562.5 GALLONS



### INSPECTION PORT

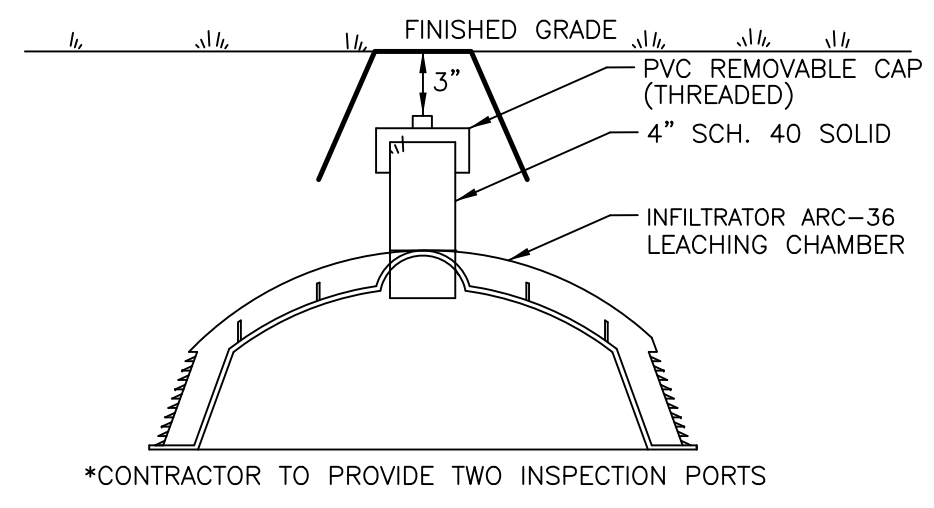


### INFILTRATOR ARC 36 CHAMBER SYSTEM

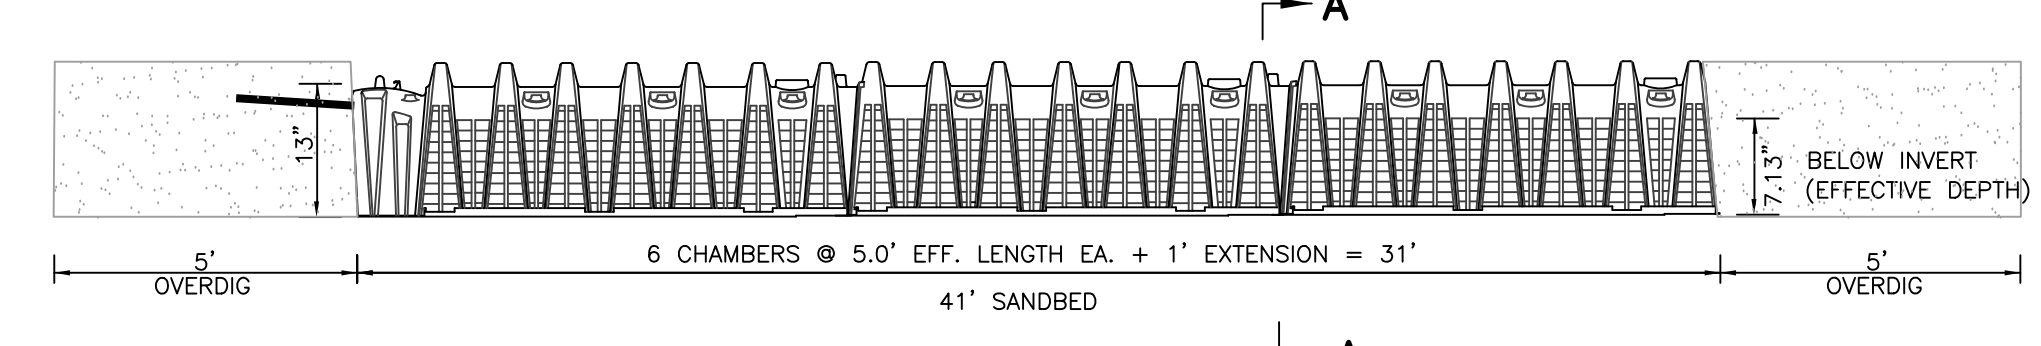

### INFILTRATOR ARC 36 LEACHING CHAMBERS SECTION A-A

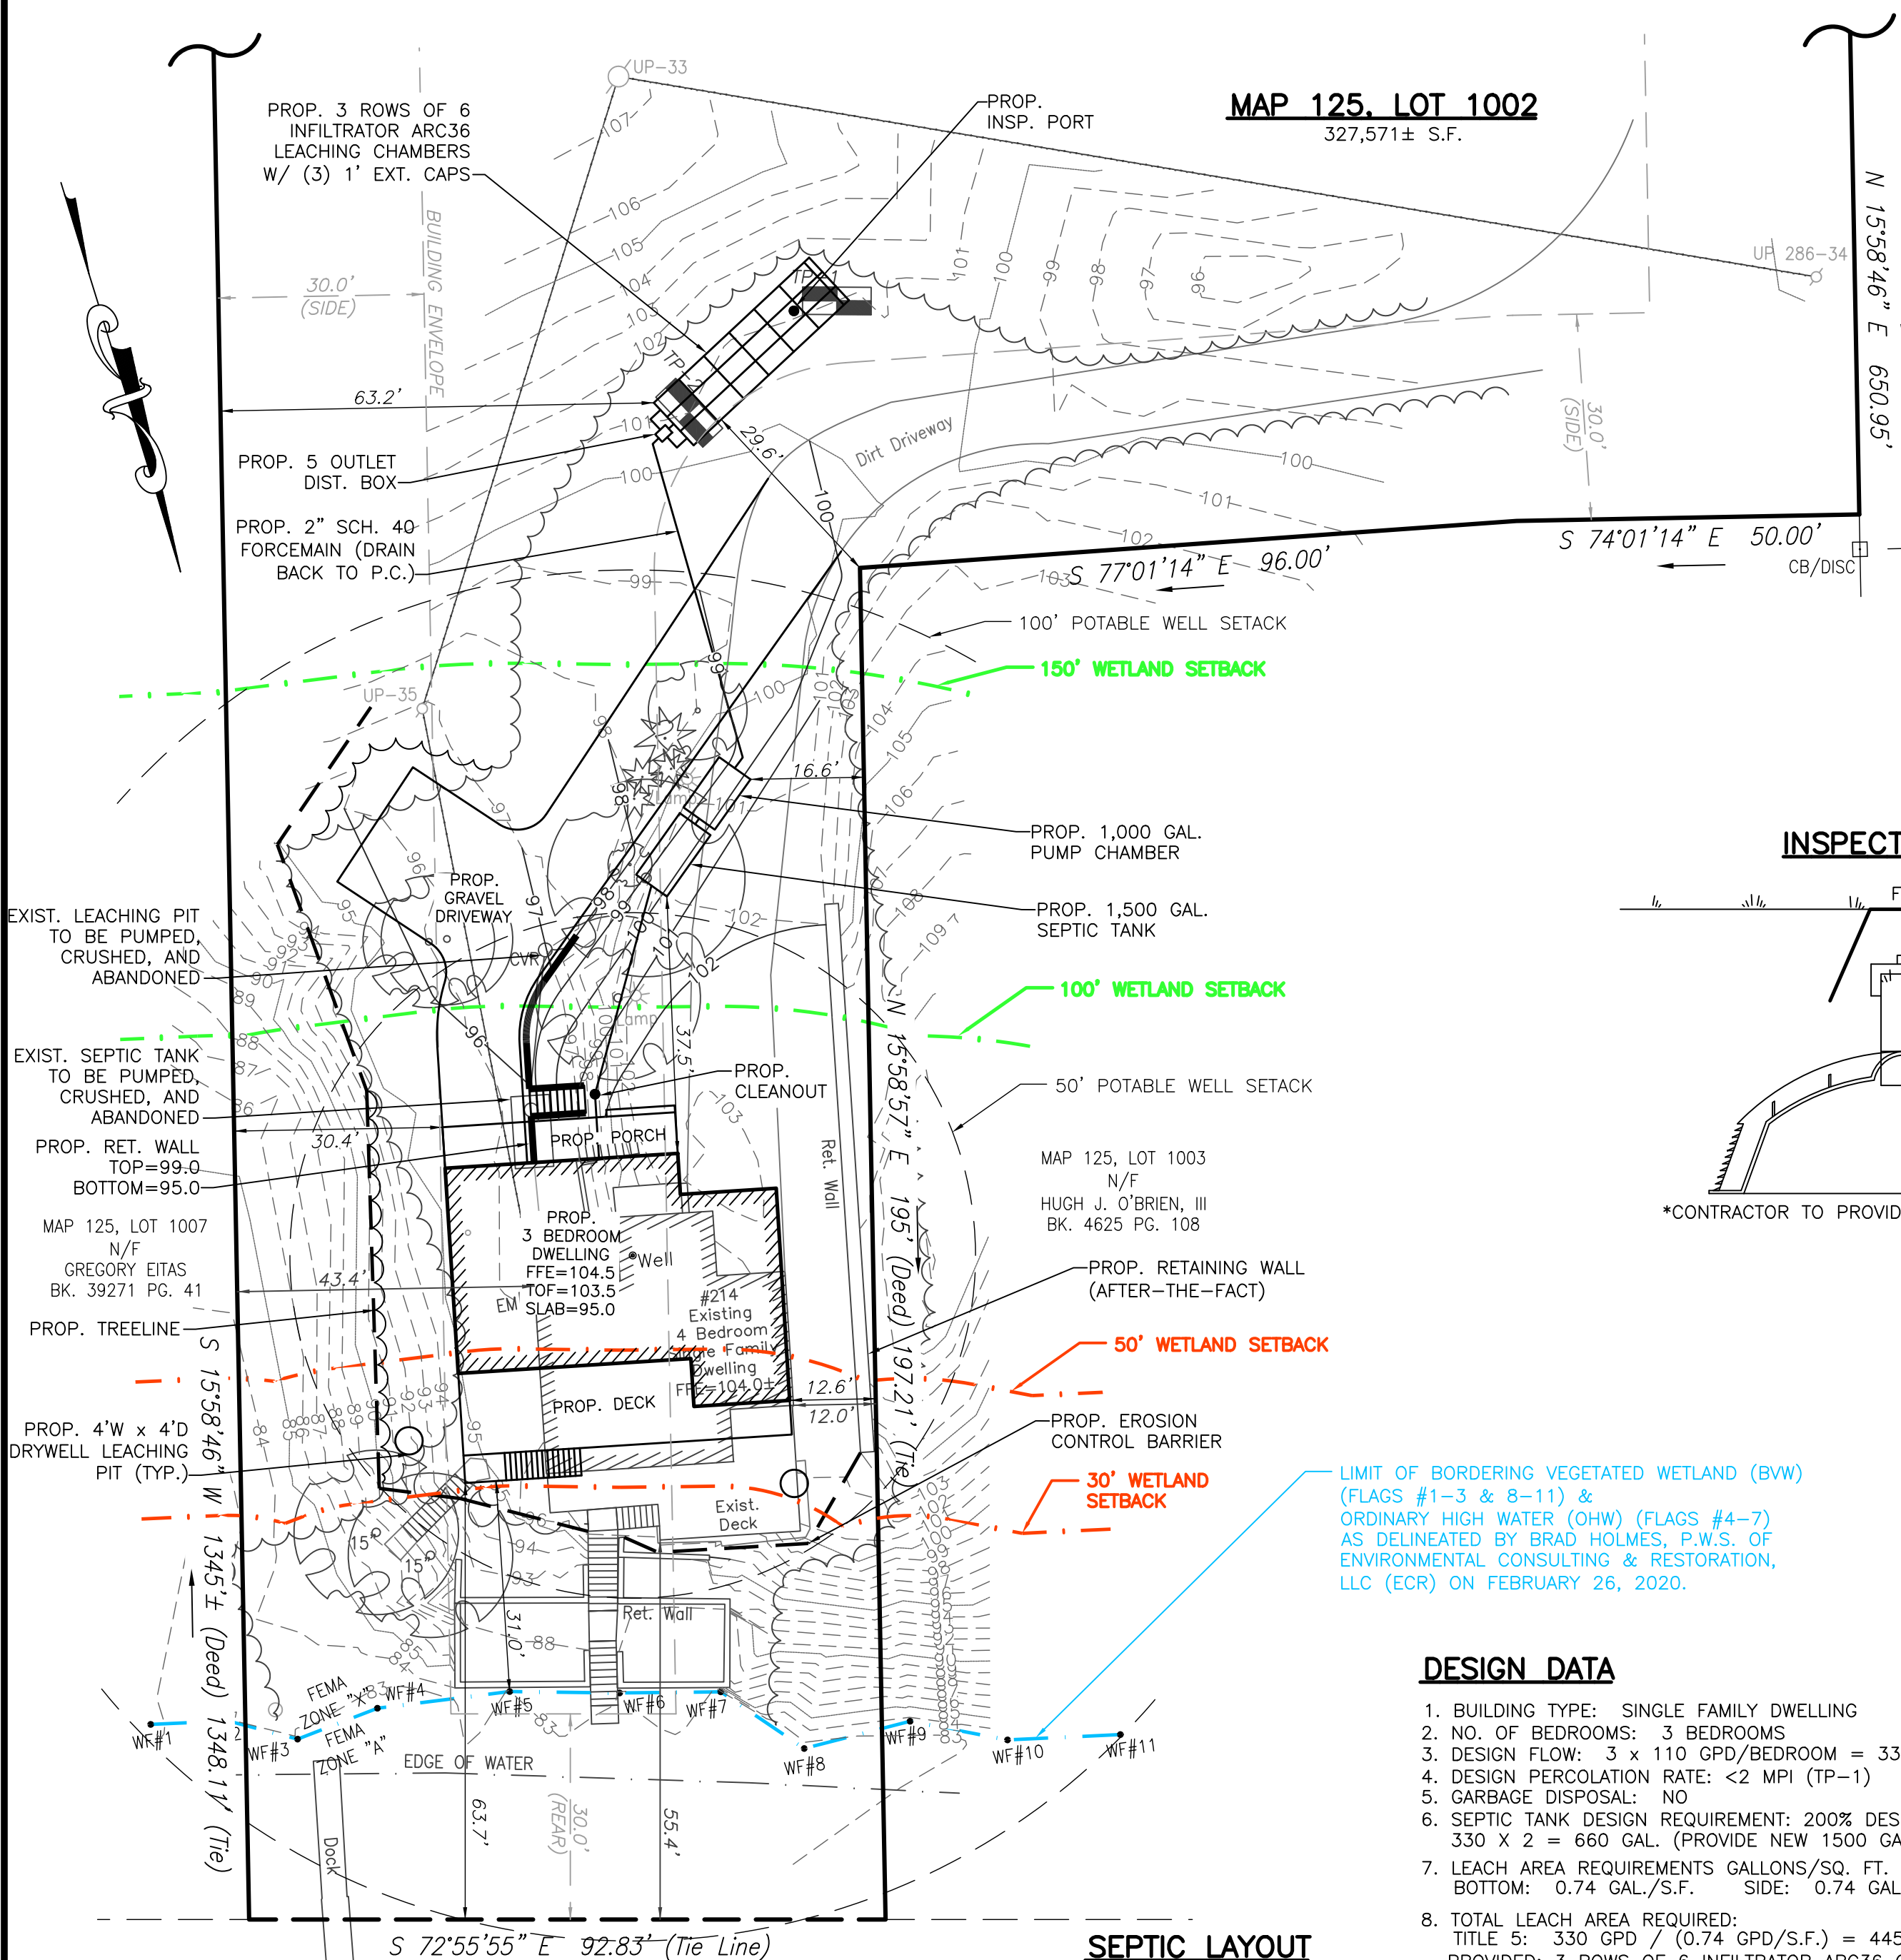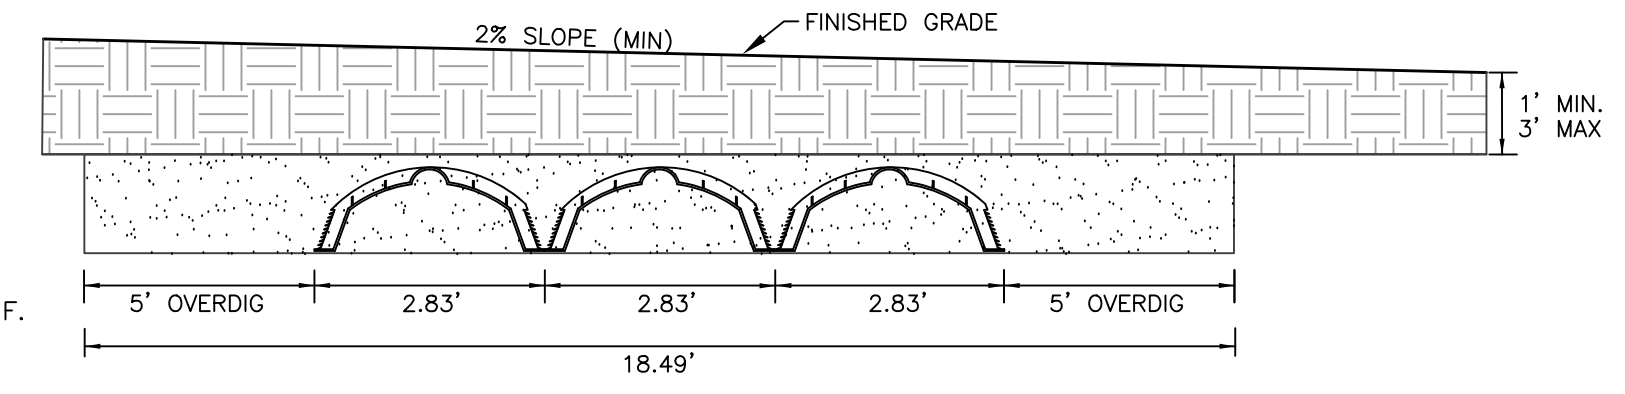

### SEPTIC LAYOUT

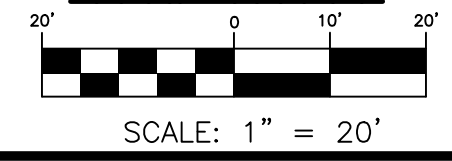

### DESIGN DATA

- BUILDING TYPE: SINGLE FAMILY DWELLING
- NO. OF BEDROOMS: 3 BEDROOMS
- DESIGN FLOW: 3 x 110 GPD/BEDROOM = 330 GPD (GALLONS PER DAY)
- DESIGN PERCOLATION RATE: <2 MPI (TP-1)
- GARBAGE DISPOSAL: NO
- SEPTIC TANK DESIGN REQUIREMENT: 200% DESIGN FLOW 330 X 2 = 660 GAL. (PROVIDE NEW 1500 GAL. SEPTIC TANK)
- LEACH AREA REQUIREMENTS GALLONS/SQ. FT. BOTTOM: 0.74 GAL./S.F. SIDE: 0.74 GAL./S.F.
- TOTAL LEACH AREA REQUIRED: TITLE 5: 330 GPD / (0.74 GPD/S.F.) = 445.9 S.F. PROVIDED: 3 ROWS OF 6 INFILTRATOR ARC36 CHAMBERS W/ (3) 1' EXT. CAPS EFFECTIVE AREA: [(18 CHAMBERS x 5.00'L) + (3) 1' EXT.] x 4.8 S.F./L.F. = 446.4 S.F. CAPACITY = 446.4 S.F. x 0.74 GPD/S.F. = 330.3 GPD \*EFFECTIVE AREA PER GENERAL USE CERTIFICATION ISSUED BY DEP

### GENERAL NOTES

- SEPTIC SYSTEM INSTALLATION CONTRACTORS SHALL BE LICENSED BY THE BOARD OF HEALTH AND MUST COMPLY WITH ALL REQUIREMENTS OF THE BOARD OF HEALTH DISPOSAL WORKS CONSTRUCTION PERMIT AND ANY CONDITIONS, IF ISSUED BY THE CONSERVATION COMMISSION.
- ALL CONSTRUCTION MUST COMPLY WITH TITLE 5 OF THE STATE ENVIRONMENTAL CODE 310 CMR 15 & THE ANY LOCAL BOARD OF HEALTH SUPPLEMENTAL REGULATIONS.
- THERE SHALL BE NO CHANGES MADE IN THIS PLAN WITHOUT THE WRITTEN PERMISSION OF THE BOARD OF HEALTH AND DESIGN ENGINEER.
- ANY CHANGE IN SITE CONDITIONS, DISCREPANCIES, ERRORS OR OMISSIONS SHALL BE BROUGHT TO THE ATTENTION OF MORSE ENGINEERING PRIOR TO THE COMMENCEMENT OF WORK.
- THIS PLAN HAS BEEN PREPARED IN ACCORDANCE WITH TITLE 5 (310 CMR 15) AND THE LOCAL BOARD OF HEALTH REQUIREMENTS TO THE FULLEST EXTENT PRACTICABLE. NO GUARANTEE TO THE SYSTEMS PERFORMANCE IS EXPRESSED OR IMPLIED.
- SOIL TEST DATA SHOWN IS LIMITED TO THE CONDITIONS EXISTING AT THE SUBJECT TEST PIT LOCATION ONLY. IF DIFFERENT SOIL CONDITIONS ARE FOUND IN THE AREA OF THE PROPOSED SOIL ABSORPTION SYSTEM THEY SHALL BE BROUGHT TO THE ATTENTION OF MORSE ENGINEERING IMMEDIATELY.
- THE CONTRACTOR SHALL NOTIFY DIGSAFE PRIOR TO ANY EXCAVATION AT THE SUBJECT PROPERTY. IT IS SPECIFICALLY CAUTIONED THAT THE SUBSURFACE UTILITIES SHOWN ARE APPROXIMATE ONLY AND HAVE BEEN COMPILED FROM AVAILABLE RECORDS AND OBSERVABLE SITE FEATURES. UTILITIES OTHER THAN THOSE SHOWN MAY BE PRESENT AT THIS LOCATION.
- THIS PLAN HAS BEEN PREPARED SPECIFICALLY AS A SEPTIC SYSTEM DESIGN AND IS NOT TO BE USED TO ESTABLISH PROPERTY LINES OR BUILDING SETBACKS. PROPERTY LINES AND BUILDING LOCATIONS ARE GRAPHIC ONLY. PROPERTY LINES NOT HAVING BEEN VERIFIED, NO REPRESENTATION OR CERTIFICATION AS TO THE ACCURACY OF THOSE SHOWN IS IMPLIED.
- CONTRACTOR TO VERIFY AND ENSURE THAT ALL INTERIOR PLUMBING IS DIRECTED INTO PROPOSED SEPTIC SYSTEM. ANY VARIATIONS FROM THE DESIGN AS SHOWN SHALL BE BROUGHT TO THE ATTENTION OF THE DESIGN ENGINEER.

### CONSTRUCTION/INSPECTION NOTES

- CONTRACTOR SHALL COORDINATE INSPECTION TIMES WITH THE LOCAL BOARD OF HEALTH AND DESIGN ENGINEER 24-HOURS IN ADVANCE OF THE FOLLOWING INSPECTIONS:
  - AFTER EXCAVATION FOR TANKS, TO VERIFY 6" STONE BASE, PRIOR TO TANK INSTALL.
  - AFTER EXCAVATION OF ALL UNSUITABLE MATERIAL FROM SOIL ABSORPTION AREA.
  - PRIOR TO COVERING THE CONSTRUCTED SYSTEM.
  - AFTER SYSTEM BACKFILL AND FINAL GRADING.
- ALL CONSTRUCTION MUST COMPLY WITH TITLE 5 OF THE STATE ENVIRONMENTAL CODE 310 CMR 15 & THE ANY LOCAL BOARD OF HEALTH SUPPLEMENTAL REGULATIONS.
- ALL TIGHT-JOINT PLUMBING SHALL BE CONSTRUCTED OF SCH. 40 PVC PIPE WITH CLEANED AND CEMENTED FITTINGS, UNLESS OTHERWISE NOTED.
- ALL PRECAST/PIPE CONSTRUCTION JOINTS AND FITTINGS SHALL BE MADE WATERTIGHT BY PARGLING WITH HYDRAULIC CEMENT.
- THE CONTRACTOR SHALL PROVIDE A SIEVE ANALYSIS OF THE TITLE 5 PERC SAND UTILIZED FOR FILL TO VERIFY THAT IT MEETS THE REQUIREMENTS OF 310 CMR 15.255(3). TITLE 5 SAND FILL SHALL COMPLY WITH THE FOLLOWING:
 

SIEVE SIZE	PARTICLE SIZE
#4	4.75 mm
#50	0.30 mm
#100	0.15 mm
#200	0.075 mm
- THE CONTRACTOR SHALL PREVENT ANY HEAVY CONSTRUCTION MACHINERY AND/OR TRUCKS FROM DRIVING OVER THE PROPOSED SOIL ABSORPTION SYSTEM LOCATION.
- THE CONTRACTOR SHALL INSTALL MAGNETIC TAPE OVER SYSTEM PIPING & COMPONENTS FOR FUTURE SUBSURFACE LOCATION.
- THE DESIGN ENGINEER SHALL CERTIFY AND PREPARE AN "AS-BUILT" PLAN FOR SUBMITTAL TO THE BOARD OF HEALTH UPON SEPTIC SYSTEM COMPLETION.
- ALL DISTURBED AREAS SHALL BE RESTORED WITH 4" LOAM & SEED POST CONSTRUCTION.
- CONTRACTOR SHALL ABANDON EXISTING SEPTIC COMPONENTS IN ACCORDANCE WITH 310 CMR SEC. 15.354 OF TITLE 5 AND LOCAL REGULATIONS BY PUMPING DRY, CRUSHING AND ABANDONING.

### SITE NOTES

- LOCUS DOES NOT LIE WITHIN A DEP DESIGNATED ZONE II RESOURCE AREA.
- ALL WETLANDS WITHIN 100 FEET OF THE PROPOSED SEWAGE SYSTEM ARE SHOWN.
- PROPERTY LINE DATA WAS OBTAINED FROM RECORDED DEED (BK. 50971 PG. 92) AND RECORDED PLANS ON FILE AT THE PLYMOUTH COUNTY REGISTRY OF DEEDS.
- ALL ACTIVE/POTABLE WELLS OBSERVED WITHIN 100' OF THE PROPOSED SYSTEM ARE SHOWN.
- LOCUS LIES IN FEMA ZONE "A" AND "X" AS SHOWN ON FEMA COMMUNITY MAP PANEL 25023C 0492I DATED JULY 17, 2012. ZONE "A" IS A SPECIAL FLOOD HAZARD AREA.

PREPARED BY:		
PROJECT: <b>SITE &amp; SEPTIC SYSTEM DESIGN PLAN</b> <b>214 BARKER ROAD</b> (ASSESSOR'S MAP 125, LOT 1002) <b>WAREHAM, MASSACHUSETTS</b>		DESIGN: JDG CHECK: JMH JOB NO: 20-122
APPLICANT: <b>BARBARA VIEIRA</b> 10 LAUREL LANE BURLINGTON, MA 01803		DATE: 4/14/2020 REV: 6/3/2020 6/8/2020
PLAN TITLE: <b>SITE &amp; SEPTIC SYSTEM DESIGN PLAN</b>		SHEET: 1