LIST OF DRAWINGS

SHEET NO.	TITLE
1 OF 9	COVER SHEET
2 OF 9	EXISTING CONDITIONS / SITE PREPARATION PLAN
3 OF 9	LAYOUT & LANDSCAPING PLAN
4 OF 9	UTILITIES PLAN
5 OF 9	GRADING & DRAINAGE PLAN
6 OF 9	LIGHTING PLAN
7 OF 9	EMERGENCY ACCESS PLAN
8 OF 9	DETAIL SHEET
9 OF 9	DETAIL SHEET




CURRENT OWNER / APPLICANT: ANGELA MCKEOWN, TRUSTEE 388 MAIN STREET REALTY TRUST **484 LIBERTY STREET** ROCKLAND, MA 02370

CIVIL ENGINEER / SURVEYOR: JC ENGINEERING, INC. 2854 CRANBERRY HIGHWAY EAST WAREHAM, MA 02538 PH: 508-273-0377

PROPOSED SITE PLAN

386 MAIN STREET WAREHAM, MASSACHUSETTS


> DATE: MARCH 21, 2023 REV 4: SEPTEMBER 13, 2023

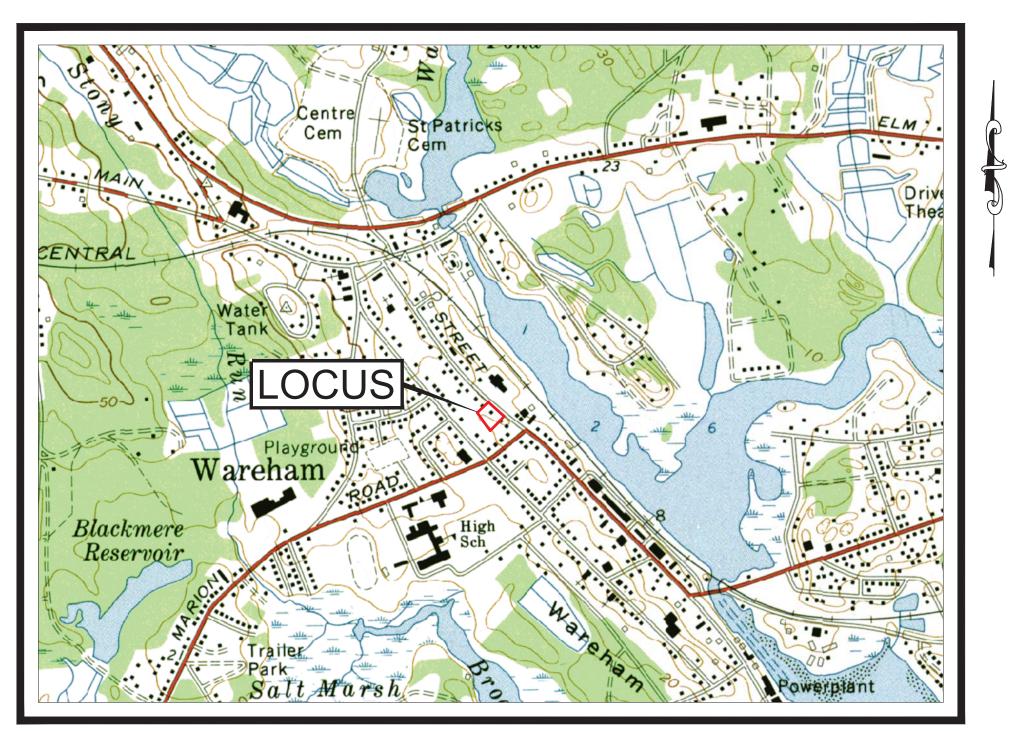


U.S.G.S. MAP SCALE 1" = 1000'


AERIAL MAP SCALE 1" = 500'

1071 5768 1073 **29** 1078 **1130 1131** 10615 1595 1080 0755 **1082 1159** 14020 1154 1156

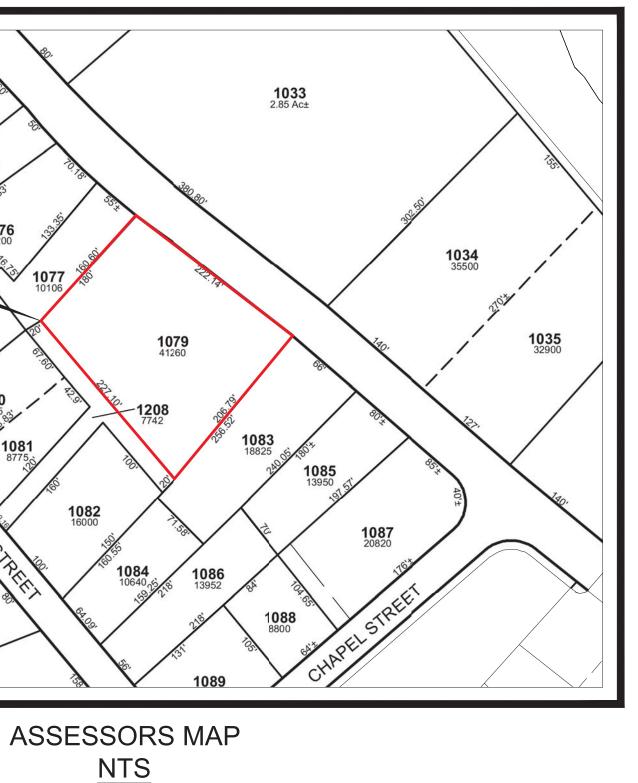

LEGEND

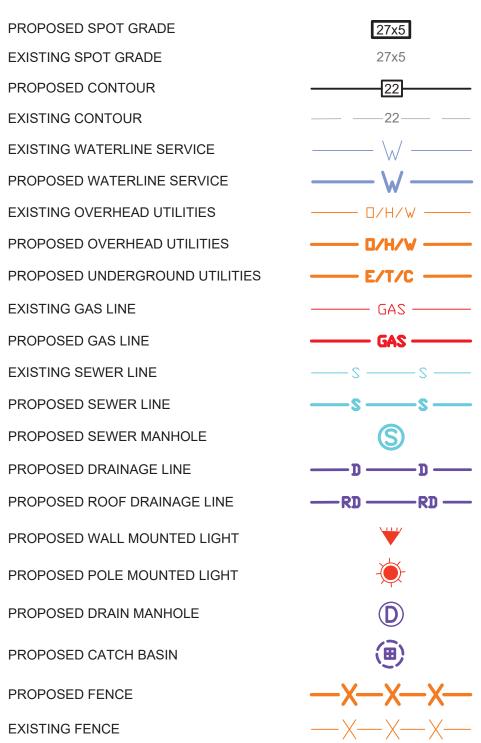

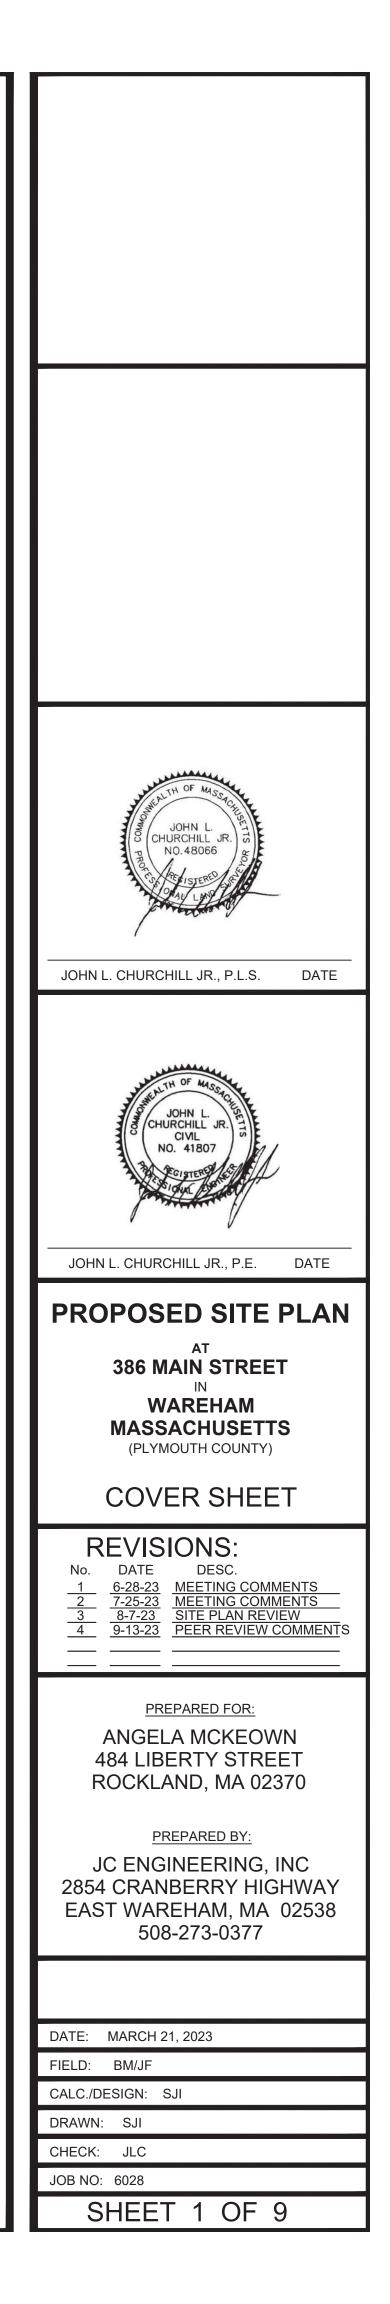

OWNER OF RECORD: 388 MAIN STREET REALTY TRUST ANGELA MCKEOWN, TRUSTEE 484 LIBERTY STREET ROCKLAND, MA 02370

FEMA FLOOD ZONE (LOT): Х

AS SHOWN ON COMMUNITY PANEL: #25023C0488K (dated 7-6-2021)

ASSESSOR'S MAP & LOT: MAP 61, LOT 1079

DEED REFERENCE: BOOK 55430, PAGE 277

PLAN REFERENCES: BOOK 38, PAGE 2941 BOOK 3385, PAGE 48

DRAINAGE **TEST PIT DATA**

INSPECTOR: Unwitnessed EVALUATOR: Bradley Bertolo, EIT, CSE DATE: January 6, 2023 TEST PIT #: 1 ELEV TOP =_ 30.50' ELEV WATER = < 21.50' PERC RATE = DEPTH OF PERC = TEXTURAL CLASS: 1 30.50' Fill 28.83' Sandy Loam 10Yr 3/2 28.33' Sandy Loam 10Yr 5/6 26.50' Fine Loamy Sand С 2.5Y 6/2 10% Gravel

Some Cobbles &

Boulders


108"

21.50'

DRAINAGE **TEST PIT DATA** INSPECTOR: Unwitnessed

EVALUATOR: Bradley Bertolo, EIT, CSE DATE: January 6, 2023 2 TEST PIT #: ELEV TOP =____ 24.00' ELEV WATER = < 14.00' PERC RATE = DEPTH OF PERC =

TEXTURAL CLASS: 1

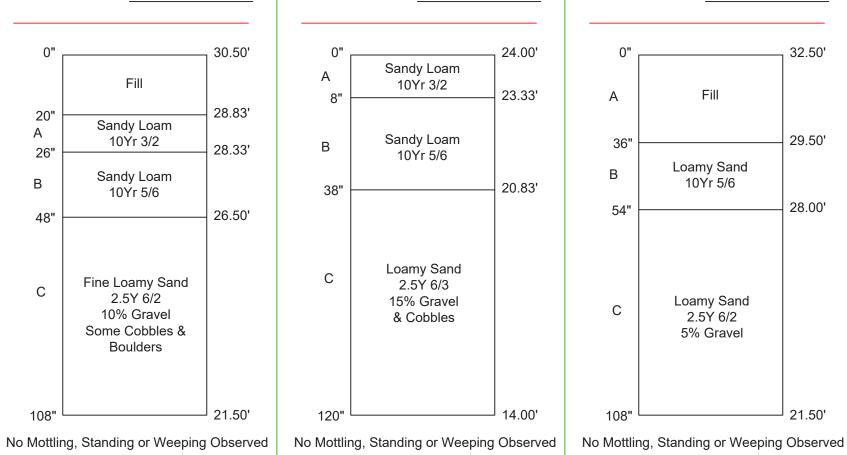

DRAINAGE **TEST PIT DATA**

INSPECT	OR: Unwitnessed			
EVALUATOR: Bradley Bertolo, EIT, CSE				
	January 6, 2023			
	- #:3			
	P = <u>32.50'</u>			
	TER = < 21.50'			
	\TE =			
)F PERC =			
TEXTUR/	AL CLASS: 1			
0"		32.50'		
А	Fill			
		29.50'		
36"		29.50		
В	Loamy Sand 10Yr 5/6			
54"		28.00'		

Loamy Sand

2.5Y 6/2

5% Gravel

21.50'

С

108"




N51° 41' 50"E


2.56'

(FND)-

CB/DISK

CB (FND)-



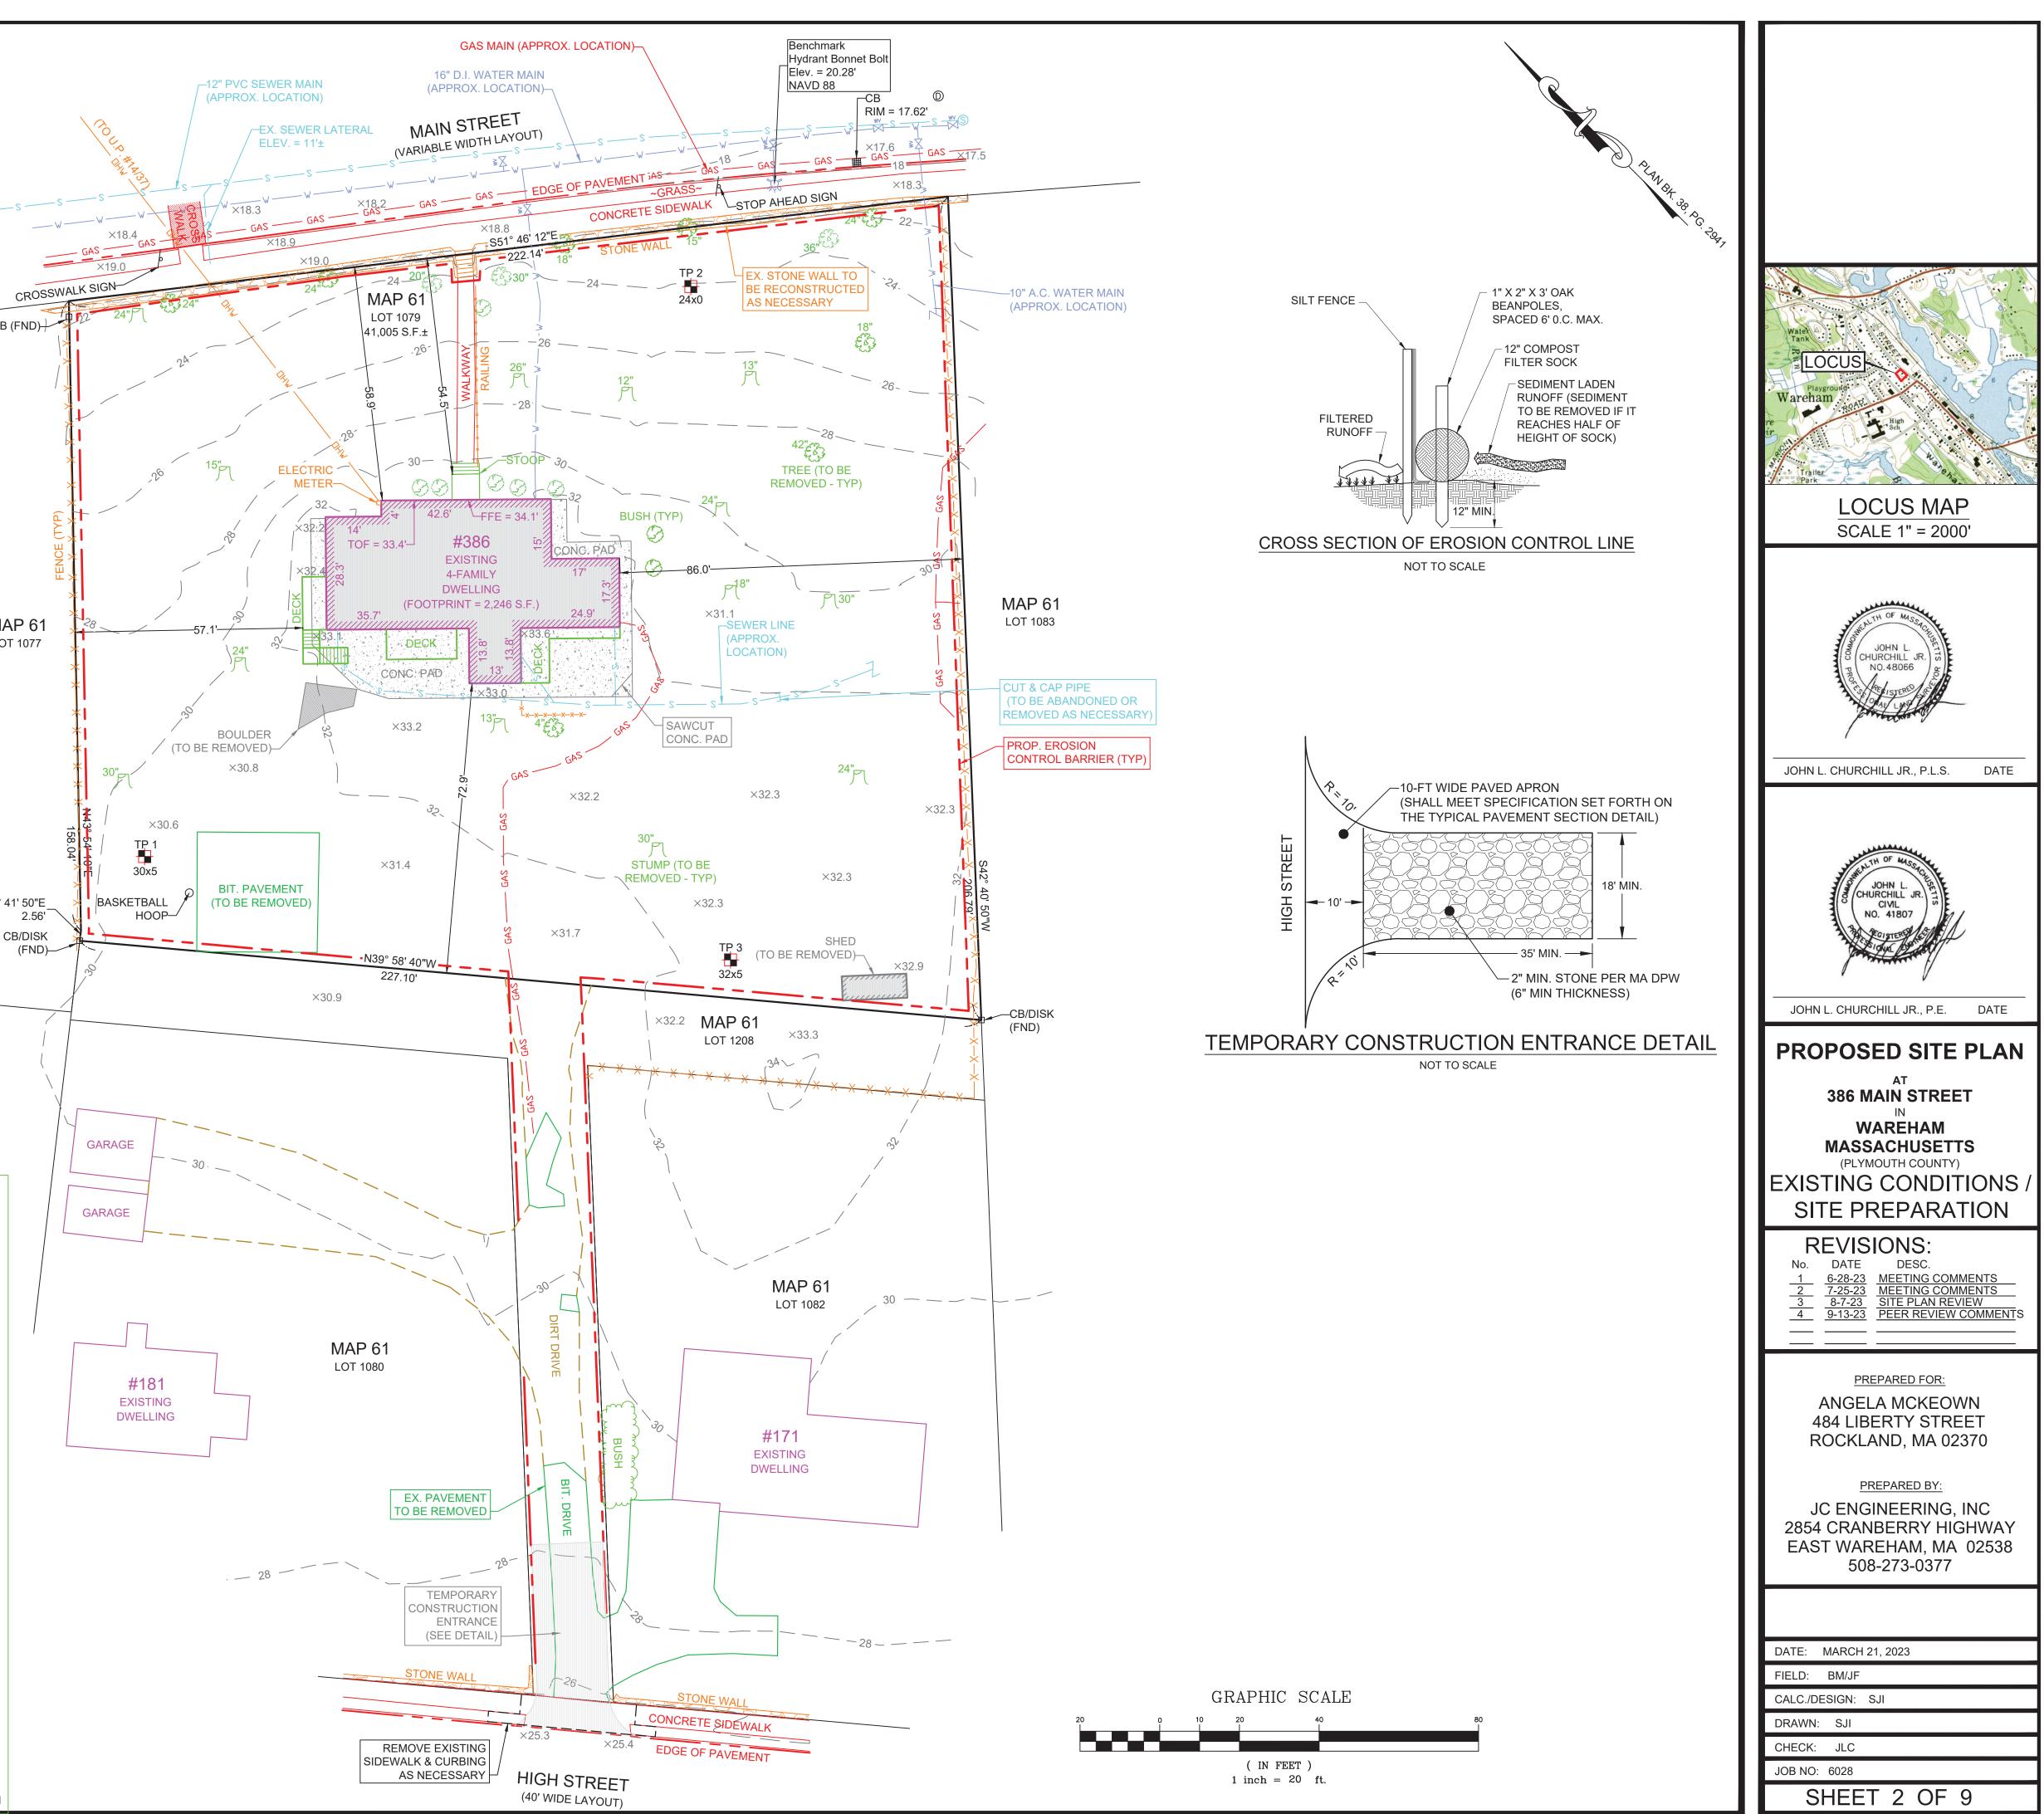

OFFSTREET PARKING SCHEDULE (TABLE 921)

NUMBER OF REQUIRED PARKING SPACES

12 (2 SPACES PER DWELLING UNIT)

8 (2 SPACES PER DWELLING UNIT)

PROPOSED USE


2-FAMILY DWELLING

4-FAMILY DWELLING

REQUIRED TOTAL

PROVIDED TOTAL

<u>20</u> <u>36</u>

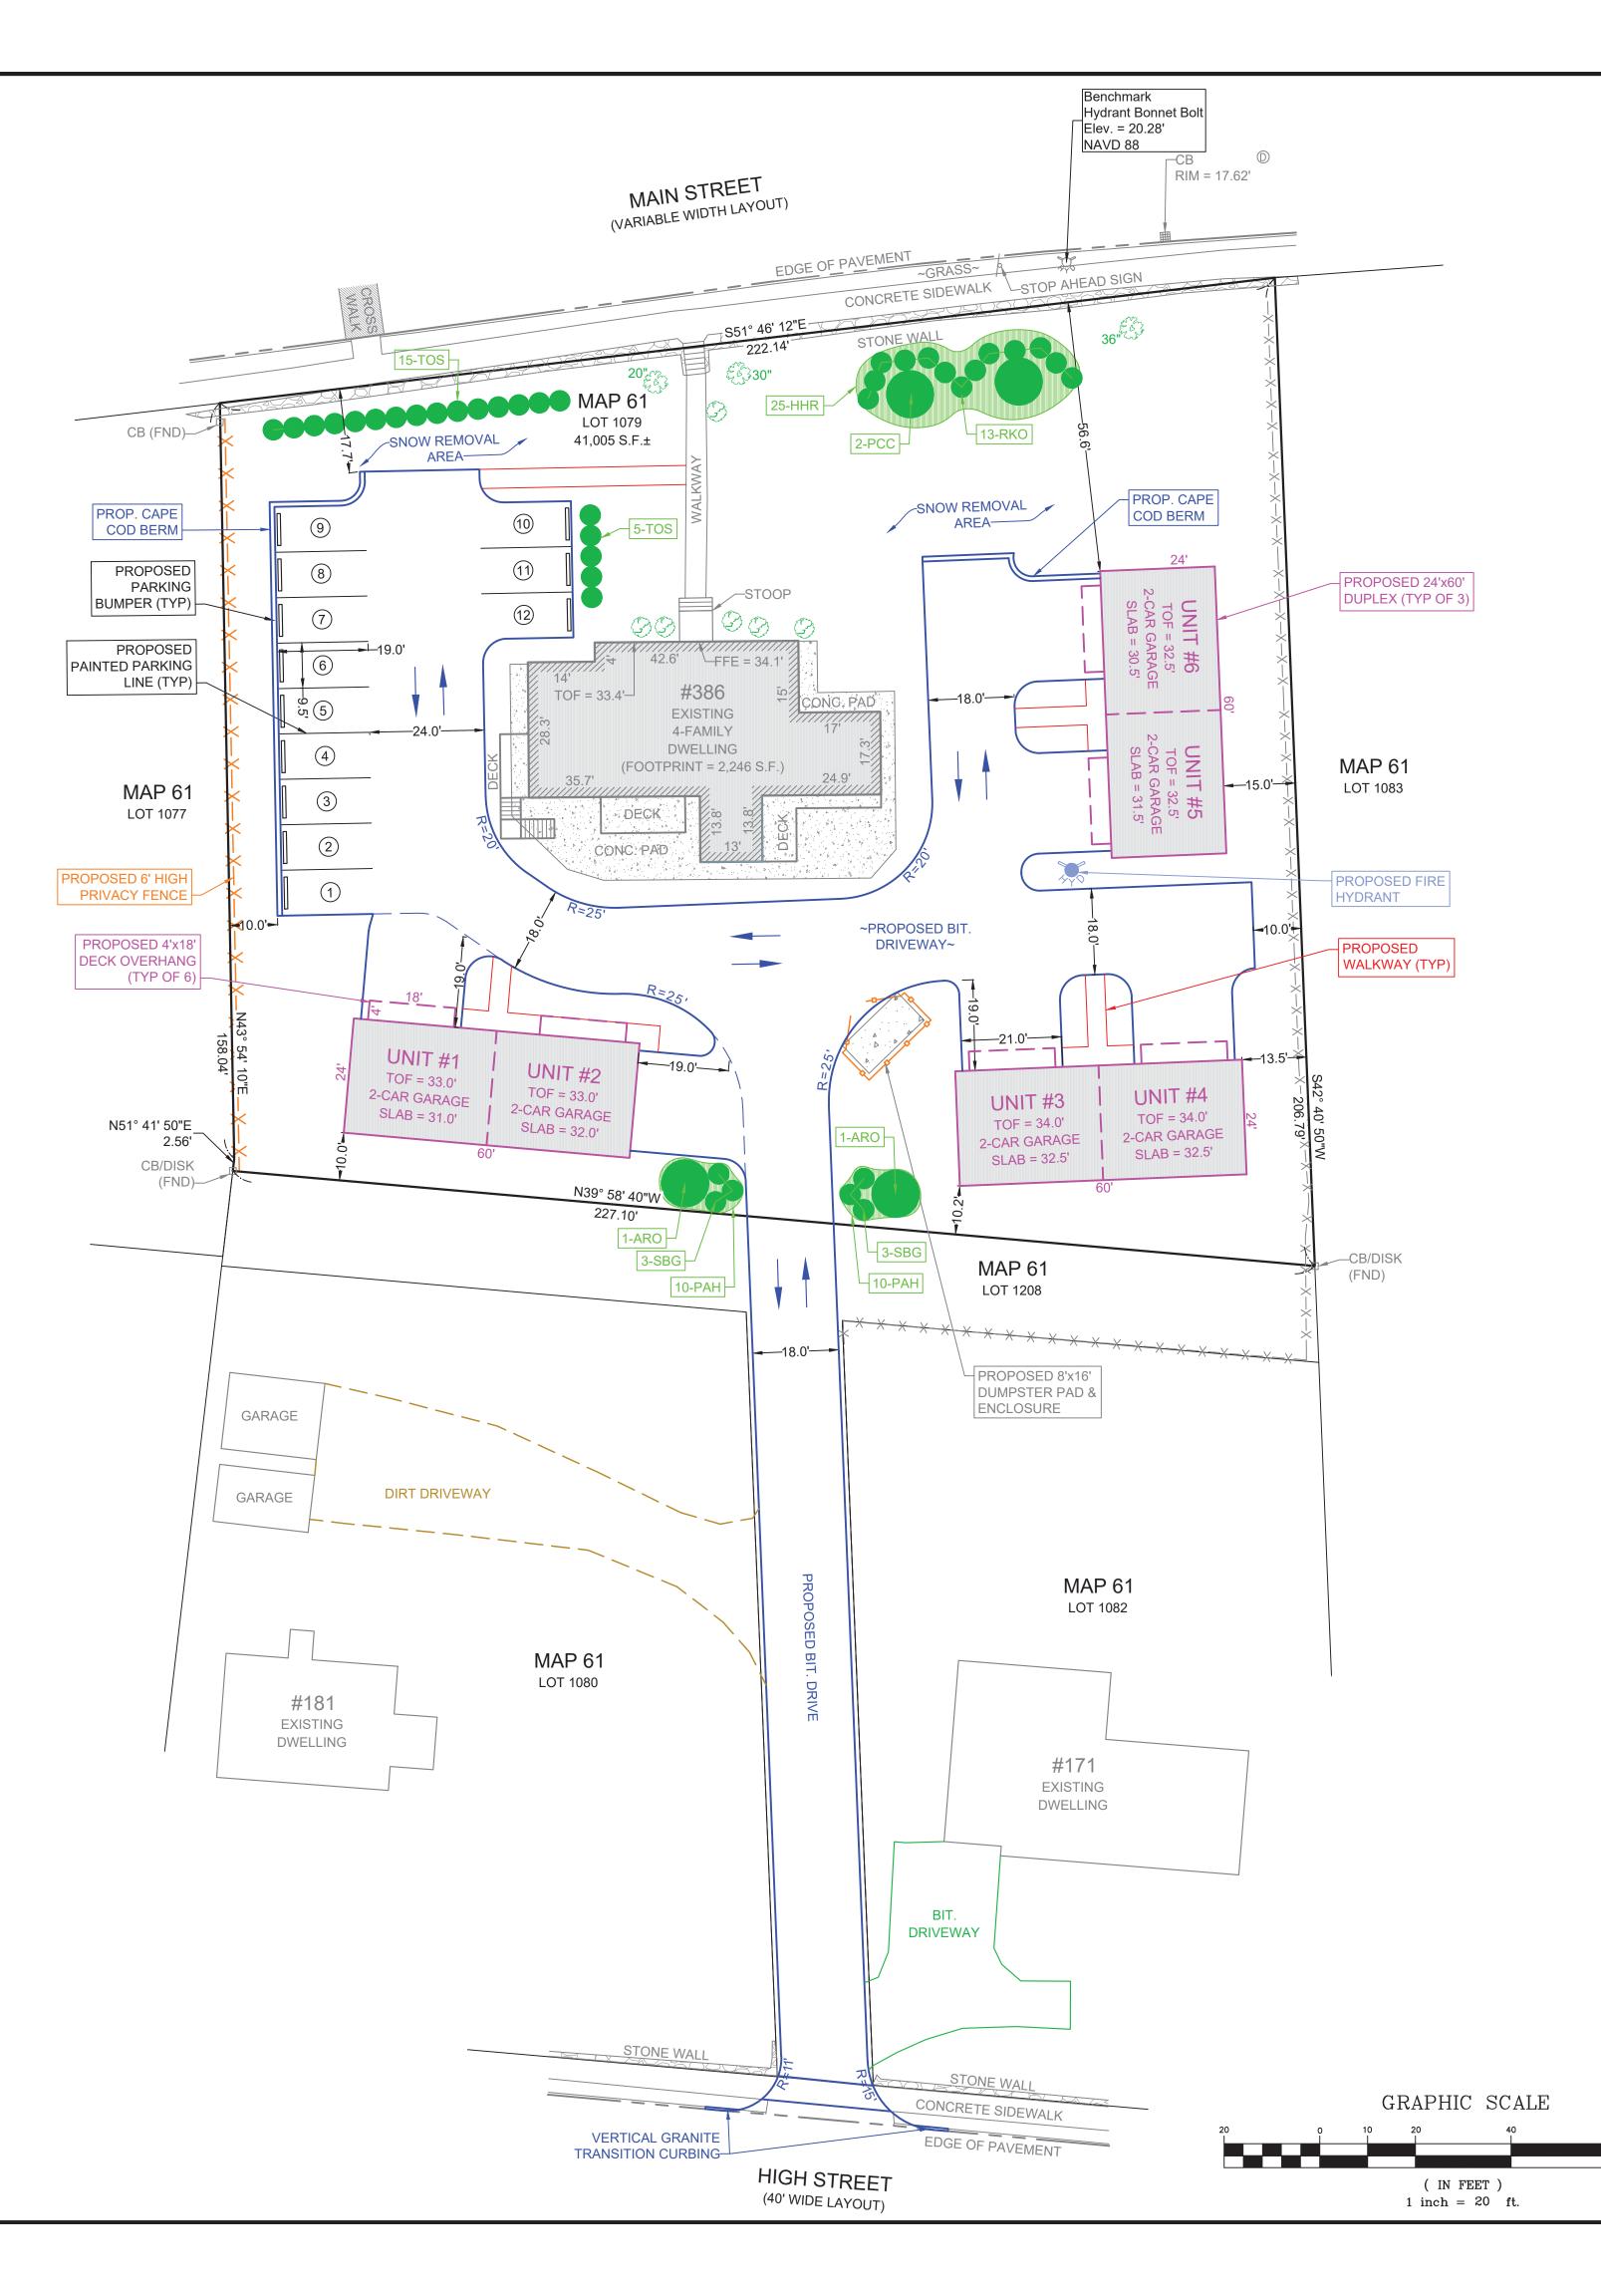

DENSITY LOT AREA = 41,005 S.F.

REQUIRED 15,000 S.F. FOR FIRST DWELLING UNIT 2,000 S.F. FOR EACH ADDITIONAL UNIT <u>PROVIDED</u> 1 DWELLING UNIT = 15,000 S.F. 9 ADDITIONAL DWELLING UNITS = 9 x 2,000 S.F. = 18,000 S.F.

TOTAL: 15,000 S.F + 19,000 S.F. = 33,000 S.F. < 41,005 S.F

ZONING SCHEDULE (TABLE 622) ZONING DISTRICT: WAREHAM VILLAGE 2 (WV-2)


ITEM	REQUIRED	EXISTING	PROPOSED
MIN. LOT AREA	15,000 S.F.	41,005 S.F.	N/A
MIN. FRONTAGE	75'	222.14'	N/A
MIN. FRONT SETBACK	*50.3'	54.5'	54.5'
MIN. SIDE SETBACK	10'	57.1'	13.5'
MIN. REAR SETBACK	10'	72.9'	10.0'
MAX. BUILDING HEIGHT	35'	< 35'	< 35'
MAX. BUILDING COVERAGE	20%	5.7%	17.1%
MAX. LOT COVERAGE	50%	11.8%	49.9%

*AVERAGE OF THE SETBACKS OF FIVE (5) RESIDENTIAL STRUCTURES ON EITHER SIDE OF THE SUBJECT PROPERTY.

FRONT SETBACK CALCULATION:

ADDRESS 402 MAIN STREET 400 MAIN STREET 398 MAIN STREET 394 MAIN STREET	FRONT SETBACK 48.4' 48.2' 39.6' 40.3'
380 MAIN STREET	<u>74.9'</u>
TOTAL =	251.4'

AVERAGE = 251.4' / 5 = 50.28' USE = 50.3'

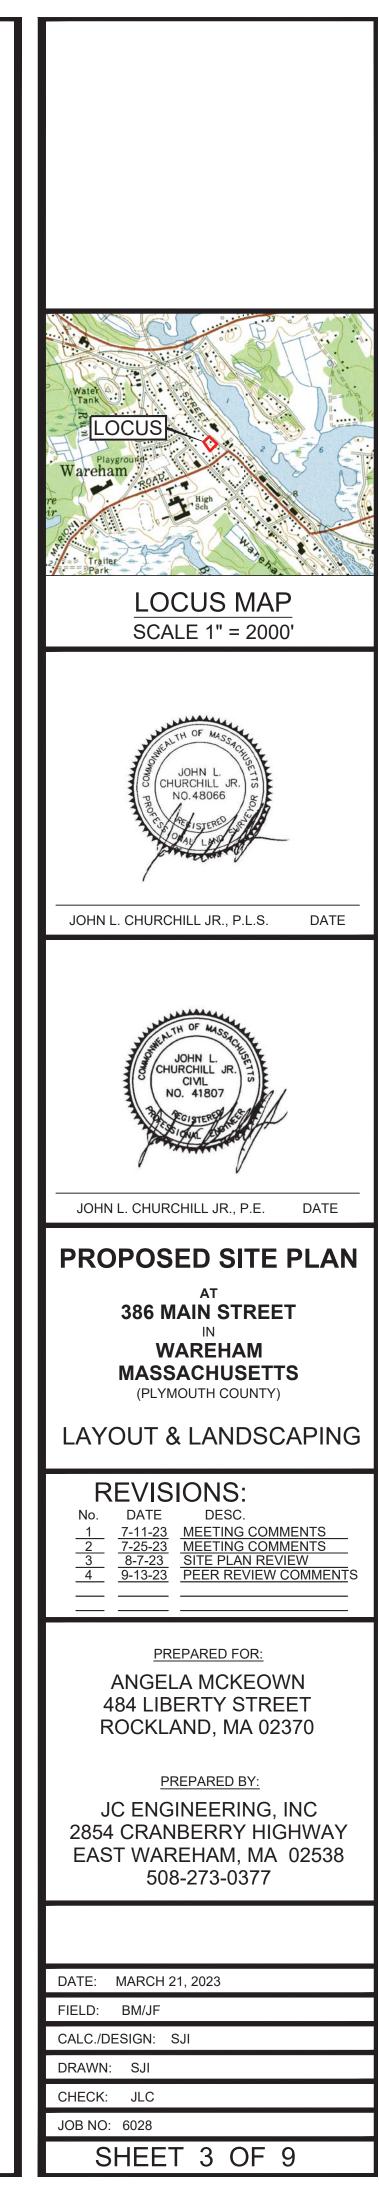

NOTES:


1. UTILITIES AS SHOWN ON THIS PLAN ARE BASED ON RECORD PLANS AVAILABLE AND FIELD LOCATED MARK OUTS PERFORMED BY THE RESPECTIVE UTILITY COMPANY. UTILITY LOCATIONS ON THIS PLAN SHALL BE CONSIDERED APPROXIMATE ONLY AND MAY NOT FULLY REPRESENT ALL UNDERGROUND UTILITIES LOCATED ON SITE. THE CONTRACTOR SHALL CONTACT DIG SAFE AT LEAST 72 HOURS PRIOR TO THE COMMENCEMENT OF CONSTRUCTION.


2. ALL SEWER WORK SHALL COMPLY WITH THE TOWN OF WAREHAM SEWER COMMISSIONERS RULES AND REGULATIONS. CONTRACTOR TO CONFIRM SIZE & ELEVATION OF EXISTING SEWER SERVICE PRIOR TO CONSTRUCTION. FINAL BUILDING SEWER INVERTS SHALL BE DETERMINED AT TIME OF CONSTRUCTION.


3. ALL WATER LINES AND CONNECTIONS SHALL COMPLY WITH THE WAREHAM FIRE DISTRICT RULES AND REGULATIONS. CONTRACTOR TO CONFIRM LOCATION OF EXISTING WATER SERVICE LINE PRIOR TO CONSTRUCTION.

4. CONTRACTOR SHALL COORDINATE WITH LOCAL UTILITY COMPANY & ELECTRICIAN FOR FINAL LOCATION, SIZE, & CONFIGURATION OF THE PROPOSED ELECTRICAL SERVICE.

5. CONTRACTOR SHALL COORDINATE WITH THE LOCAL GAS COMPANY FOR FINAL LOCATION, SIZE, & CONFIGURATION OF THE PROPOSED GAS SERVICE.

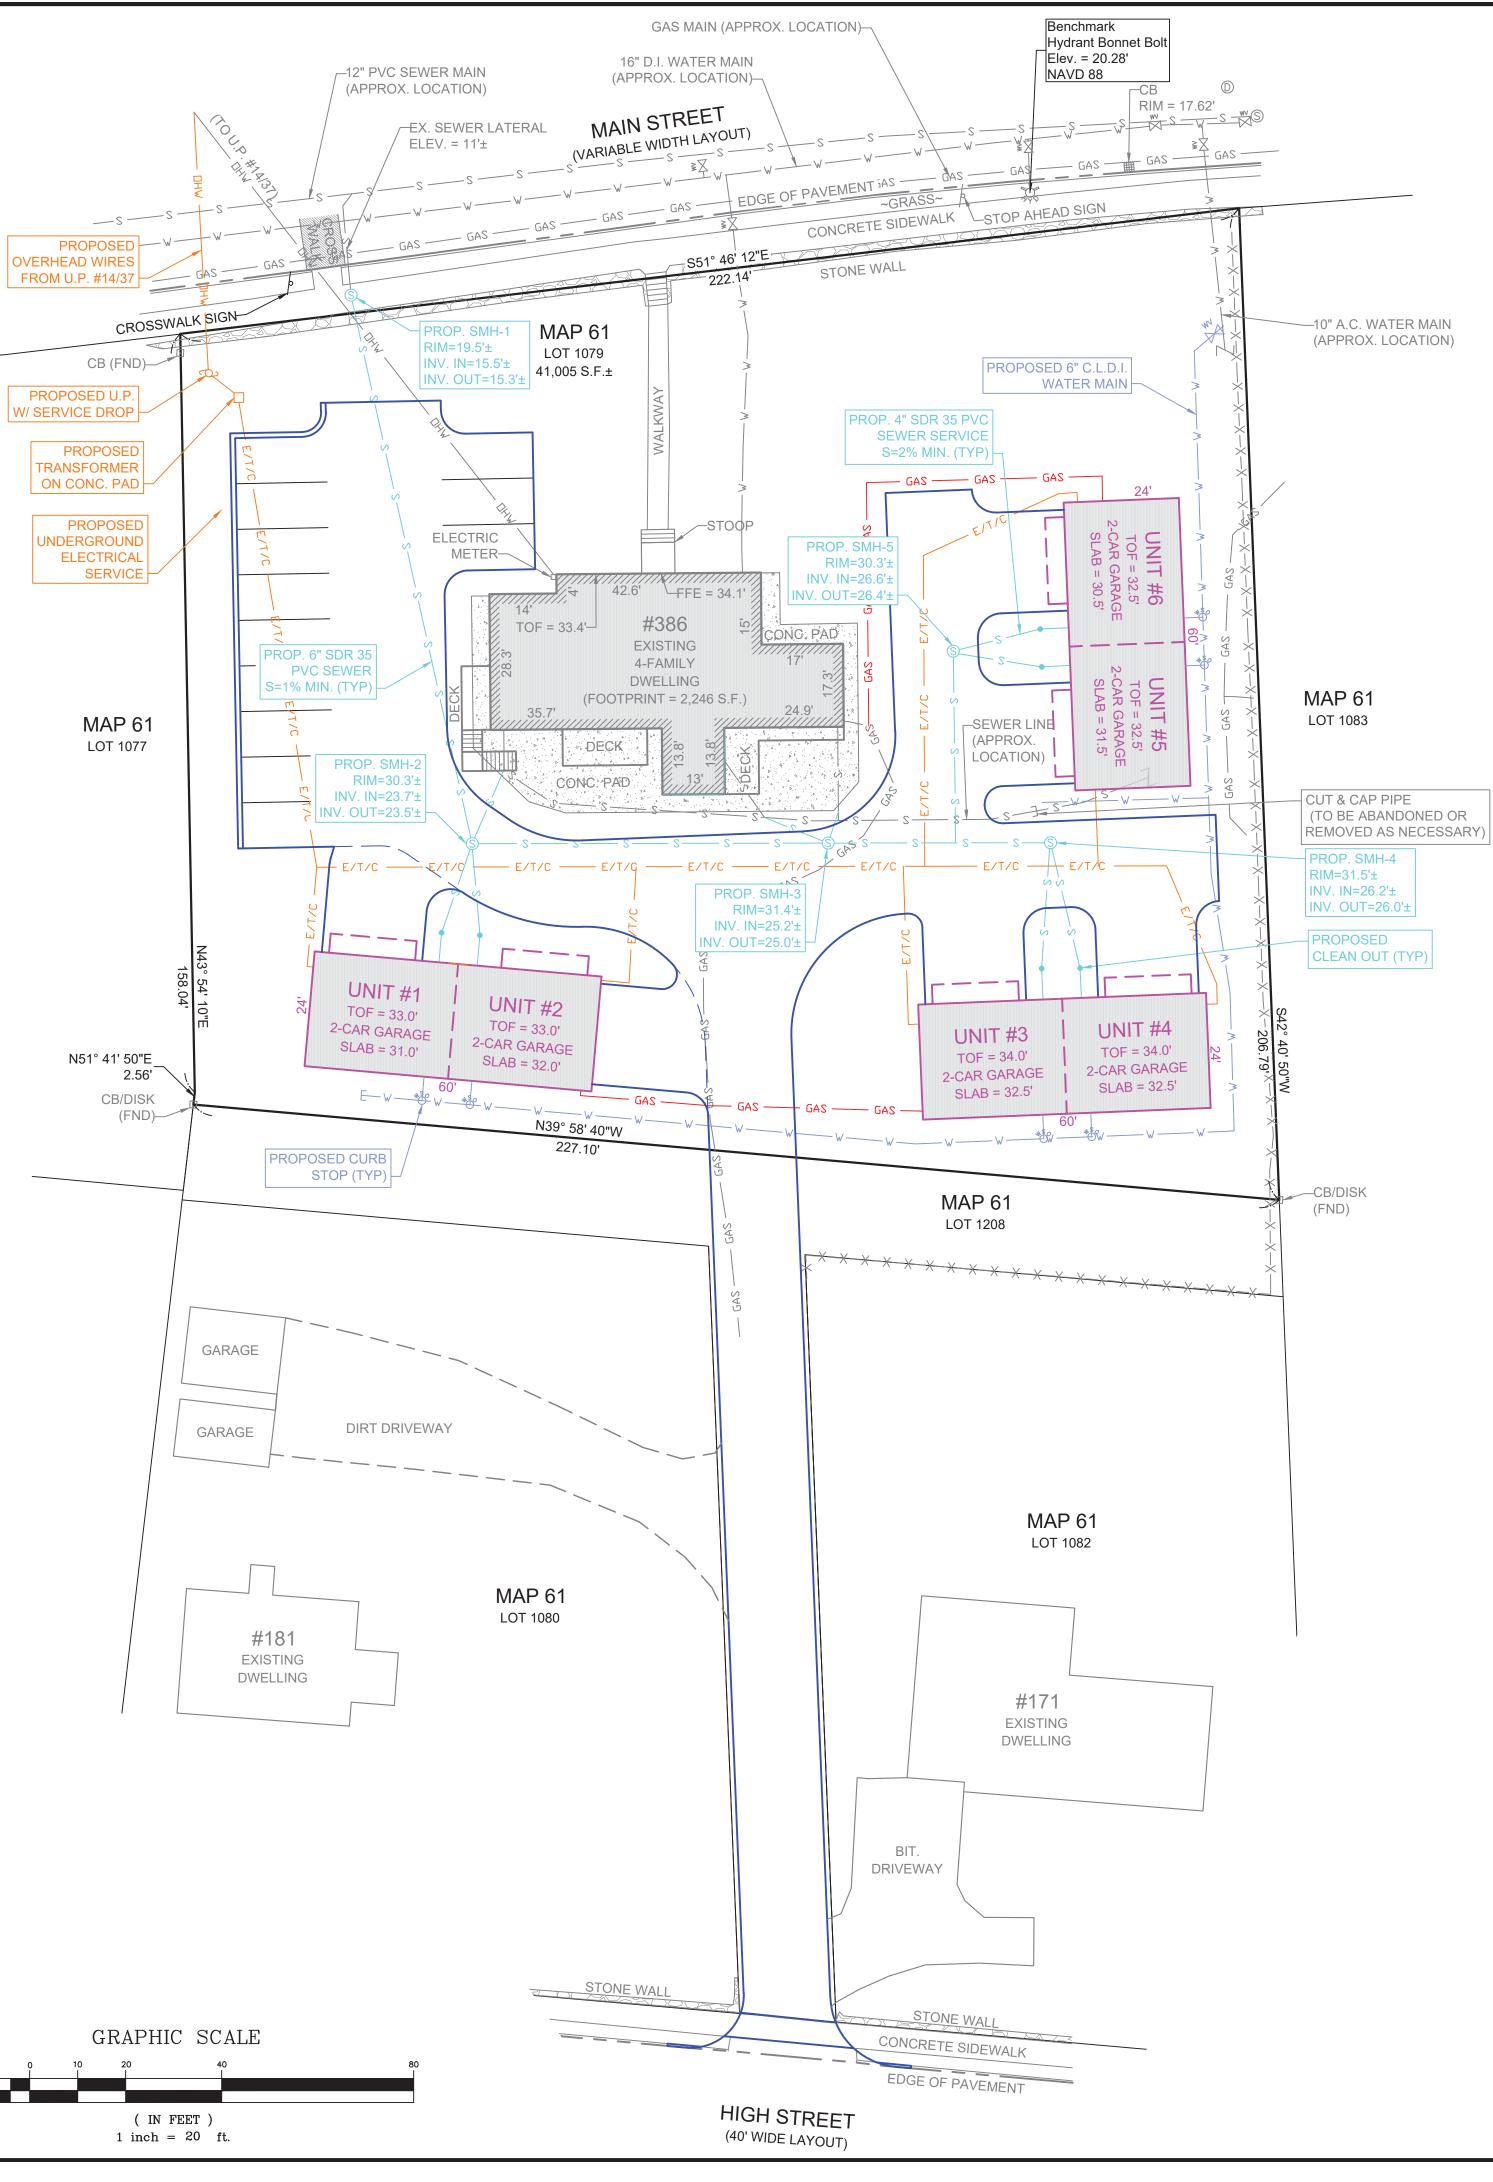


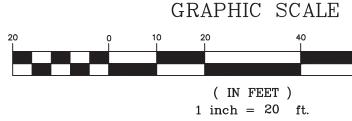


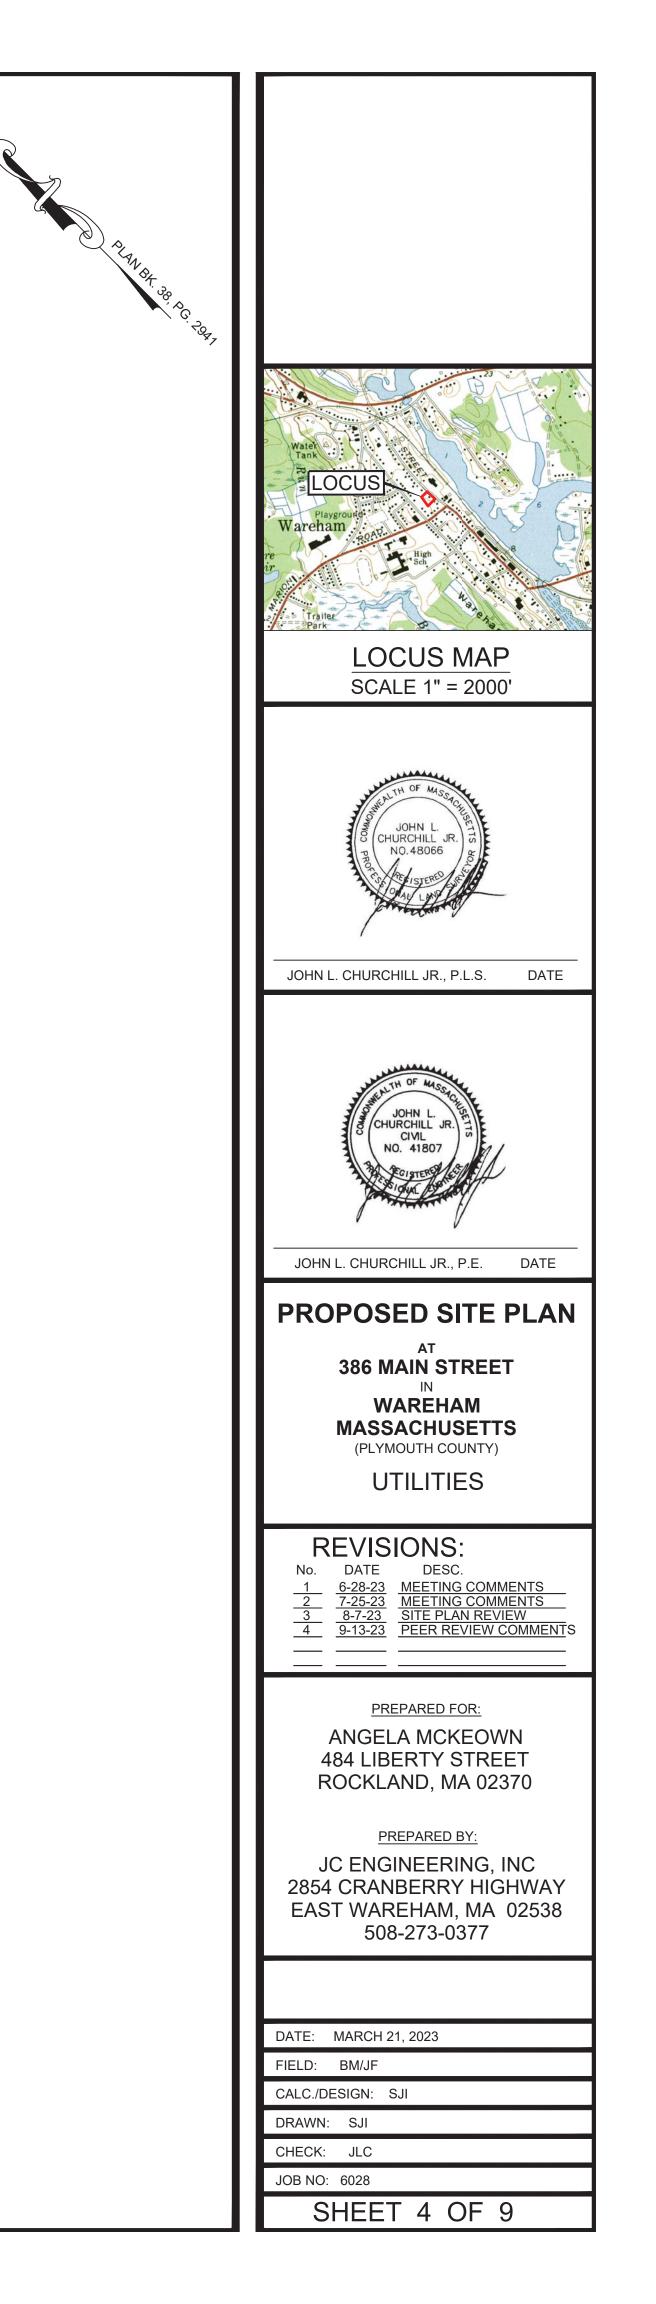


GRADING & DRAINAGE NOTES:

- 1. ALL CUT & FILL SLOPES SHALL BE 3:1 OR FLATTER UNLESS OTHERWISE NOTED ON THIS PLAN.
- 2. EXISTING AND PROPOSED GRADE CONTOURS ARE SHOWN AT 2-FT INTERVALS.
- 3. MINIMUM COVER OVER PIPE SHALL NOT BE LESS THAN 1.0 FEET.
- 4. THE DRIVEWAY SHALL NOT BE PAVED UNTIL THE ENTIRE PERMANENT DRAINAGE SYSTEM HAS BEEN INSTALLED AND PIPE CONNECTIONS COMPLETE. CONTRACTOR SHALL NOTIFY ENGINEER PRIOR TO BACKFILL FOR INSPECTION.
- 5. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROPER INSPECTION AND MAINTENANCE OF ALL STORMWATER MANAGEMENT FACILITIES UNTIL SUCH TIME THAT THE DRIVEWAY, BUILDINGS, AND ASSOCIATED UTILITIES ARE ACCEPTED BY THE OWNER.

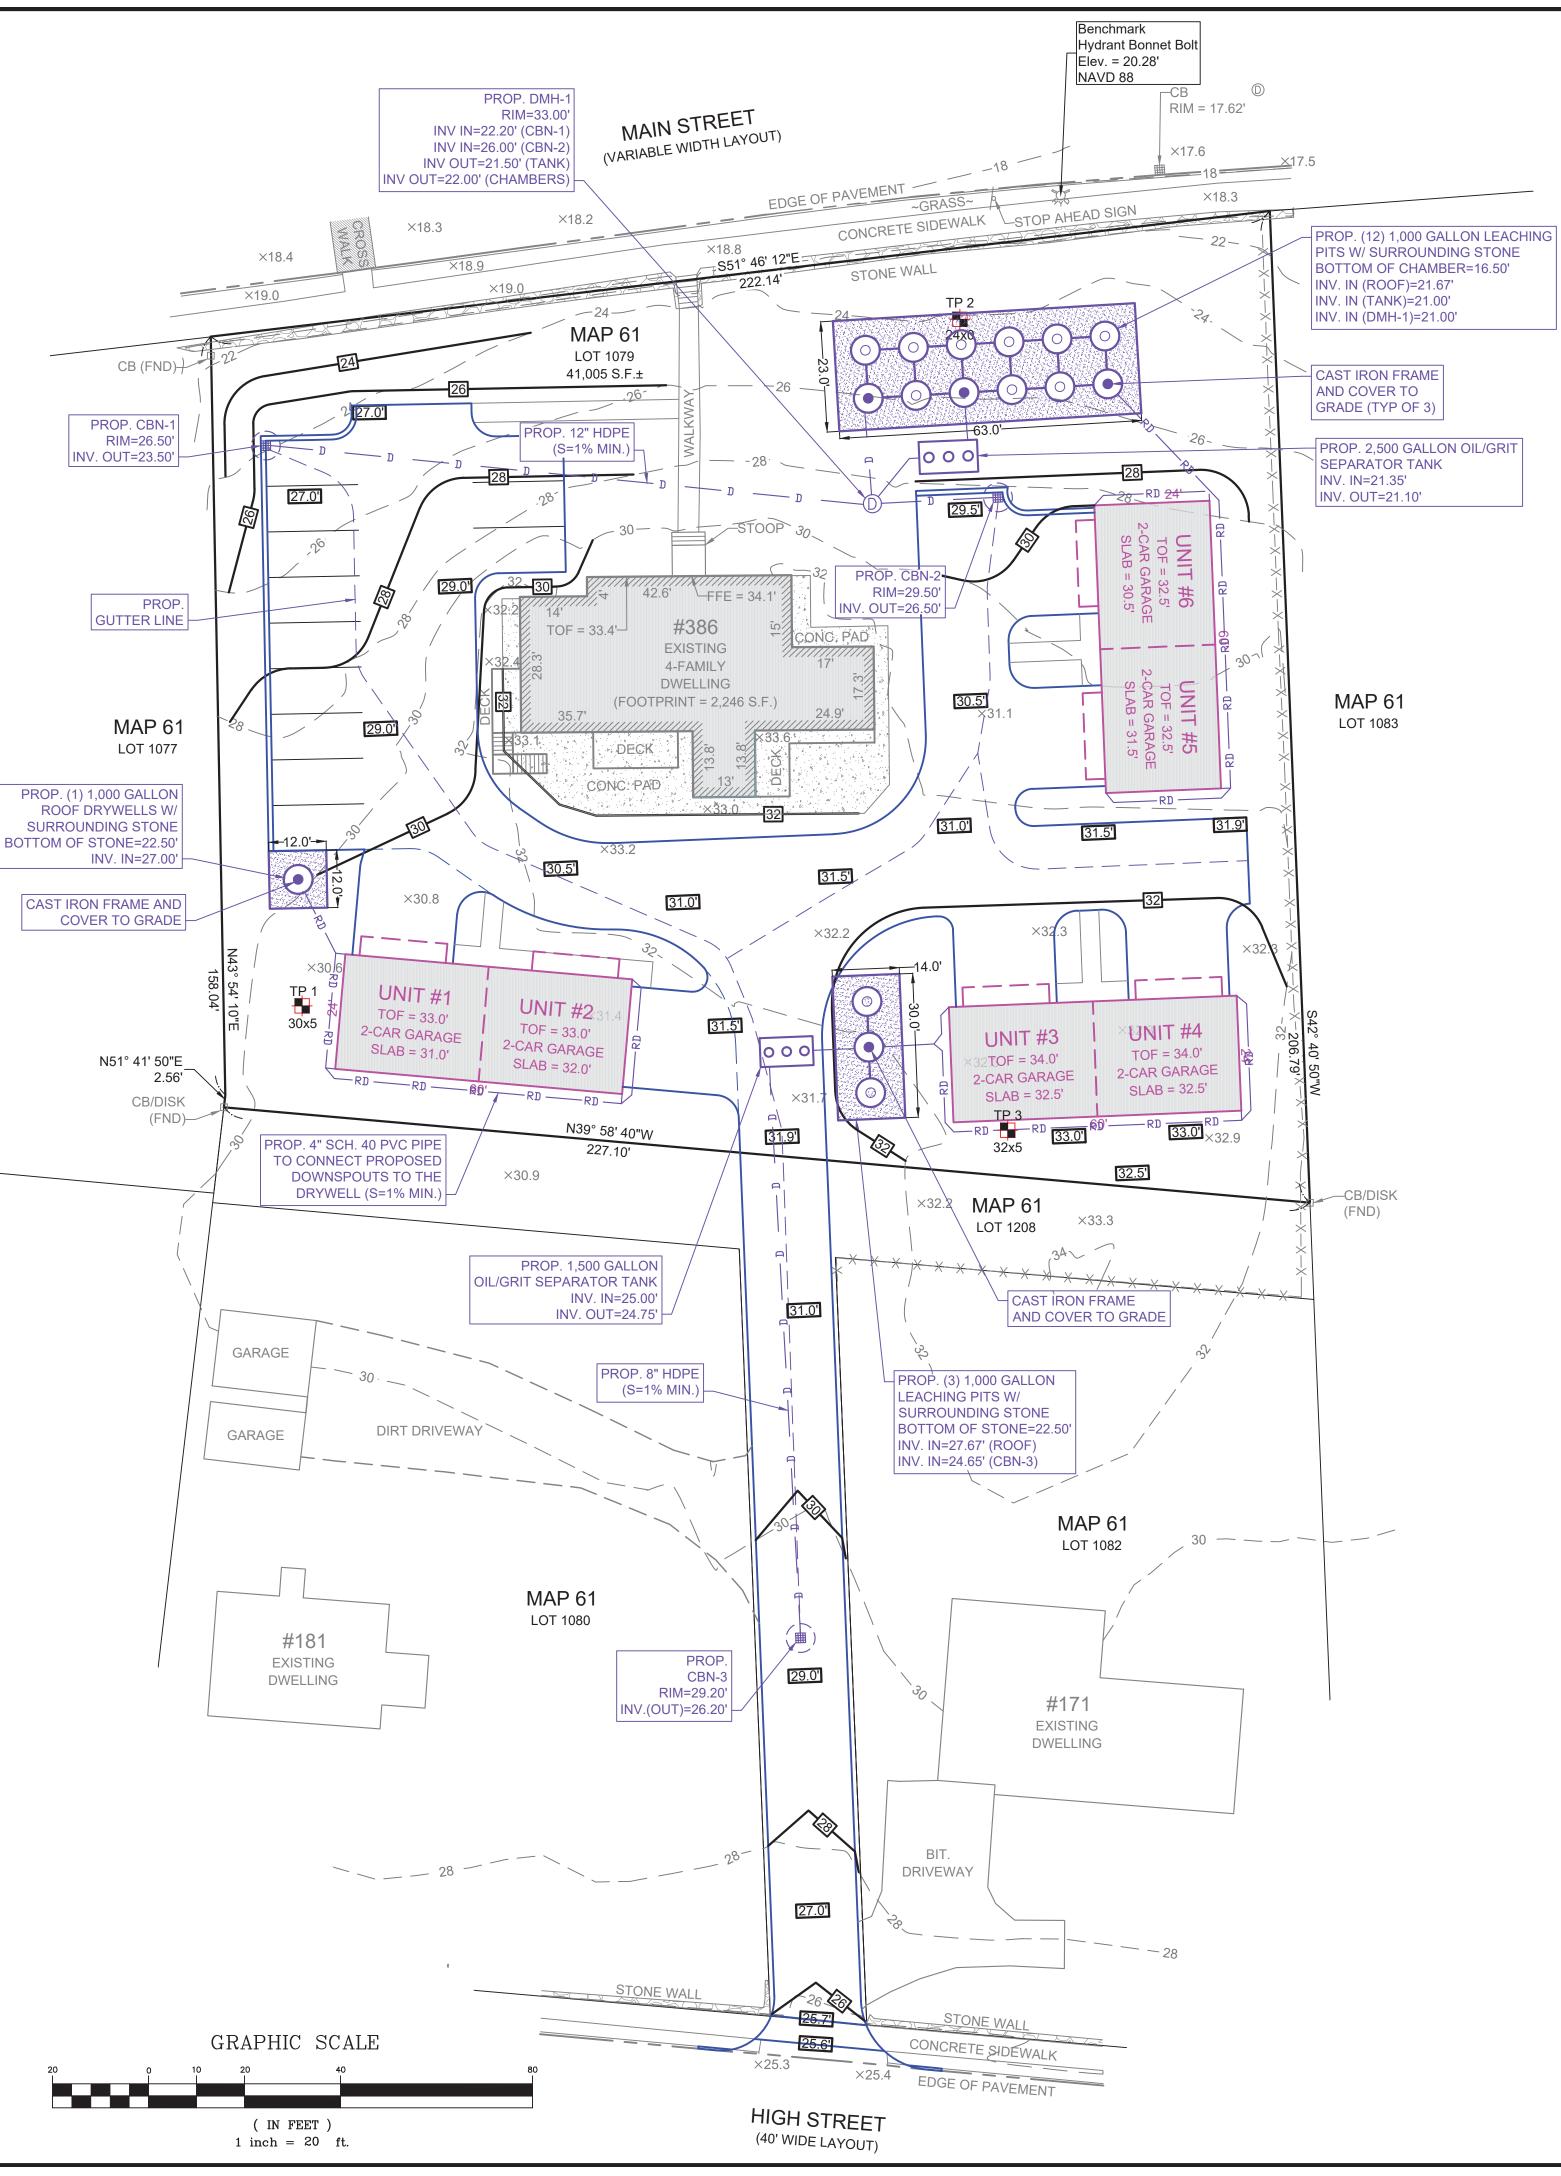

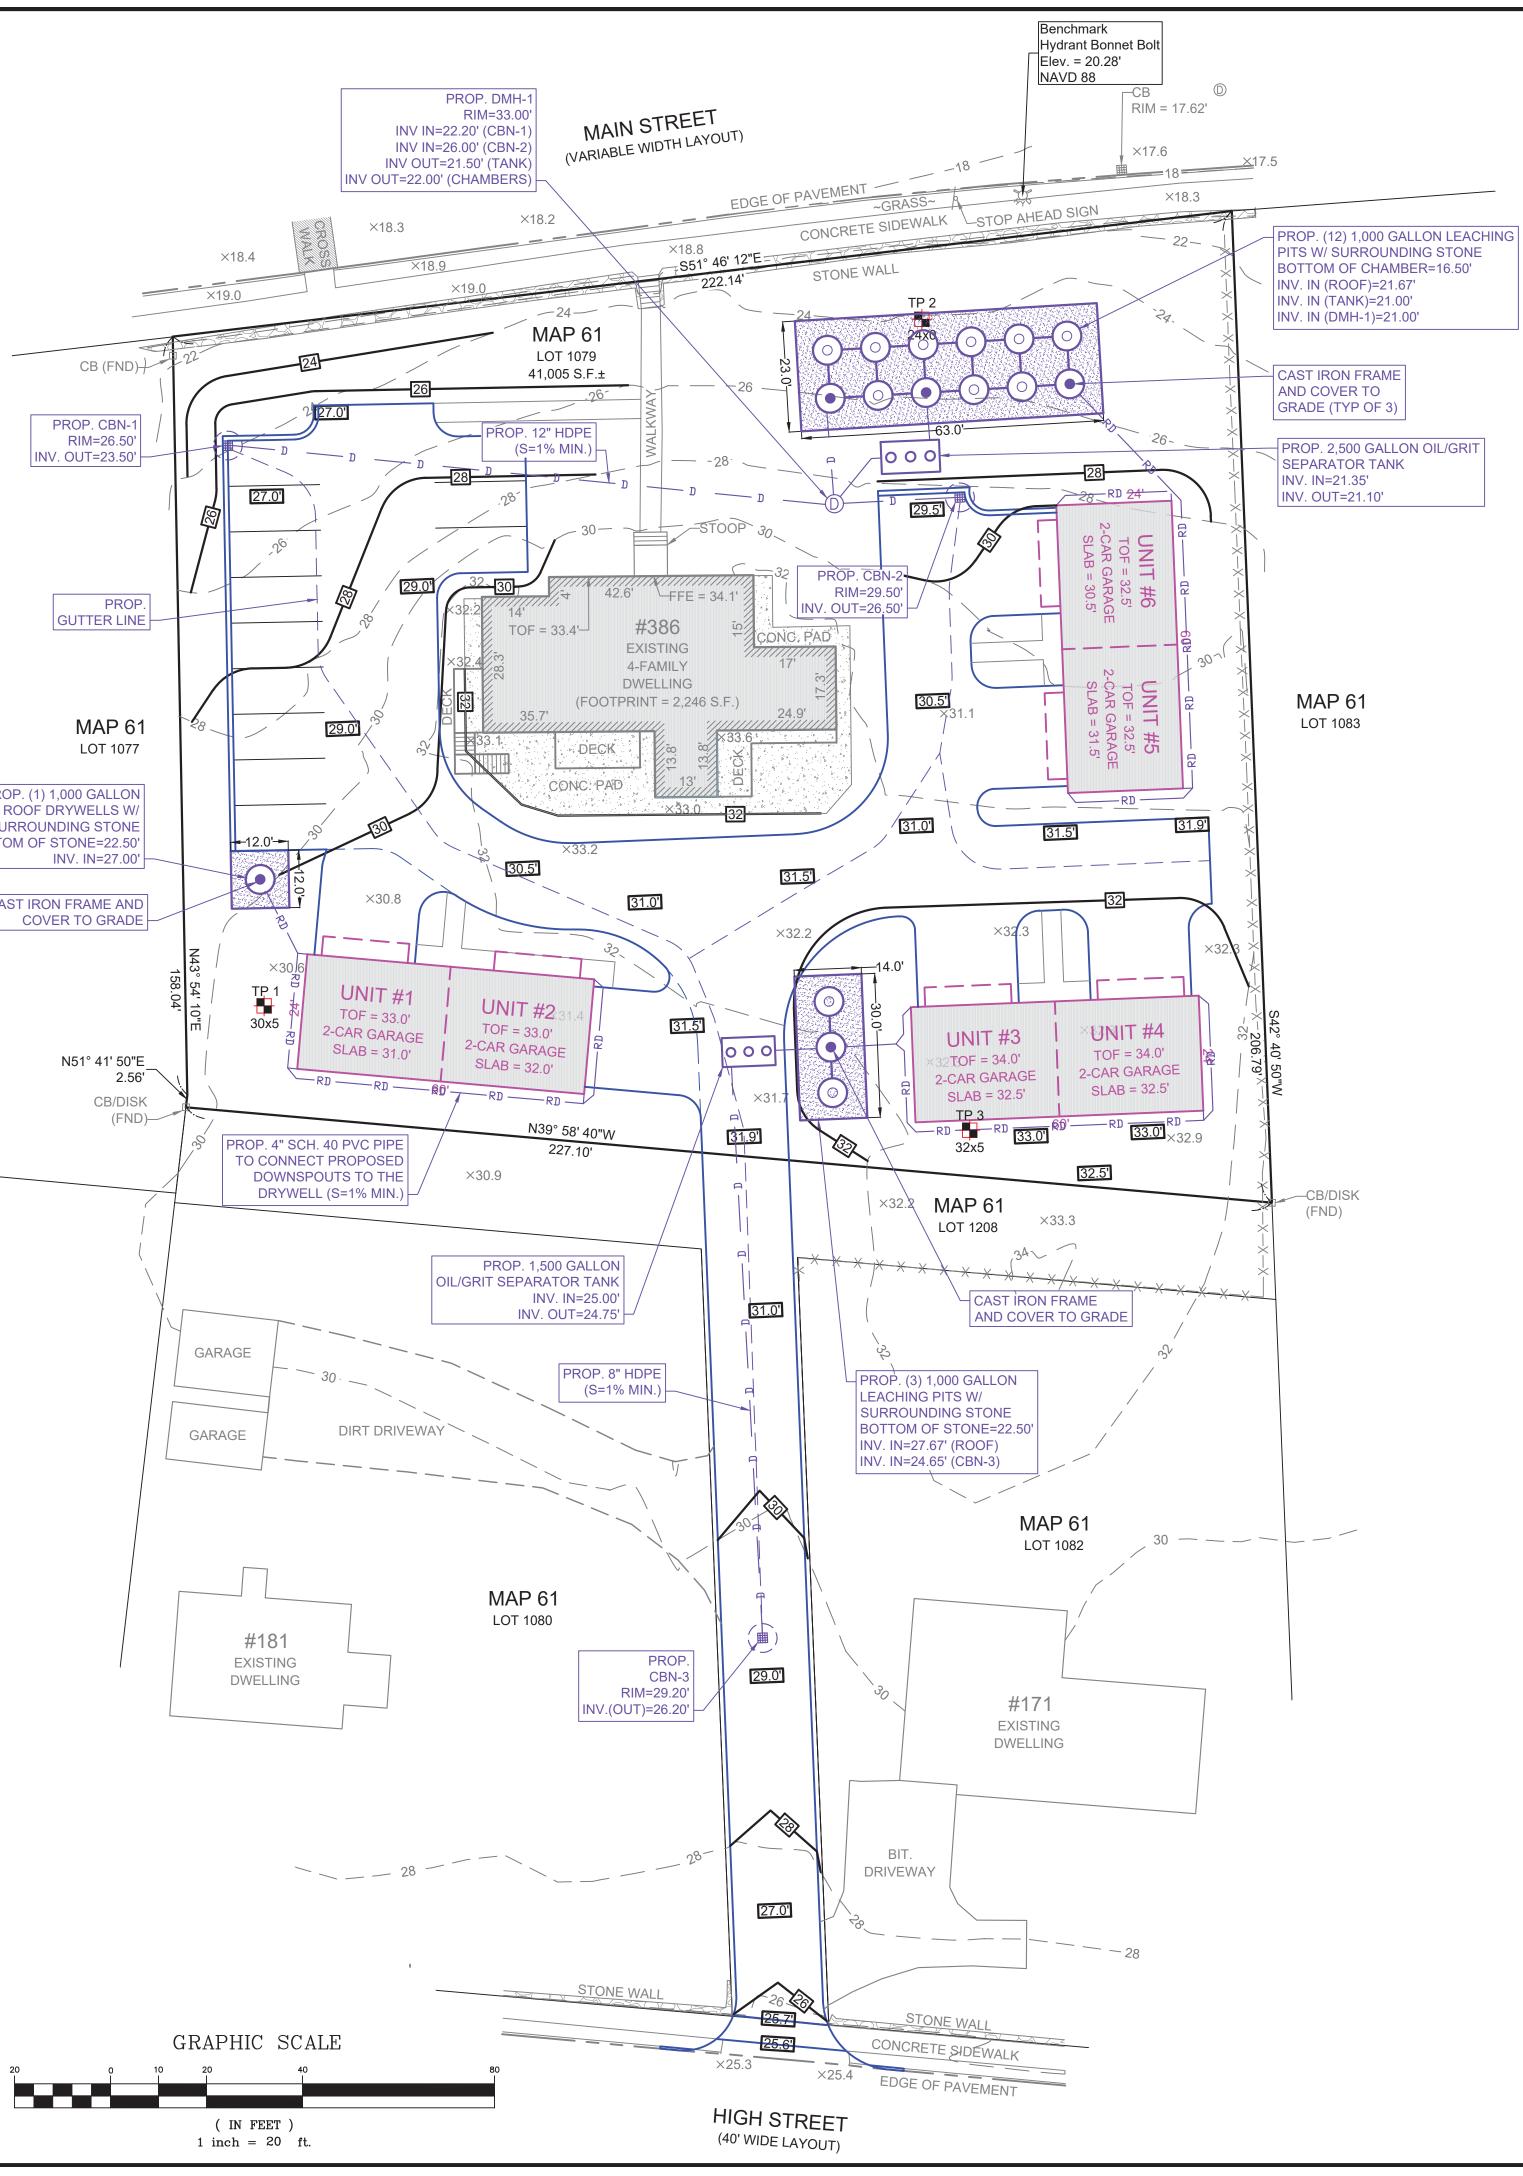

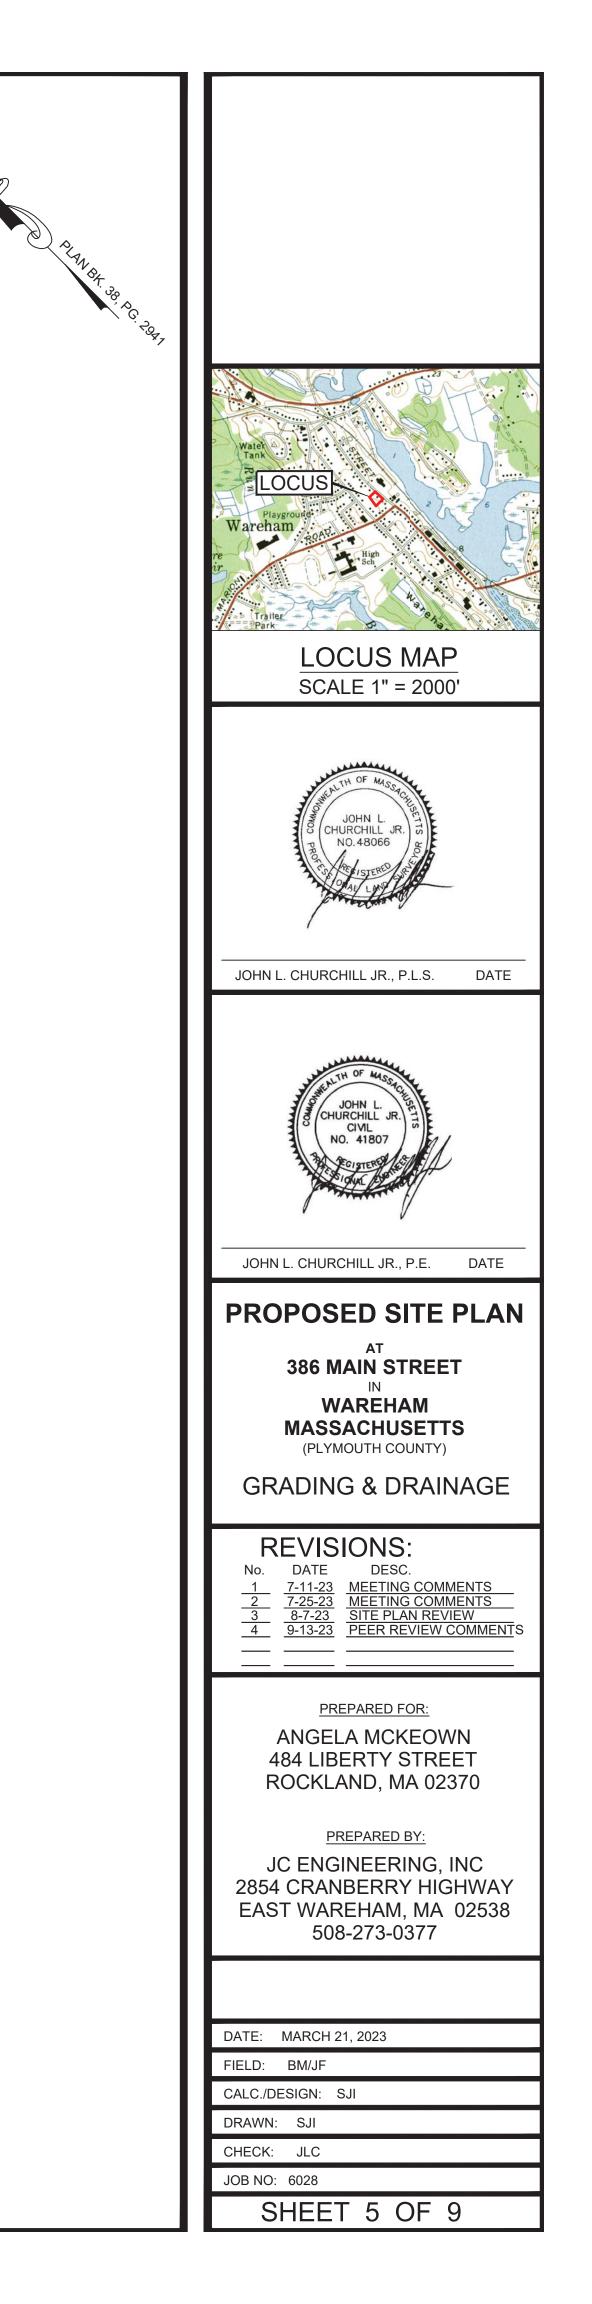

AREA & ROADWAY LIGHTING RAZAR SERIES - LED

LOW PROFILE AREA LUMINAIRE

Heavy cast, low copper aluminum assembly (A356 alloy, <.2% copper) minimum wall thickness .188". LED Module mounting area is machined to within a 0.002" surface flatness variance for maximum surface contact and thermal conductivity from the LED modules to the radiating fins. Passive radiating fins above the LED Optics provide superior thermal management and long LED life. The optical and electrical compartments are integrated with the support arm to create one assembly. Cast and hinged driver compartment cover allows access to the drivers and wiring.

Electrical Housing w/ Integrated Arm Heavy cast low copper aluminum (A356 alloy; <0.2% copper) assembly with integral cooling ribs surrounding the electrical compartment and a flat surface on the top of the arm to accommodate a photocell receptacle Solid barrier wall separates optical and electrical compartments. The optical compartment and electrical compartment with the integrated port arm combine to create one assembly. Minimum wall thickness is .188". Cast and hinged driver assembly cover is integrated with wiring

PLED" Optics

compartment cover.

Optical Housing

Emitters (LED's) are arrayed on a metal core PCB panel with each emitter located on a copper thermal transfer pad and enclosed by an LED refractor, LED optics completely seal each individual emitter to meet an IP66 rating. In asymmetric distributions, a micro-reflector inside the refractor re-directs the house side emitter output towards the street side and functions as a house side shielding element. Refractors are injection molded H12 acrylic. Each LED refractor is sealed to the PCB over an emitter and all refractors are retained by an aluminum frame. Any one Panel, or group of Panels in a luminaire, have the same optical pattern. LED refractors produce standard site/area distributions. Panels are field replaceable and field rotatable in 90° increments.

LED Driver(s)

Constant current electronic with a power factor of >.90 and a minimum operating temperature of -40°F/-40°C. Driver(s) is/are UL and cUL recognized and mounted directly against the Electrical Housing to facilitate thermal transfer, held down by universal clamps to facilitate easy removal. In-line terminal blocks facilitate wiring between the driver and optical arrays. Drivers accept an input of 120-277V, 50/60Hz or 347V-480V, 50,60Hz. (0 - 10V dimmable driver is standard. Driver has a minimum of 3KV internal surge protection. Luminaire supplied with 20KV surge protector for field accessible installation.)

LED Emitters

High output LED's are utilized with drive currents ranging from 350mA to 1050mA. 70CRI Minimum. LED's are available in standard Neutral White (4000K), or optional Cool White (5000K) or Warm White (3000K). Consult Factory for other LED options.


Amber LED's TRA (True Amber) LED's utilize material that emits light in the amber spectral bandwidth only without the use of phosphors.

Electrostatically applied TGIC Polyester Powder Coat on substrate prepared with 20 PSI power wash at 140°F. Four step media blast and iron phosphate pretreatment for protection and paint adhesion. 400°F bake for maximum hardness and durability.

Mast Arm Fitter/Electrical Housing

Replaces standard Electrical Housing. Fits standard 2 3/8" O.D. horizontal tenon. Two (2) straps with two (2) bolts each encircle the lower half of the tenon. Upper half of the tenon rests on self-centering steps that position the angle of the luminaire at 0°, +1.5°, +1.5 or +3° up from the horizontal. All hardware is stainless steel.

U.S. Pole Company Inc | 660 West Avenue O. Palmdale. CA 93551 An Employee Owned Company | Phone (661) 233-2000 www.usaltg.com

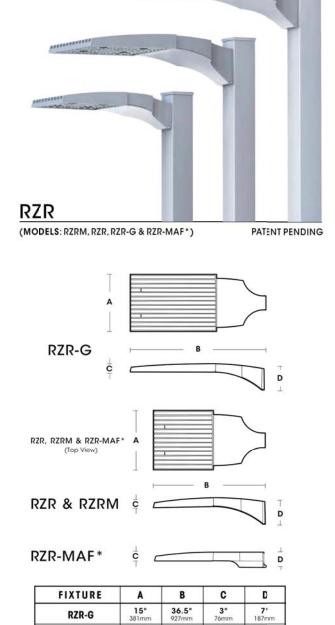

SOF MARKET STATE

PROJECT NAME:

PROJECT TYPE:

14.75" 28.25" 2.75" 6.5" 375mm 718mm 70mm 165mm RZR 11.5" 22" 2.5" 5.25" 292mm 559mm 64mm 133mm RZRM RZR-MAF 15" 28.25" 2.5" 4'

UL U.L. Listed for Wet Location 2022158 U.S. ARCHITECTURAL

AREA & ROADWAY LIGHTING



Features

The NEW Dezīner Series is a flexible, configurable pedestrian scale decorative pendant luminaire with an 6.7" diameter upper housing of 0.125" thick formed aluminum with a large assortment of spun aluminum shades and ornamental options. Each lower housing is comprised of a 0.080" thick spun aluminum reflector with an integrated LED module seat, thermal management for long LED life and a thermally isolated solid state power supply chamber. Trulevel ™ ball coupling.

PLED[™] Optics

Emitters (LED's) are arrayed on a metal core PCB panel with each emitter located on a copper thermal transfer pad and enclosed by an LED refractor. LED optics completely seal each individual emitter to meet an IP66 rating. In asymmetric distributions, a micro-reflector inside the refractor re-directs the house side emitter output towards the street side and functions as a house side shielding element. Refractors are injection molded H12 acrylic. Each LED refractor is sealed to the PCB over an emitter and all refractors are retained by an aluminum frame. Any one Panel, or group of Panels in a luminaire, have the same optical pattern. LED refractors produce standard site/area distributions. All optics are UO, Zero Uplight and are Dark Sky compliant. Panels are field replaceable and field rotatable in 90° increments.

LED Emitters


High Power White LED's are driven between 350mA and 875mA for a maximum output of 2.5 Watts nominal. LED's are available in standard Warm White (2700K & 3000K), Neutral White (4000K), or Cool White (5000K). All Standard LED's have a minimum of 70 CRI. Consult Factory for other LED options. Lumen Maintenance of L93 at 100,000 hours (TM-21 calculated at 6x Test Time) for all LED options.

True Amber LED's TRA-True Amber LED's emit light in the amber spectral bandwidth centered on 585-590nm. True Amber has negligible blue light and is suitable for wildlife.

LED Driver

Constant current electronic with a power factor of >.90 and a minimum operating temperature of -40°F/-40°C. Driver(s) is/are UL and cUL recognized and mounted directly against the Electrical Housing to facilitate thermal transfer, held down by universal clamps to facilitate easy removal. In-line terminal blocks facilitate wiring between the driver and optical arrays. Drivers accept an input of 120-277V (UNV), 50/60Hz or 347V & 480V, 50,60Hz, 0 - 10V dimmable driver is standard. Driver has a minimum of 3KV internal surge protection. Luminaire supplied with 20KV surge protector for field accessible installation.)

Super TGIC polyester powder coating is applied onto a metal substrate this has been pretreated with a four-stage process for maximum adhesion and color refention. The top coat is baked at 400° F for maximum hardness and exterior durability.





PROJECT NAME:

PROJECT TYPE:









DS6S Skirted The smallest models within the Deziner Series, offer 5 customizable styles

available with optional Ambience[™] Low Luminance Lens and unlit Bands.

2023062

U.S. ARCHITECTURAL

				⁺ 0.0	⁺ 0.0	⁺ 0.0	[†] 0.0
		⁺ 0.0	⁺ 0.0	⁺ 0.0	⁺ 0.0	⁺ 0.0	⁺ 0.0
	⁺ 0.0	⁺ 0.0	⁺ 0.0	⁺ 0.0	⁺ 0.0	[†] 0.0	⁺ 0.0
	[†] 0.0	⁺ 0.0	⁺ 0.0	⁺ 0.0	⁺ 0.0	[†] 0.0	[†] 0.0
	⁺ 0.0	[†] 0.0	⁺ 0.0	⁺ 0.0	[†] 0.0	[†] 0.0	0 .0
)	⁺ 0.0	⁺ 0.0		0.0	[†] 0.0	[†] 0.0	[†] 0.1
0	⁺ 0.0	CB∲(∎NE)()()()()()()	÷0.1	[†] 0.1	[†] 0.2	[†] 0.3
.0	⁺ 0.0	⁺ 0.0	[†] 0.1	⁺ 0.2	[†] 0.4	0.7	[†] 0.9
).0	⁺ 0.0	⁺ 0.0	⁺ 0.1	⁺ 0.4	1.0	[†] 1.4	[‡] 1.6
).0	[†] 0.0	⁺ 0.1	⁺ 0.1	[†] 0.6	[†] 1.4	⁺ 1.7	[†] 1.6
0.0	[†] 0.0	⁺ 0.1	⁺ 0.2	[†] 0.6	[†] 1.7	, [†] 1.7	1. -
0.0	⁺ 0.0	⁺ 0.1	⁺ 0.1	[†] 0.6	1.	β [†] 1.5	-
0.0	⁺ 0.0	[†] 0.0	⁺ 0.1	+ 0.4	↓ [†] 1.	.6 1.5	; [†]
0.0		[†] 0.0		1 d.	3 [†]	.9 [†] . ⁻	7
.0.Č		ИАР (LOT 107		1 D		2 A 1.9 ¹ .	7
.0) [†] 0.	0 ⁺ 0.	0 0	.c [†] C).5	[†] 1.5 [†]	.3
).(o ⁺ 0	.0 0	.0 [†]).0	D.6	⁺ 1.5 ⁺	1.0
Ĵ.	0 [†]).O [†]).0 (b.0	⁺ 0.6	⁺ 1.2	ŧ <u>.</u> 0
Ĵ	.0	.0. [†]	0.0		[†] 0. 4	[†] 1.7 WM	[†] 3.5 —
ţ).0	⁺ 0.0	0.0 c	N43° 54' 10"Eo	[†] 0.2	⁺ 0.4	
+		[⁺] o.0 1° 41' 50	[†] 0.0	0_ # 0_0	⁺ 0.1	[†] 0.2	TC 2-CAI SLA
	• 0.0		56'	\ <u>+</u> 0.0	[†] 0.0	[†] 0.0	
	[†] 0.0	(F№ [†] 0.0	ND) [†] 0.0	0.0	⁺ 0.0	⁺ 0.0	0.0
-	0.0	⁺ 0.0	[†] 0.0	⁺ 0.0	⁺ 0.0	[†] 0.0	⁺ 0.0
	⁺ 0.0	⁺ 0.0	⁺ 0.0	⁺ 0.0	⁺ 0.0	⁺ 0.0	0.0
	⁺ 0.0	⁺ 0.0	[†] 0.0	⁺ 0.0	⁺ 0.0	⁺ 0.0	[†] 0.0
	້ ງ.0	⁺ 0.0	⁺ 0.0	[†] 0.0	±0.0	0.0	⁺ 0.0
		⁺ 0.0	⁺ 0.0	GAR [†] 0.0	RAGE [†] 0.0	[†] 0.0	⁺ 0.0
			f _{0.0}	[†] 0.0 GAR∕	0.0 AGE	[†] 0.0	[†] 0.0 DIF
				±-0.0	[†] 0.0	† .0 .	<u></u>
					¹ c	o [†] 0.0	* 0.

JOB NAME: 368 MAIN ST - WAREHAM APEX LIGHTING SOLUTIONS WORKPLANE/CALC PLANE: AT FINISH GRADE MOUNTING HEIGHT: SEE LUMINAIRE SCHEDUL APPS: DM

SALES: SS SPECIFIER: JC ENGINEERING Luminaire Schedule

	Qty	Label	Arrangement		
	1	SL2A	Single		
	3	SL2B	Single		
	1	SL3	Single		
	17	WM	Single		
[Calculation Summary				
	Label				
	CalcPts_1				
	PARKING AND DRIVE LANES				

4594


2406

6392

964

USA

U.L. Listed for Wet Location

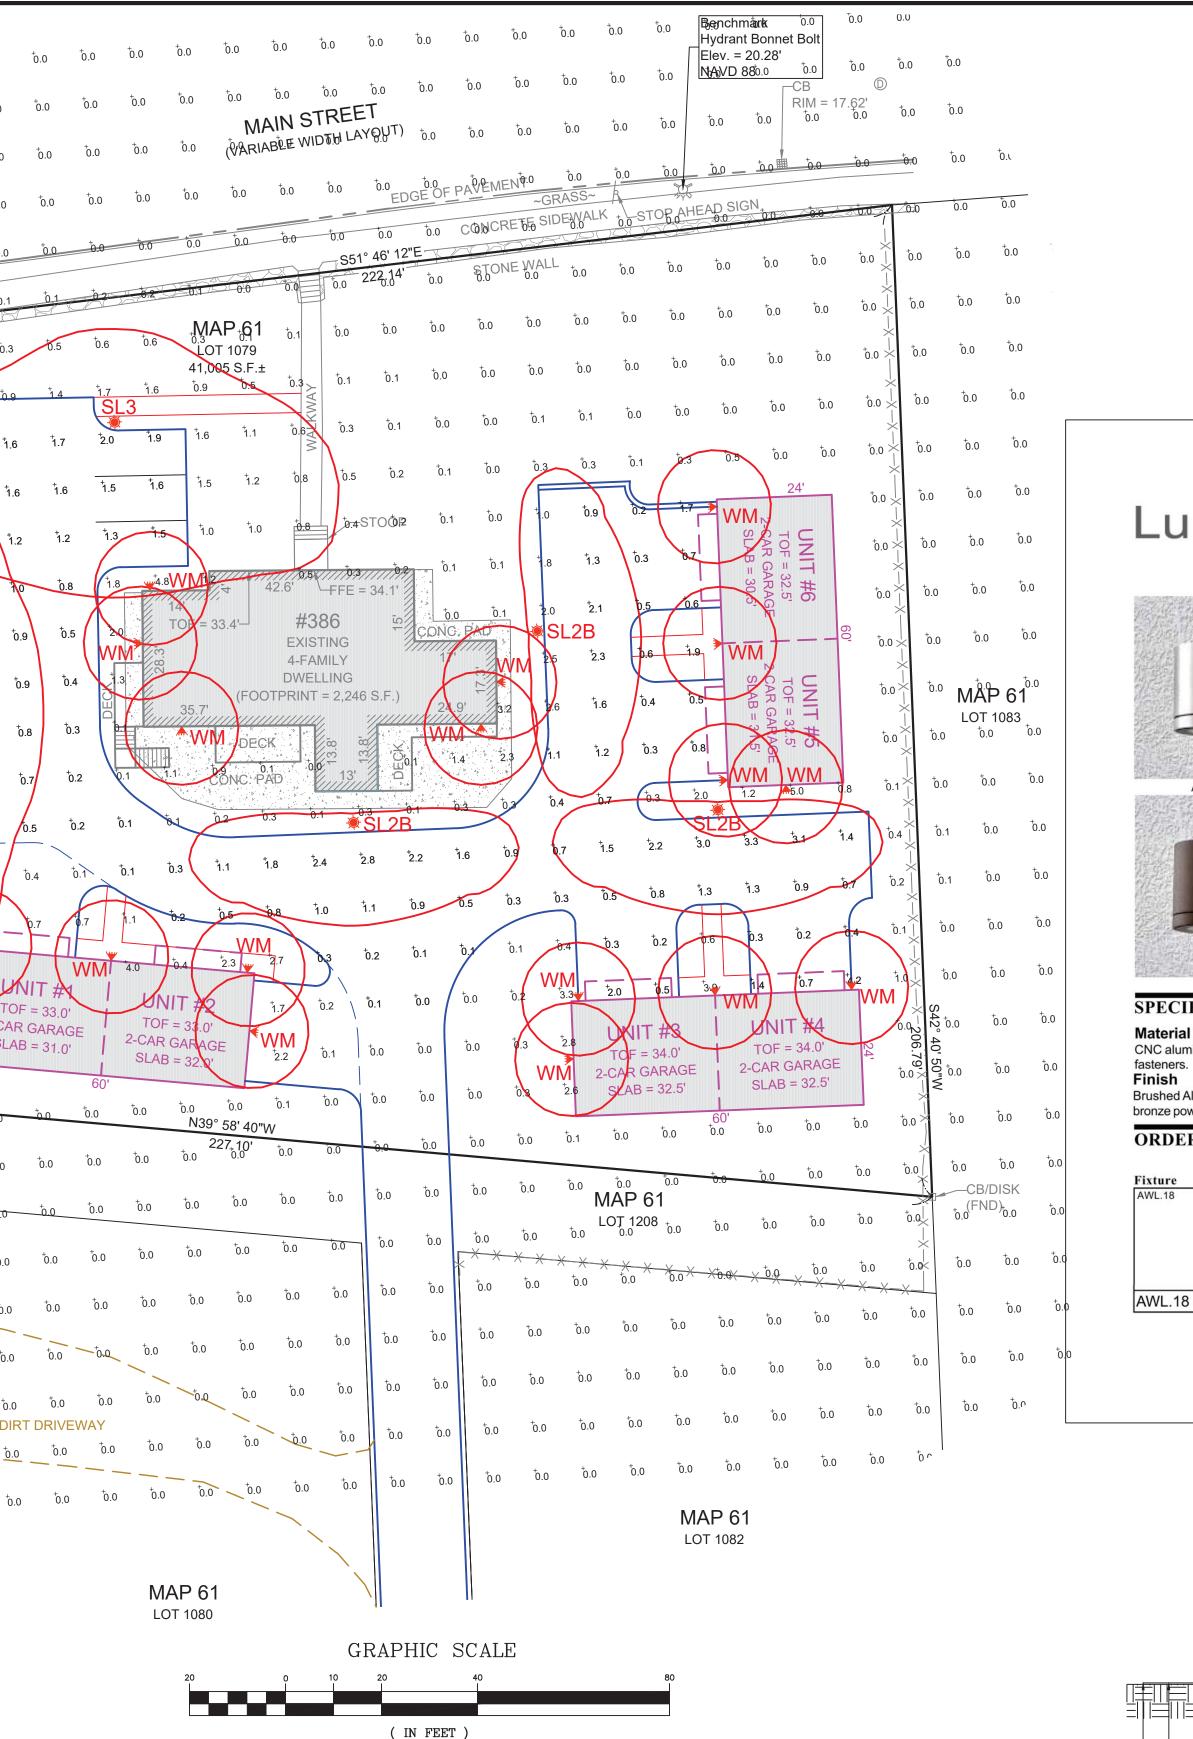

Input Watts LLF BUG Rating Lumens Description 42.7 0.900 B1-U0-G1 USAL RZR-PLED-II-40LED-350mA-30K-HS-VOLT-FINISH / MOUNTED TO POLE @ 20FT 0.900 B0-U0-G1 USAL DS6C-PLED-II-20LED-350mA-30K-HS-VOLT-FINISH / MOUNTED TO POLE @ 20FT 23.6 42.7 USAL RZR-PLED-III-M-40LED-350mA-30K-VOLT-FINISH / MOUNTED TO POLE @ 20FT 0.900 B2-U0-G2 10.5 0.900 B1-U0-G0 LUMENART AWL.18-11W LED--UNV-3000K-W-FINISH / WALL MOUNTED @ 15FT AFG TO BOF

1 inch = 20 ft.


Grid Height	Avg	Max	Min	Avg/Min	Max/Min
0	0.19	5.0	0.0	N.A.	N.A.
0	1.12	4.2	0.0	N.A.	N.A.


PHOTOMETRIC PLAN PREPARED BY APEX LIGHTING SOLUTIONS.





ENVELOPE ______ TIRE PATH ______ OVERHANG ______ PATH

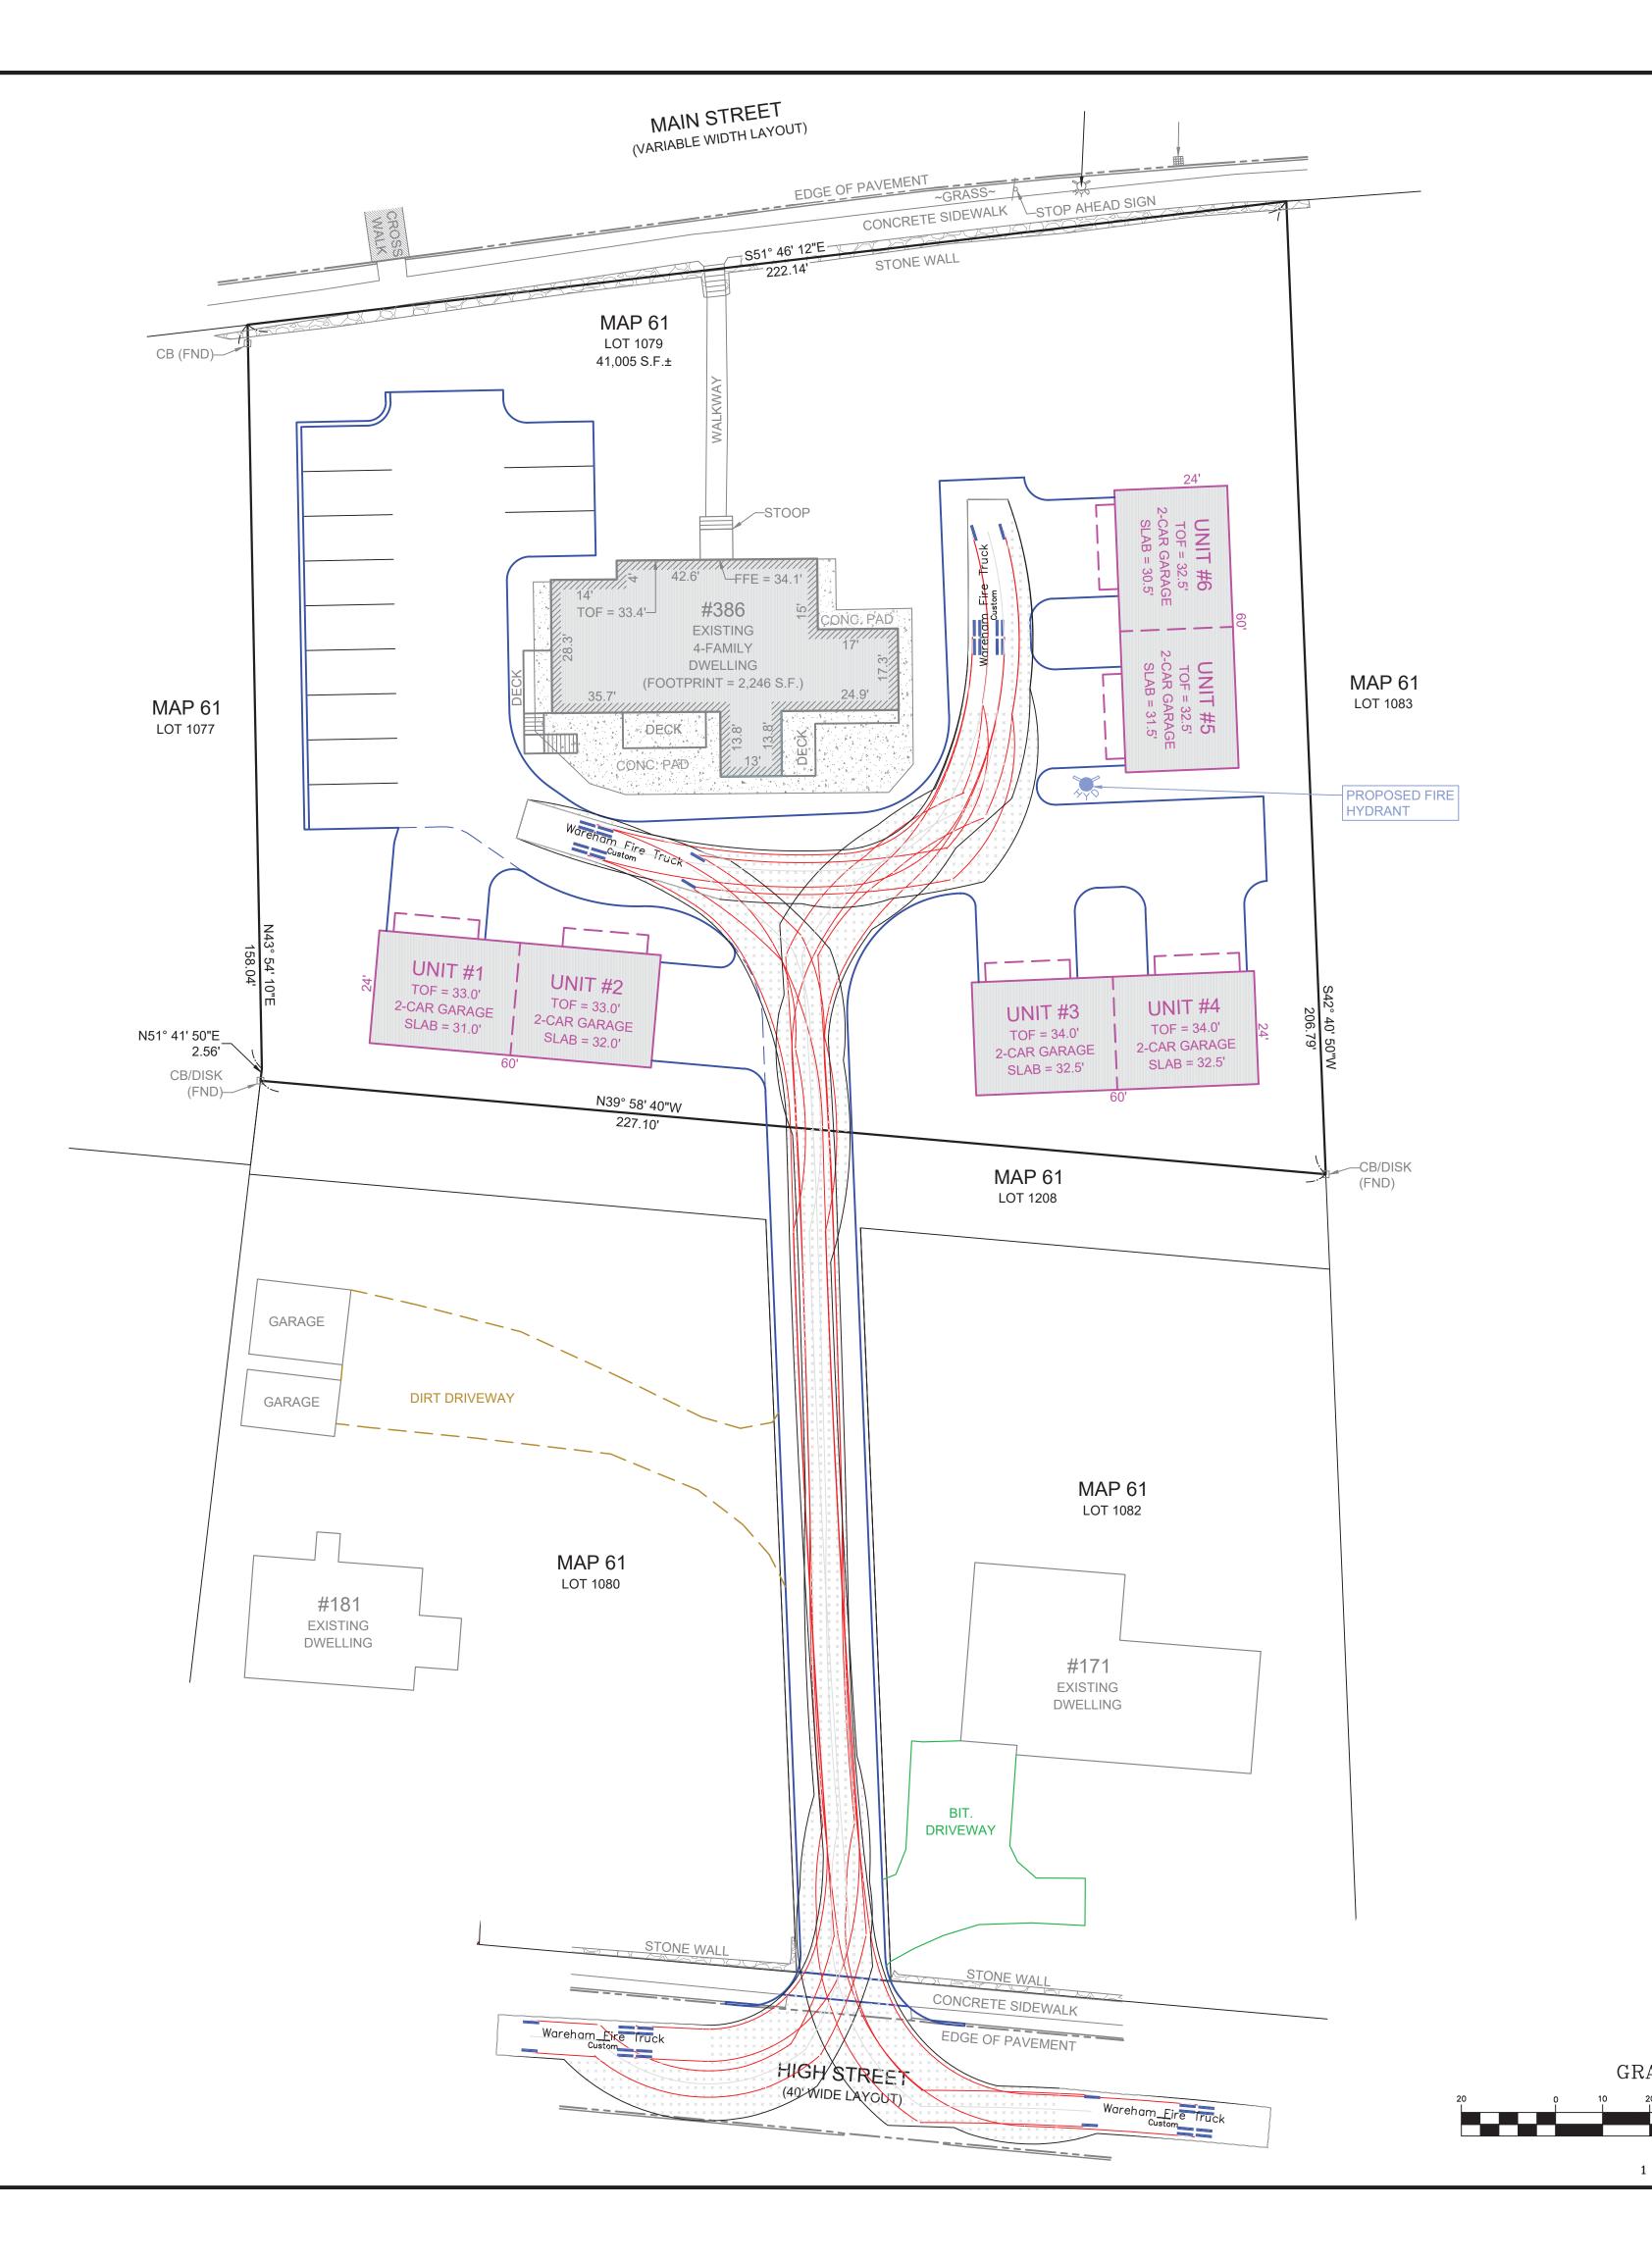

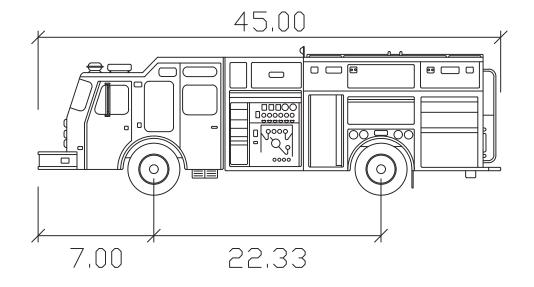

Wareham Fire Truck	feet
Width	: 8,50
Track	: 6,83
Lock to Lock Time	: 6,0
Steering Angle	: 40,0

	OLAN BT. 38. DC. CORT
	or we
	^۲ رو رو
	Water Control
	Wareham
	re ir
	2) == Traiter
	LOCUS MAP
	SCALE 1" = 2000'
	weren
	Stuffed TH OF MASS 72
	JOHN L. CHURCHILL JR. NO.48066
	To Are ISTERE
	ANT LAST
	JOHN L. CHURCHILL JR., P.L.S. DATE
	NUTH OF MASS
	19
	JOHN L. CHURCHILL JR. CIVIL NO. 41807
	33 PECIPTERS LET
	Provide the state of the state
	. ,
	JOHN L. CHURCHILL JR., P.E. DATE
	PROPOSED SITE PLAN
	386 MAIN STREET
	WAREHAM
	EMERGENCY ACCESS
	REVISIONS:
	No. DATE DESC.
	17-11-23MEETING COMMENTS27-25-23MEETING COMMENTS38-7-23SITE PLAN REVIEW49-13-23PEER REVIEW COMMENTS
	4 9-13-23 PEER REVIEW COMMENTS
	PREPARED FOR:
	ANGELA MCKEOWN
	484 LIBERTY STREET ROCKLAND, MA 02370
	JC ENGINEERING, INC 2854 CRANBERRY HIGHWAY
	EAST WAREHAM, MA 02538
	508-273-0377
	DATE: MARCH 21, 2023
	FIELD: BM/JF CALC./DESIGN: SJI
GRAPHIC SCALE	DRAWN: SJI
	CHECK: JLC
(IN FEET)	JOB NO: 6028
(IN FEEI) $1 inch = 20 ft.$	SHEET 7 OF 9

PLANTING NOTES:

1. ALL PLANT MATERIAL SHALL CONFORM TO THE STANDARDS OF THE AMERICAN ASSOCIATION OF NURSERYMEN ANSI Z260.1 OR THE LATEST EDITION. ALL PLANT MATERIAL SHALL BE TRUE TO SPECIES, VARIETY AND SIZE AND SHALL BE CERTIFIED DISEASE AND INSECT FREE AT THE TIME OF DELIVERY TO THE SITE. THE OWNER AND/OR LANDSCAPE ARCHITECT RESERVES THE RIGHT TO APPROVE OR REJECT THE PLANT MATERIAL ON SITE PRIOR TO INSTALLATION.

2. THE LANDSCAPE ARCHITECT SHALL SPECIFY AN ACCEPTABLE REPLACEMENT SHOULD ANY PLANT MATERIAL BE UNAVAILABLE AT TIME OF DELIVERY.

3. ALL PLANT MATERIAL SHALL BE PROPERLY PLANTED AND STAKED IN CONFORMANCE WITH THE DETAILS PROVIDED. PROVIDE THREE (3) STAKES PER TREE UNLESS OTHERWISE NOTED. INSTALL ALL PLANT MATERIAL ON UNDISTURBED GRADE OR GRADES THAT HAVE BEEN ESTABLISHED DURING CONSTRUCTION AND APPROVED BY THE LANDSCAPE ARCHITECT. FURNISH ALL PLANT MATERIAL IN APPROVED CONTAINERS OR BALLED AND BURLAPPED. CUT AND REMOVE BURLAP FROM THE TOP ONE-THIRD (1/3) OF THE ROOT BALL. ENTIRELY REMOVE ALL WIRE ROOT BALL BASKETS FROM THE PLANTING PIT PRIOR TO FINAL BACKFILLING OF PLANTING PIT.

4. PROVIDE PLANTING PITS AS INDICATED ON THE PLANTING DETAILS. BACKFILL PLANTING PITS WITH ONE PART EACH OF TOPSOIL, ONE PART PEAT MOSS OR COMPOSTED LEAF MATTER (TWO YEARS OLD), AND ONE PART EXISTING SOILS ON THE SITE. IF IN THE OPINION OF THE LANDSCAPE ARCHITECT EXCESSIVELY WET SOIL CONDITIONS EXIST, THEN PLANTING PITS SHALL BE EXCAVATED AN ADDITIONAL 12" AND FILLED WITH SAND TO THE BOTTOM OF THE PLANT PIT. A SLOW RELEASE FERTILIZER SHALL BE ADDED TO THE BACKFILL MIX IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS FOR NEW TRANSPLANTS

5. NEWLY INSTALLED PANT MATERIAL SHALL BE WATERED AT THE TIME OF THE INSTALLATION AND AGAIN WITHIN 24 HOURS OF THE INSTALLATION. REGULAR WATERING SHALL BE PROVIDED BY THE LANDSCAPE CONTRACTOR TO ENSURE ESTABLISHMENT, GROWTH AND SURVIVAL OF ALL PLANTS.

6. ALL PLANT MATERIAL SHALL BE GUARANTEED FOR A PERIOD OF TWO YEARS AFTER THE DATE OF FINAL ACCEPTANCE BY THE LANDSCAPE ARCHITECT. ANY PLANT THAT DIES WITHIN THE GUARANTEE PERIOD SHALL BE REMOVED (INCLUDING THE ROOT BALL) AND REPLACED WITH A SPECIMEN OF THE SAME VARIETY AND SIZE AS THE ORIGINALLY SPECIFIED PLANT, AT THE EXPENSE OF THE LANDSCAPE CONTRACTOR.

7. THE LANDSCAPE CONTACTOR SHALL FURNISH A MINIMUM OF 24" OF TOPSOIL IN ALL PLANTING BEDS. A COMPLETE SOIL ANALYSIS SHALL BE CONDUCTED BY THE LANDSCAPE CONTRACTOR PRIOR TO PLANTING TO DETERMINE THE EXTENT OF MODIFICATIONS NECESSARY TO THE PH AND NUTRIENT LEVELS OF THE PLANTING SOIL TO ENSURE SURVIVAL OF THE PLANTS. THE CONTRACTOR SHALL FURNISH THE TEST RESULTS TO THE LANDSCAPE ARCHITECT FOR REVIEW AND APPROVAL PRIOR TO PLANTING.

8. ALL PLANTING BEDS AND TREE WELLS SHALL RECEIVE A 3" MINIMUM LAYER OF FINELY SHREDDED PINE BARK. THE LANDSCAPE CONTRACTOR SHALL SUBMIT A SAMPLE OF THE MULCH TO THE LANDSCAPE ARCHITECT PRIOR TO DELIVERY OF THE MULCH TO THE SITE.

9. ALL SHRUB MASSES SHALL BE PLANTED IN CONTINUOUS MULCHED BEDS.

10. IN THE CASE OF A DISCREPANCY BETWEEN THE QUANTITIES LISTED IN THE PLANT SCHEDULE AND THOSE ILLUSTRATED IN THE PLAN, THE PLAN SHALL RULE.

11. ALL LANDSCAPE AREAS NOT PLANTED WITH TREES, SHRUBS, GROUND COVER OR SOD SHALL BE RESTORES WITH 6" OF TOPSOIL AND SHALL BE SEEDED AS INDICATED ON THE PLANS. (T & S)


12. APPLICATION OF GRASS SEED FERTILIZER AND MULCH SHALL BE ACCOMPLISHED BY BROADCAST OR HYDRO SEEDING AT THE RATES OUTLINED BELOW:

LIMESTONE: 100 LBS / 1000 SF FERTILIZER; USE LOW PHOSPHATE AND SLOW RELEASE NITROGEN FERTILIZER 1000 LBS/ACRE



– TYPE I-1 BIT. PAVEMENT: 1 1/4" WEARING COARSE OVER 1 3/4" BINDER COARSE (PER MASSDOT SPECIFICATIONS SECTION 460)

> - 8" OF DENSE GRADED CRUSHED STONE MASS DOT M2.01.7 OR APPROVED EQUAL TESTED PRIOR TO USE ON SITE




APPROVED SUBGRADE

PAVEMENT NOTES: 1. SUBGRADE MATERIAL SHALL CONSISTS OF INERT MATERIAL THAT IS HARD, DURABLE STONE AND/OR COARSE SAND, FREE FROM LOAM AND CLAY TO A DEPTH NOT LESS THAN 4-FT BELOW FINISHED GRADE ELEVATION. ALL UNSUITABLE MATERIAL SHALL BE EXCAVATED AND REMOVED PRIOR TO SUBGRADE INSTALLATION.

2. SUBGRADE SHALL BE PLACED IN MAXIMUM 8" LIFTS (COMPACTED TO 95%) 3. REFER TO SITE PLAN FOR EXTENTS OF BIT. PAVEMENT.

4. THE INSTALLED BINDER COARSE SHALL BE SWEPT CLEAN PRIOR TO THE INSTALLATION OF THE WEARING COARSE BY A MECHANICAL SWEEPER. TACK COAT SHALL BE APPLIED PER THE SPECIFICATIONS.

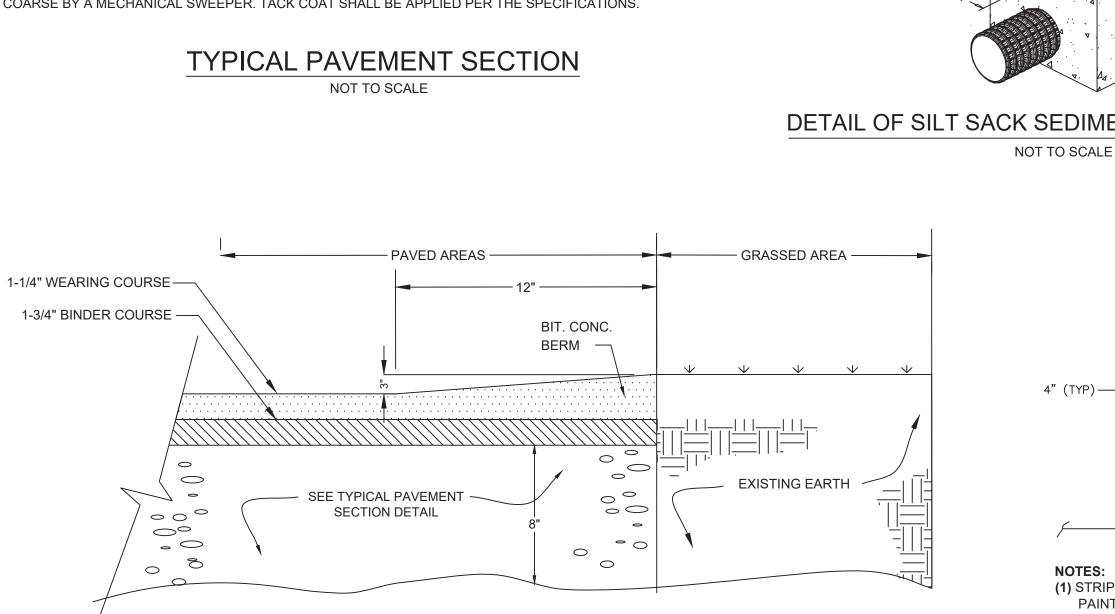

CAPE COD BERM

NOT TO SCALE


NOTES:

INSTALLATION DETAIL

1" REBAR FOR BAG

SILTSACK -

REMOVAL FROM INLET

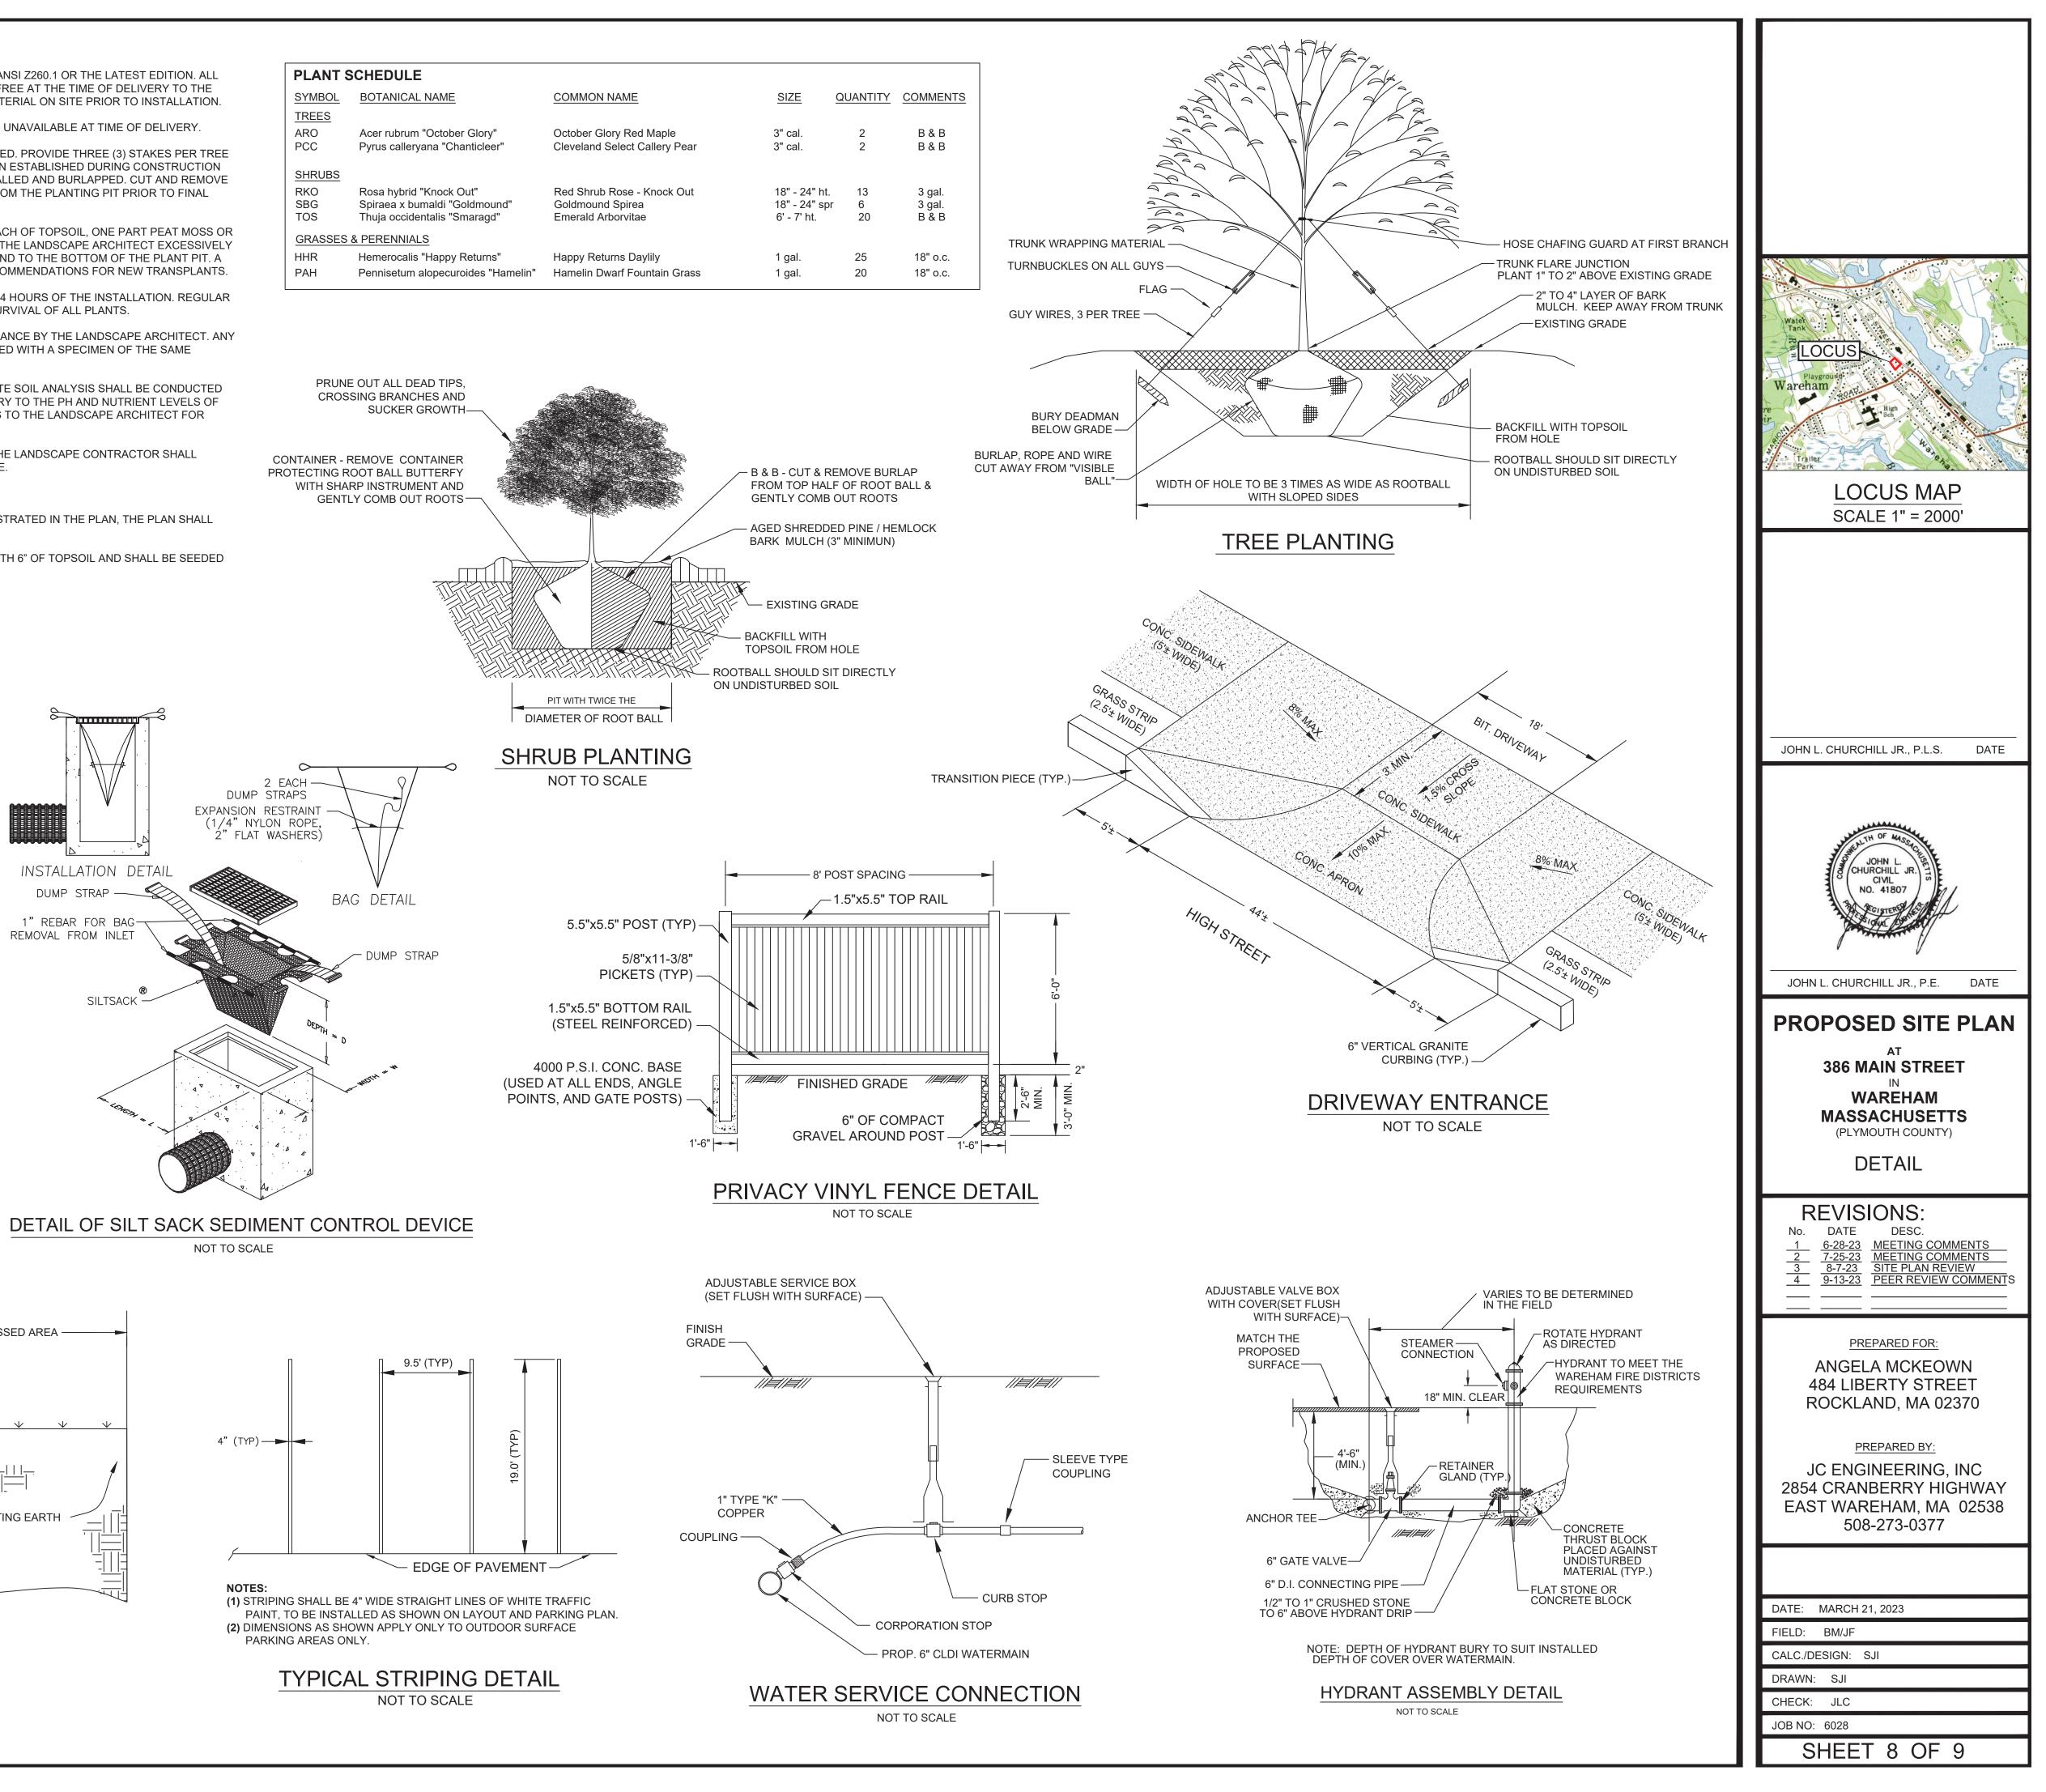

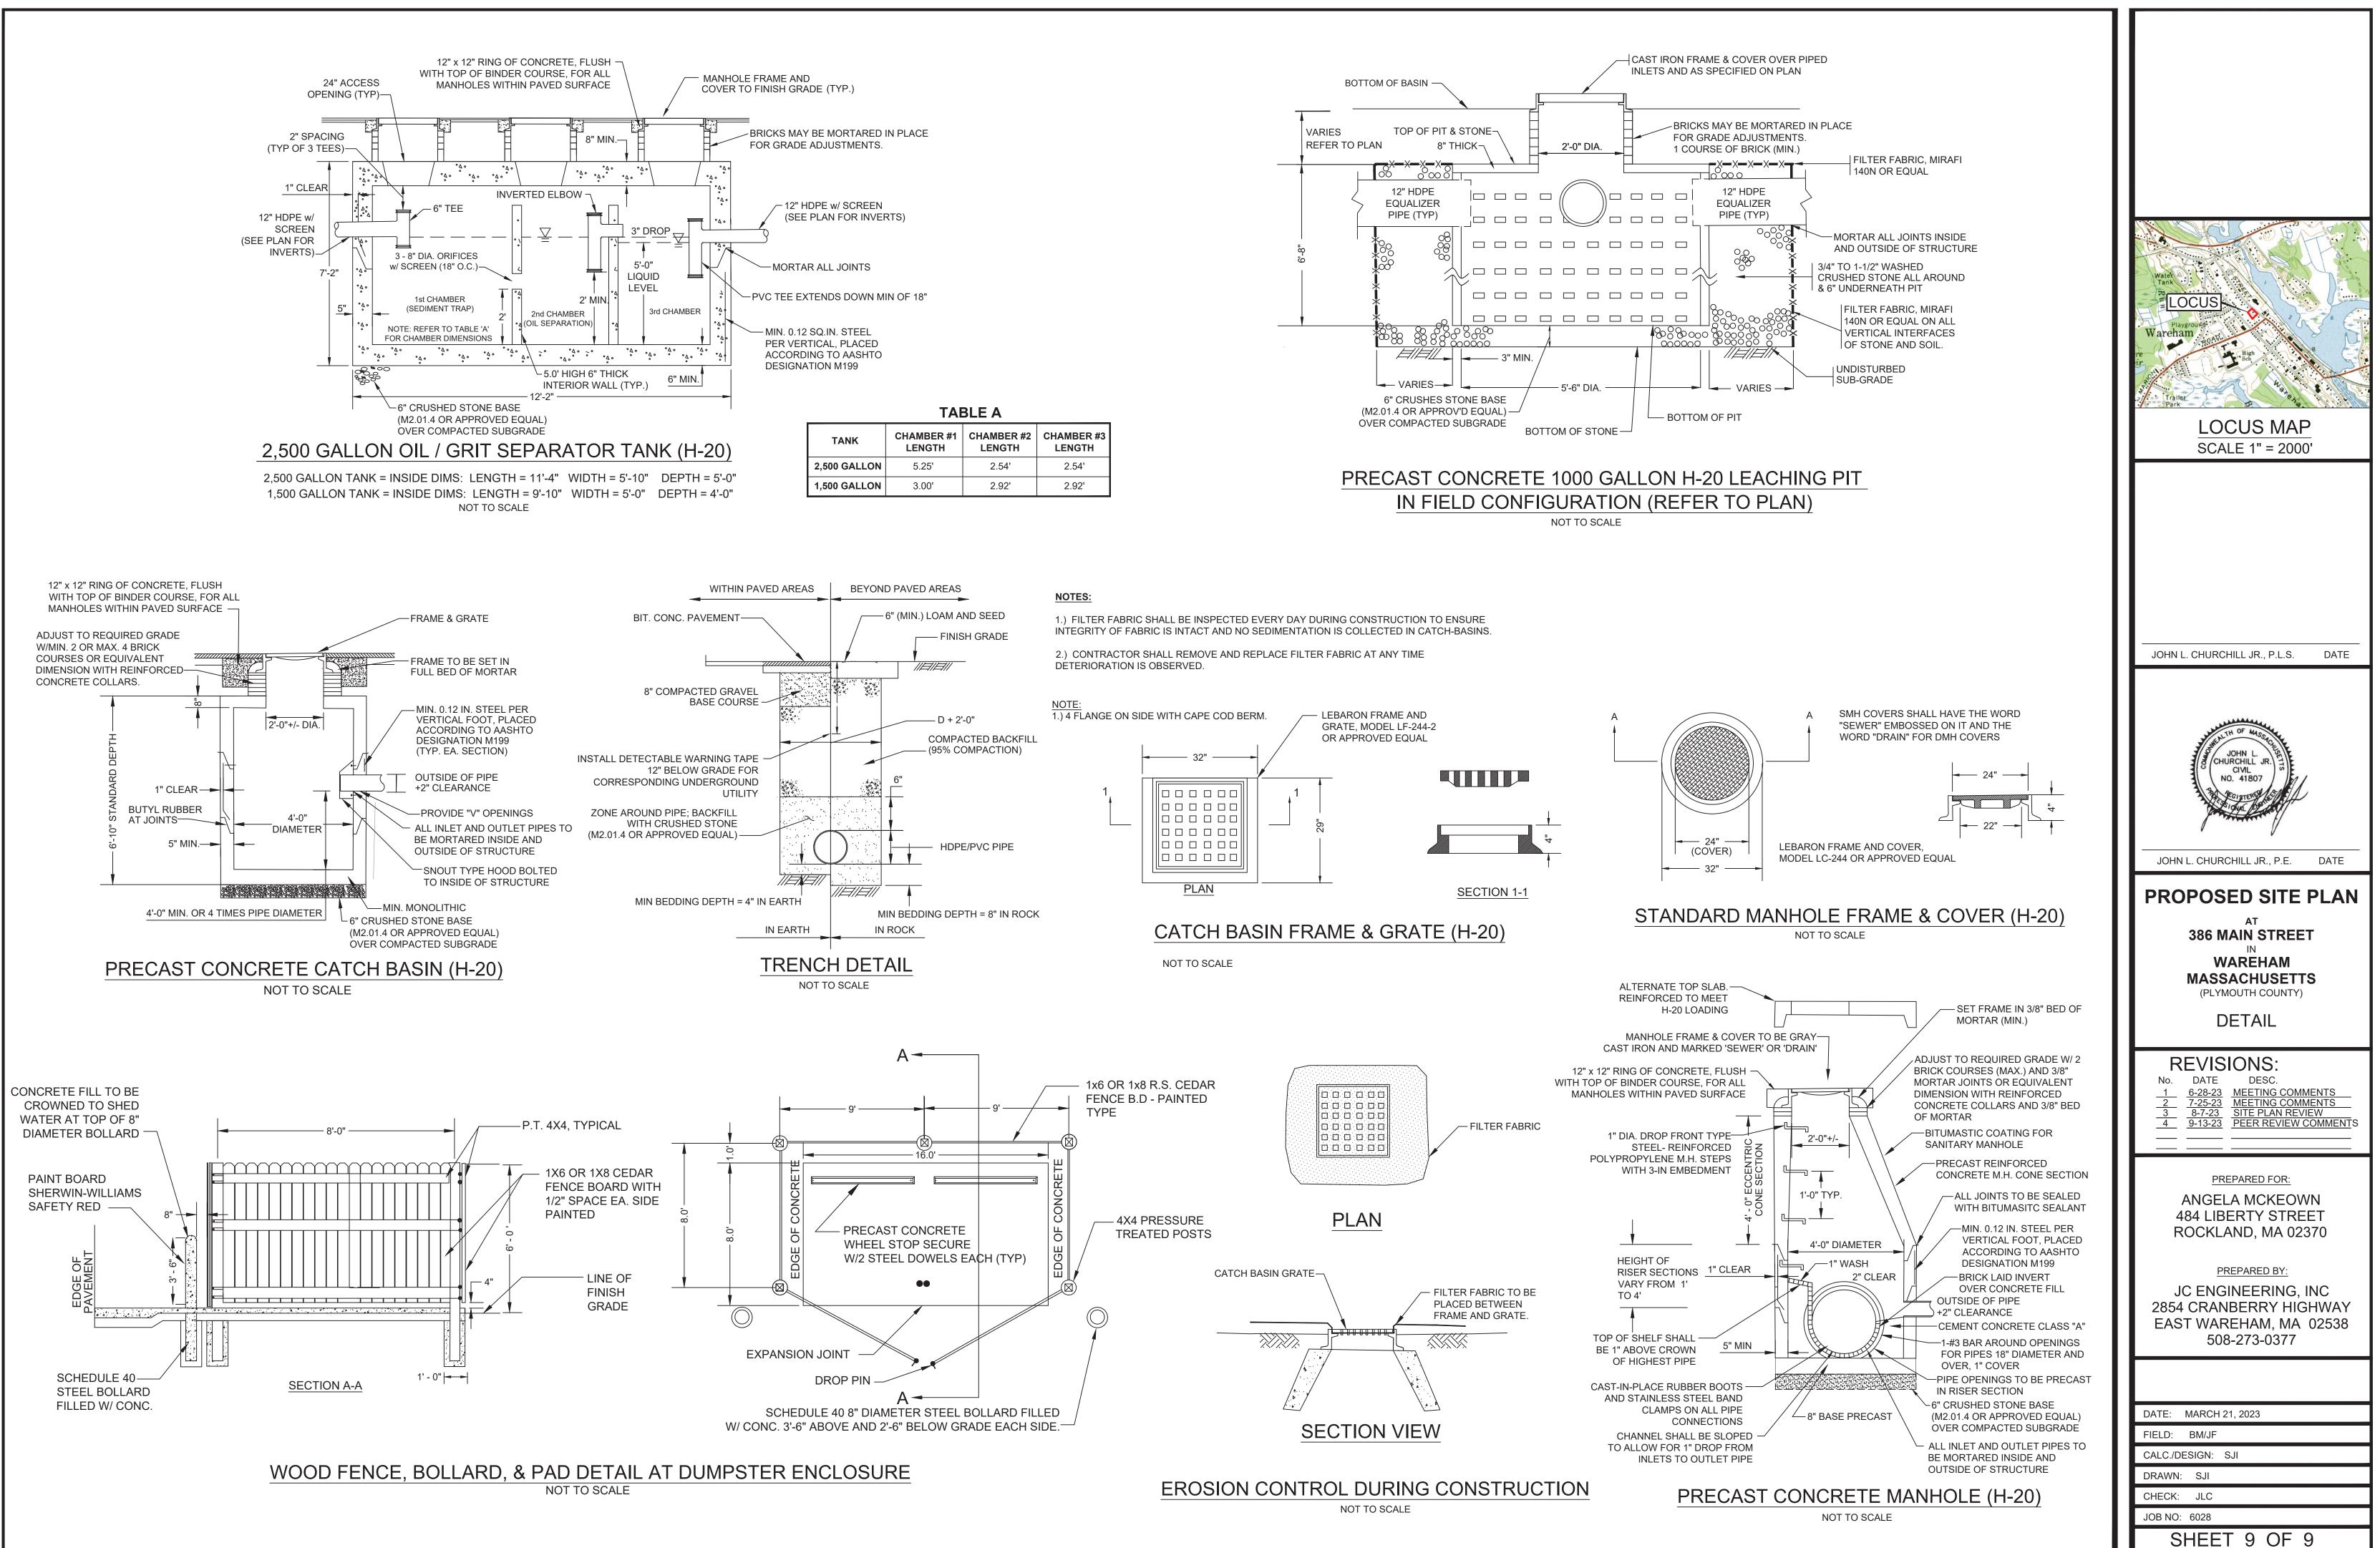


TABLE A				
TANK	CHAMBER #1 LENGTH	CHAMBER #2 LENGTH	CHAMBER #3 LENGTH	
2,500 GALLON	5.25'	2.54'	2.54'	
1,500 GALLON	3.00'	2.92'	2.92'	

