
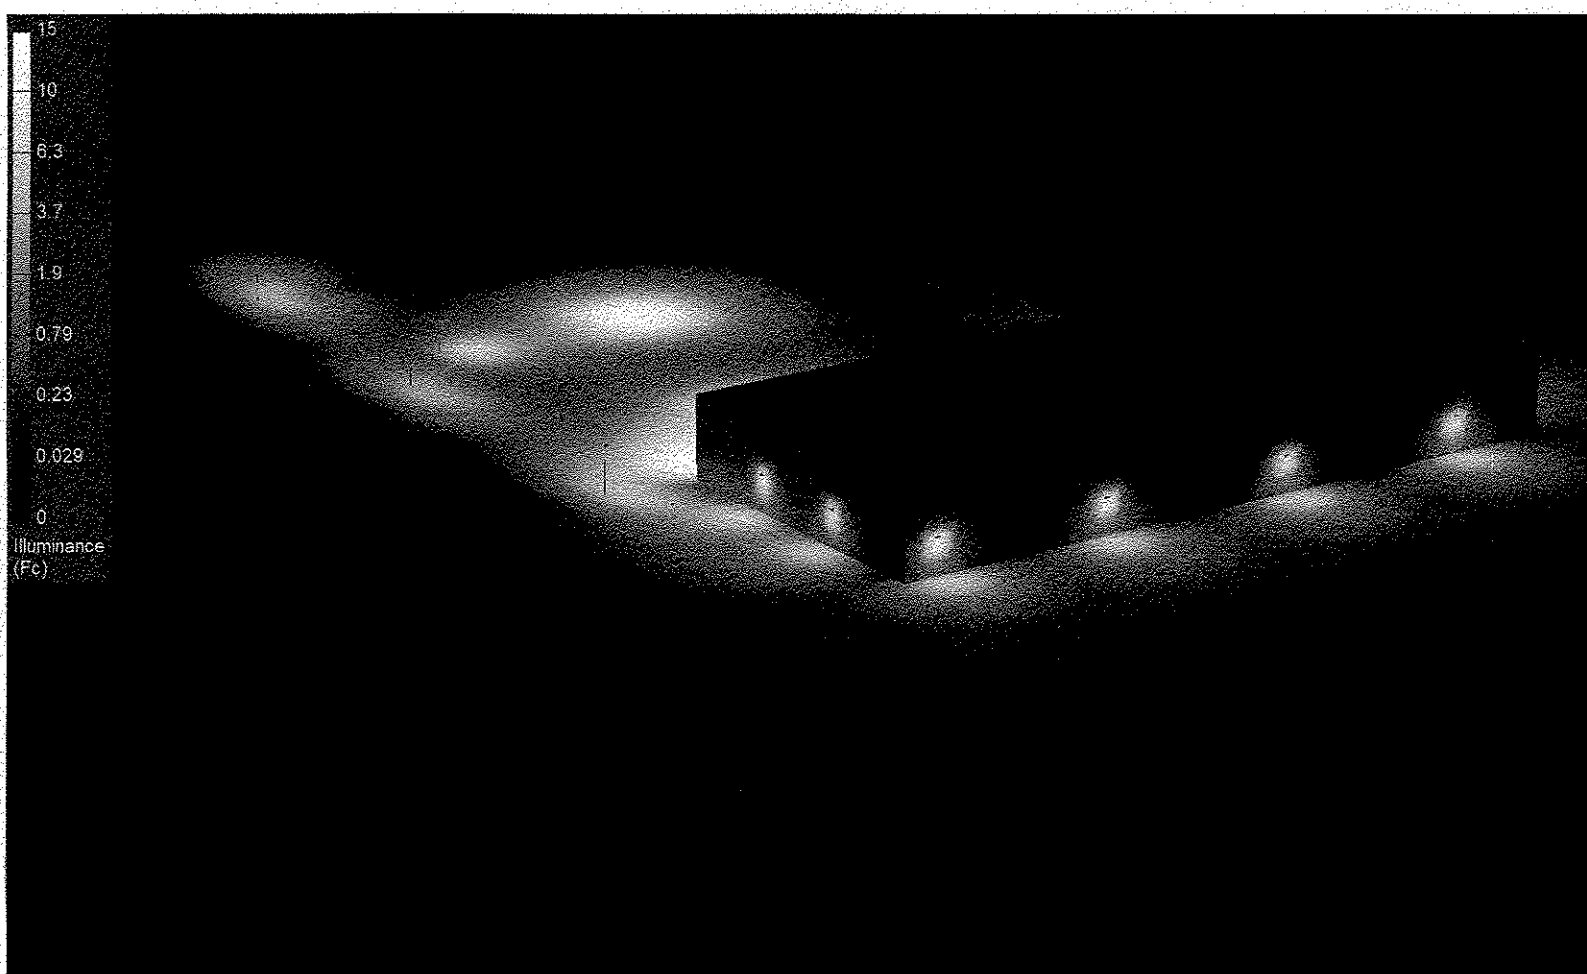


Scale: 1 inch = 40 Ft.

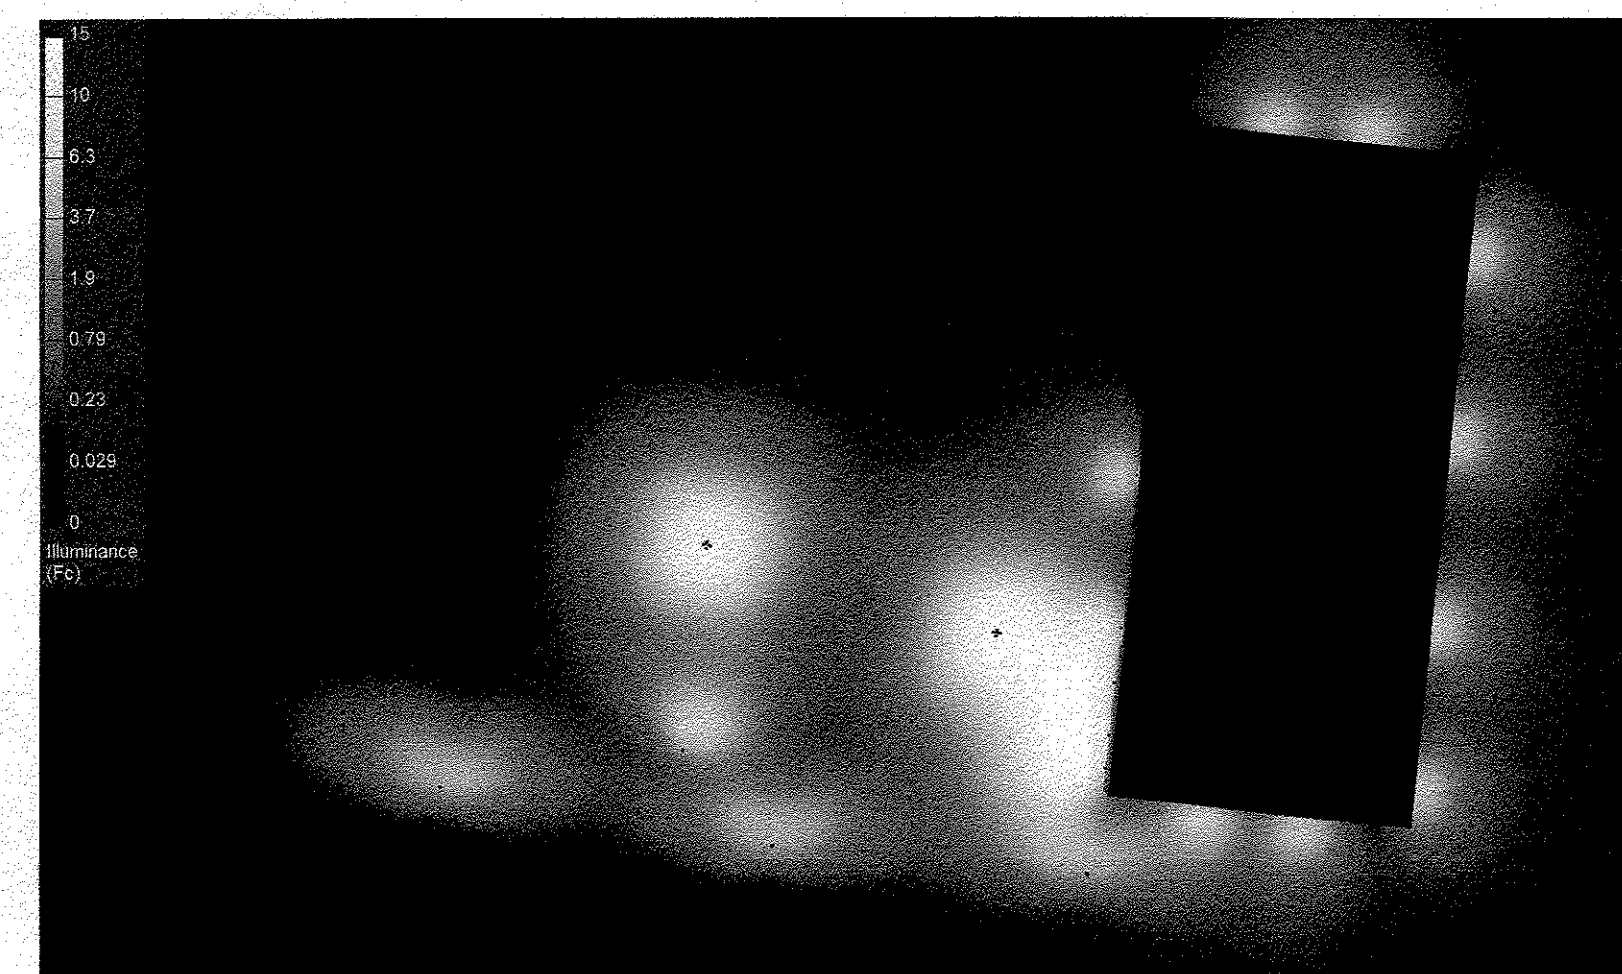

Calculation Summary											
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min	Description	PtSpLr	PtSpTb	Meter Type
Loading Dock	Illuminance	Fc	12.54	22.4	4.0	3.14	5.60	readings taken at grade	10	10	Horizontal
Site	Illuminance	Fc	0.89	12.8	0.0	N.A.	N.A.	readings taken at grade	10	10	Horizontal
Drive	Illuminance	Fc	1.67	6.5	0.1	16.70	65.00	Stat area			
Parking 1	Illuminance	Fc	3.00	12.8	0.3	10.00	42.67	Stat area			
Parking 2	Illuminance	Fc	1.13	3.3	0.5	2.26	6.60	Stat area			

Luminaire Schedule							
All quotes/orders generated from this layout must be forwarded to the Local Rep Agency							
Symbol	Qty	Tag	Label	Arrangement	LLF	Description	BUG Rating
3	A	ALED2T78		SINGLE	1.000	Pole mounted (Type II)	B2-U0-G2
1	B	ALED4T78		SINGLE	1.000	Pole mounted (Type IV)	B1-U0-G2
2	B	ALED4T78 x4@90		4 @ 90°	1.000	Pole mounted (Type IV) x4@90	B1-U0-G2
10	C	WP3LED83L-750U		SINGLE	1.000	Wall mounted	B1-U4-G4
3	D	WPLED4T125		SINGLE	1.000	Wall mounted	B1-U0-G3

Luminaire Tag Summary	
Tag	Qty
A	3
B	9
C	10
D	3

Expanded Luminaire Location Summary					
LumNo	Tag	X	Y	MTG HT	Orient
1	C	761.638	506.76	15	81.832
2	C	807.886	501.983	15	81.832
3	C	850.346	453.168	15	354.495
4	C	841.346	366.918	15	354.495
5	C	697.41	349.378	15	171.366
6	B	496.265	317.962	20	171.87
6	B	497.538	316.265	20	261.87
6	B	499.235	317.538	20	351.87
6	B	497.962	319.235	20	81.87
7	C	832.346	280.668	15	354.495
8	C	690.16	278.878	15	171.366
9	B	630.765	276.962	20	171.87
9	B	632.038	275.265	20	261.87
9	B	633.735	276.538	20	351.87
9	B	632.462	278.235	20	81.87
10	D	686.275	253.838	20	171.366
11	D	683.775	229.588	20	171.366
12	B	487.181	223.087	20	63.011
13	D	682.275	214.338	20	171.366
14	A	374.805	206.219	20	78.257
15	C	824.346	202.918	15	354.495
16	C	729.697	196.652	15	266.406
17	C	775.947	191.902	15	266.406
18	A	528.386	178.994	20	84.815
19	A	674.412	165.491	20	83.785
Total Quantity: 25					

The Lighting Analysis, eLayout, Energy Analysis and/or Visual Simulation ("Lighting Design") provided by RAB Lighting Inc. ("RAB") represents an anticipated prediction of lighting system performance based upon design parameters and information supplied by others. These design parameters and information provided by others have not been independently verified by RAB. RAB makes no warranty, either implied or stated, with respect to the actual measured light levels or energy consumption of the lighting system. RAB is not responsible for any lighting system performance that does not conform to the design parameters and information provided by others. RAB is not responsible for any lighting system performance that does not conform to the design parameters and information provided by others. RAB is not responsible for any lighting system performance that does not conform to the design parameters and information provided by others.

Scale: as noted  
 Date: 6/10/2020  
 Job Name: Master Millwork Lighting Layout Version A  
 Project # 153767  
 Case # 00401768  
 Filename: Master Millwork 00401768A.AGI  
 Drawn By: K. Gonzales, LC

Prepared For:  
 Holbrook Associated  
 35 Reservoir Park Drive  
 Rockland, MA 02370  
 Tel: 781-871-0011