
TOWN OF WAREHAM, MASSACHUSETTS WAREHAM WATER POLLUTION CONTROL INSTALLATION OF LOW-PRESSURE SEWER FORCE MAIN CONTRACT NO. 2022-001



WAREHAM WATER POLLUTION CONTROL

GUY CAMPINHA, DIRECTOR OF WATER POLLUTION CONTROL

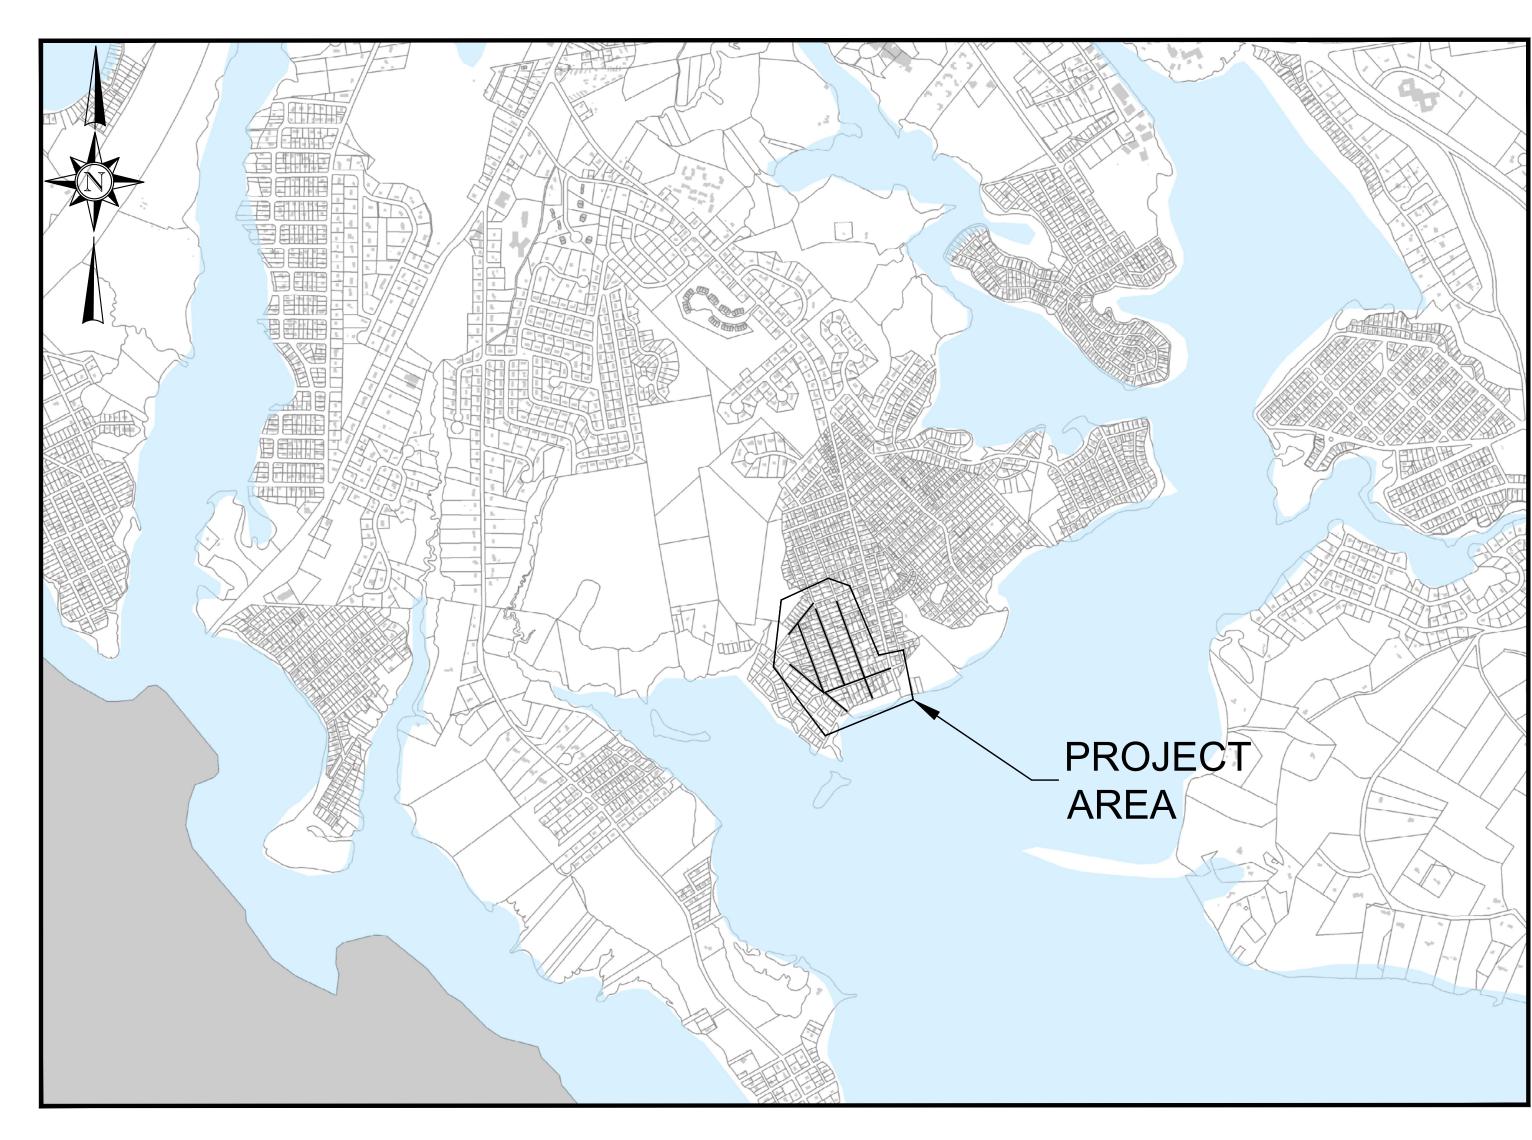

PLAN INDEX


SHEET NO.	DESCRIPTION
G-1	LOCUS PLAN
G-2	LEGEND AND GENERAL NOTES
C-1 thru C-12	PROPOSED LOW PRESSURE SEWER FORCE MAIN
CD-1 thru CD-3	CONSTRUCTION DETAILS

LOCATION MAP

NOT TO SCALE


PREPARED BY:







REGISTERED PROFESSIONAL


ISSUE DATE: 8/3/2022

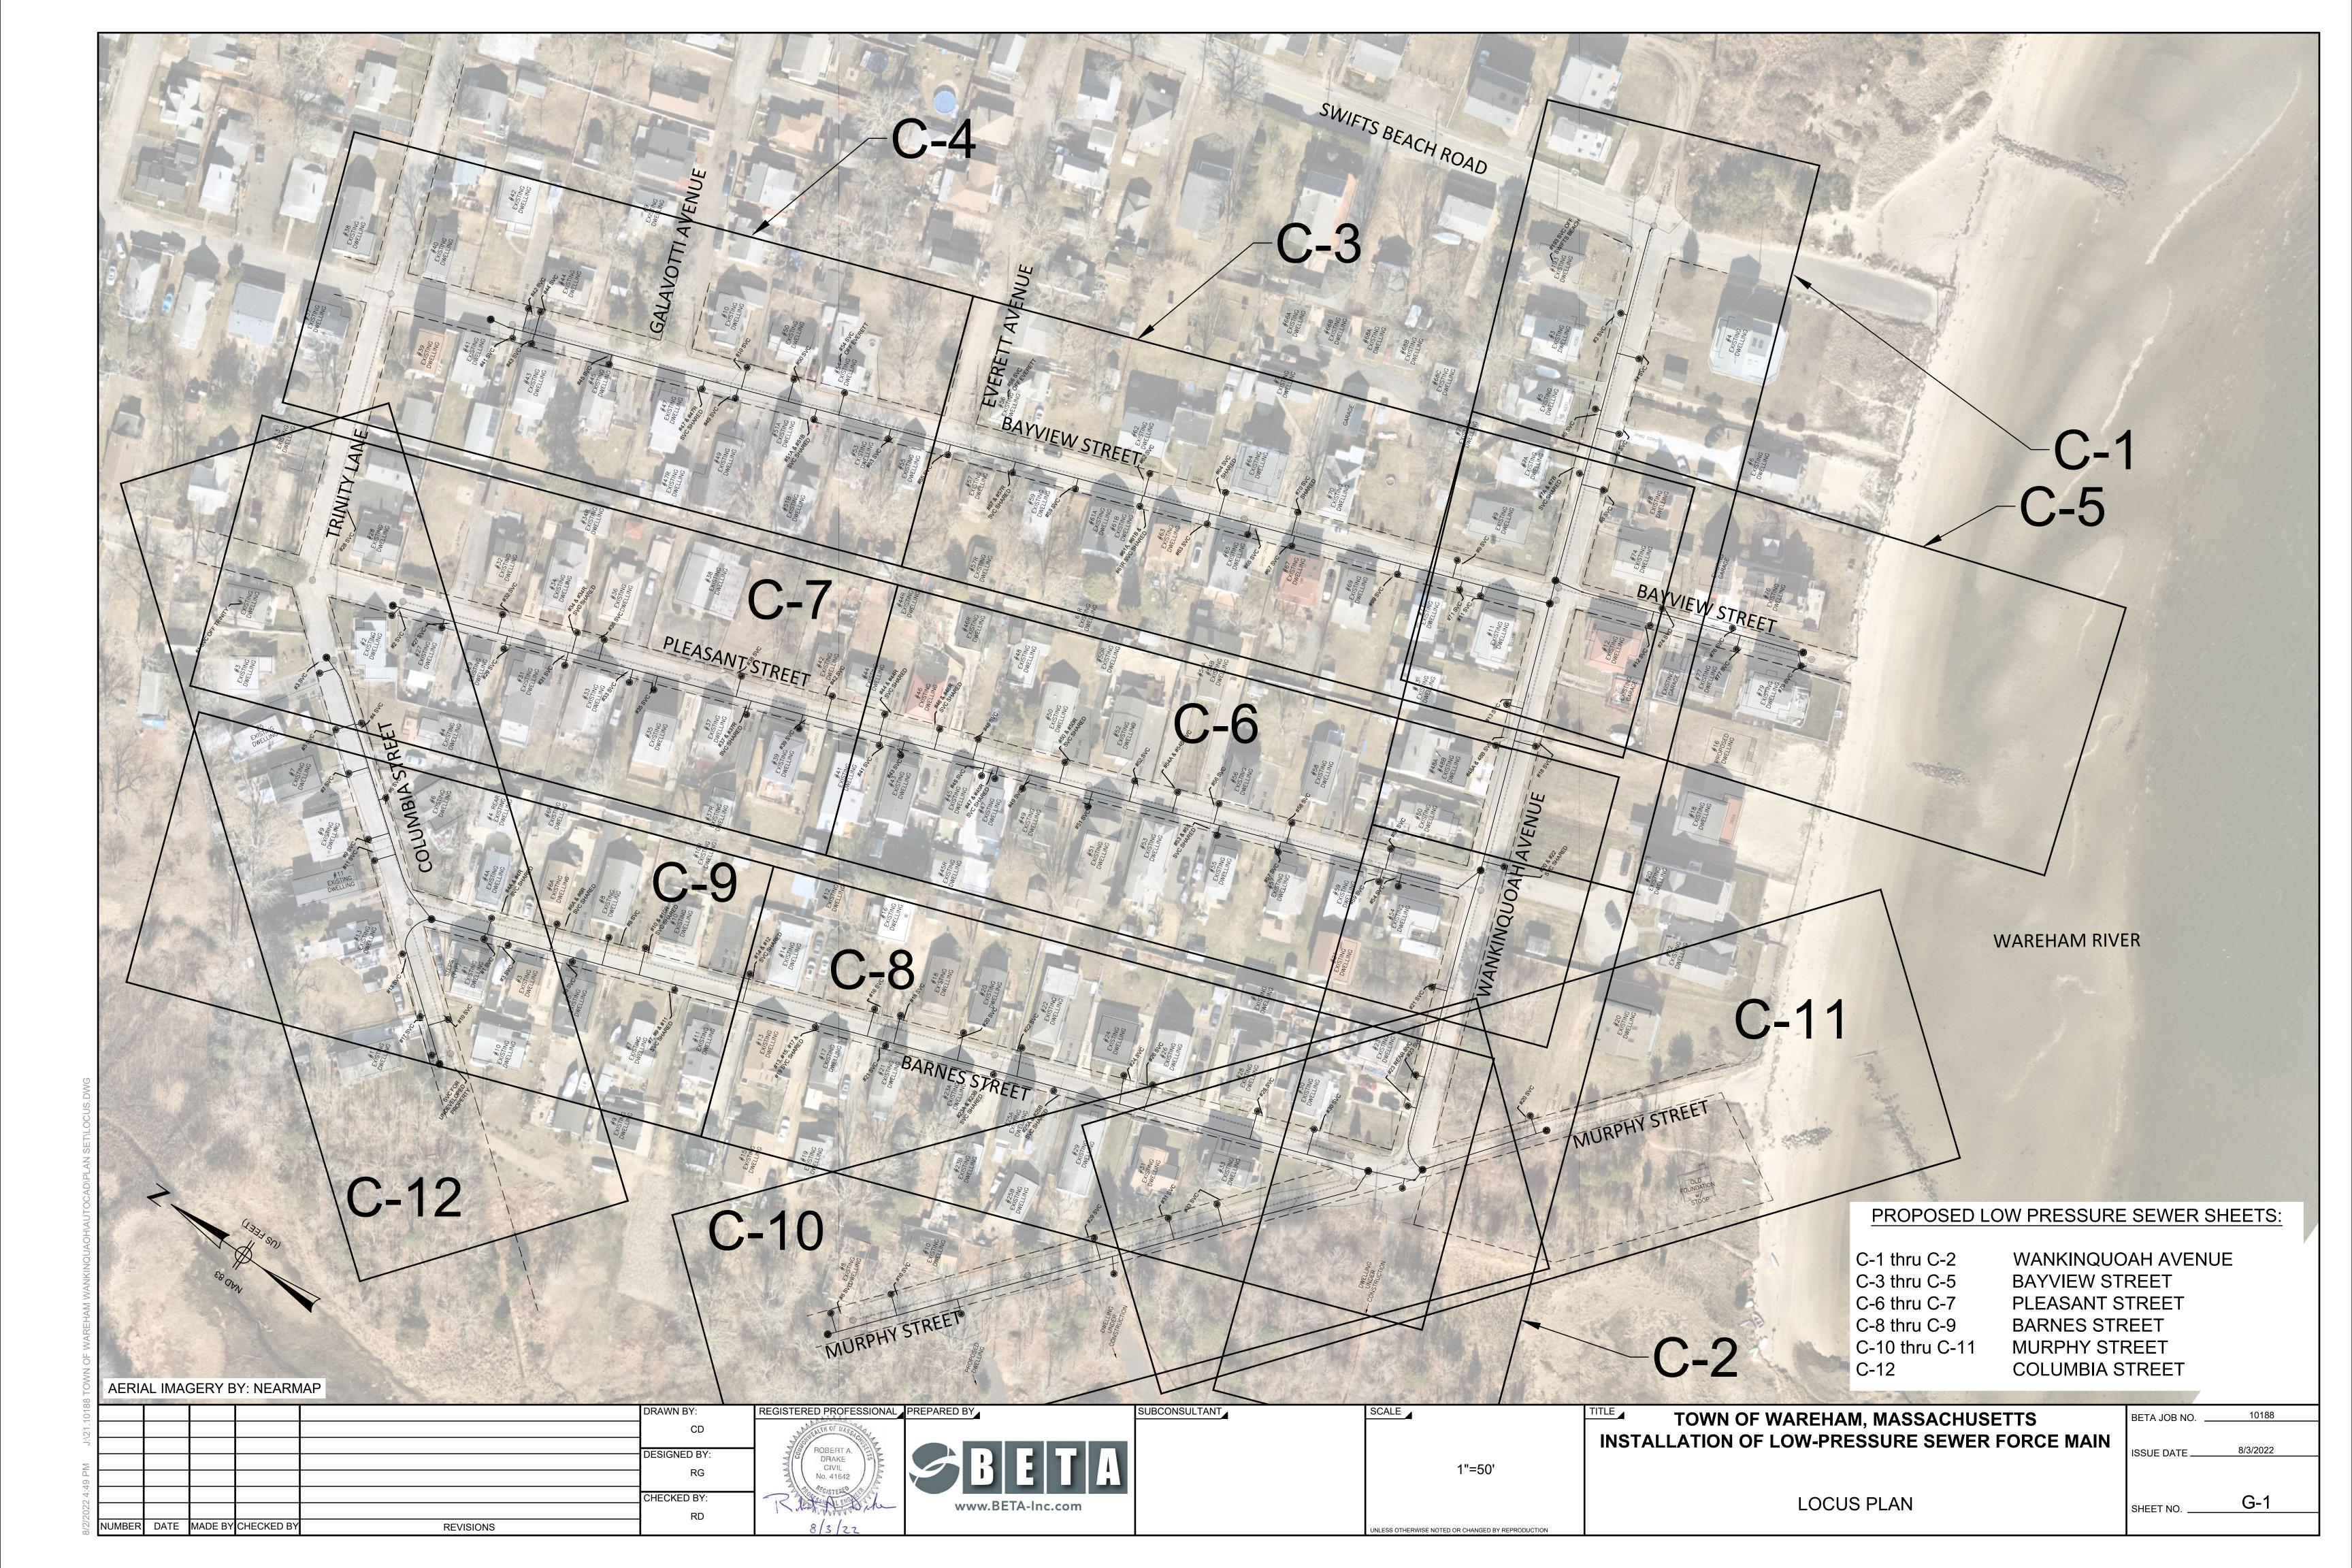



EXISTING BASINS ADJACENT TO DISTURBED AREAS. PROVIDE SILT FENCING AND HAY BALES IN ACCORDANCE WITH DIVISION 2 SPECIFICATION REQUIREMENTS AND **GENERAL NOTES** AS SHOWN ON THE CIVIL DETAIL DRAWINGS. **ABBREVIATIONS** -W- - - - - W- 8" W -W- - - - WATER LINE **GENERAL** TREE PRESERVATION BIT BITUMINOUS 27. PROTECT TREES WITHIN THE LIMITS OF WORK BY INSTALLING BLACK CORRUGATED PLASTIC AROUND TREES, AS INDICATED IN THE CONTRACT 1. THESE GENERAL NOTES ARE NOT INTENDED TO REPLACE THE SPECIFICATIONS FOR THIS CONTRACT. SEE SPECIFICATIONS FOR OTHER REQUIREMENTS IN ADDITION TO THE GENERAL NOTES. CB CATCH BASIN -G---G GAS LINE CONC CONCRETE 28. PRIOR TO CONSTRUCTION DETERMINE REQUIRED CLEARANCES AND CONTRACT LICENSED ARBORIST TO PRUNE TREES. 2. FOR ALL CONSTRUCTION, THE PUBLIC RIGHT-OF-WAY SHALL BE THE LIMIT OF DISTURBANCE. ALL SURFACES DAMAGED OUTSIDE OUTSIDE THE PUBLIC RIGHT-OF-WAY SHALL BE REPLACE IN KIND, AT THE CONTRACTORS EXPENSE. OVERHEAD WIRES CBDISC CONCRETE BOUND W/DISC 29. BRANCHES OR LIMBS DAMAGED DURING CONSTRUCTION SHALL BE CUT BACK TO THE TRUNK OR A LATERAL BRANCH. ---- SEWER SERVICE LATERAL 3. THE CONTRACTOR SHALL CONFINE ALL ACTIVITIES FOR CONSTRUCTION PURPOSES WITHIN THE INDICATED LIMITS OF WORK AS SHOWN IN THE CBDH CONCRETE BOUND W/DRILLHOLE CONTRACT DRAWINGS. ALL SURFACES DAMAGED OUTSIDE THESE LIMITS BY THE CONTRACTOR'S OPERATIONS SHALL BE RESTORED BY THE 30. MAKE EVERY EFFORT TO MAINTAIN EXCAVATION ACTIVITIES OUTSIDE LIMITS OF THE TREE CANOPY. SEWER MANHOLE CBN CONCRETE BOUND W/NO DH CONTRACTOR TO THEIR ORIGINAL CONDITION AT CONTRACTOR'S EXPENSE. CAPPED SEWER SERVICE 31. ROOTS LARGER THAN 1.5" IN DIAMETER ENCOUNTERED IN EXCAVATIONS SHALL BE CUT OFF SQUARELY USING A SHARP ARBORIST SAW. CMP CORRUGATED METAL PIPE SEWER SHUTOFF VALVE DYL DOUBLE YELLOW LINE 32. MAINTAIN STORAGE OF EQUIPMENT AND MATERIALS OUTSIDE THE DISTANCE OF THE RADIUS OF THE TREE CANOPY. 4. BASE MAPPING BASED ON GEOGRAPHIC INFORMATION SYSTEMS (GIS) DATA, DATA DIGITIZED FROM AERIAL, DATA COLLECTED VIA GPS AND SURVEY DRAIN MANHOLE DH DRILL HOLE BY JC ENGINEERING, INC., 2854 CRANBERRY HIGHWAY, EAST WAREHAM, MA 02538. CATCH BASIN **EOP EDGE OF PAVEMENT** 5. VERTICAL DATUM IS NAVD88. 0 UTILITY POLE/ LIGHT EL ELEVATION 6. THE LOCATION, SIZE, AND MATERIAL OF EXISTING PIPES, DUCTS, CONDUITS AND OTHER UNDERGROUND STRUCTURES AND/OR UTILITIES SHOWN ON FIRE HYDRANT FNC **FENCE** THESE PLANS ARE FROM THE BEST AVAILABLE SOURCES AND ARE NOT WARRANTED TO BE EXACT, NOR IS IT WARRANTED THAT ALL UNDERGROUND PIPES, UTILITIES OR STRUCTURES ARE SHOWN. EXACT LOCATION TO BE DETERMINED BY CONTRACTOR IN FIELD. WATER GATE FFE FIRST FLOOR ELEVATION WATER TEE 7. EXISTING UTILITIES HAVE BEEN PLOTTED FROM THE BEST AVAILABLE DATA AND ARE APPROXIMATE ONLY. PRIOR TO CONSTRUCTION, THE GAS LATERAL CONTRACTOR SHALL VERIFY LOCATIONS OF ALL EXISTING UTILITIES AND NOTIFY ALL UTILITY COMPANIES (PUBLIC AND PRIVATE). IN ADDITION, "DIG WATER CAP GPL GUY POLE SAFE" MUST BE CONTACTED AT 1(888)-DIG-SAFE. CONTRACTOR TO CONTACT TOWN OF WAREHAM FOR THE LOCATION OF TOWN OF WAREHAM OWNED UTILITIES INCLUDING SEWER, WATER, DRAIN AND OTHER TOWN OWNED UTILITIES. WATER PIPE BEND INV INVERT WATER PIPE REDUCER 8. "AS-BUILT" DRAWINGS MAY BE EXAMINED AT THE TOWN OF WAREHAM ENGINEERING OFFICE. THE OWNER DOES NOT GUARANTEE THE ======= IP IRON PIPE CORRECTNESS OF THE CONTENTS OF THESE PLANS. THE CONTRACTOR IS CAUTIONED AGAINST RELYING SOLELY ON THE "AS-BUILTS" WITHOUT CURB STOP VERIFYING THE SAME BY FIELD INVESTIGATIONS. IR IRON ROD GAS GATE LCP LAND COURT PLAN 9. PROPERTY LINES AND CITY/TOWN LINES ARE SHOWN FOR INFORMATION ONLY. **GUY WIRE** LATERAL ELEVATION **EXISTING UTILITIES** TRAFFIC SIGN LPSS LOW PRESSURE SEWER SYSTEM 10. EXISTING UTILITIES ENCOUNTERED DURING CONSTRUCTION SHALL BE PROTECTED AND SUPPORTED AT ALL TIMES BY THE CONTRACTOR. ALL CURBING REINFORCED CONCRETE PIPE EXISTING SERVICES TO BE MAINTAINED AT ALL TIMES. THE CONTRACTOR SHALL CONDUCT HIS OPERATIONS TO INTERFERE AS LITTLE AS POSSIBLE WITH — — PROPERTY LINE EXISTING UTILITIES. PAYMENT FOR PROVIDING SAID PROTECTION AND SUPPORTS SHALL BE CONSIDERED A PART OF AND PAID FOR UNDER THE RISER ON UTILITY POLE APPROPRIATE PIPE OR STRUCTURE ITEMS UNLESS OTHERWISE INDICATED AND/OR DIRECTED BY THE OWNER. THE CONTRACTOR SHALL HAVE NO CLAIM RIGHT OF WAY LINE FOR ADDITIONAL COMPENSATION BY REASON OF DELAY AND/OR INCONVENIENCE IN ADAPTING HIS OPERATIONS ACCORDINGLY. SEWER LATERAL DRIVE DRIVEWAY SMH SEWER MANHOLE 11. CONTRACTOR IS RESPONSIBLE FOR REPAIR OF DAMAGED UTILITIES CAUSED BY THE CONTRACTORS OPERATIONS AT NO ADDITIONAL COST TO THE CONC. WALK **CONCRETE WALK** SWL SOLID WHITE LINE STONE WALL REMOVAL AND DISPOSAL SYL SOLID YELLOW LINE STKD STOCKADE 12. THE CONTRACTOR SHALL BE RESPONSIBLE FOR REMOVING AND LEGALLY DISPOSING (R&D) ALL MATERIALS INDICATED ON THE PLANS INCLUDING BUT NOT LIMITED TO ALL GRIT AND DEBRIS FROM THE EXISTING STRUCTURES WHICH SHALL BE CONSIDERED 'SPECIAL WASTE' AND SHALL BE REMOVED HOUSE / BUILDING STRUCTURE STL STOP LINE AND DISPOSED OF AS INDICATED IN THE SPECIFICATIONS. ALL DEMOLITION MATERIAL INCLUDING CONCRETE, PIPE, AND BRICK THAT WAS IN CONTACT **DECIDUOUS TREE** WITH SEWAGE SHALL BE CLEANED IN ACCORDANCE WITH MA DEP REQUIREMENTS AND DISPOSED OF ACCORDINGLY. ONCE CLEANED, DEMOLITION UPL UTILITY POLE MATERIALS SHALL NOT BE CONSIDERED SPECIAL WASTE. NO TEMPORARY STORAGE WILL BE ALLOWED IN TOWN. TREE LINE ULT UTILITY POLE WITH LIGHT SITE RESTORATION _____ CONTOUR MAJOR VERMICULITE CLAY PIPE ---- 14 ---- CONTOUR MINOR WATER LATERAL 13. EXCEPT WHERE NOTED BY PROPOSED CONTOUR LINES, ALL FINAL CONTOUR LINE ELEVATIONS SHALL BE THE SAME AS EXISTING CONTOUR LINE $\times 16.5$ SPOT ELEVATION PE POLYETHYLENE □ SB/DH 14. JOINTS BETWEEN NEW BITUMINOUS CONCRETE ROADWAY PAVEMENT AND SAWCUT EXISTING PAVEMENT SHALL BE SEALED WITH BITUMEN AND STONE BOUND/DRILL HOLE M-C MAIN TO CURB BACKSANDED. O IP IRON PIPE C-H CURB TO HOUSE 15. ALL CURBING DISTURBED BY CONSTRUCTION OPERATIONS SHALL BE RESET, RESTORED OR REPLACED IN KIND, IF DAMAGED, INCLUDING CEMENT TRAVERSE STATION CONCRETE, AS SPECIFIED IN MHD DETAIL 10.3.0, REGARDLESS OF ITS PROXIMITY TO THE DRAIN OR SEWER, AS DIRECTED BY THE OWNER/ENGINEER PAYMENT SHALL BE CONSIDERED PART OF AND PAID FOR UNDER THE APPROPRIATE PIPE ITEMS AS APPLICABLE UNLESS OTHERWISE INDICATED ON STD STEEL DUCT GA **GALVANIZED** 16. ALL SIDEWALK AND WHEELCHAIR RAMP AREAS DISTURBED BY THE CONTRACTOR'S OPERATIONS SHALL BE REPAIRED IN CONFORMANCE TO THE AMERICANS WITH DISABILITIES ACT (ADA) REQUIREMENTS AND THE ARCHITECTURAL ACCESS BOARD (AAB) REQUIREMENTS AT THE CONTRACTOR'S CEMENT LINED STEEL UNK UNKNOWN MATERIAL 17. THE CONTRACTOR SHALL REMOVE AND RESET ALL SIGNS DISTURBED DURING CONSTRUCTION, IN CONFORMANCE WITH THE MASSACHUSETTS CONTROLLED DENSITY FILL STANDARD SPECIFICATIONS AND CONSTRUCTION STANDARDS. LDCC LOW DENSITY CELLULAR CONCRETE 18. ALL GRASSED OR WOODED AREAS DISTURBED BY THE CONSTRUCTION OPERATIONS SHALL BE LOAMED AND SEEDED IN ACCORDANCE WITH THE SHLO STATE HIGHWAY LAYOUT SPECIFICATIONS. FINAL RESTORATION SHALL BE EQUAL TO OR BETTER THAN THAT WHICH EXISTED PRIOR TO CONSTRUCTION AS DETERMINED SOLELY **PROPOSED** BY THE OWNER/ENGINEER. PAYMENT SHALL BE CONSIDERED PART OF AND PAID FOR UNDER THE APPROPRIATE PIPE ITEMS AS APPLICABLE UNLESS ABANDON / ABANDONED OTHERWISE INDICATED. SAW CUT LINE CTE CONNECT TO EXISTING MAINTENANCE OF EXISTING FLOWS SEWER SERVICE DIG AND REPLACE C−C CUT & CAP 19. FLOW IN ALL SANITARY SEWERS, COMBINED SEWERS AND DRAINS SHALL BE MAINTAINED AT ALL TIMES. CONTRACTOR SHALL PROVIDE BYPASS SEWER MAIN REMOVE AND DISPOSE EQUIPMENT AS NECESSARY TO COMPLETE WORK. SEE SPECIFICATIONS. **DRAIN PIPE** VERIFY IN FIELD 20. THE CONTRACTOR SHALL PROVIDE ALL TEMPORARY EQUIPMENT, PIPING, FITTINGS AND APPURTENANCES NECESSARY TO COMPLETE THIS CONTRACT. Z/Z/Z/Z/Z/Z/Z/Z/Z/Z/Z/Z/Z/Z/Z/Z ABANDON / FILL WITH CDF **SEWER MANHOLE** 21. THE CONTRACTOR SHALL INSTALL AND MAINTAIN ALL TEMPORARY BYPASS-LINES UNTIL THE MODIFICATIONS AND CONSTRUCTION ARE COMPLETE. GRAN. **GRANITE** SEWER SERVICE SHUTOFF **EXCAVATION SUPPORT, DEWATERING** PK PK NAIL DRAIN MANHOLE CAST IRON 22. ALL CONSTRUCTION WORK SHALL BE PERFORMED IN THE DRY. THE CONTRACTOR SHALL PROVIDE, OPERATE AND MAINTAIN ALL PUMPS, DRAINS, CATCH BASIN WELL POINTS, SCREENS, OR OTHER FACILITIES NECESSARY TO CONTROL, COLLECT AND DISPOSE SURFACE AND SUBSURFACE WATER ENCOUNTERED IN VC, VCP VITRIFIED CLAY (PIPE) THE PERFORMANCE OF THE WORK. SEWER / DRAIN BULKHEADS DUCTILE IRON **GRINDER PUMP** 23. DISCHARGE FROM DEWATERING OPERATIONS SHALL NOT BE DIRECTLY DISCHARGED INTO THE SEWER OR DRAIN. ALL CONSTRUCTION DEWATERING DUCTILE IRON CEMENT-LINED SHALL HAVE SILT AND SEDIMENT REMOVED PRIOR TO DISCHARGE (SEE SPECIFICATIONS). STRAW WATTLE REINFORCED CONCRETE (PIPE) SOIL EROSION AND SEDIMENTATION CONTROL DIRECTION OF FLOW (SEWER) HIGH DENSITY POLYETHYLENE LIMIT OF WORK 24. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO MAINTAIN ALL SOIL EROSION AND SEDIMENT CONTROLS ON THE PROJECT SITE FOR THE CP, CPP CORRUGATED PLASTIC (PIPE) ENTIRE DURATION OF THE CONSTRUCTION PERIOD. THE CONTRACTOR SHALL FOLLOW THE DIRECTION OF THE RESIDENT ENGINEER WITH REGARD TO INSTALLATION, MAINTENANCE, AND REPAIR OF ALL SOIL EROSION AND SEDIMENTATION CONTROLS ON THE PROJECT SITE. TEMPORARY SOIL EROSION CHAIN LINK FENCE AND SEDIMENTATION CONTROLS (HAYBALES, SILT FENCE, ETC.) SHALL BE MAINTAINED UNTIL ALL EXPOSED SOILS ARE SATISFACTORILY STABILIZED. PROP PROPOSED 25. ALL EROSION AND SEDIMENTATION (E&S) CONTROL MEASURES SHALL BE INSTALLED BY THE CONTRACTOR AND INSPECTED BY THE ENGINEER PRIOR TYP TYPICAL TO THE START OF CONSTRUCTION. THE E&S CONTROLS SHALL BE CLEANED AND MAINTAINED THROUGHOUT THE DURATION OF CONSTRUCTION OPERATIONS AND UNTIL ALL DISTURBED AREAS ARE STABILIZED AFTER CONSTRUCTION IS COMPLETE. E&S CONTROLS SHALL BE INSPECTED AND DOUBLE YELLOW LINE CLEANED AFTER ALL STORM EVENTS AND UPON THE REQUEST OF THE OWNER OR ENGINEER. CONTRACTOR SHALL MAINTAIN AN ADEQUATE SUPPLY OF HAY BALES ON SITE TO BE INSTALLED IN AREAS WHERE EXISTING E&S CONTROLS HAVE FAILED OR AS DETERMINED NECESSARY BY THE ENGINEER. NO SINGLE WHITE LIN WORK OR STORAGE OF CONSTRUCTION EQUIPMENT WILL BE PERMITTED OUTSIDE THE LIMIT OF DISTURBANCE. STB STOP BAR 26. PROVIDE SOIL EROSION AND SEDIMENT CONTROL MEASURES AT PERIMETERS OF ALL EXCAVATION AREAS, DISTURBED SURFACES AND AT ALL CATCH HMC HOT MIX CURB DRAWN BY: REGISTERED PROFESSIONAL PREPARED BY SUBCONSULTANT CALE 10188 TOWN OF WAREHAM, MASSACHUSETTS BETA JOB NO. INSTALLATION OF LOW-PRESSURE SEWER FORCE MAIN 8/3/2022 ROBERT A ISSUE DATE ___ DESIGNED BY DRAKE CIVIL LEGEND AND GENERAL NOTES **NONE** No. 41642 CHECKED BY: G-2 www.BETA-Inc.com RD DATE MADE BY CHECKED BY **REVISIONS**

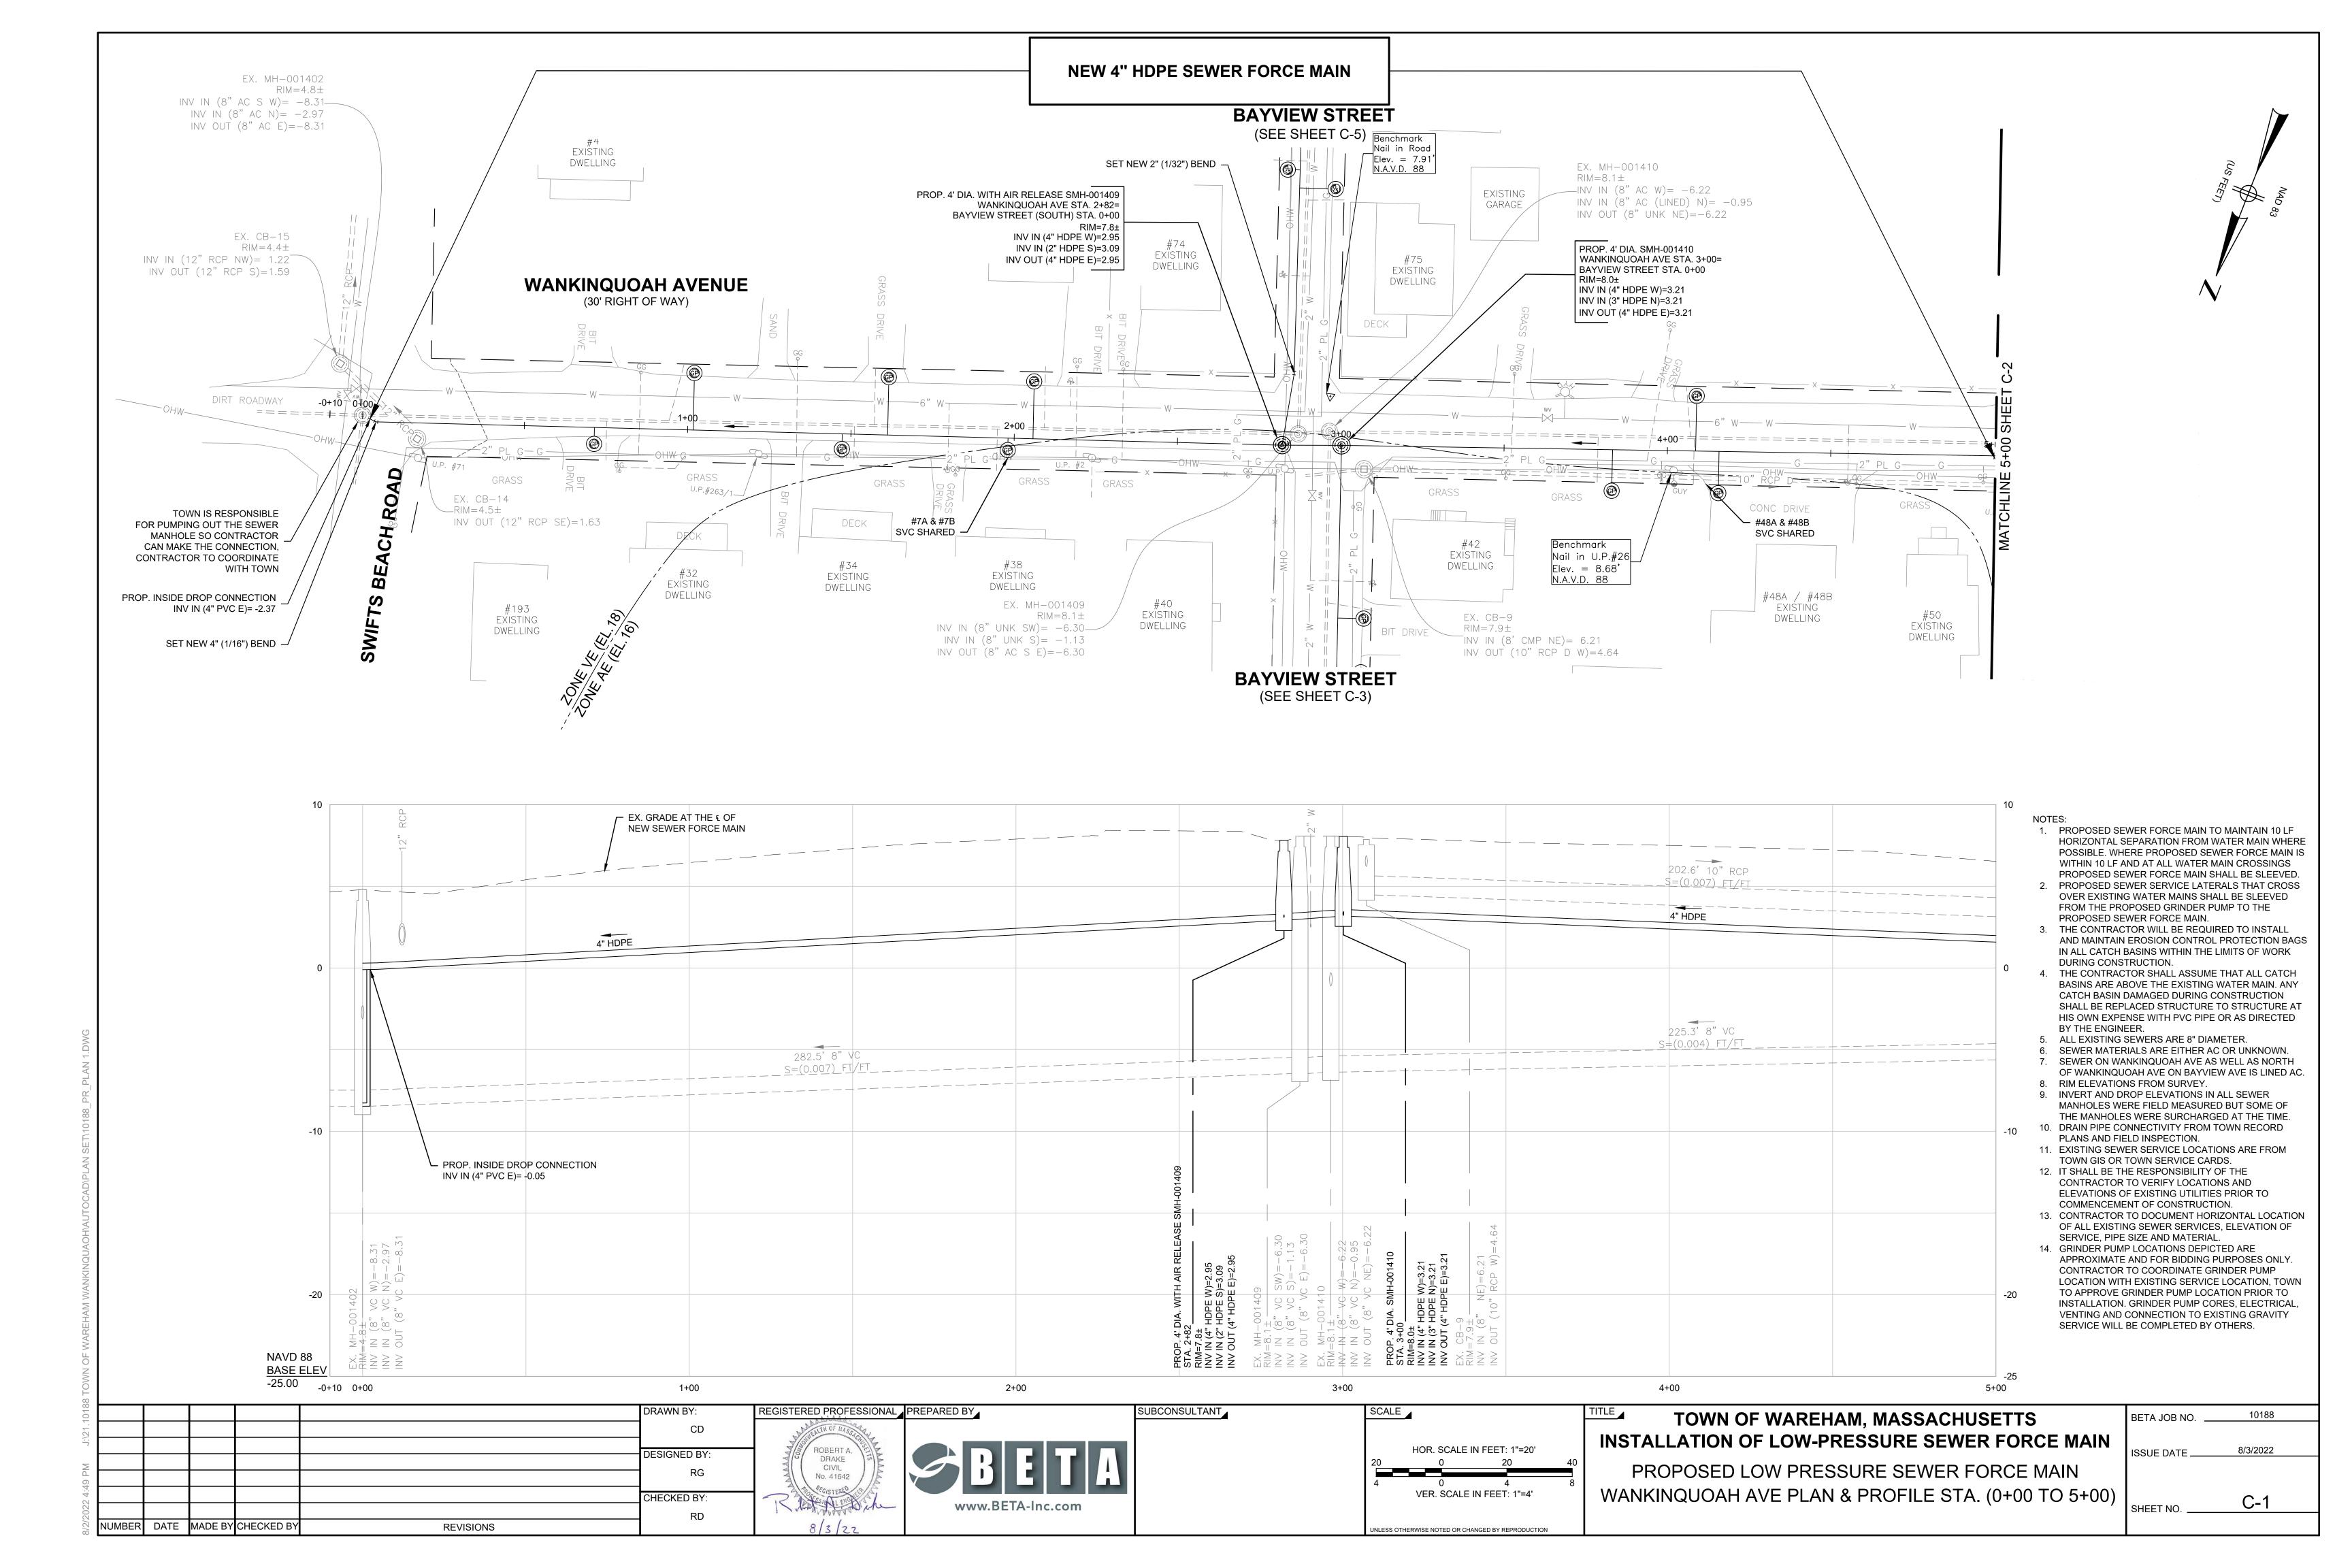


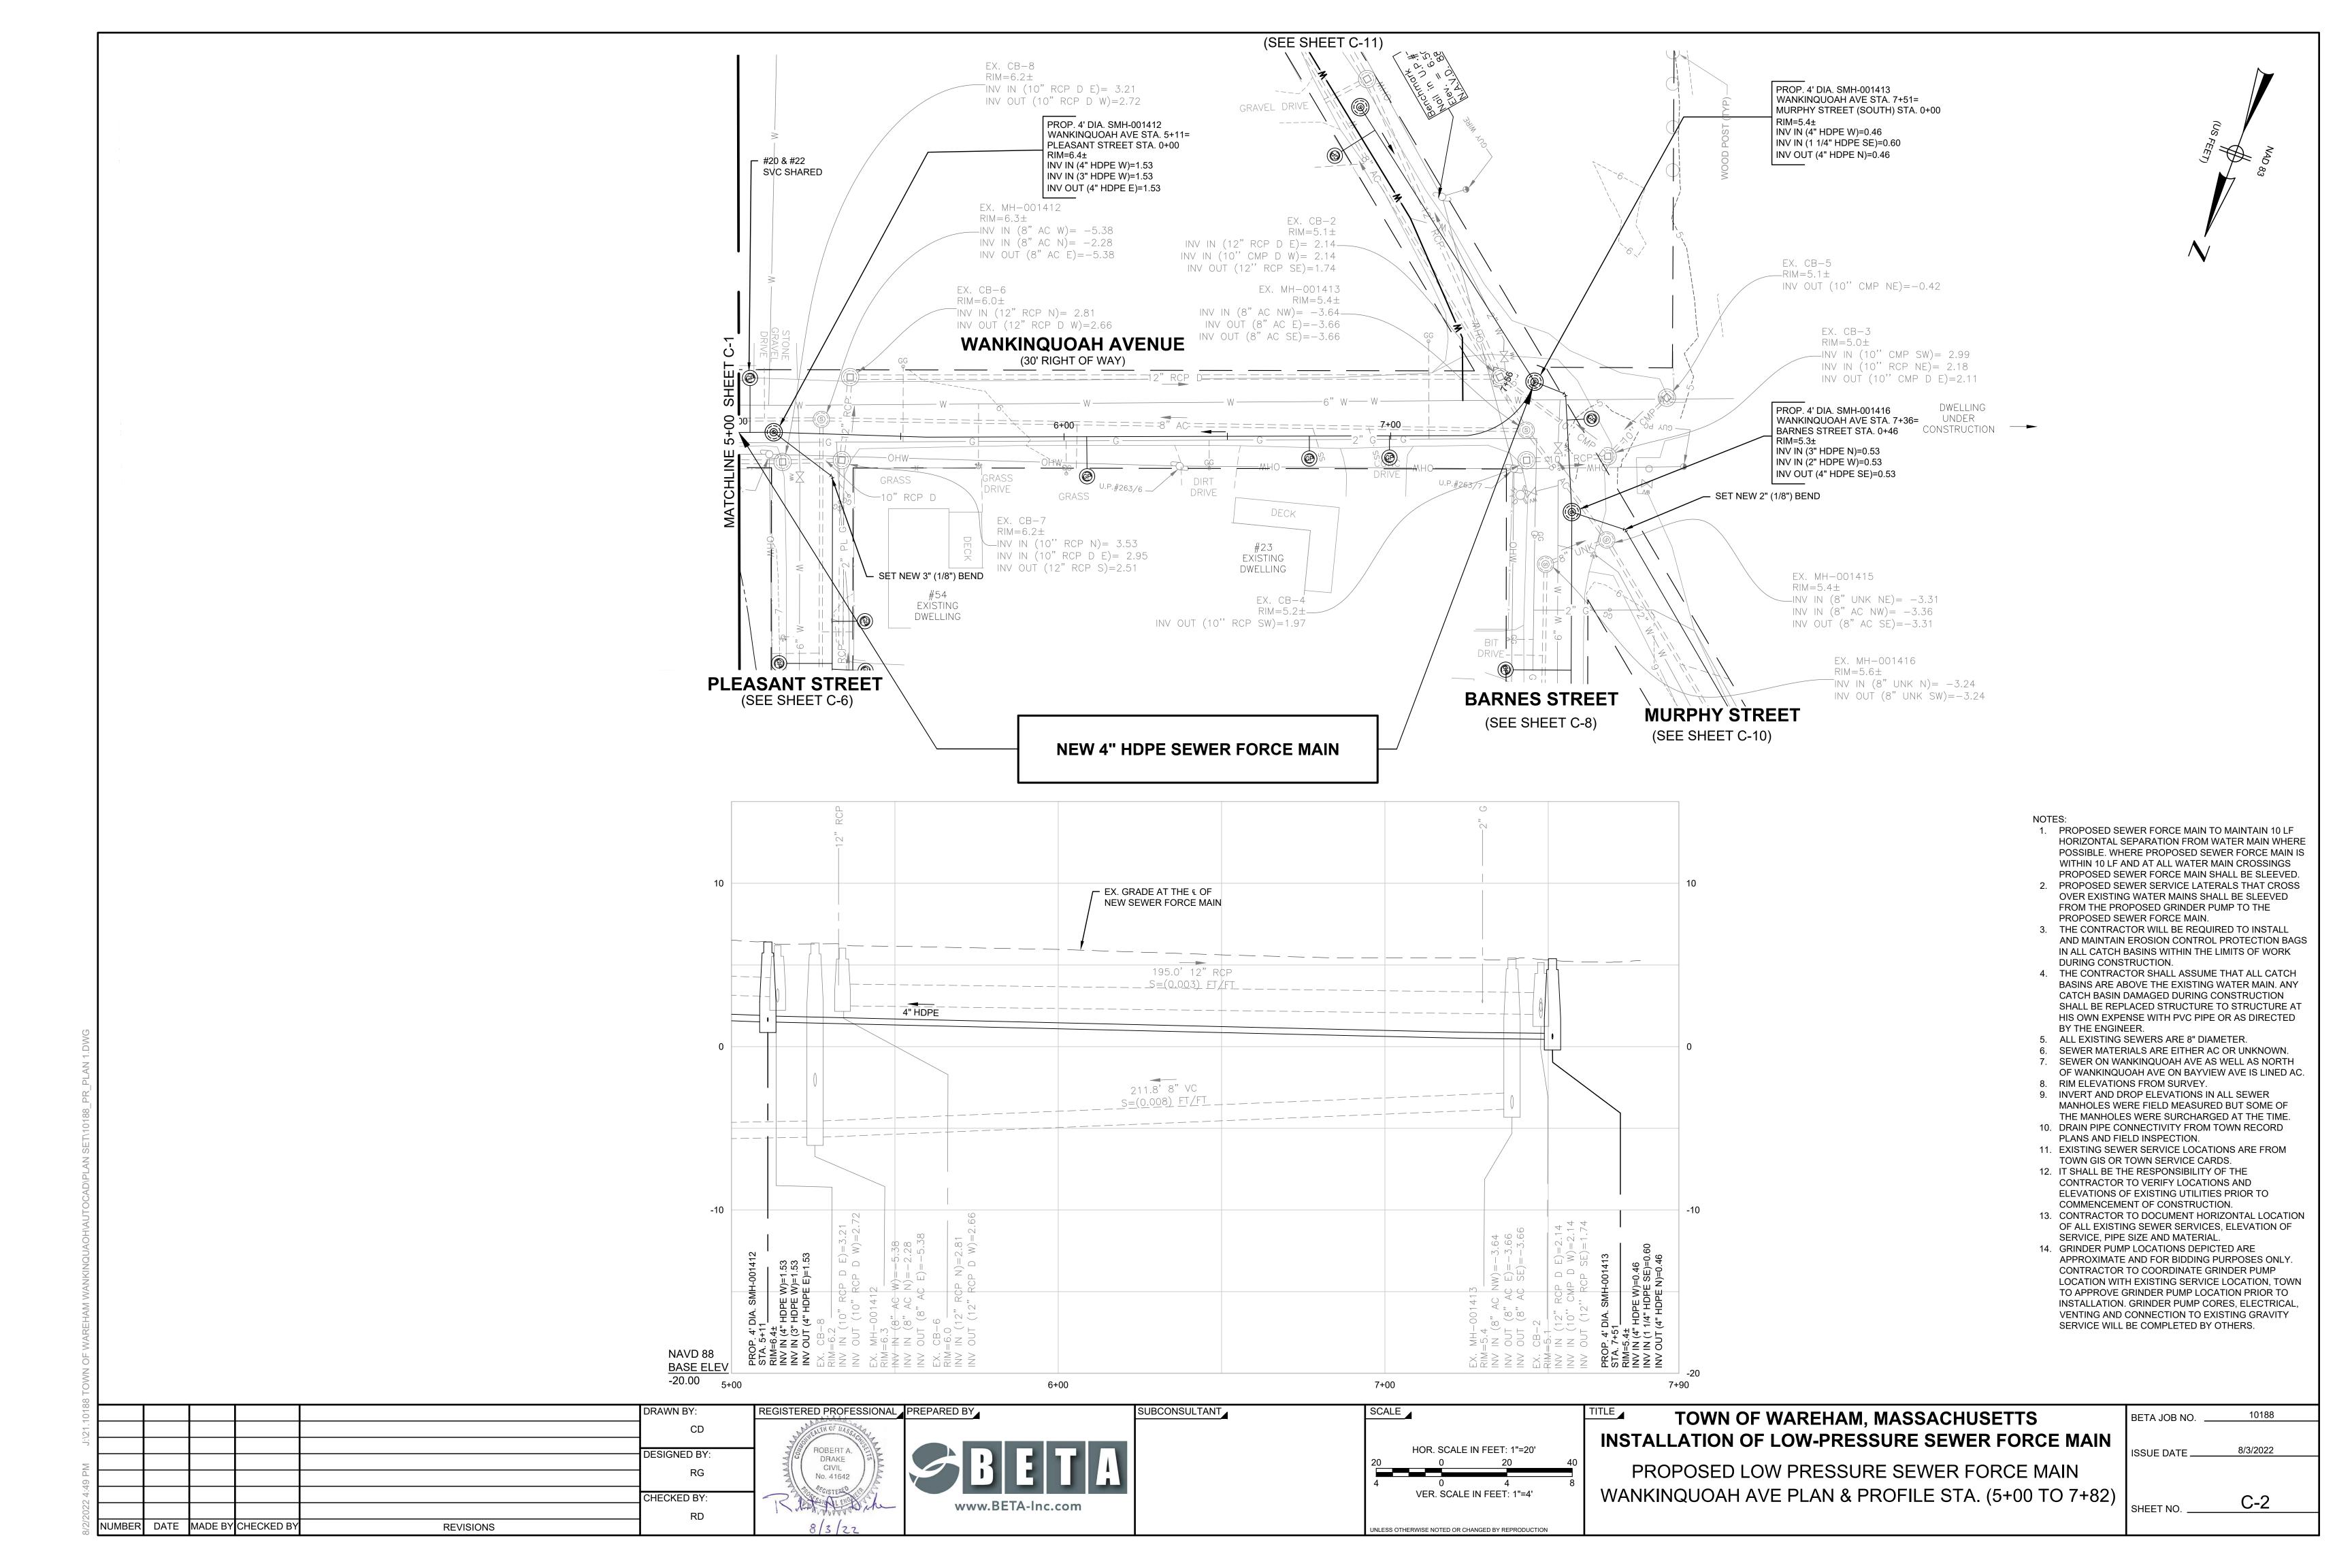

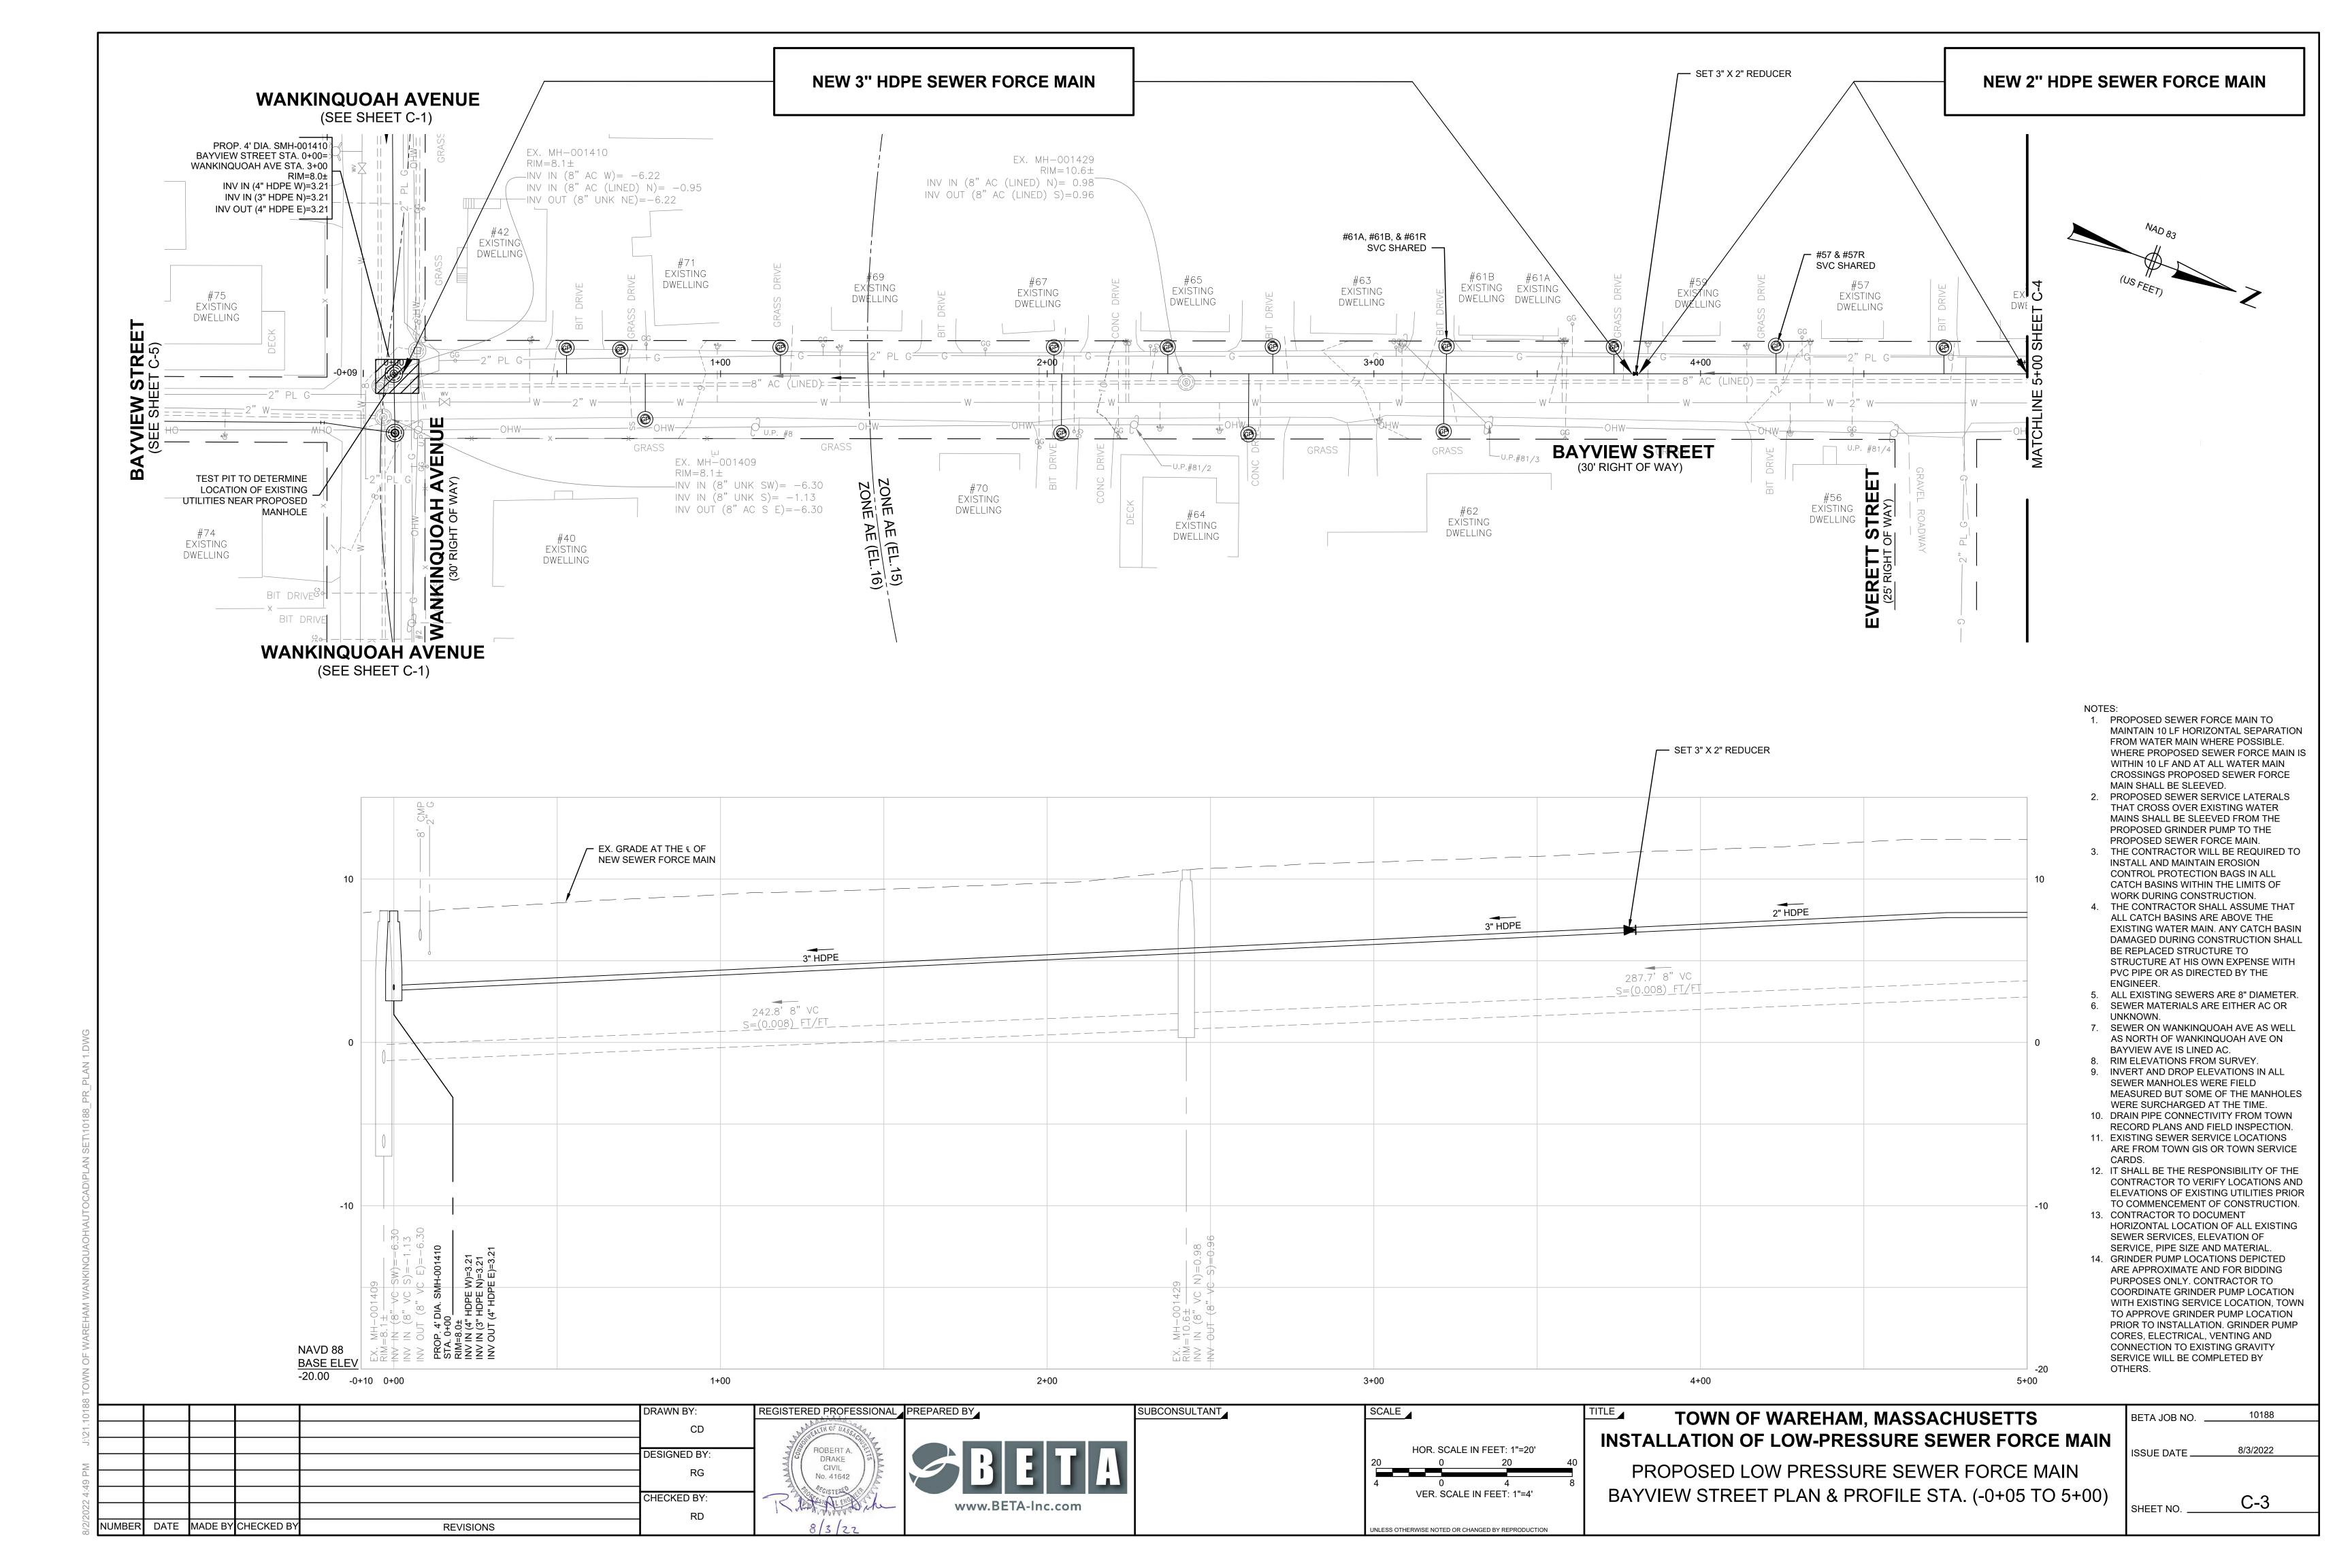

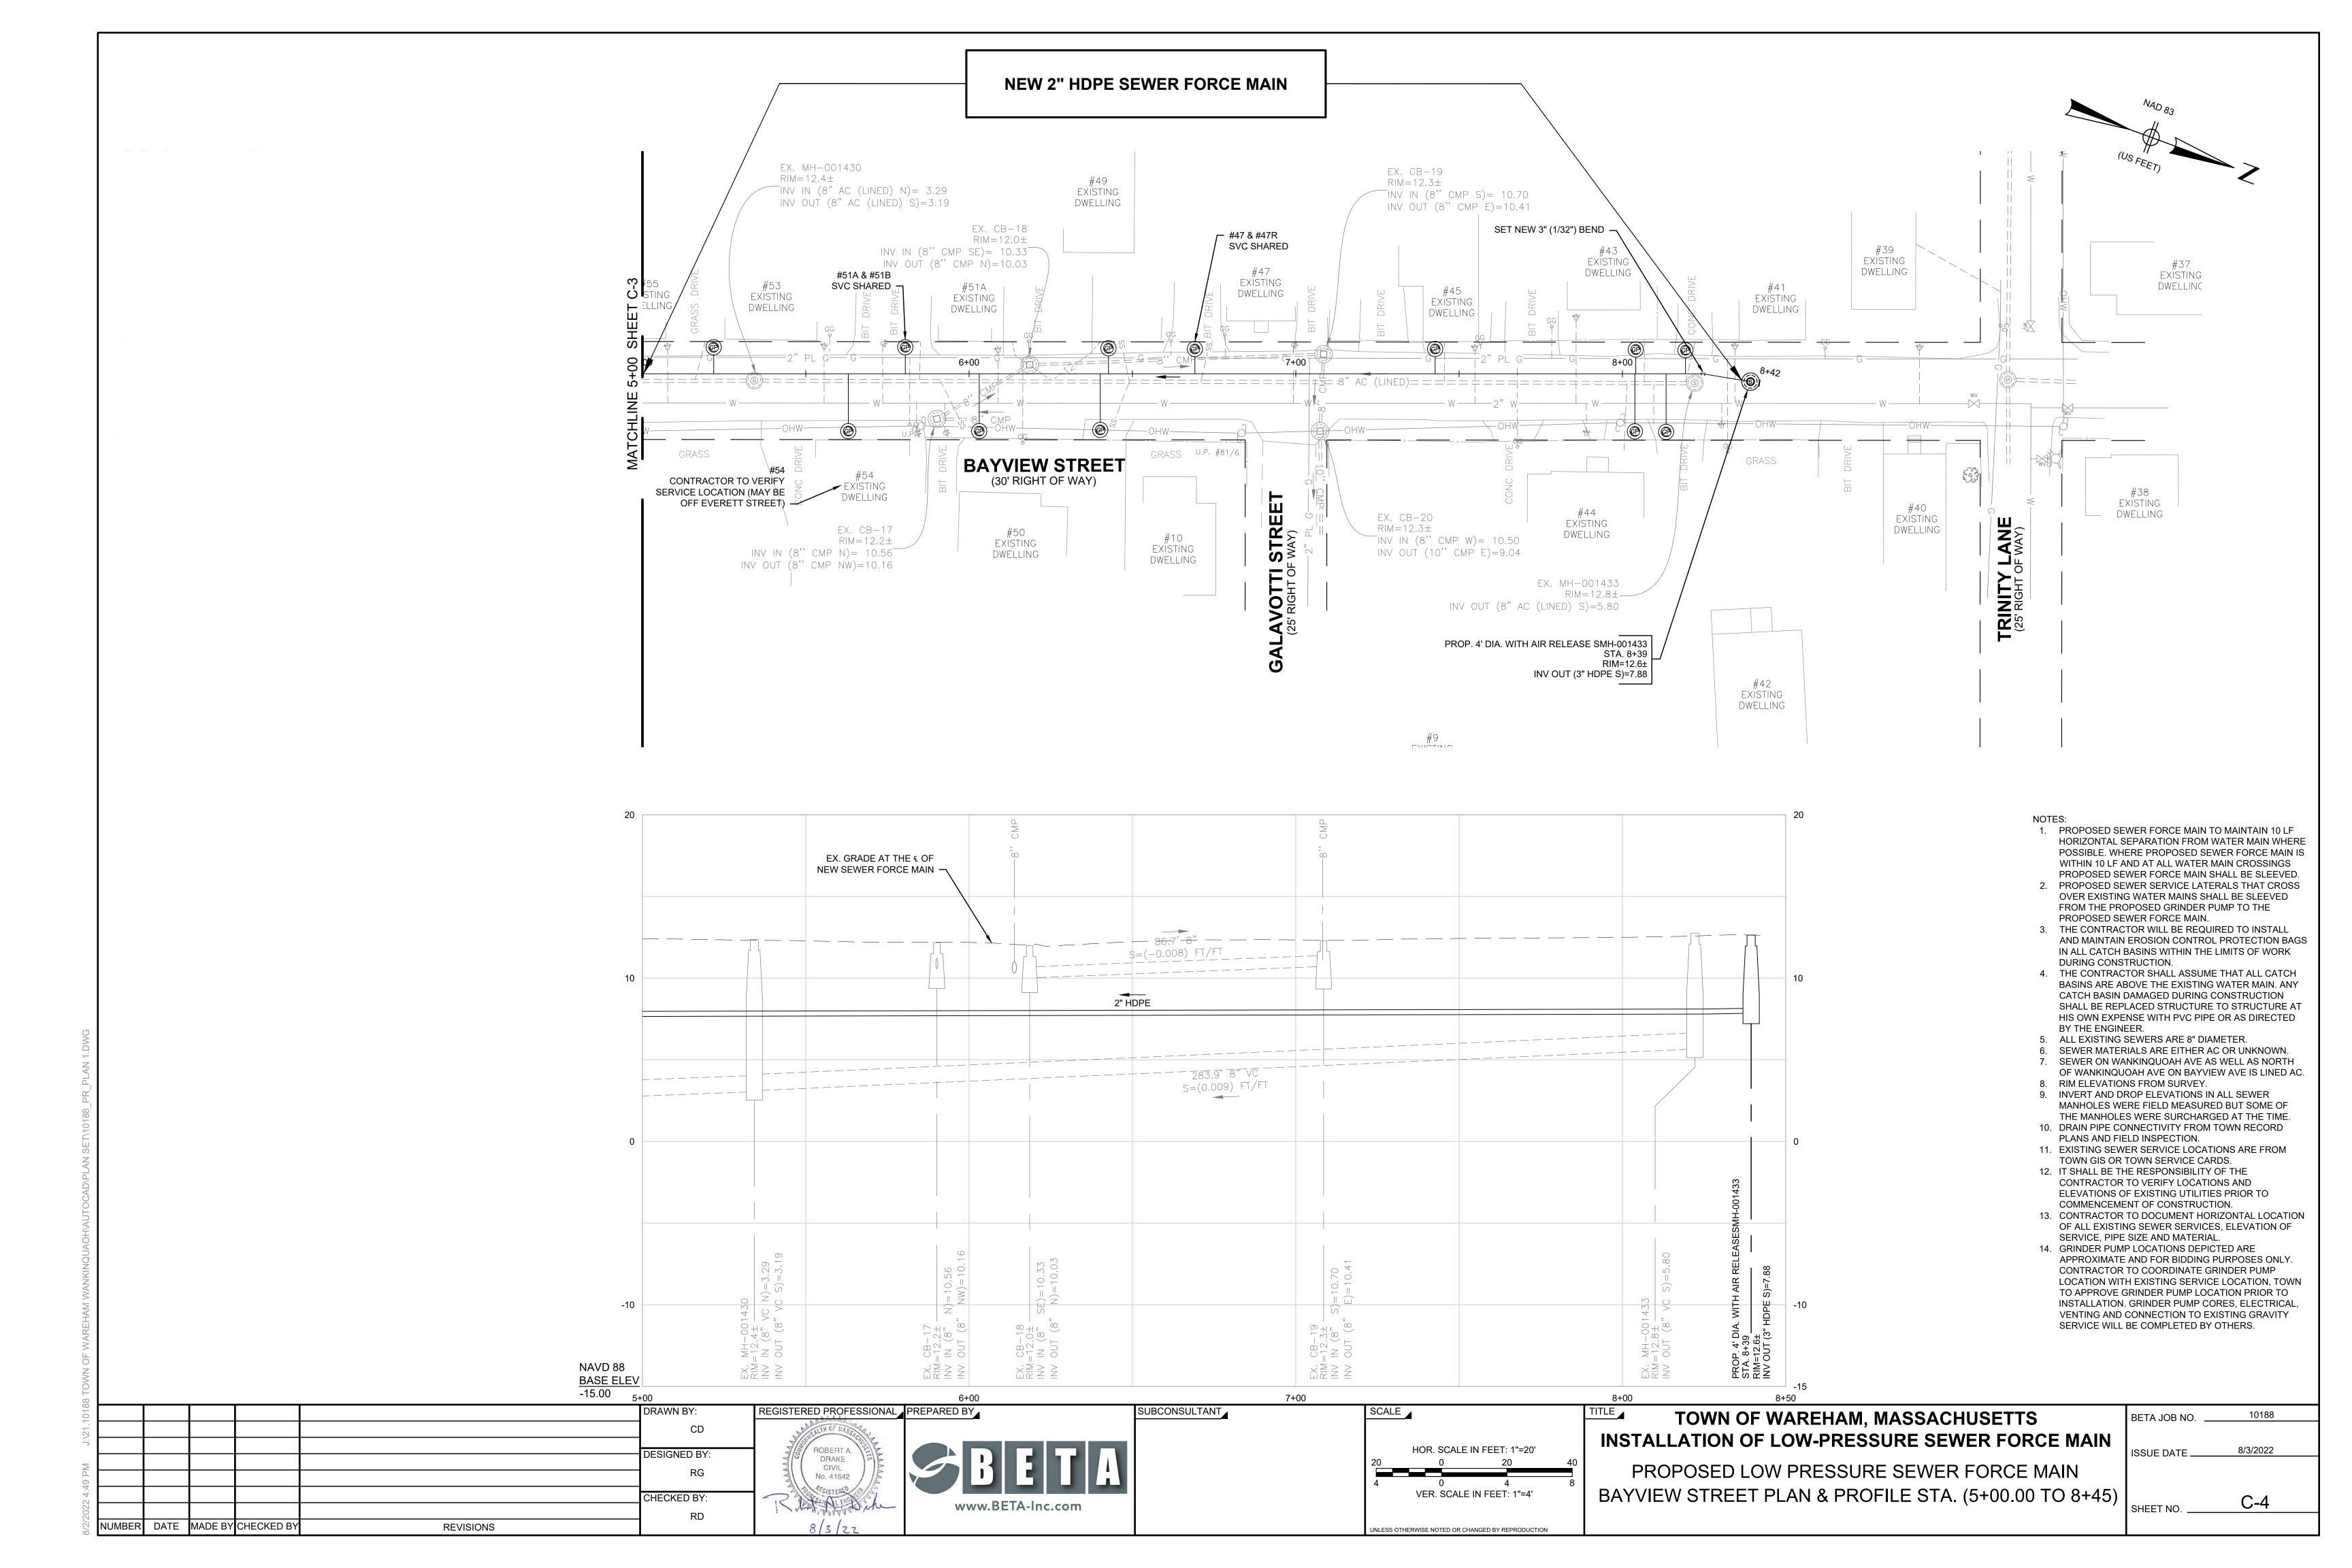

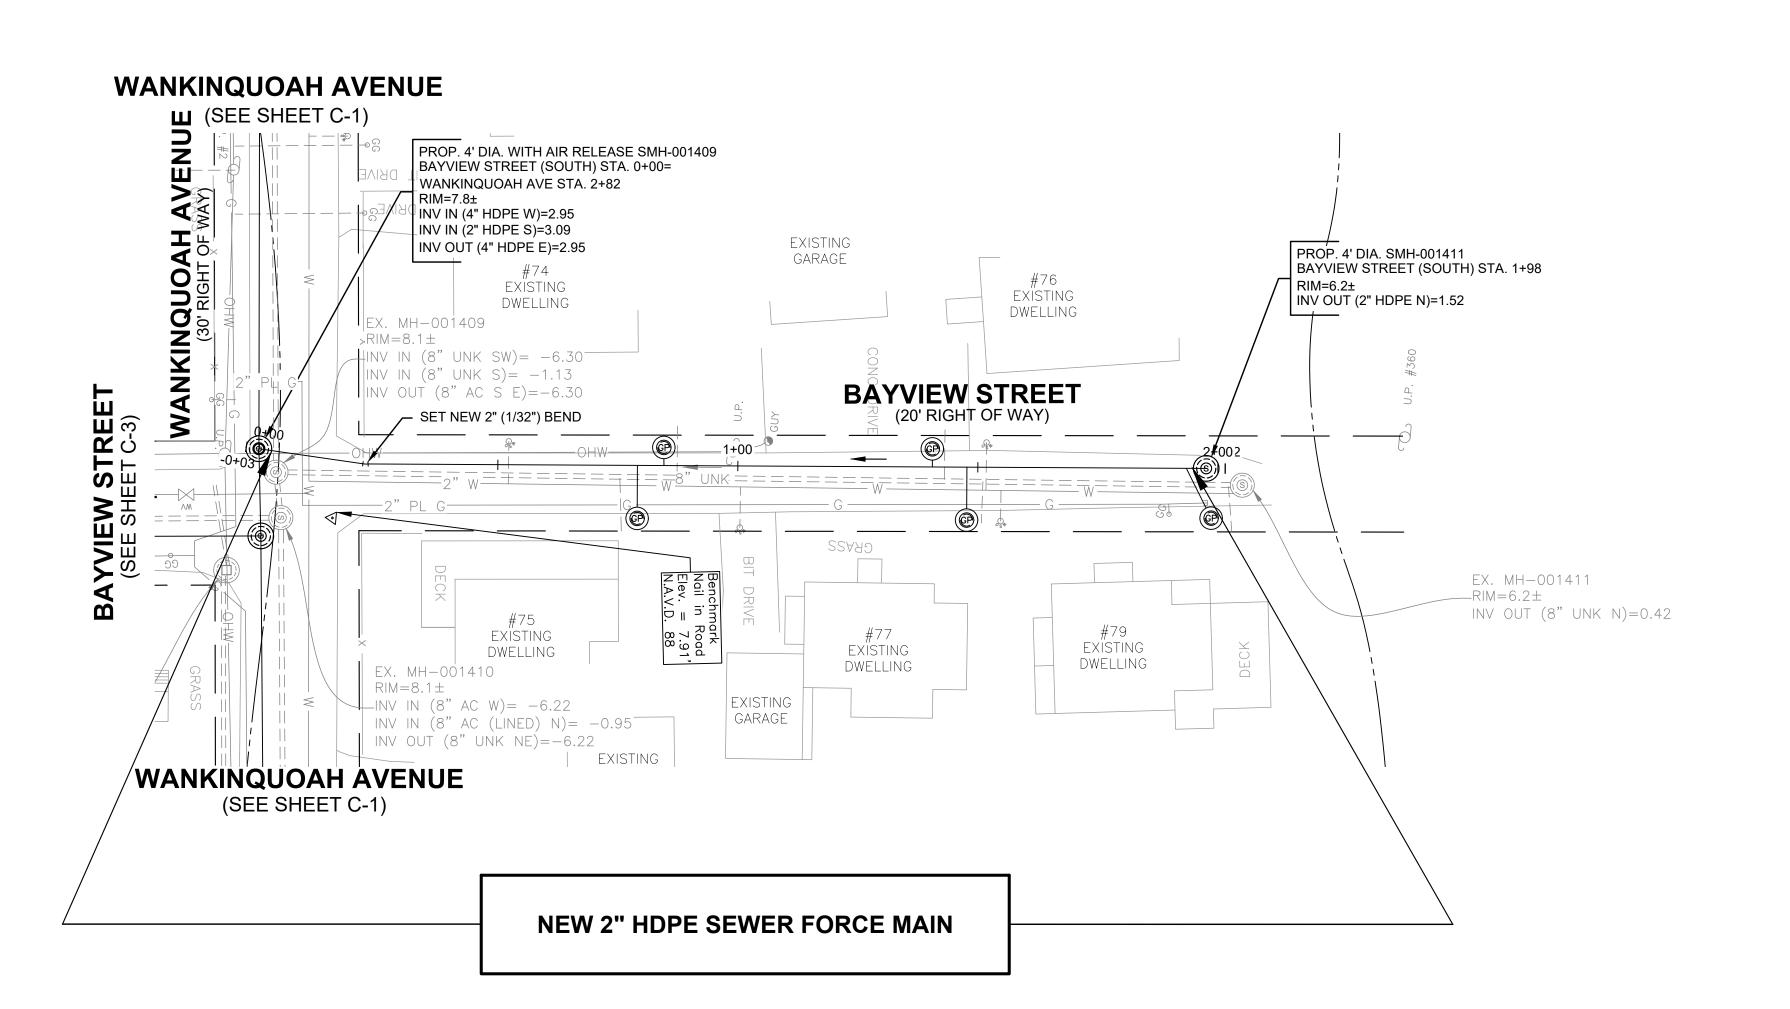

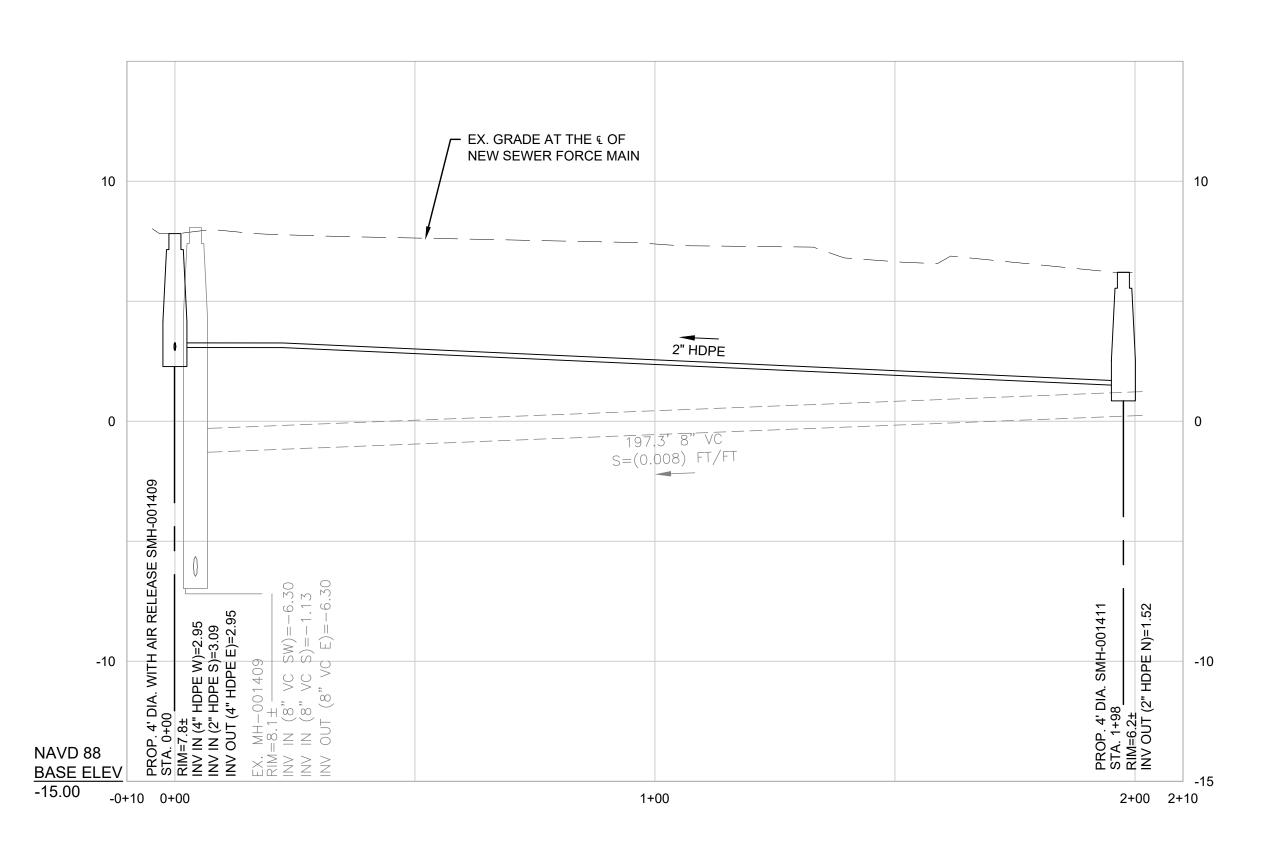

SUBCONSULTANT




- PROPOSED SEWER FORCE MAIN TO MAINTAIN 10 LF HORIZONTAL SEPARATION FROM WATER MAIN WHERE POSSIBLE. WHERE PROPOSED SEWER FORCE MAIN IS WITHIN 10 LF AND AT ALL WATER MAIN CROSSINGS PROPOSED SEWER FORCE MAIN SHALL BE SLEEVED.
- PROPOSED SEWER SERVICE LATERALS THAT CROSS OVER EXISTING WATER MAINS SHALL BE SLEEVED FROM THE PROPOSED GRINDER PUMP TO THE PROPOSED SEWER FORCE MAIN.
- 3. THE CONTRACTOR WILL BE REQUIRED TO INSTALL AND MAINTAIN EROSION CONTROL PROTECTION BAGS IN ALL CATCH BASINS WITHIN THE LIMITS OF WORK DURING CONSTRUCTION.
- 4. THE CONTRACTOR SHALL ASSUME THAT ALL CATCH BASINS ARE ABOVE THE EXISTING WATER MAIN. ANY CATCH BASIN DAMAGED DURING CONSTRUCTION SHALL BE REPLACED STRUCTURE TO STRUCTURE AT HIS OWN EXPENSE WITH PVC PIPE OR AS DIRECTED BY THE ENGINEER.
- ALL EXISTING SEWERS ARE 8" DIAMETER.
 SEWER MATERIALS ARE EITHER AC OR UNKNOWN.
 SEWER ON WANKINQUOAH AVE AS WELL AS NORTH
- 7. SEWER ON WANKINQUOAH AVE AS WELL AS NORTH
 OF WANKINQUOAH AVE ON BAYVIEW AVE IS LINED AC.
 8. RIM ELEVATIONS FROM SURVEY.
 9. INVERT AND DROP ELEVATIONS IN ALL SEWER
- MANHOLES WERE FIELD MEASURED BUT SOME OF THE MANHOLES WERE SURCHARGED AT THE TIME.

 10. DRAIN PIPE CONNECTIVITY FROM TOWN RECORD
- 10. DRAIN PIPE CONNECTIVITY FROM TOWN RECORD PLANS AND FIELD INSPECTION.11. EXISTING SEWER SERVICE LOCATIONS ARE FROM
- TOWN GIS OR TOWN SERVICE CARDS.


 12. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY LOCATIONS AND
- ELEVATIONS OF EXISTING UTILITIES PRIOR TO COMMENCEMENT OF CONSTRUCTION.

 13. CONTRACTOR TO DOCUMENT HORIZONTAL LOCATION
- OF ALL EXISTING SEWER SERVICES, ELEVATION OF SERVICE, PIPE SIZE AND MATERIAL.
- 14. GRINDER PUMP LOCATIONS DEPICTED ARE APPROXIMATE AND FOR BIDDING PURPOSES ONLY. CONTRACTOR TO COORDINATE GRINDER PUMP LOCATION WITH EXISTING SERVICE LOCATION, TOWN TO APPROVE GRINDER PUMP LOCATION PRIOR TO INSTALLATION. GRINDER PUMP CORES, ELECTRICAL, VENTING AND CONNECTION TO EXISTING GRAVITY SERVICE WILL BE COMPLETED BY OTHERS.

10188						DRAWN BY:	REC
21.1						CD	
<u>.</u>						DESIGNED BY:	
M	-					RG	
4:50						OLIFOKED DV	
2022						CHECKED BY:	
3/2/2	NUMBER	DATE	MADE BY	CHECKED BY	REVISIONS	RD	

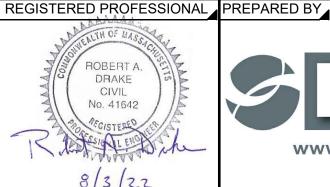




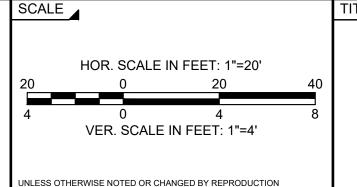



TOWN OF WAREHAM, MASSACHUSETTS INSTALLATION OF LOW-PRESSURE SEWER FORCE MAIN


PROPOSED LOW PRESSURE SEWER FORCE MAIN BAYVIEW STREET (SOUTH) PLAN & PROFILE STA. (-0+05 TO 1+87)


BETA JOB NO.	10188
ISSUE DATE	8/3/2022
SHEET NO	C-5
SHEET NO	

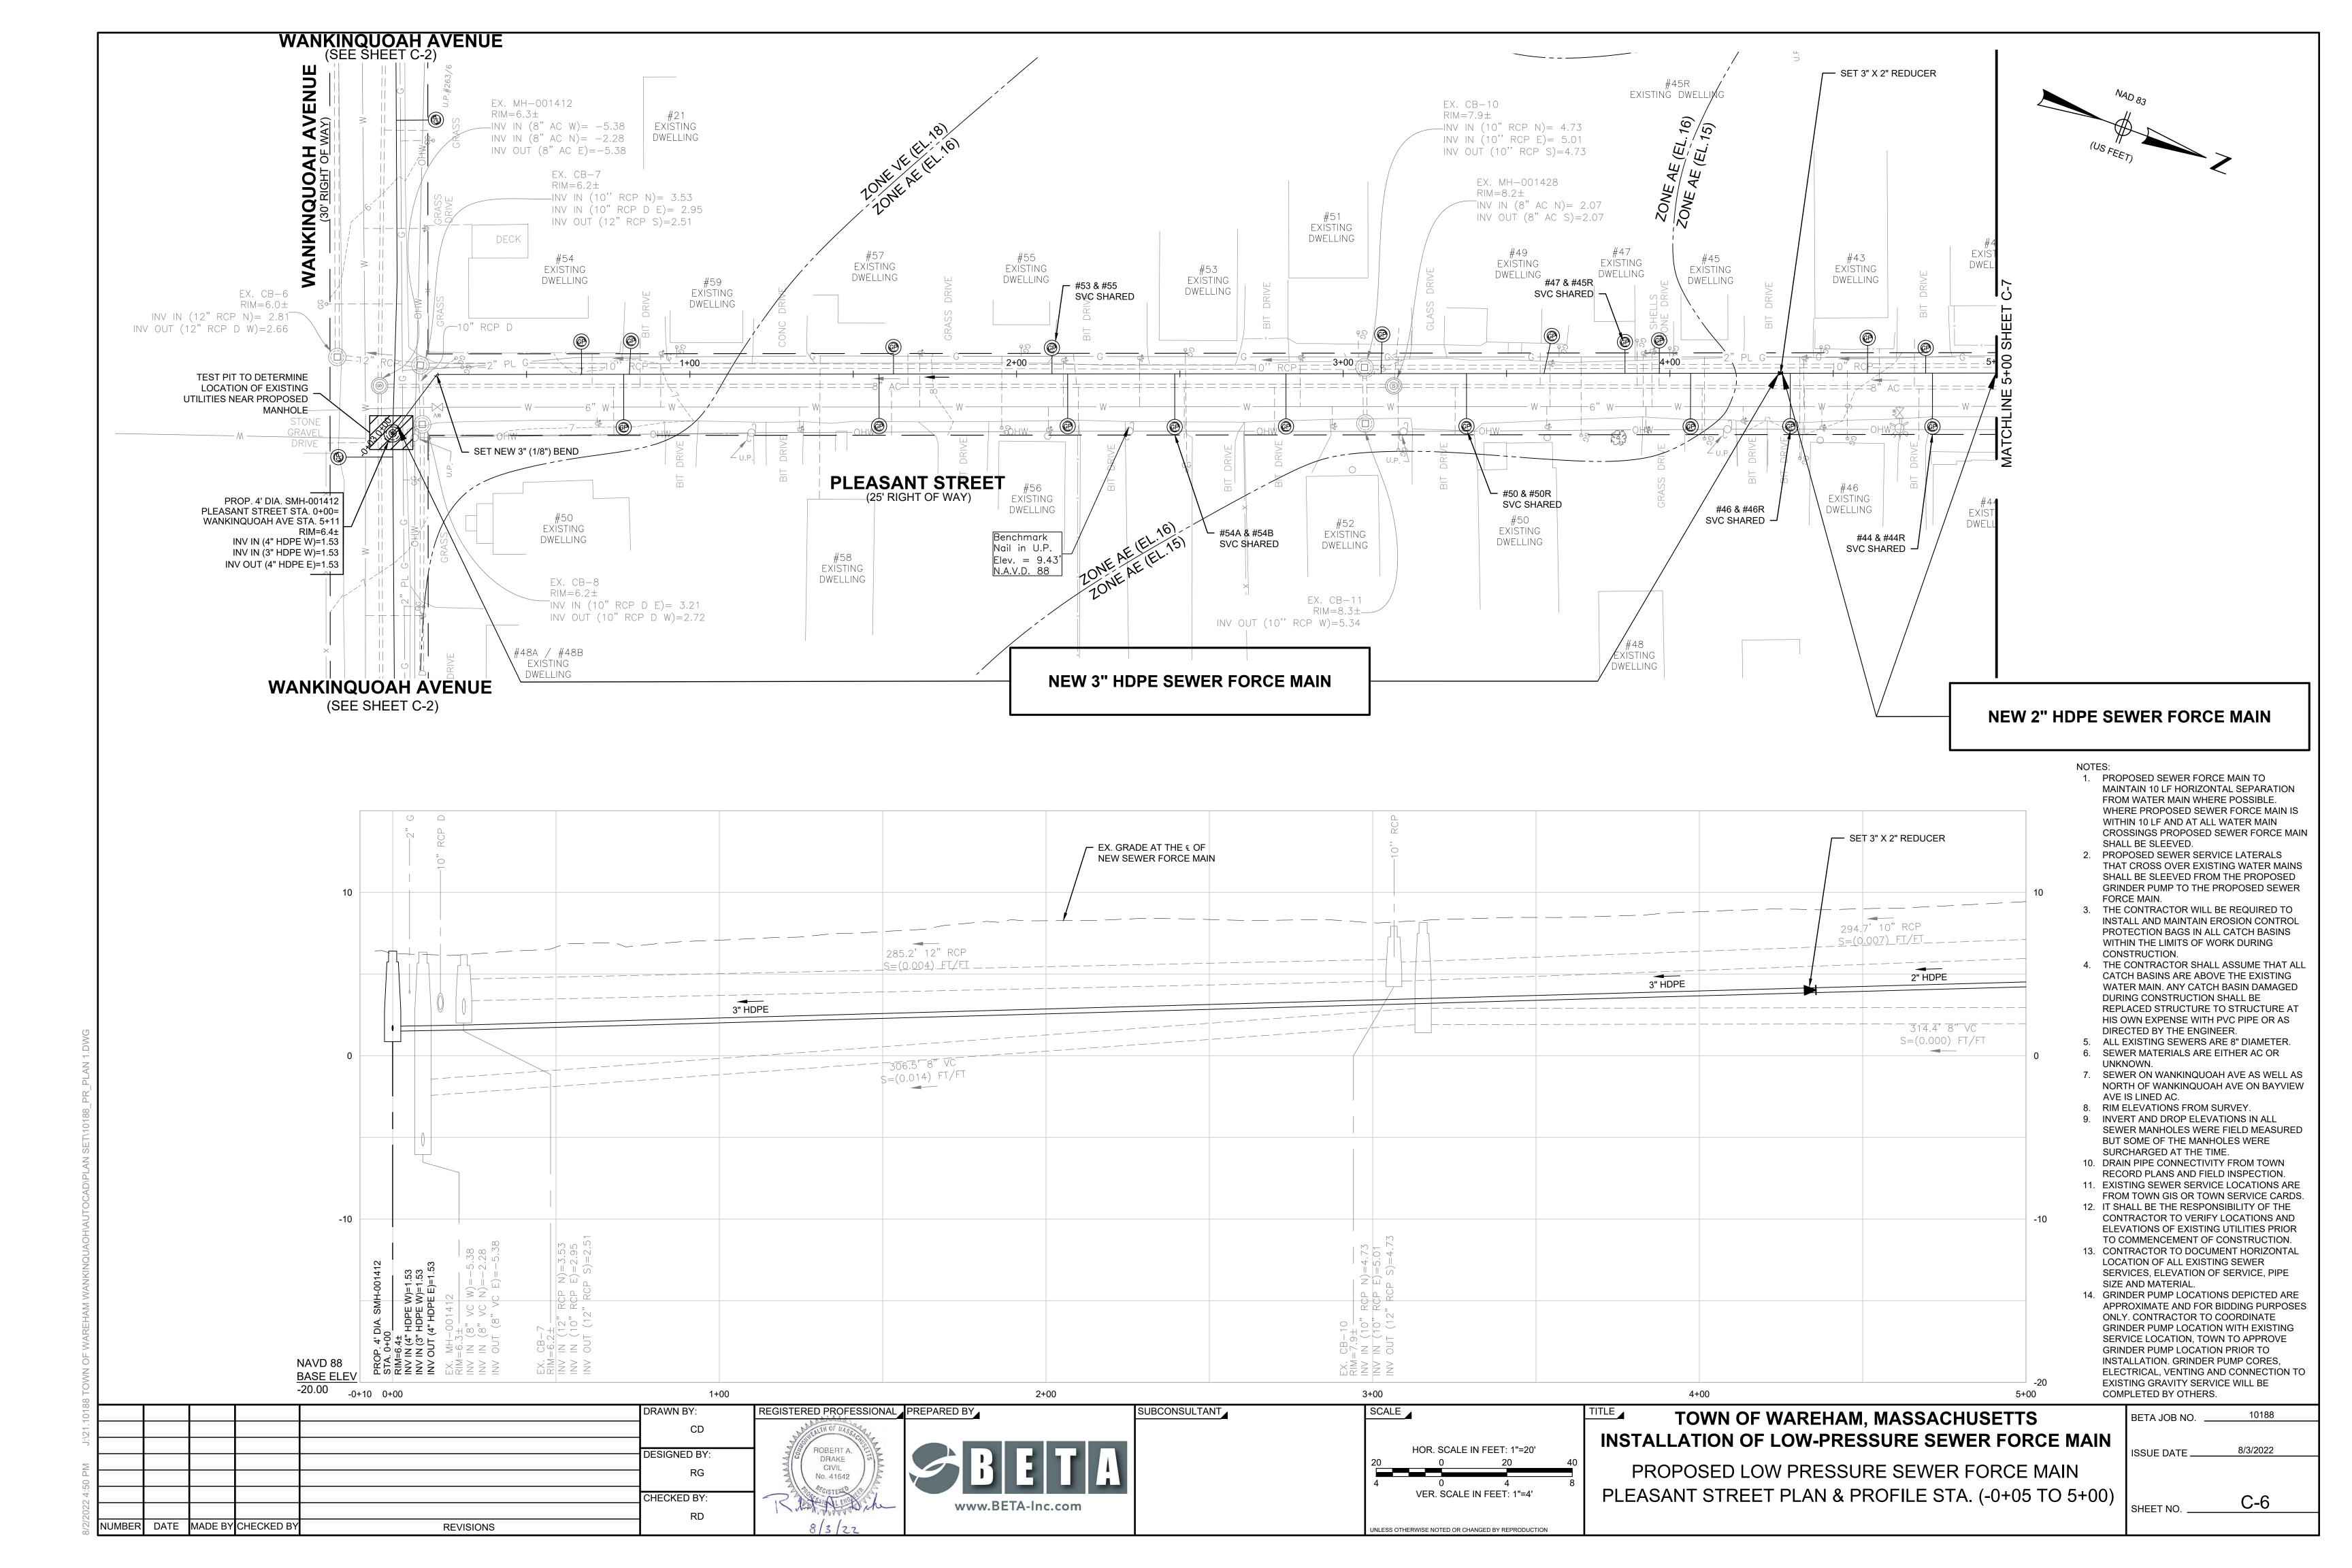


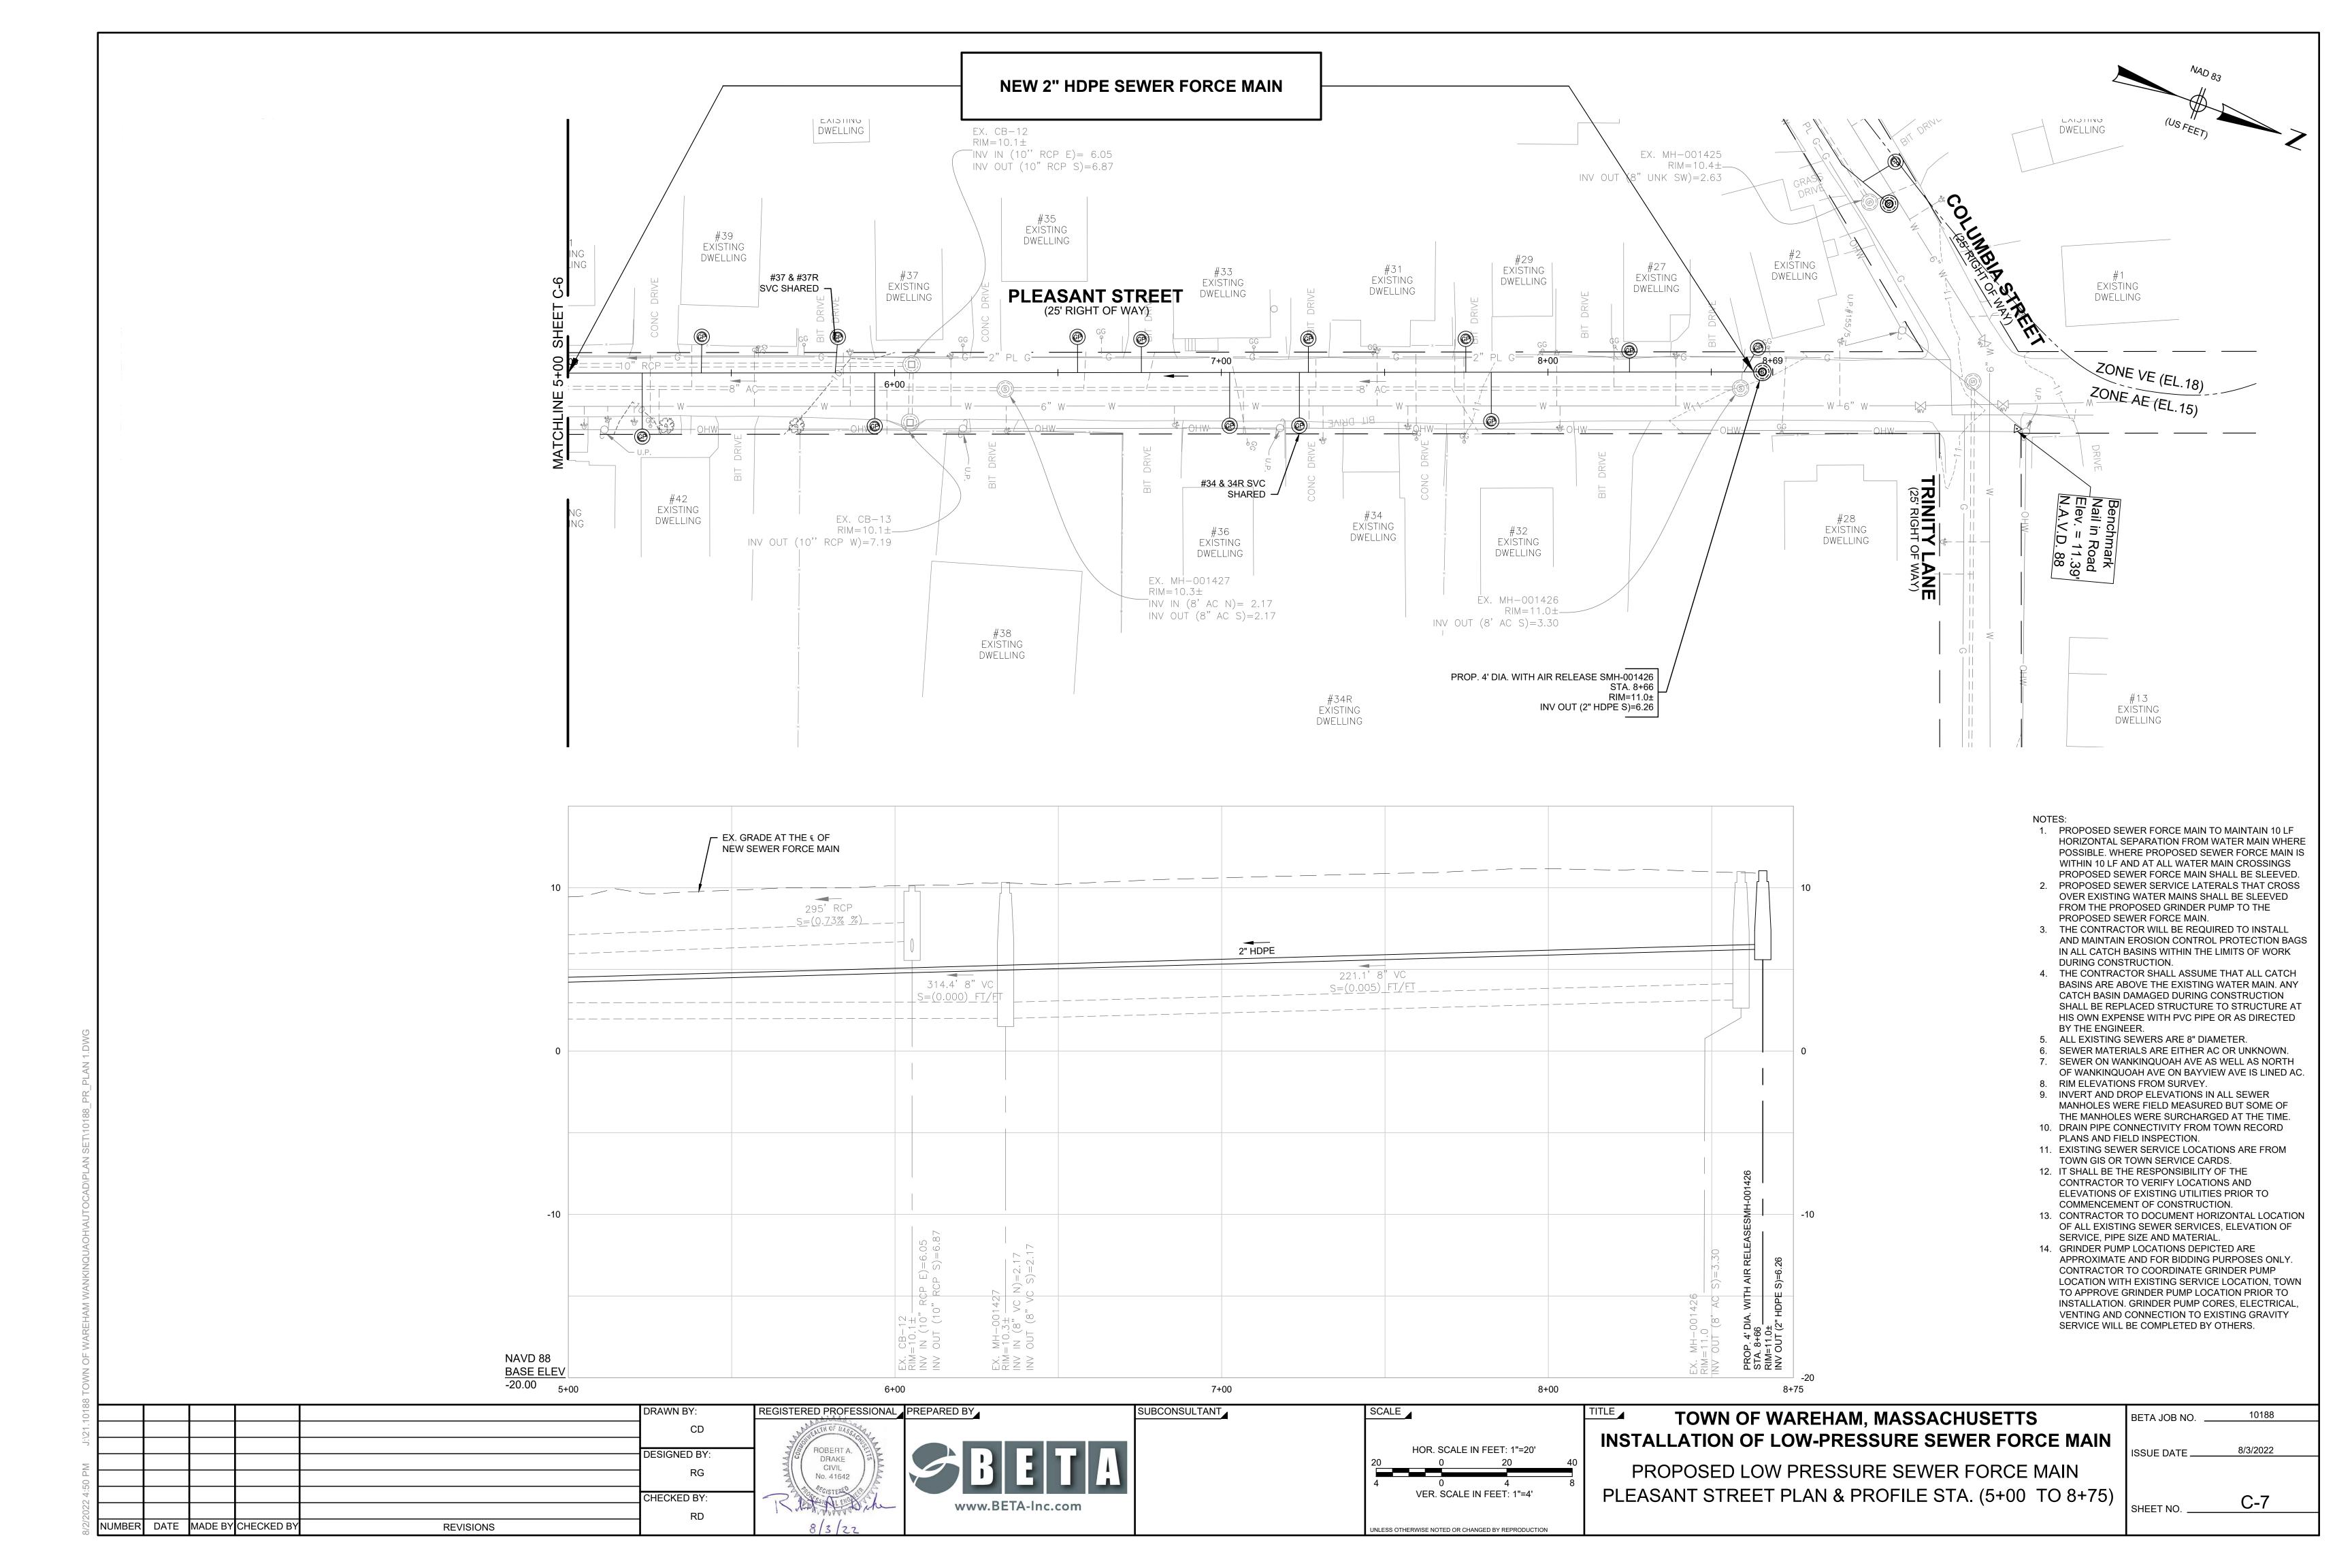


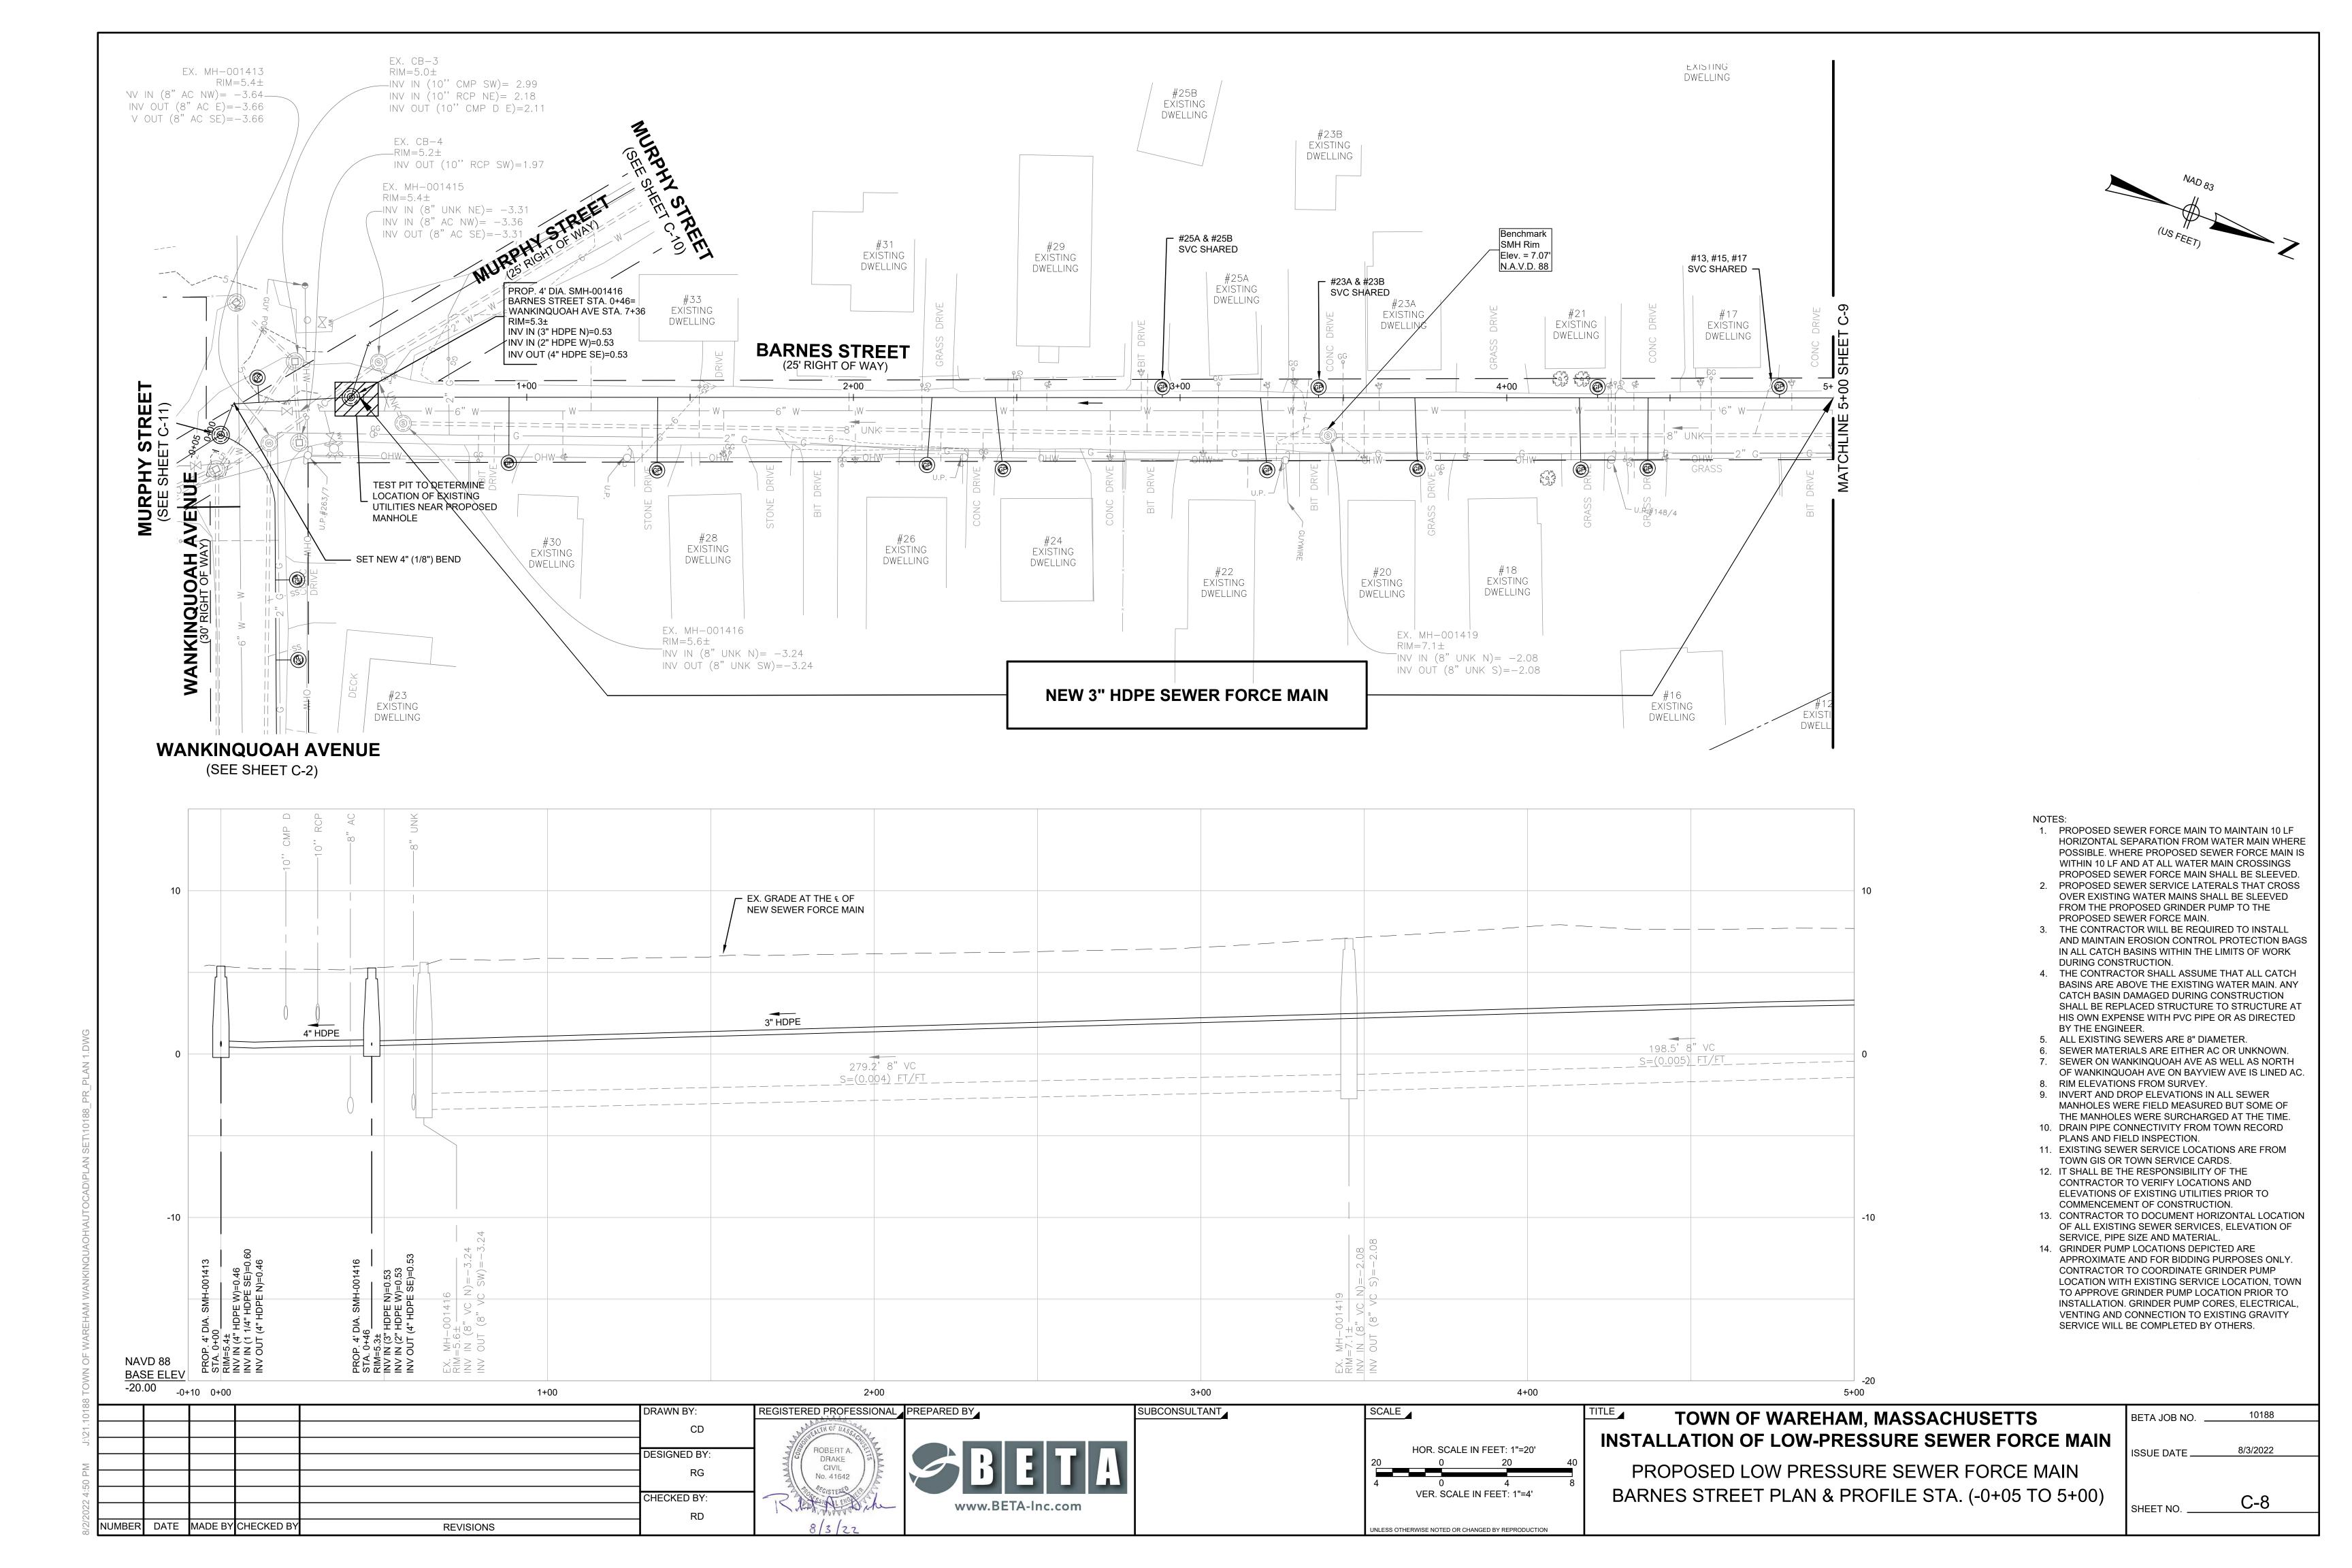


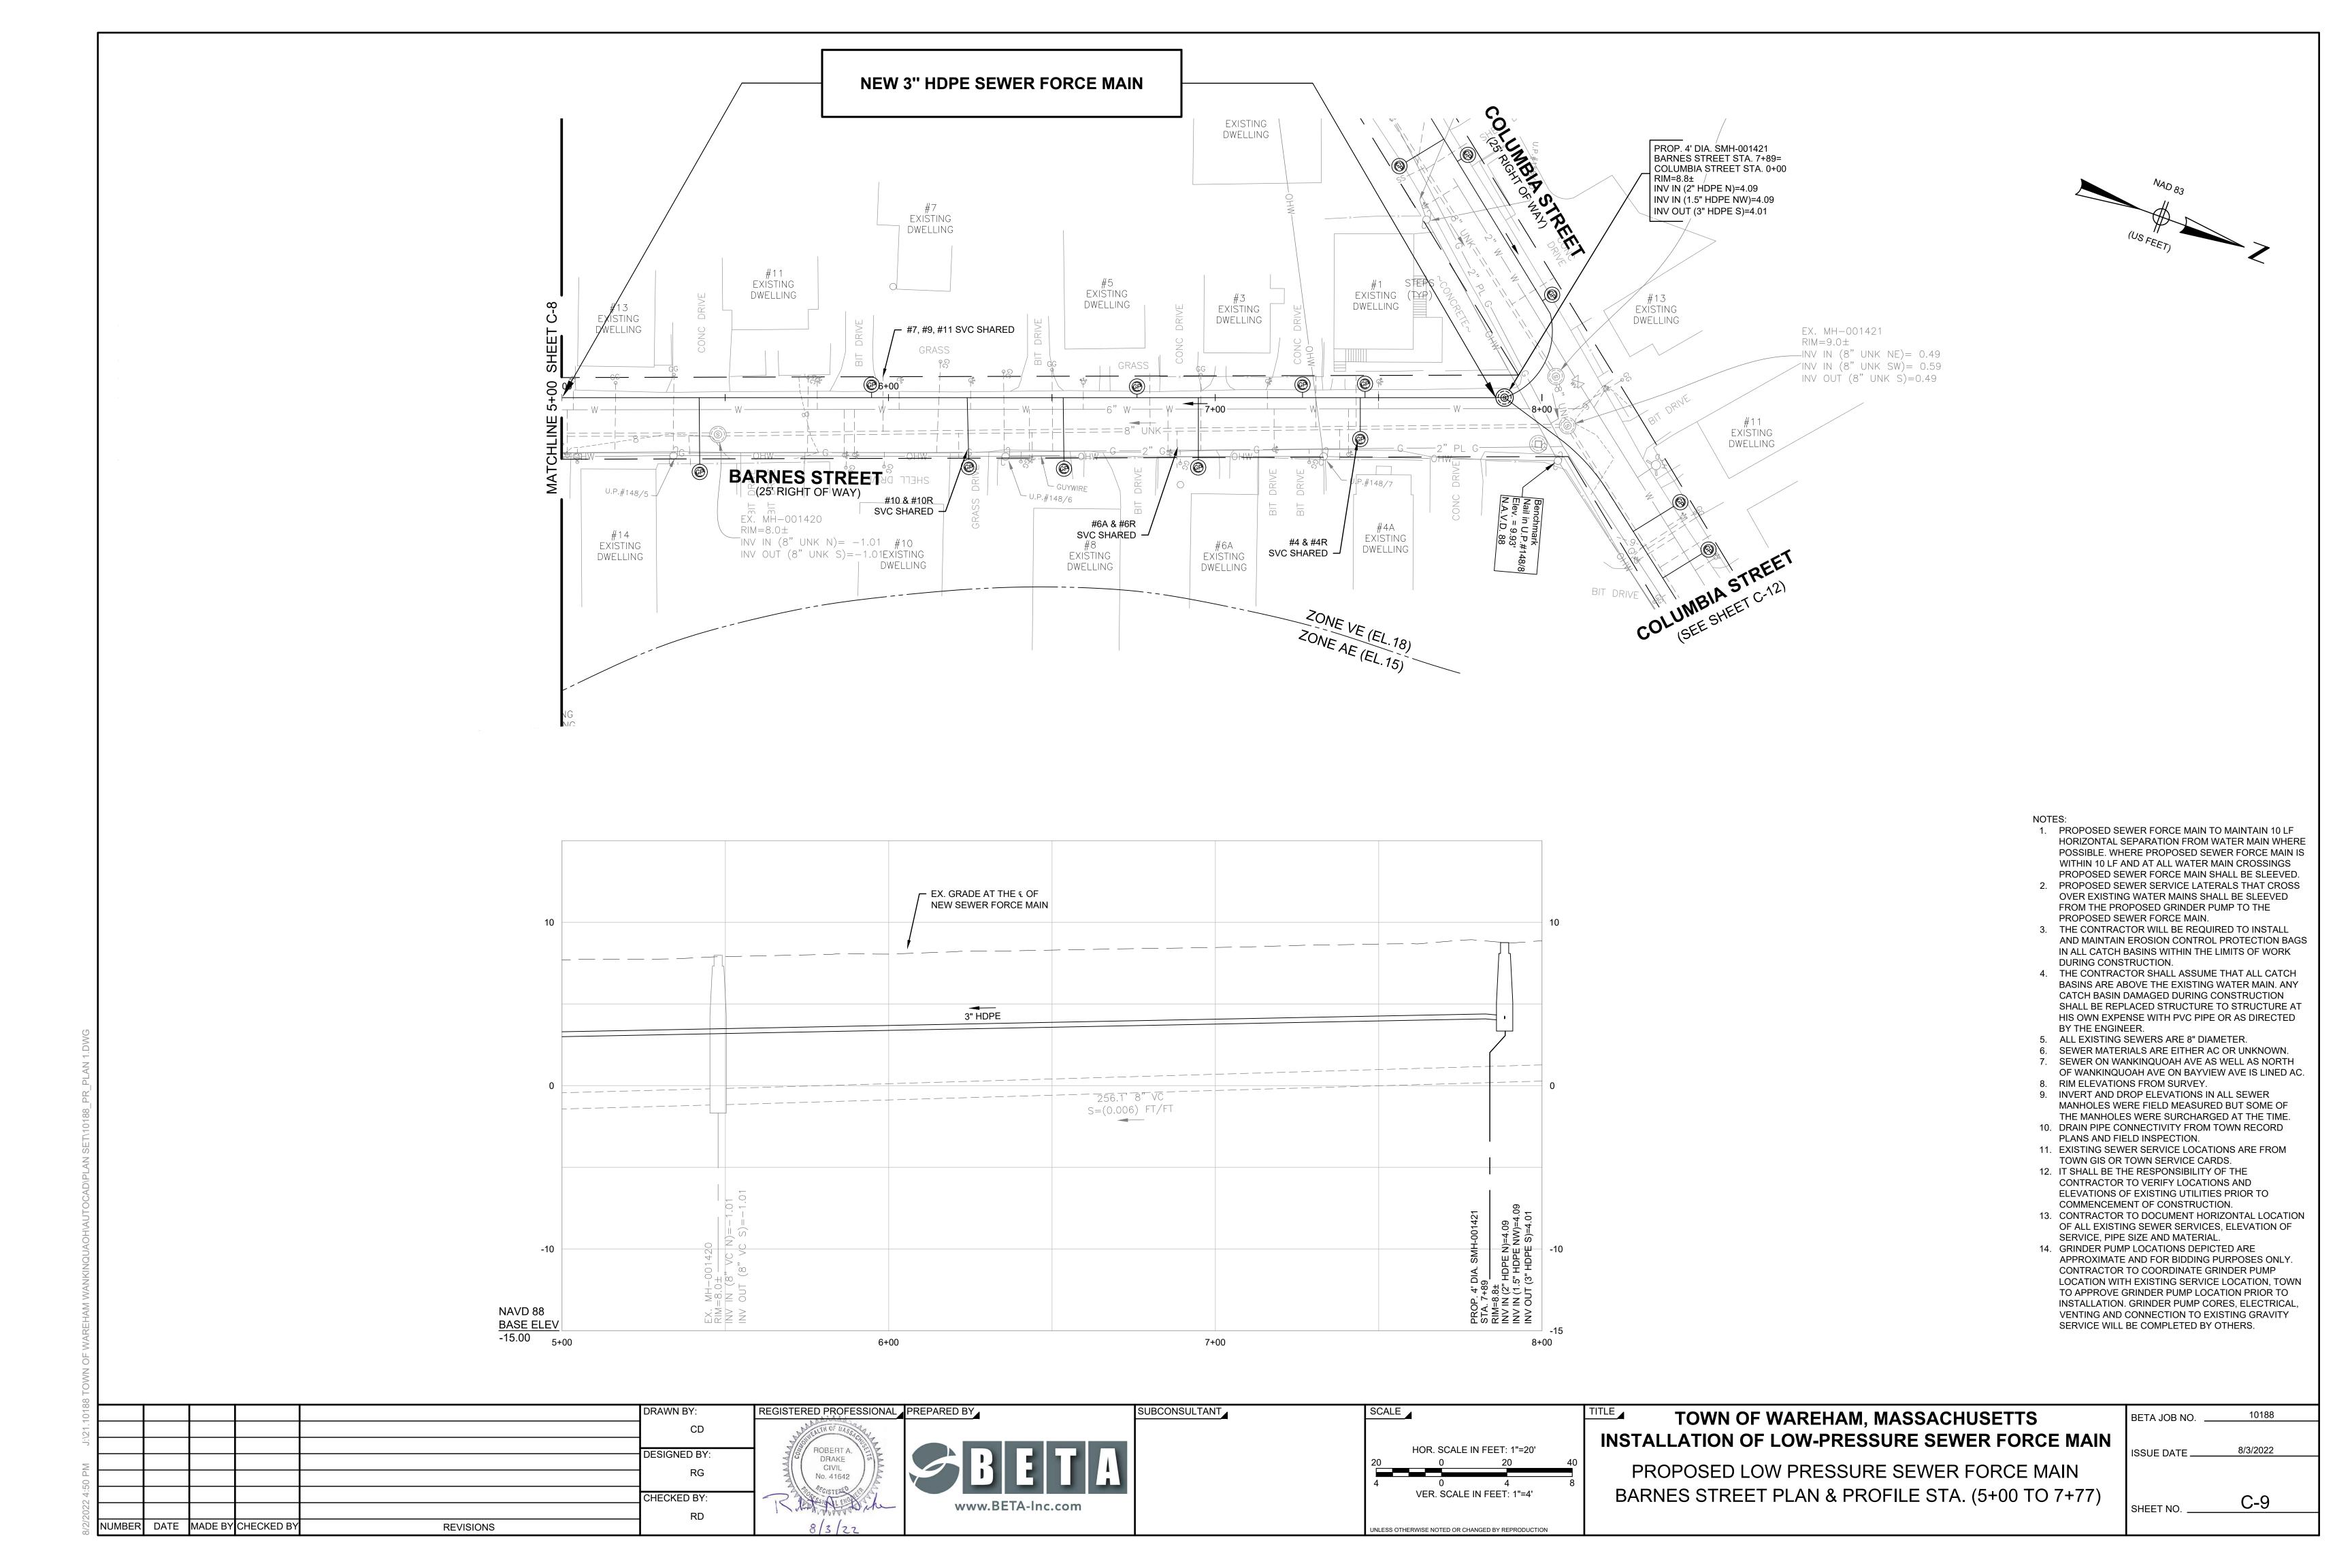

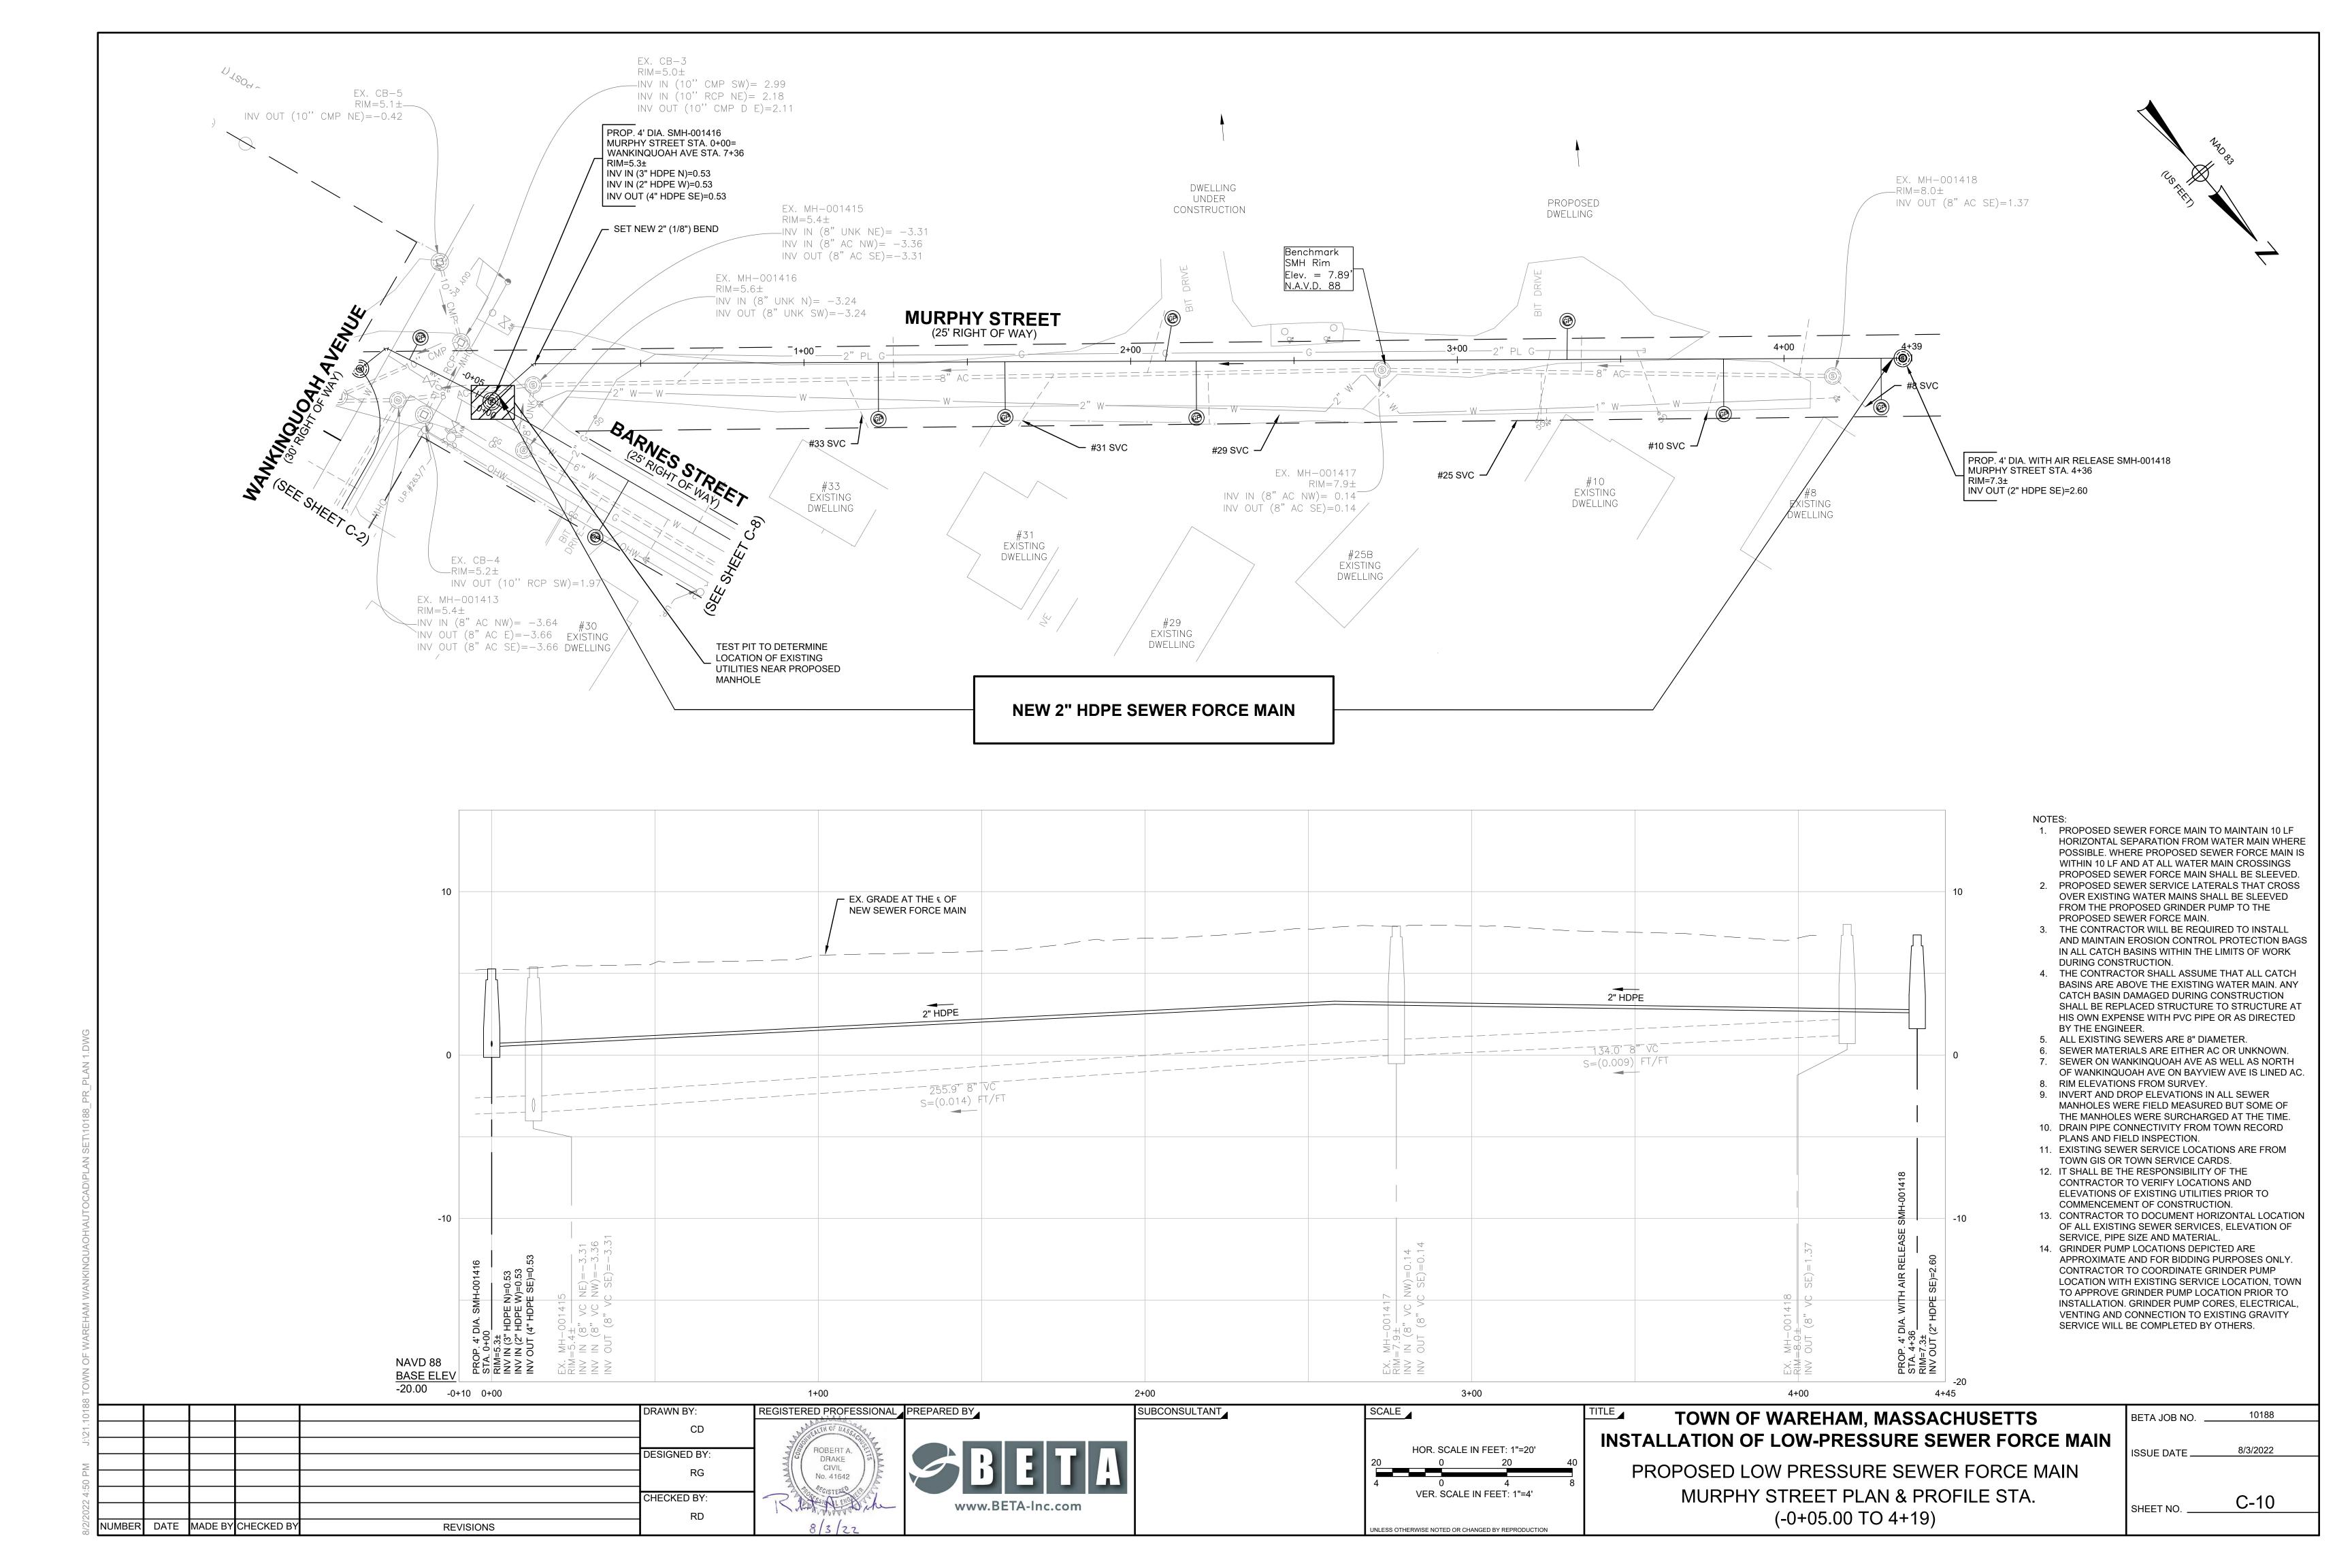

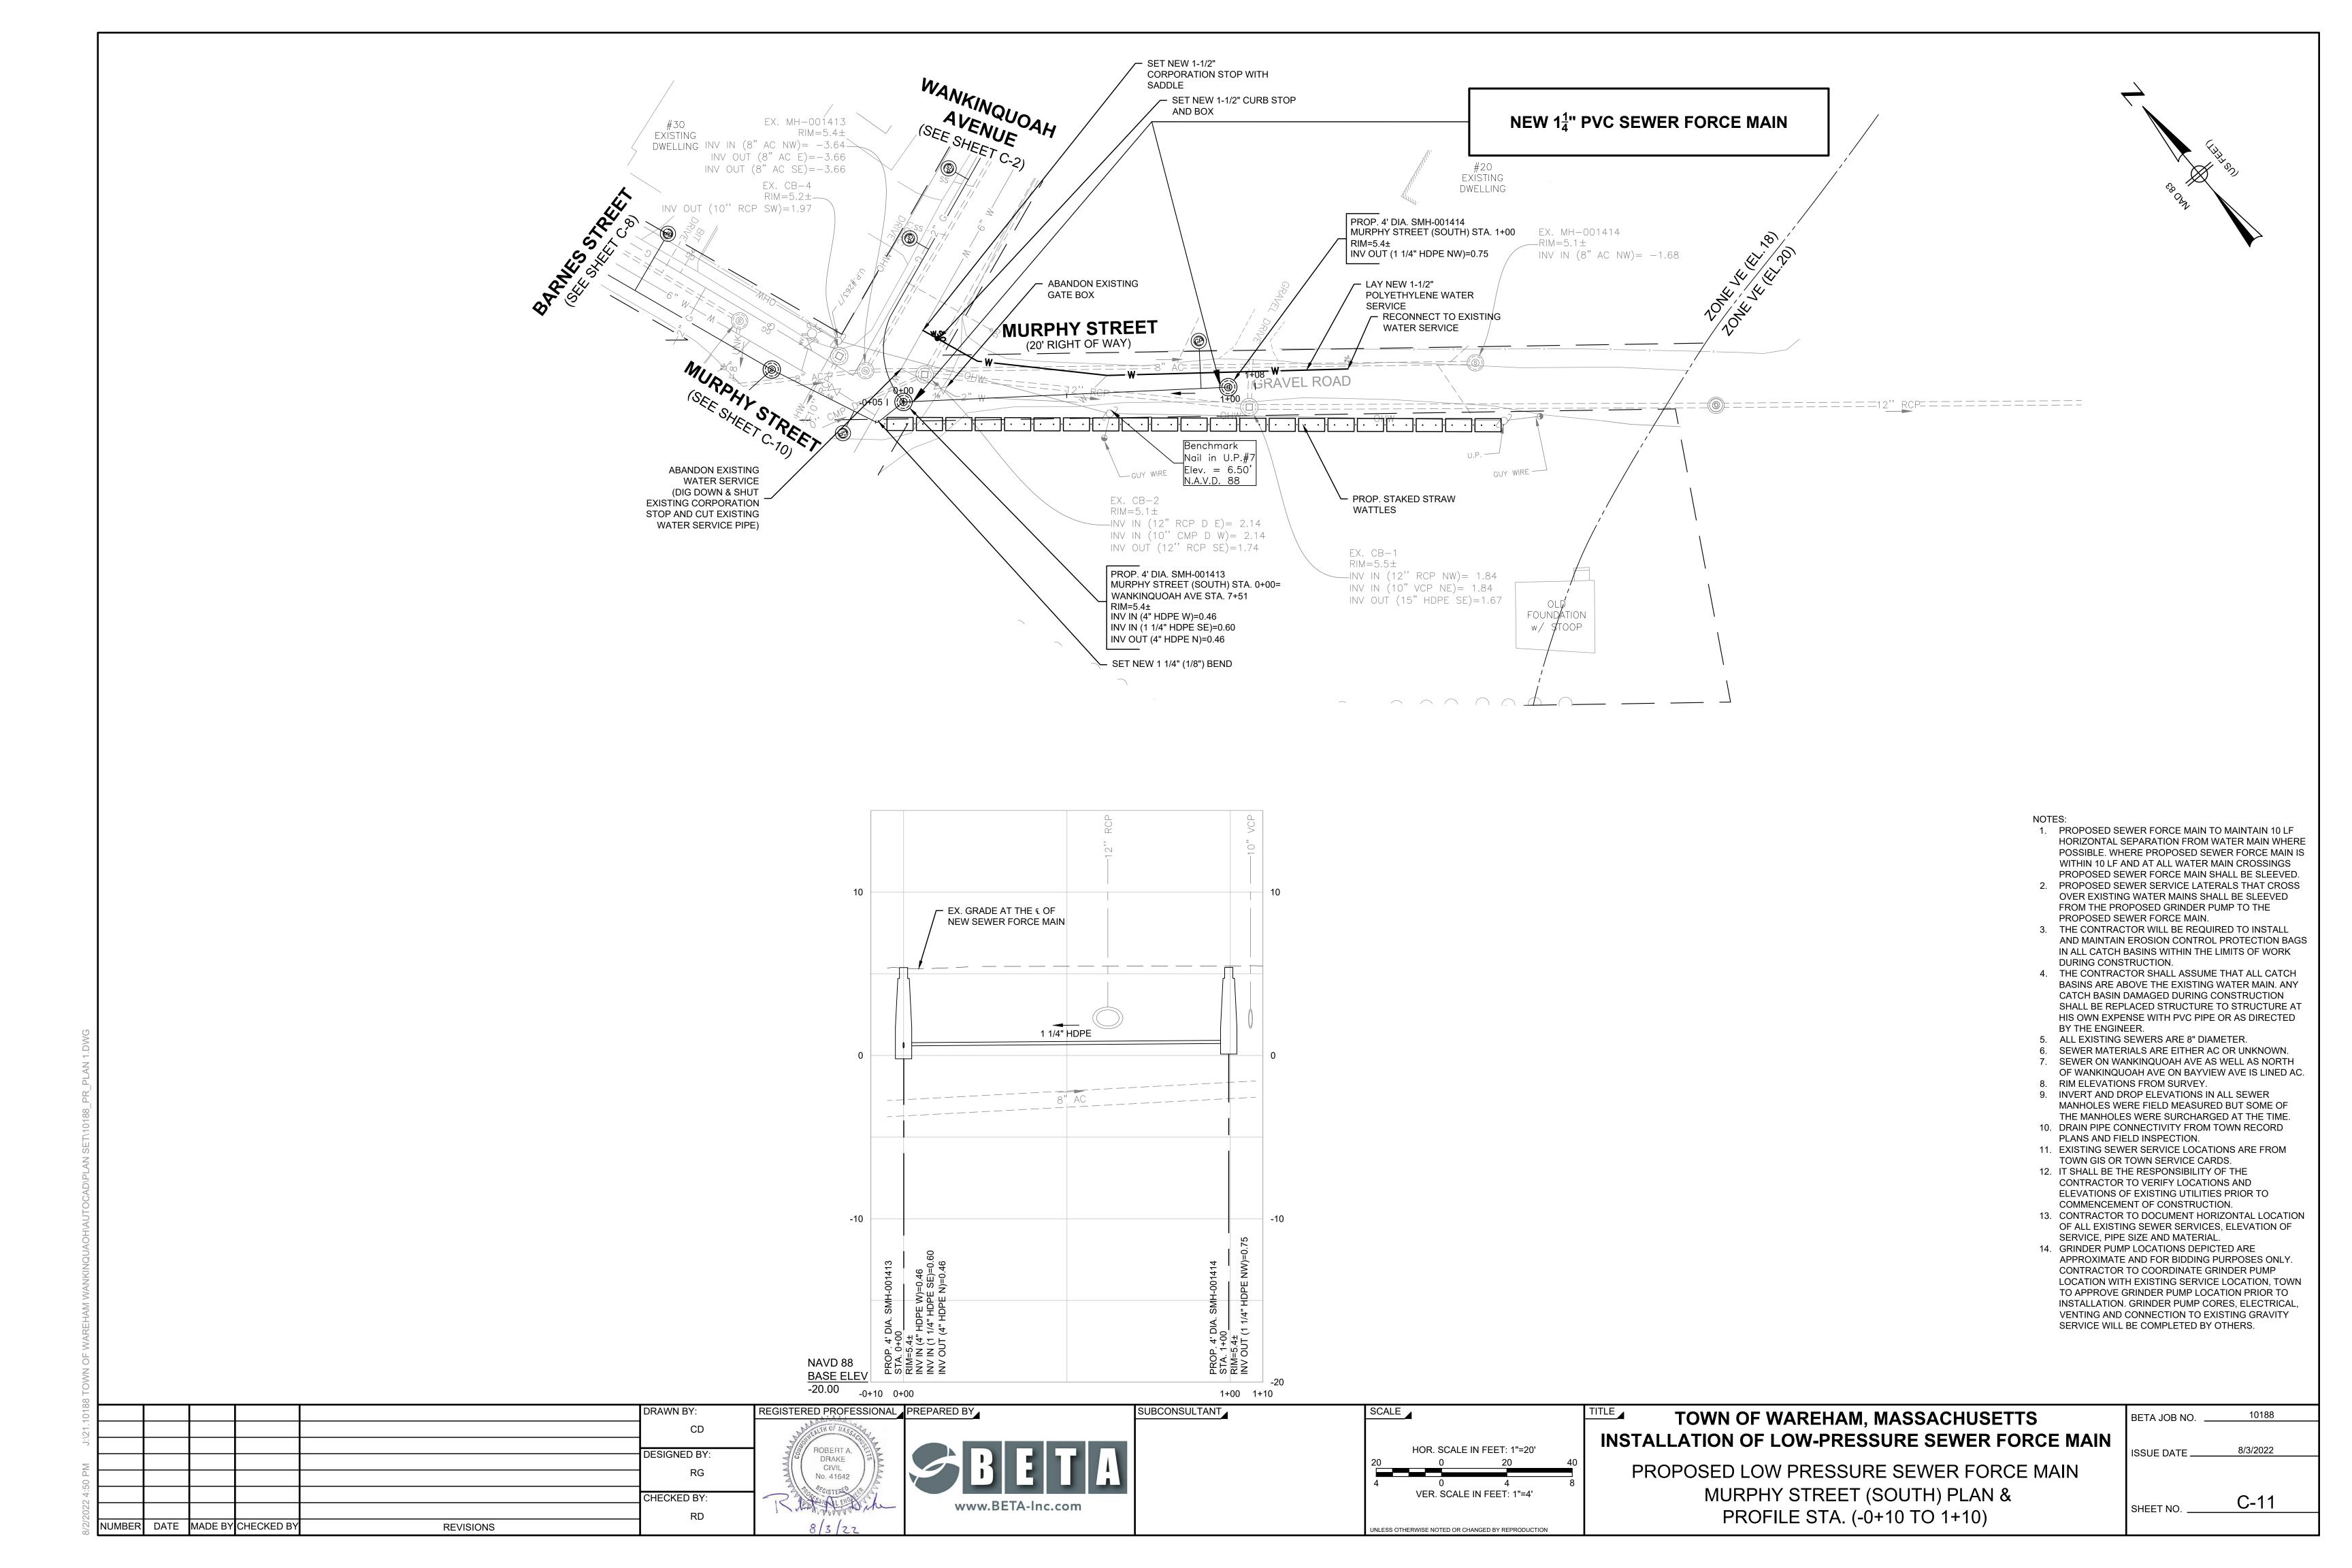

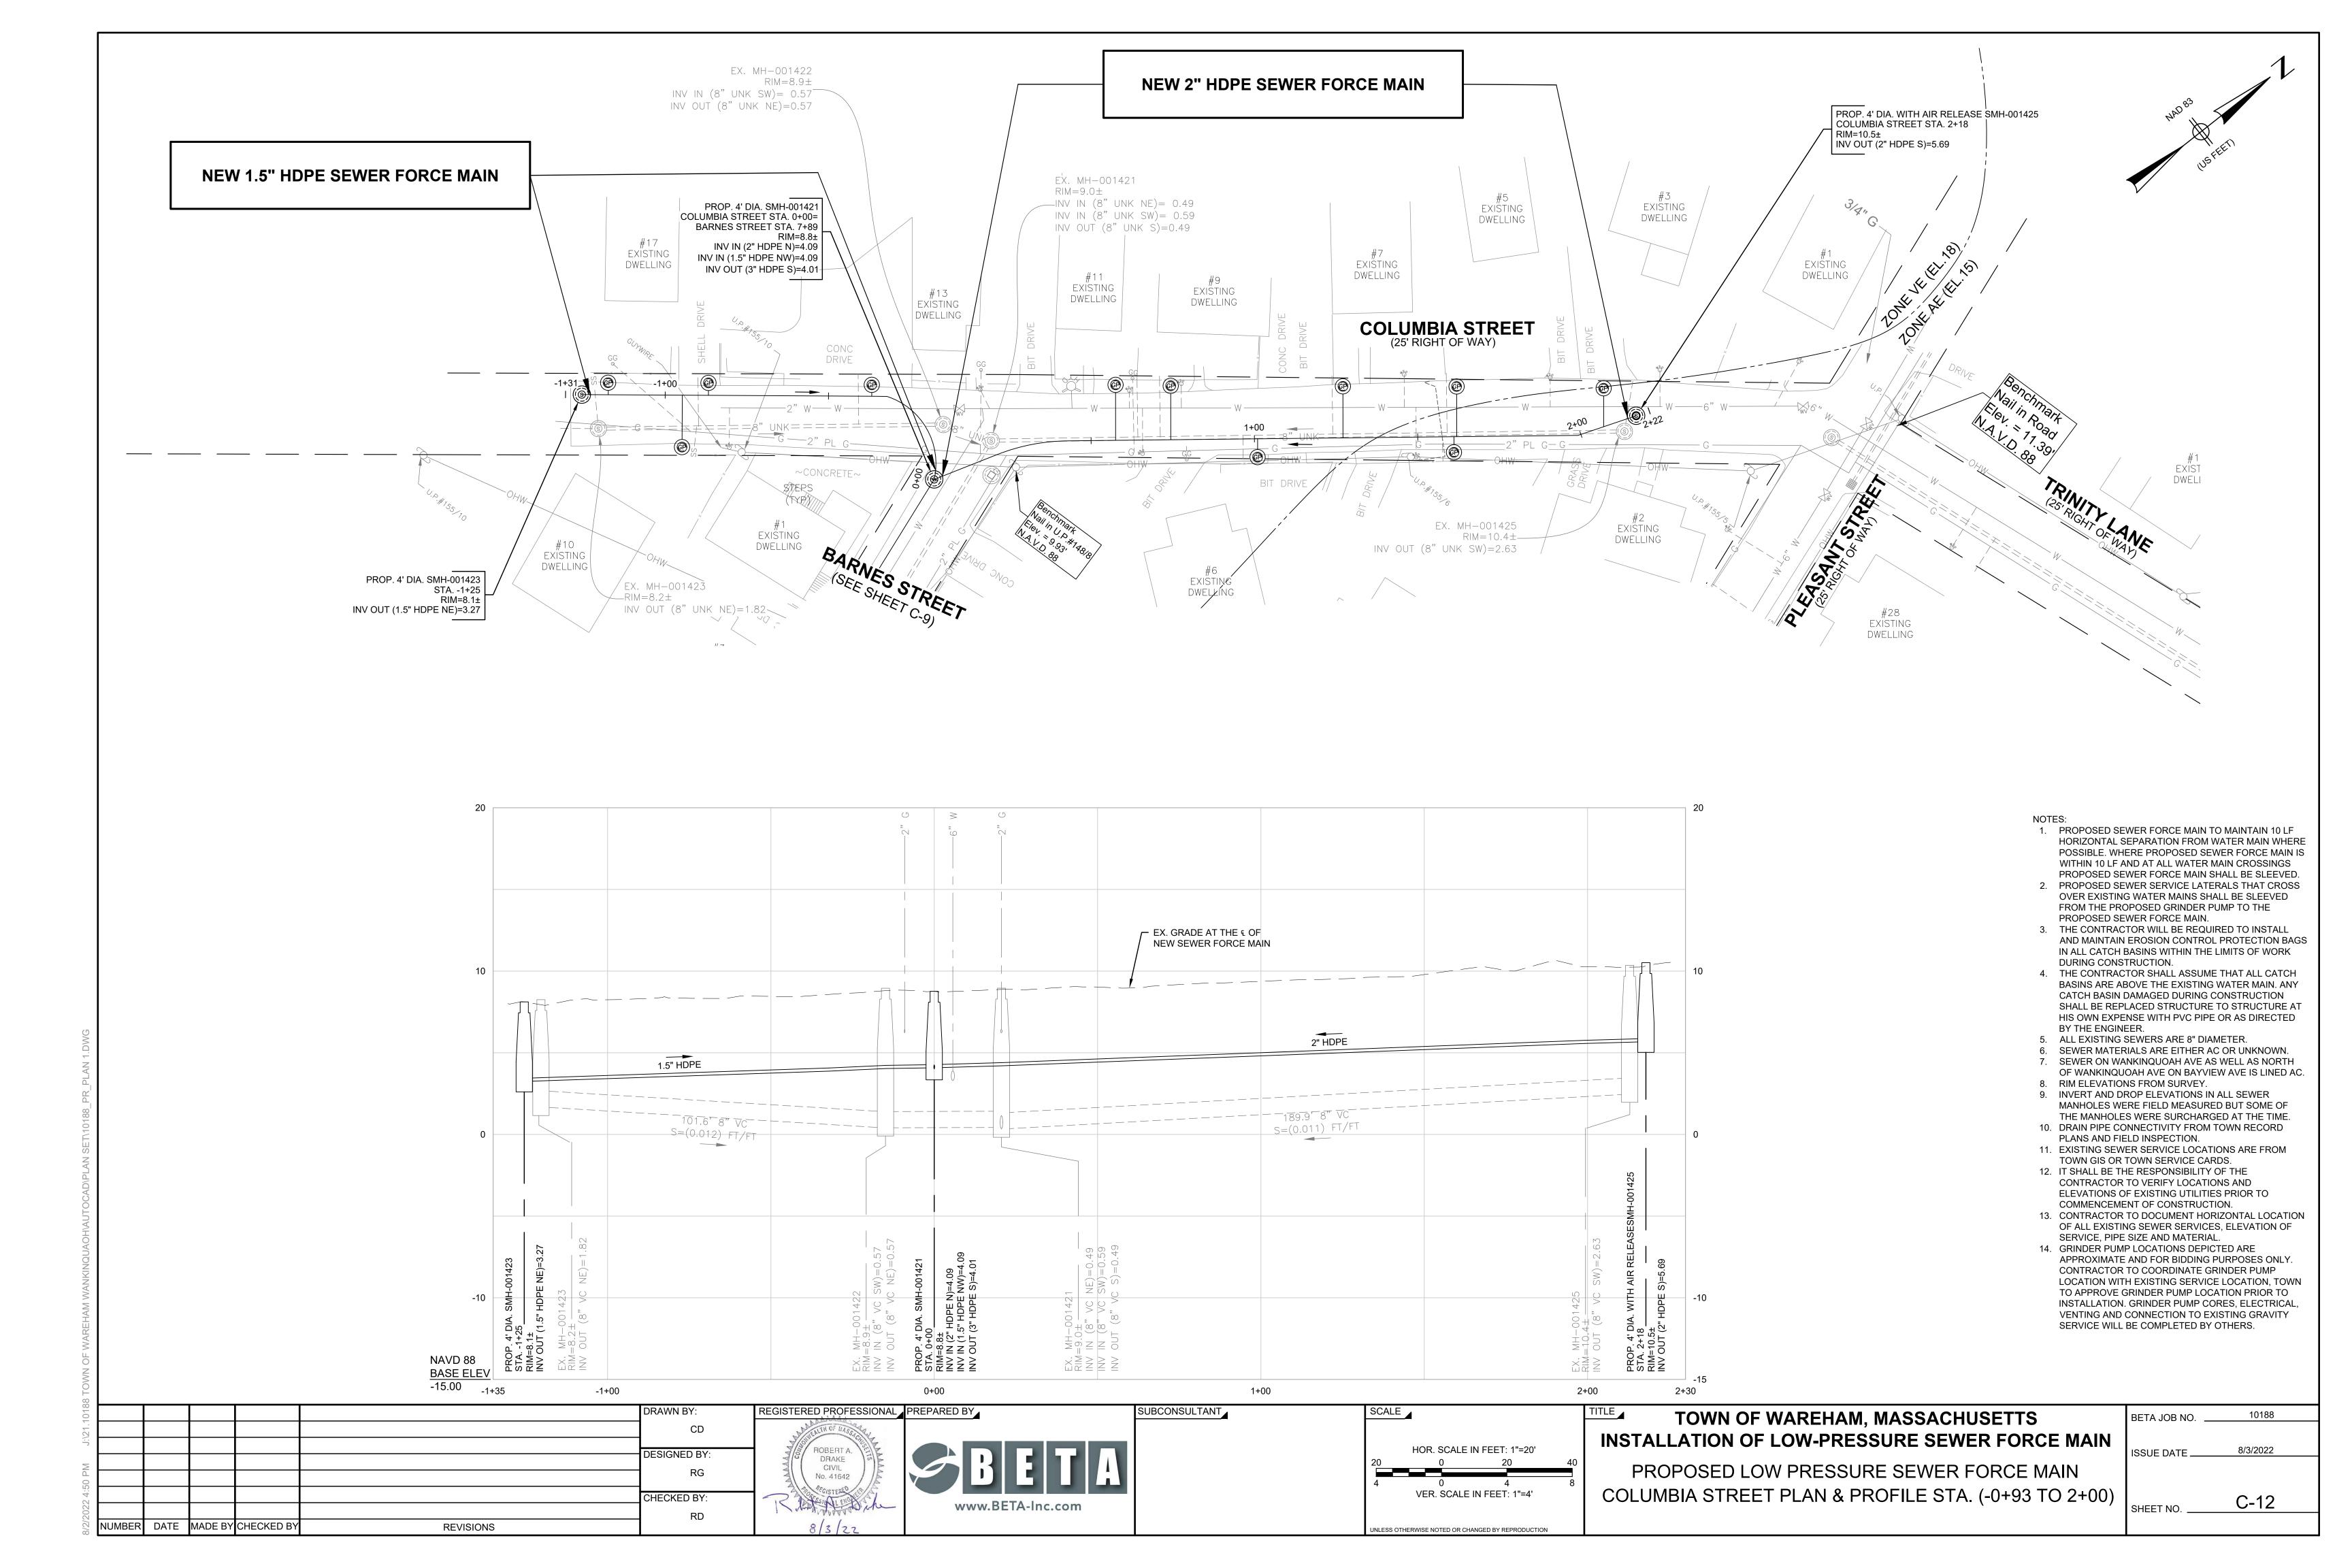


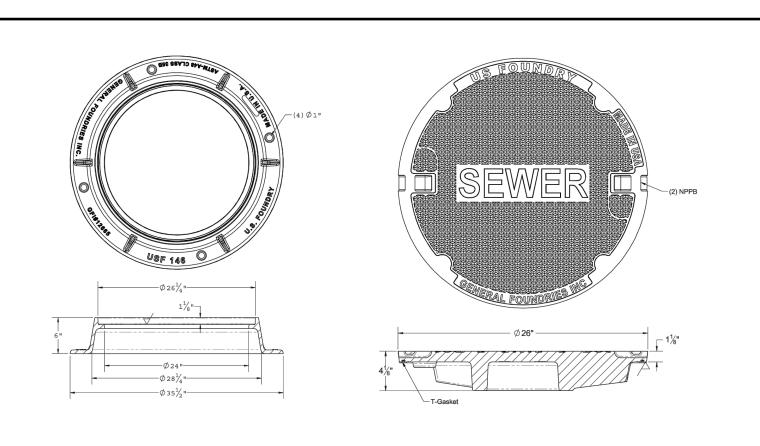

- FRAME AND COVER SET FOR SEWER MANHOLES SHALL BE MODEL NOS. 8021904 / 8013697 AS MANUFACTURED BY GENERAL FOUNDRIES INC
- COVER CASTING SHALL CONFORM TO THE MUNICIPAL STANDARD (AS SHOWN) UNLESS OTHERWISE DIRECTED BY THE ENGINEER.
- COVER LETTERING DETAIL APPLIES TO ALL COVER SIZES AND WATERTIGHT MANHOLE COVERS IN ACCORDANCE WITH NOTES IN TYPICAL
- FOR SHALLOW STRUCTURES 6" HIGH FRAMES MAY BE SUBSTITUTED FOR STANDARD 8" HIGH FRAMES FOR SHALLOW-PROFILE STRUCTURES AS INDICATED ON THE PLANS OR AS DIRECTED BY THE ENGINEER. NO FRAMES LESS THAN 6" HIGH SHALL BE ALLOWED.
- FRAME AND COVER SHALL BE SET IN FULL BED OF MORTAR ON A MINIMUM OF TWO COURSES OF BRICK.

26-INCH SEWER MANHOLE FRAME AND COVER (FOR CLEANOUT AND AIR RELEASE STRUCTURES)

NOT TO SCALE

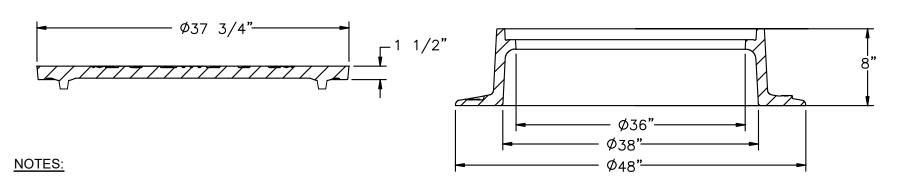

- 1. FRAME AND COVER SET FOR SEWER MANHOLES SHALL BE MODEL NOS. 13681 AS MANUFACTURED BY GENERAL FOUNDRIES INC OR
- COVER CASTING SHALL CONFORM TO THE MUNICIPAL STANDARD (AS SHOWN) UNLESS OTHERWISE DIRECTED BY THE ENGINEER.
- COVER LETTERING DETAIL APPLIES TO ALL COVER SIZES AND WATERTIGHT MANHOLE COVERS IN ACCORDANCE WITH NOTES IN TYPICAL MANHOLE DETAIL.

36-INCH SEWER MANHOLE FRAME AND COVER (FOR GRINDER PUMP STRUCTURES)

NOT TO SCALE 36" FRAME & COVER (SEE -SPEC 02607) — 24" —— DEPTH VARIES POWER SUPPLY CONDUIT - INSTALL CAP. REMAINING ELEC CONDUIT TO BE INSTALLED BY OTHERS 1.25" DISCHARGE LATERAL WET-WELL VENT WHIP INSTALL CAP. REMAINING VENT PIPING TO BE *SEE LOW INSTALLED BY OTHERS **PRESSURE** SEWER SERVICE CONNECTION DETAIL FOR CONTINUATION 4" INLET (TYP.) INSTALL CAP. GRAVITY SEWER SERVICE PIPE TO BE CONNECTED BY COMPACTABLE BACKFILL FINE GRAVEL OR STONE CLASS I OR II SOILS AROUND STATION - UNDISTURBED EARTH CONCRETE ANCHOR

1. PUMP STATION TANK, STRUCTURE, CASTING, SERVICE PIPING, PIPE STUBS TO BE INSTALLED BY CONTRACTOR. PUMP CORES AND ALARM PANEL TO BE PURCHASED BY CONTRACTOR BUT INSTALLED BY OTHERS. 2. ALL EXISTING SHARED SEWER SERVICES ARE TO BE DUPLEX GRINDER PUMP STATIONS.

GRAVEL BEDDING

DATE MADE BY CHECKED BY

GRINDER PUMP STATION DETAIL NOT TO SCALE

REVISIONS

DRAWN BY: DESIGNED BY RG CHECKED BY:

RD



CONCRETE PIPE SUPPORT

W/PIPE ANCHOR STRAP (TYP.)

SUBCONSULTANT_

— 12"x12"x4" SUMP

- FILTER FABRIC (MIRAFI 1100N OR

6" MIN. COMPACTED

APPROVED EQUIVALENT)

STONE BASE

MANHOLE FRAME & COVER AS

MALE ALUMIMINUM QUICK CONNECT

COUPLING W/LOCKABLE DUST CAP

STAINLESS STEEL

BALL VALVE (TYP.)

4' DIA. PRECAST

FOR SIZE)

HDPE TEE

STAINLESS STEEL

- BALL VALVE (TYP.)

└─ 12"x12"x4" SUMP

FILTER FABRIC (MIRAFI 1100N OR

- MIN. 2 COURSES OF BRICK

MALE ALUMIMINUM QUICK

CONNECT COUPLING (TYP.)

— 4' DIA. PRECAST

EXT. BASE

FOR SIZE)

HDPE TEE

(SEE PLANS

MANHOLE WITH

STAINLESS STEEL

-SDR11 HDPE

BALL VALVE

 — 6" MIN. COMPACTED STONE BASE

APPROVED EQUIVALENT)

MANHOLE FRAME & COVER AS

SPECIFIED

. MANHOLE WITH EXT BASE (SEE PLANS

FINISH GRADE -

MECHANICAL COUPLING (TYP.)

CONCRETE PIPE SUPPORT

LOCATE FLUSHING QUICK CONNECT IN MANHOLE COVER OPENING.

LOW PRESSURE IN-LINE (3-WAY) CLEANOUT STRUCTURE

SECTION VIEW

NOT TO SCALE

W/PIPE ANCHOR STRAP (TYP.)

FINISH GRADE -

MANHOLE STEPS PER -SPEC. SECTION 02607 **COMBINATION AIR**

VACUUM VALVE,

SUPPORT WITH **BRACKET**

VAL-MATIC MODEL

202C.2 OR EQUAL

STAINLESS STEEL

BALL VALVE

SDR11 HDPE

HDPE TEE-

PRESSURE PIPE

KOR'N SEAL OR ─

LINKSEAL (TYP.) PIPE

PENETRATIONS

FLEXIBLE—

MECHANICAL

COUPLING (TYP.)

MIN. 2 COURSES OF BRICK —

SDR11 HDPE

PRESSURE PIPE -

HDPE TEE—

KOR'N SEAL OR

PENETRATIONS

LINKSEAL (TYP.) PIPE

MANHOLE STEPS PER

SPEC. SECTION 02607

SCALE _

TOWN OF WAREHAM, MASSACHUSETTS **INSTALLATION OF LOW-PRESSURE SEWER FORCE MAIN**

CONSTRUCTION DETAILS 1

FILL COMPACTED AS SPECIFIED. COMPACTED AS SPECIFIED — REMOVE ALL SHEETING. ZONE AROUND PIPE BACKFILL WITH - WASHED SAND; MATERIAL EXCAVATED SELECT FILL SHALL BE FROM TRENCH NOT PERMITTED IN ZONE THOROUGHLY COMPACTED - 4" MIN. CLEARANCE NOTE: 5'-0" MIN. COVER 1. FOAM INSULATION TO BE USED IN TRENCH OVER BEDDED PIPE, IF LESS THAN 5' OF COVER TO PROTECT FROM FROST. FORCE MAIN TRENCH DETAIL NOT TO SCALE


PAVING & SUB-BASE AS SPECIFIED

12" MIN. COMPACTED BANK-RUN

THE ENGINEER)

COMMON BORROW OR COMMON

GRAVEL (INCREASE AS DIRECTED BY

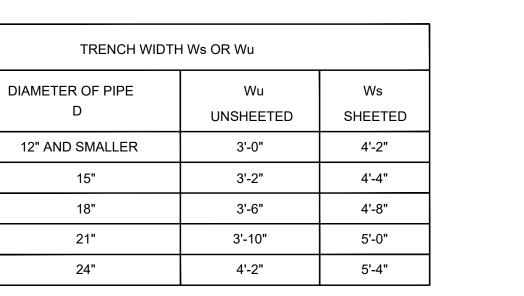

EXISTING GRADE

2" BUFFALO TYPE – ROADWAY BOX WITH

COVER LABELED

INC., NO STEM

MANUFACTURED BY

STATEWIDE INDUSTRIES

ATTACHED OR EQUAL

— *SEE GRINDER PUMF

CONTINUATION

MATIVE SOIL

24" MIN.

STONE

CRUSHED

STATION DETAIL FOR

"SEWER",

CRUSHED

STONE

(MIRAFI 1100N OR

APPROVED EQUIVALENT)

☐ FILTER FABRIC

MATCH EXISTING GRADE

PVC TEE -

LOW PRESSURE —

PIPE

SERVICE SDR 11 HDPE

THOROUGHLY

COMPACTED SELECT

BEARING MINIMUM

MATERIAL (CONTROLLED

DENSITY FILL REQUIRED

ON SELECT STREETS) —

CONCRETE 1'-0" SQUARE

1¹/₄" STAINLESS STEEL

CURB STOP & CHECK-

VALVE ASSEMBLY AT

__111 STAINELSS STEEL

CORPORATION STOP

PROPERT LINE

STONE

-3/8" CRUSHED

1. IF SERVICE PIPE LENGTH IS LESS THAN 5' LONG DO NOT INSTALL CORPORATION STOP

LOW PRESSURE SEWER SERVICE CONNECTION


NOT TO SCALE

STONE

-3/8" CRUSHED


TRENCH WIDTH TABLE

NOT TO SCALE

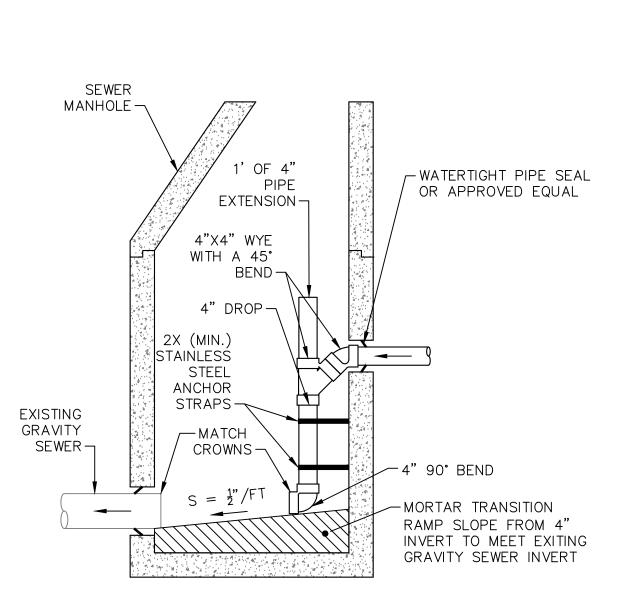

LOW PRESSURE SEWER DISCHARGE TO **GRAVITY SEWER MANHOLE WITH INSIDE DROP**


NOT TO SCALE

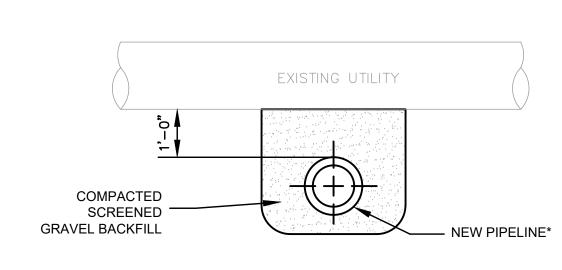

* ONE FULL LENGTH OF PIPE CENTERED UNDER EXISTING PIPE OTHER THAN SEWERS

NOTE: DETAIL APPLICABLE FOR PIPE SECTIONS EXPOSED DURING CONSTRUCTION

TYPICAL SECTION AT EXISTING UTILITIES NOT TO SCALE

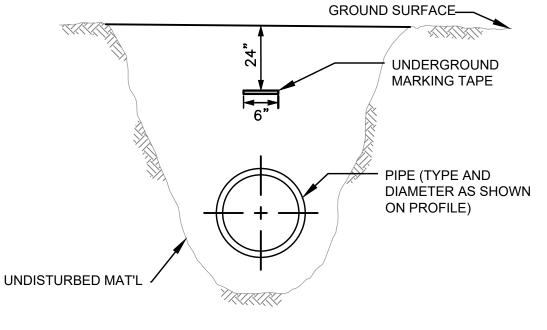

UNPAVED-

COMMON FILL

SEE SPECIFICATIONS

EXISTING GROUND

SURFACE

FOR FINAL GRADING -

1. MARKING TAPE TO BE INSTALLED OVER ALL PIPELINES AND CONDUITS INSTALLED UNDER THIS CONTRACT.

2. MARKING TAPE FOR NON-FERROUS PIPE OR CONDUITS TO BE DETECTABLE, MAGNETIC TYPE.

3. MARKING TAPE FOR FERROUS PIPE OF CONDUITS TO BE NON-DETECTABLE, NON-MAGNETIC TYPE.

4. MARKING TAPE IS TO BE 6-INCHES WIDE AND INSTALLED DIRECTLY ABOVE THE PIPE OR CONDUIT APPROXIMATELY 24-INCHES BELOW THE PROPOSED FINISHED GRADE.

> **UNDERGROUND UTILITY** MARKING TAPE DETAIL

> > NOT TO SCALE

10188 BETA JOB NO. 8/3/2022 ISSUE DATE ___

CD-1 SHEET NO.

REGISTERED PROFESSIONAL PREPARED BY

ROBERT A

DRAKE

CIVIL

No. 41642

LOCATE COMBINATION AIR VALVE/FLUSHING QUICK CONNECT IN MANHOLE COVER OPENING

LOW PRESSURE IN-LINE (3-WAY) CLEANOUT / COMBINATION AIR VALVE

STRUCTURE SECTION VIEW

NOT TO SCALE

NONE

ILESS OTHERWISE NOTED OR CHANGED BY REPRODUCTIO

